



Designation: E835/E835M – 93 (Reapproved 2002)

Standard Guide for Modular Coordination of Clay and Concrete Masonry Units¹

This standard is issued under the fixed designation E835/E835M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the Department of Defense.

INTRODUCTION

This guide is issued as a standard for reference in design, specification, manufacture and construction using metric (SI) or inch-pound units. The SI preferred dimensions are based on the internationally recognized building module of 100 mm. The inch-pound preferred dimensions are based on the U.S. recognized building module of 4 inches. Dimensions given in millimeters (mm) apply to units designed for SI use. Dimensions given in inches (in.) apply to units designed for inch-pound use.

This guide is intended to minimize the potential field cutting of units due to the layout requirements of the construction and contract documents. It is not the intent of this guide to restrict or limit the production of units not conforming to modular dimensional coordination.

1. Scope

1.1 This guide covers unit sizes for clay and concrete masonry units laid in mortar for use in buildings and building systems designed in accordance with the principles of modular coordination. Specifically it covers:

- 1.1.1 Sizes of full-size units and supplementary units.
- 1.1.2 Joint thicknesses.
- 1.1.3 Specified dimensions.

1.2 Permissible variations from specified dimensions of masonry units vary with intended use, project requirements and type of product. Thus, permissible dimensional variations for masonry units should be obtained from the appropriate ASTM specification. See Section 2 for a listing of appropriate specifications.

2. Referenced Documents

2.1 *ASTM Standards*:²

C43 Terminology of Structural Clay Products³

¹ This guide is under the jurisdiction of ASTM Committee E06 on Performance of Buildings and is the direct responsibility of Subcommittee E06.21 on Serviceability.

Current edition approved Oct. 10, 2002. Published January 2003. Originally approved in 1981. Last previous edition approved in 1999 as E835/E835M – 93 (1999). DOI: 10.1520/E0835_E0835M-93R02.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

³ Withdrawn. The last approved version of this historical standard is referenced on www.astm.org.

C67 Test Methods for Sampling and Testing Brick and Structural Clay Tile

C140 Test Methods for Sampling and Testing Concrete Masonry Units and Related Units

E577 Guide for Dimensional Coordination of Rectilinear Building Parts and Systems

E631 Terminology of Building Constructions

3. Terminology

3.1 *Definitions of Terms Specific to This Standard:*

3.1.1 For descriptions of terms not listed in 3.1.2-3.1.12 see Terminology C43, the Terminology section of Guide E577, or Terminology E631.

3.1.2 *coordinating dimension*—a preferred modular dimension for masonry or masonry openings coordination, including allowances for standard joint thicknesses. (For example, vertical coordination based on masonry units with three courses equal to 200 mm or 8 in.) See Fig. 1.

3.1.3 *grid line*—a line of the modular (100 mm or 4 in.) grid, used for referencing of building dimensions in design and construction, normally occurring as centerlines in modular coursing and as coordinating lines for masonry and masonry openings.

3.1.4 *height*—vertical dimension of masonry units or masonry, measured parallel to the intended face of the unit or units. See Fig. 2.

3.1.5 *length*—horizontal dimension of masonry units or masonry, measured parallel to the intended face of the unit or units. See Fig. 2.

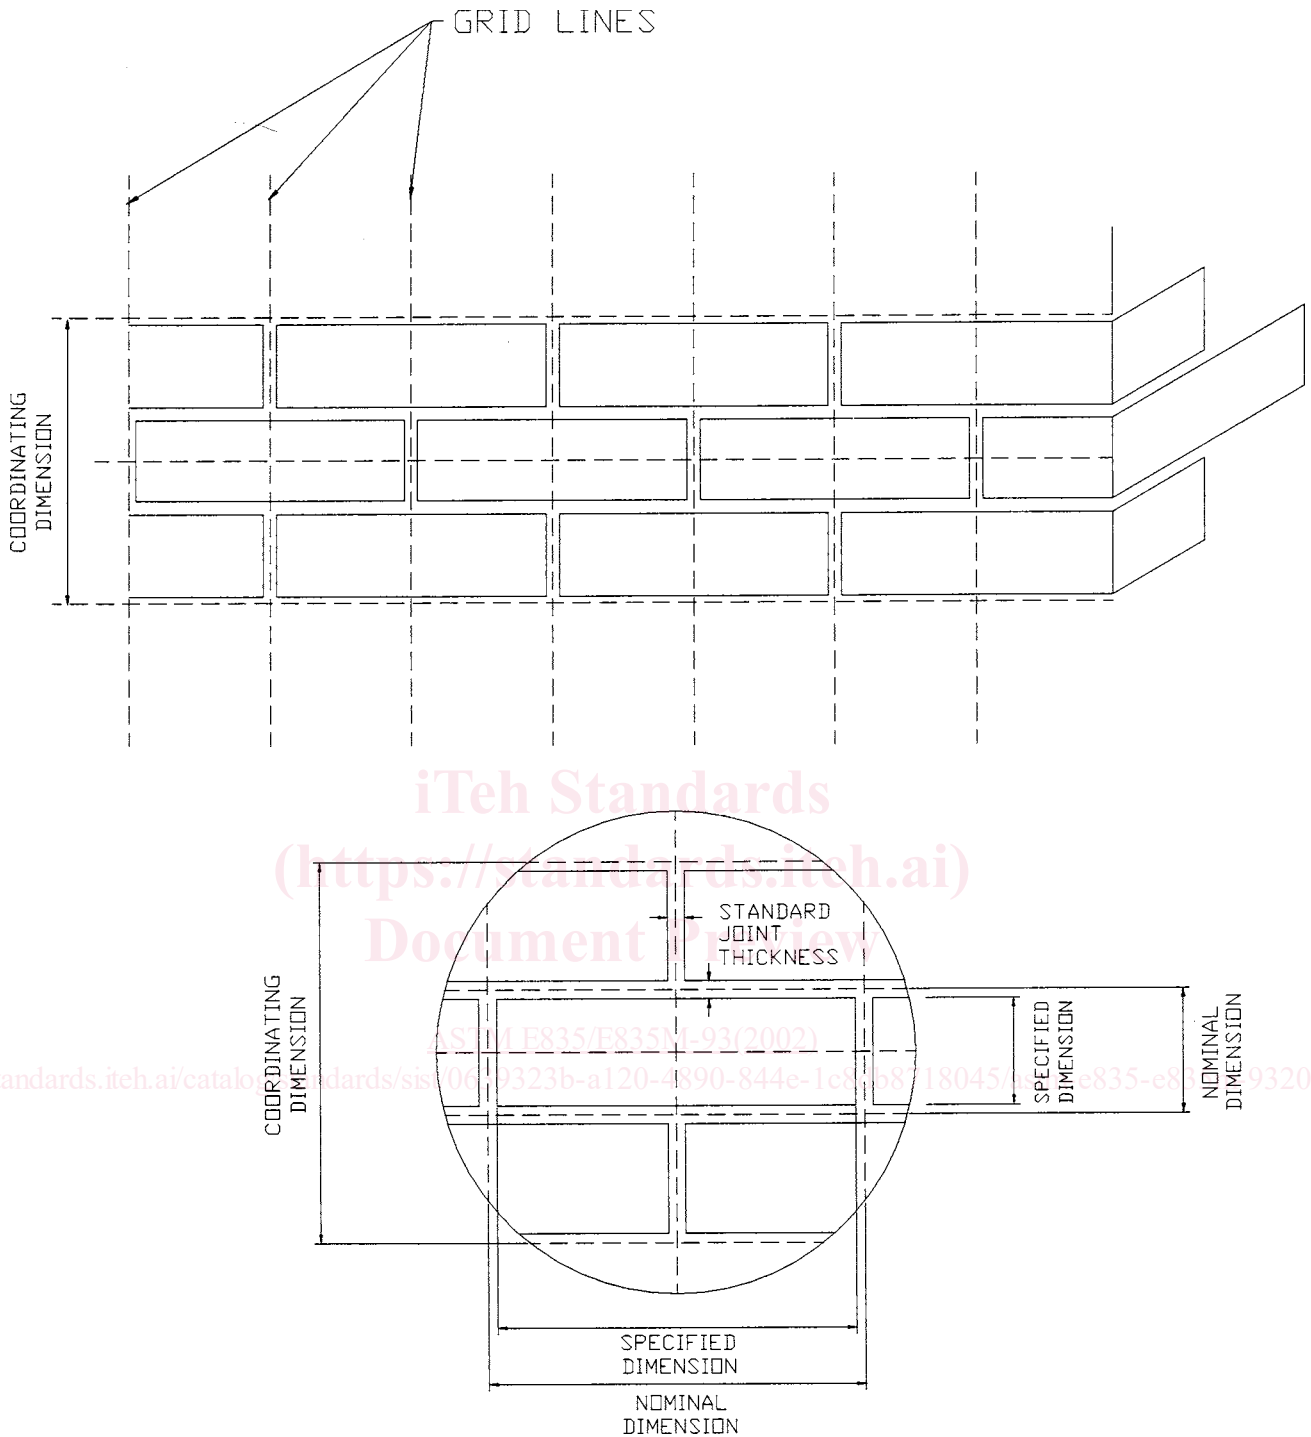


FIG. 1 Coordinating, Nominal, and Specified (Standard) Dimensions for Masonry Units

3.1.6 *nominal dimension*—a dimension greater than the specified (standard) dimension by the thickness of one mortar joint, but not more than 13 mm or ½ in.

3.1.6.1 *Discussion*—Standard mortar joint thicknesses are 6 mm (¼ in.), 10 mm (⅜ in.), and 13 mm (½ in.).

3.1.7 *nominal size*—the measure of layout of a single masonry unit, taken between centerlines of mortar joints, which is equal to the specified unit size plus the thickness of one mortar joint. See Fig. 1.

3.1.8 *specified (standard) dimension*—the nominal dimension less the thickness of a standard mortar joint; that is, the net dimension of the masonry unit. See Fig. 1.

3.1.9 *specified size*—the average of measured dimensions of the masonry units determined in accordance with Test Methods C67 or Method C140, excluding standard joint thickness.

3.1.10 *supplementary unit*—an additional masonry unit used to provide modular (100 mm or 4 in.) flexibility.