

**SLOVENSKI**

**OSIST-TP IEC/TR2 61000-5-  
4:2004**

**PREDSTANDARD**

februar 2004

---

---

Electromagnetic compatibility (EMC) - Part 5: Installation and mitigation guidelines -  
Section 4: Immunity to HEMP - Specifications of protective devices against HEMP  
radiated disturbance - Basic EMC publication

**iTeh Standards**  
**(<https://standards.iteh.ai>)**  
**Document Preview**

[SIST-TP IEC/TR2 61000-5-4:2004](https://standards.iteh.ai/catalog/standards/sist/69119ada-eba5-43f6-92aa-f87073a37e36/sist-tp-iec-tr2-61000-5-4-2004)

<https://standards.iteh.ai/catalog/standards/sist/69119ada-eba5-43f6-92aa-f87073a37e36/sist-tp-iec-tr2-61000-5-4-2004>

---

---

ICS 33.100.01

Referenčna številka  
OSIST-TP IEC/TR2 61000-5-4:2004(en)



**RAPPORT  
TECHNIQUE – TYPE 2**

**CEI  
IEC**

**1000-5-4**

**TECHNICAL  
REPORT – TYPE 2**

Première édition  
First edition  
1996-08

---

---

**Compatibilité électromagnétique (CEM) –**

**Partie 5:**

**Guide d'installation et d'atténuation –**

**Section 4: Immunité à l'IEM-HA –**

**Spécifications des dispositifs de protection  
contre les perturbations rayonnées IEM-HA –  
Publication fondamentale en CEM**

**Electromagnetic compatibility (EMC) –**

**Part 5:**

**Installation and mitigation guidelines –**

**Section 4: Immunity to HEMP –**

**Specifications for protective devices against  
HEMP radiated disturbance –  
Basic EMC publication**

© CEI 1996 Droits de reproduction réservés — Copyright - all rights reserved

Aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'éditeur.

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher

Bureau central de la Commission Electrotechnique Internationale 3, rue de Varembe Genève Suisse



Commission Electrotechnique Internationale  
International Electrotechnical Commission  
Международная Электротехническая Комиссия

CODE PRIX  
PRICE CODE

**U**

● Pour prix, voir catalogue en vigueur  
For price, see current catalogue

## CONTENTS

	Page
FOREWORD .....	5
Clause	
1 Scope .....	9
2 Normative reference.....	9
3 Definitions.....	9
4 Specifications for protective devices against radiated disturbances .....	11
4.1 General classification for shielding devices .....	13
4.2 General requirements .....	13
4.3 Specifications .....	15
4.3.1 General .....	15
4.3.2 Barrier materials .....	15
4.3.3 Shielded cables and conduits .....	29
4.3.4 Gasketing materials .....	37
4.3.5 Shielding components .....	39
Annexes	
A General theory.....	41
B Bibliography.....	54

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**ELECTROMAGNETIC COMPATIBILITY (EMC) –**  
**Part 5: Installation and mitigation guidelines**  
**Section 4: Immunity to HEMP – Specifications for protective devices**  
**against HEMP radiated disturbance –**  
**Basic EMC publication**

## FOREWORD

- 1) The IEC (International Electrotechnical Commission) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of the IEC is to promote international cooperation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, the IEC publishes International Standards. Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. The IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of the IEC on technical matters, prepared by technical committees on which all the National Committees having a special interest therein are represented, express, as nearly as possible, an international consensus of opinion on the subjects dealt with.
- 3) They have the form of recommendations for international use published in the form of standards, technical reports or guides and they are accepted by the National Committees in that sense.
- 4) In order to promote international unification, IEC National Committees undertake to apply IEC International Standards transparently to the maximum extent possible in their national and regional standards. Any divergence between the IEC Standard and the corresponding national or regional standard shall be clearly indicated in the latter.
- 5) Attention is drawn to the possibility that some of the elements of this International Standard may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.
- 6) The IEC has not laid down any procedure concerning marking as an indication of approval and has no responsibility when an item of equipment is declared to comply with one of its standards.

The main task of IEC technical committees is to prepare International Standards. In exceptional circumstances, a technical committee may propose the publication of a technical report of one of the following types:

- type 1, when the required support cannot be obtained for the publication of an International Standard, despite repeated efforts;
- type 2, when the subject is still under technical development or where for any other reason there is the future but not immediate possibility of an agreement on an International Standard;
- type 3, when a technical committee has collected data of a different kind from that which is normally published as an International Standard, for example "state of the art".

Technical reports of types 1 and 2 are subject to review within three years of publication to decide whether they can be transformed into International Standards. Technical reports of type 3 do not necessarily have to be reviewed until the data they provide are considered to be no longer valid or useful.

IEC 1000-5-4, which is a technical report of type 2, has been prepared by subcommittee 77C: Immunity to high altitude nuclear electromagnetic pulse (HEMP), of IEC technical committee 77: Electromagnetic compatibility.

The text of this this technical report is based on the following documents:

FDIS	Report on voting
77C/26/CDV	77C/36/RVC

Full information on the voting for the approval of this technical report can be found in the report on voting indicated in the above table.

This document is issued in the type 2 Technical Report series of publications (according to G.4.2.2 of part 1 of the IEC/ISO Directives as a "prospective standard for provisional application" in the field of electromagnetic compatibility because there is an urgent requirement for guidance on how standards in this field should be used to meet an identified need.

This document is not to be regarded as an "International Standard". It is proposed for provisional application so that information and experience of its use in practice may be gathered. Comments on the content of this document should be sent to the IEC Central Office.

A review of this type 2 Technical Report will be carried out not later than three years after its publication, with the options of either extension for a further three years or conversion to an International Standard or withdrawal.

Annexes A and B are for information only.

---

**ELECTROMAGNETIC COMPATIBILITY (EMC) –**  
**Part 5: Installation and mitigation guidelines**  
**Section 4: Immunity to HEMP – Specifications for protective devices**  
**against HEMP radiated disturbance –**  
**Basic EMC publication**

## 1 Scope

This technical report defines how protective devices for High Altitude Nuclear Electromagnetic Pulse (HEMP) protection of civilian systems are specified. Performance requirements will be given in future IEC standards. This technical report is intended to be used for the harmonization of existing or future specifications issued by protective devices manufacturers, electronic equipment manufacturers, administrative bodies and other buyers.

This technical report covers protective devices currently used for protection against HEMP radiated EM fields. In general, parameters relevant to HEMP, that is parameters related to very fast changes of EM fields, as a function of time, are dealt with.

## 2 Normative reference

The following normative document contains provisions which, through reference in this text, constitute provisions of this technical report. At the time of publication, the edition indicated was valid. All normative documents are subject to revision, and parties to agreements based on this technical report are encouraged to investigate the possibility of applying the most recent edition of the normative document indicated below. Members of IEC and ISO maintain registers of currently valid International Standards.

IEC 50(161): 1990, *International Electrotechnical Vocabulary (IEV) – Chapter 161: Electromagnetic compatibility*

## 3 Definitions

For the purpose of this technical report, the following definitions apply.

**HEMP/HA-NEMP:** The two acronyms are equivalent and accepted for High Altitude Nuclear Electromagnetic Pulse. HEMP is preferable to HA-NEMP.

**barrier:** Separation used to insulate electrical circuits from electromagnetic disturbances. (A shield is a special type of barrier.)

**contact resistance:** Resistance measured in ohms between two objects in contact with each other.

**compression set:** The per cent of permanent height reduction in a material caused by compression under specific conditions of heat, pressure and time.

**corrosion resistance:** Resistance to a chemical action which causes gradual destruction of the surface of a metal by oxidation, electrolysis or chemical contamination.

**cut-off frequency:** The frequency at which the magnitude of a measured characteristic quantity has decreased to a specified fraction of its low-frequency value.

NOTE – For a waveguide it is the frequency below which electromagnetic energy is not efficiently propagated in the guide. This frequency depends on the cross-section geometry and dimensions of the guide.

**elongation:** The increase in length of a material stressed under tension.

**point of entry:** The physical place at the surface of a closed enclosure through which the energy penetrates.

**protective device:** An electrical component such as a filter, gas discharge tube, metal oxide varistor, etc., for protection against conducted disturbances, or a shield, gasket, waveguide trap, etc., for protection against radiated disturbances. Such an element, or a combination of several of them, thus forms part of the conceptual electromagnetic barrier of the system.

**shield:** Electrically conductive material placed around a system circuit, component, or cable to suppress the effect of an electromagnetic field within or beyond definite regions.

**shielding effectiveness:** The measure, generally in dB, of the reduction or attenuation of the amplitude of an electromagnetic field at a point in space before and after the placement of a shield, between a source and this point.

**skin depth:** The depth of a conductive material beyond which the current density has decreased by one Neper ( $1/e$  or 36,8 %) in comparison with its value at the surface of the material.

**surface resistivity:** The resistance of a material between two opposite sides of a unit square of its surface, commonly expressed in ohms per square.

**surface transfer impedance** (of a coaxial line): The quotient of the voltage induced in the centre conductor of a coaxial line per unit length by the current on the external surface of the coaxial line. [IEV 161-04-15]

**tensile strength:** The maximum tensile stress applied, during stretching, to a specimen to rupture.

**transfer admittance:** A mathematical relationship between the induced current on a conductor located on the protected side of a shielded region and the voltage on the unprotected side of the enclosure. This is the dual quantity of the transfer impedance.

**transfer impedance** (of a screened circuit): The quotient of the voltage appearing between two specified points in the screened circuit by the current in a defined cross-section of the screen. [IEV 161-04-14]

**volume resistivity:** The electrical resistance between opposite faces of  $1 \text{ cm}^3$  of material, commonly expressed in ohms.centimetres.

**waveguide below cut-off:** A protective element consisting of a length of waveguide which limits the passage of electromagnetic energy below a fixed frequency.

**waveguide trap:** A waveguide below cut-off serving as an electromagnetic protection device in a barrier.

#### 4 Specifications for protective devices against radiated disturbances

The shielding effectiveness of a shielded enclosure (Faraday cage, cabinet or shielded building) is violated by penetrations, openings and seams. All of these shall be treated in such a way that the resulting degradation of the shielding effectiveness is as small as possible. This goal is achieved by means of specific protection devices.

In the following, these protection devices are dealt with one by one, by explaining their principles of operation, showing their limitations in some cases, and finally listing the specifications that shall be given by the manufacturers.



The figures help demonstrate the principle of operation and may also serve as examples of how the frequency-dependent parameters might be presented.

#### 4.1 *General classification for shielding devices*

Barrier materials:

- shielding materials;
- viewing windows;
- air vent panels;
- waveguide traps;
- conductive coatings;
- conductive adhesives and sealants.

Shielded cables and conduits:

- solid shields;
- leaky shields;
- connectors.

Gasketing materials:

- knitted wire mesh gaskets;
- metal fibers and screen gaskets;
- oriented wire gaskets;
- conductive elastomer gaskets.

Shielding components:

- toggle boots;
- shaft seals;
- connector gaskets;
- ring seals;
- foil tapes;
- etc.

#### 4.2 *General requirements*

The shielding materials needed to reach the required shielding effectiveness shall meet several electrical, mechanical and environmental criteria.

##### *Electrical requirements*

For barrier materials, attenuation values shall be supplied for E and H fields, and for plane waves in the frequency range 10 kHz to 1000 MHz. For gasketing materials the same information as above is required, and in addition, the d.c. resistance shall be provided. For shielded cables the specification of transfer impedance and, if necessary, transfer admittance in the frequency range 10 kHz to 100 MHz is required.

##### *Mechanical requirements*

All the mechanical characteristics necessary for the correct use of the materials should be available to the user. These are listed in the following subclauses.

### *Environmental requirements*

The total shielding effectiveness of a shielded enclosure is limited by the failure of seams to achieve adequate electrical contact. The shielding integrity of a seam can be increased by improving this contact. This might be achieved by using conductive gasketing.

However, the use of certain gaskets does not maintain the shielding integrity for a long time and environmental conditions, such as dust, moisture and vapors shall be taken into consideration. For example, to seal against dust and moisture, flat or strip EMI gaskets joined to a sponge or solid elastomer are adequate. Therefore, information concerning the appropriate environmental use of specific gasketing materials is required.

## 4.3 *Specifications*

### 4.3.1 *General*

Both mechanical and electrical design aspects should be considered in order to specify protection devices.

Specifications include:

- general description (presentation, purpose);
- application information (specific use);
- material description (material, consistency, color, finish, etc.);
- performance characteristics (E, H and plane wave attenuation, d.c. resistance, temperature range, mechanical properties, transfer impedance and if necessary transfer admittance);
- dimensions;
- recommendations for use (surface preparation, pressure, safety and operational cautions);
- methods of construction;
- mounting techniques (way of assembly);
- storage recommendations.

### 4.3.2 *Barrier materials*


#### 4.3.2.1 *Shielding materials*

Two types are generally available:

##### a) *Wire mesh*

The shielding effectiveness depends on the size of the volume to be shielded, and especially on the mesh size and the wire mesh manufacturing. The shielding effectiveness increases when the mesh size decreases or when using a double shield, the two shields being insulated from each other and presenting only one connection point to the earth.

For the cage sizes presented in figure 1, the cut-off frequency is about 80 MHz. At higher frequencies, there is a resonant effect resulting in oscillations.

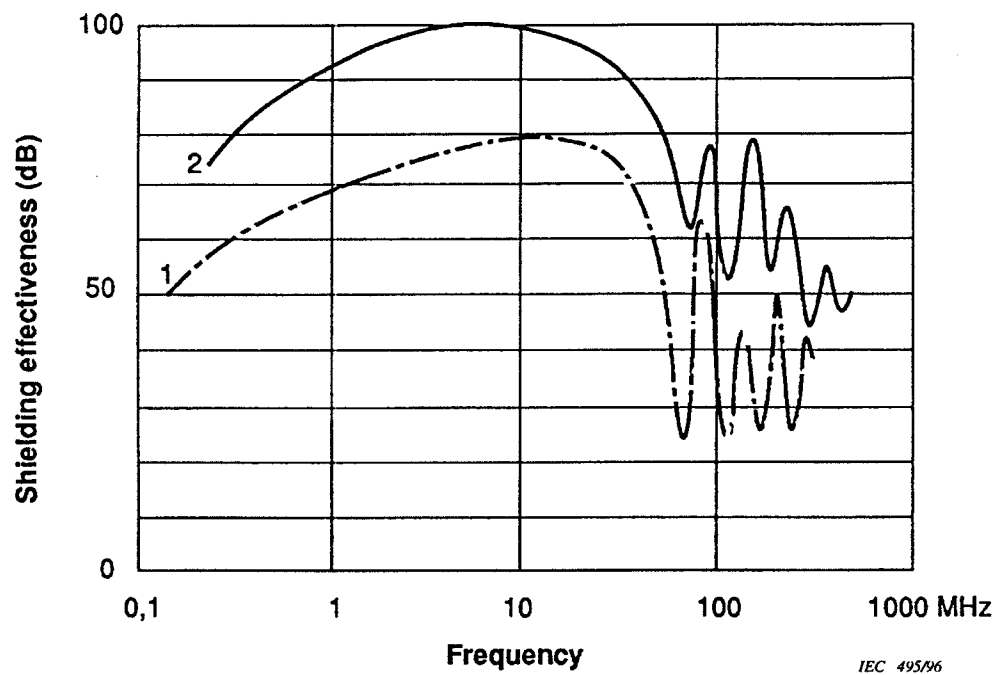

Curve 1: dimensions 3 m x 3,25 m x 3 m  
Hexagonal mesh: 15 mm x 17 mm  
Curve 2: dimensions 4 m x 4 m x 3 m  
Square mesh: 4 mm

Figure 1 – Typical plane wave attenuation for double-wall cages