



Designation: D 6245 – 98 (Reapproved 2002)

# Standard Guide for Using Indoor Carbon Dioxide Concentrations to Evaluate Indoor Air Quality and Ventilation<sup>1</sup>

This standard is issued under the fixed designation D 6245; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope

1.1 This guide describes how measured values of indoor carbon dioxide (CO<sub>2</sub>) concentrations can be used in evaluations of indoor air quality and building ventilation.

1.2 This guide describes the determination of CO<sub>2</sub> generation rates from people as a function of body size and level of physical activity.

1.3 This guide describes the experimentally-determined relationship between CO<sub>2</sub> concentrations and the acceptability of a space in terms of human body odor.

1.4 This guide describes the following uses of indoor CO<sub>2</sub> concentrations to evaluate building ventilation—mass balance analysis to determine the percent outdoor air intake at an air handler, the tracer gas decay technique to estimate whole building air change rates, and the constant injection tracer gas technique at equilibrium to estimate whole building air change rates.

1.5 This guide discusses the use of continuous monitoring of indoor and outdoor CO<sub>2</sub> concentrations as a means of evaluating building ventilation and indoor air quality.

1.6 This guide discusses some concentration measurement issues, but it does not include or recommend a method for measuring CO<sub>2</sub> concentrations.

1.7 This guide does not address the use of indoor CO<sub>2</sub> to control outdoor air intake rates.

1.8 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

## 2. Referenced Documents

2.1 *ASTM Standards:*<sup>2</sup>

**D 1356** Terminology Relating to Sampling and Analysis of Atmospheres

**D 3249** Practice for General Ambient Air Analyzer Procedures

**E 741** Test Method for Determining Air Change in a Single Zone by Means of Tracer Gas Dilution

2.2 *Other Documents*

**ASHRAE** Standard 62 Ventilation for Acceptable Indoor Air Quality<sup>3</sup>

## 3. Terminology

3.1 *Definitions*—For definitions and terms used in this guide, refer to Terminology **D 1356**.

3.2 *Definitions of Terms Specific to This Standard:*

3.2.1 *air change rate, n*—the total volume of air passing through a zone to and from the outdoors per unit time, divided by the volume of the zone (s<sup>-1</sup>, h<sup>-1</sup>).<sup>4</sup>

3.2.2 *bioeffluents, n*—gases emitted by people as a product of their metabolism that can result in unpleasant odors.

3.2.3 *single-zone, n*—an indoor space, or group of spaces, wherein the CO<sub>2</sub> concentration is uniform and that only exchanges air with the outdoors.

## 4. Summary of Guide

4.1 When investigating indoor air quality and building ventilation, a number of tools are available to understand the building being studied. One such tool is the measurement and interpretation of indoor and outdoor CO<sub>2</sub> concentrations. Using CO<sub>2</sub> concentrations to evaluate building indoor air quality and ventilation requires the proper use of the procedures involved, as well as consideration of several factors related to building and ventilation system configuration, occupancy patterns, non-occupant CO<sub>2</sub> sources, time and location of air sampling, and instrumentation for concentration measurement. This guide discusses ways in which CO<sub>2</sub> concentrations can be used to evaluate building indoor air quality and ventilation.

4.2 Section 6 discusses the rate at which people generate CO<sub>2</sub> and the factors that affect this rate.

4.3 Section 7 discusses the use of indoor concentrations of CO<sub>2</sub> as an indicator of the acceptability of a space in terms of perceptions of human body odor.

<sup>3</sup> Available from American Society of Heating, Refrigerating, and Air-Conditioning Engineers, Inc., 1791 Tullie Circle, NE, Atlanta, GA 30329.

<sup>4</sup> A common way of expressing air change rate units is ach = air changes per hour.

<sup>1</sup> This guide is under the jurisdiction of ASTM Committee D22 on Sampling and Analysis of Atmospheres and is the direct responsibility of Subcommittee D22.05 on Indoor Air.

Current edition approved March 10, 1998. Published May 1998.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

4.4 Section 8 describes the use of mass balance analysis to determine the percent outdoor air intake at an air handler based on the measured CO<sub>2</sub> concentrations in the supply, return, and outdoor air intake airstreams.

4.5 Section 9 describes the use of the tracer gas decay technique to determine building air change rates using occupant-generated CO<sub>2</sub> as a tracer gas. The tracer gas decay technique is described in detail in Test Method E 741, and this section discusses the application of this test method to the special case of occupant-generated CO<sub>2</sub> after the occupants have left the building.

4.6 Section 10 describes the use of the constant injection tracer gas technique with occupant-generated CO<sub>2</sub> to estimate outdoor air ventilation rates. This technique is sometimes referred to as equilibrium analysis, and Section 10 discusses the use of this technique and the assumptions upon which it is based.

4.7 Section 11 discusses the use of continuous monitoring of CO<sub>2</sub> concentrations as a means of evaluating indoor air quality and ventilation in buildings. In this discussion, continuous refers to real-time concentration measurement recorded with a datalogging device over several days.

4.8 Section 12 discusses CO<sub>2</sub> concentration measurement issues, including measuring outdoor concentrations, sample locations for indoor concentration measurements, establishing the uncertainty of measured concentrations, and calibration.

## 5. Significance and Use

5.1 Indoor CO<sub>2</sub> concentrations have been described and used by some people as an indicator of indoor air quality. These uses have included both appropriate and inappropriate interpretations of indoor CO<sub>2</sub> concentrations. Appropriate uses include estimating expected levels of occupant comfort in terms of human body odor, studying occupancy patterns, investigating the levels of contaminants that are related to occupant activity, and screening for the sufficiency of ventilation rates relative to occupancy. Inappropriate uses include the application of simple relationships to determine outdoor air ventilation rates per person from indoor CO<sub>2</sub> concentrations without verifying the assumptions upon which these relationships are based, and the interpretation of indoor CO<sub>2</sub> concentrations as a comprehensive indicator of indoor air quality.

5.2 Outdoor air ventilation rates affect contaminant levels in buildings and building occupants' perception of the acceptability of the indoor environment. Minimum rates of outdoor air ventilation are specified in building codes and indoor air quality standards, for example, ASHRAE Standard 62. The compliance of outdoor air ventilation rates with relevant codes and standards are often assessed as part of indoor air quality investigations in buildings. The outdoor air ventilation rate of a building depends on the size and distribution of air leakage sites, pressure differences induced by wind and temperature, mechanical system operation, and occupant behavior. Given all of this information, ventilation rates are predictable; however, many of these parameters are difficult to determine in practice. Therefore, measurement is required to determine outdoor air change rates reliably.

5.3 The measurement of CO<sub>2</sub> concentrations has been promoted as a means of determining outdoor air ventilation

rates per person. This approach, referred to in this guide as equilibrium analysis, is based on a steady-state, single-zone mass balance of CO<sub>2</sub> in the building and is sometimes presented with little or no discussion of its limitations and the assumptions on which it is based. As a result, in some cases, the technique has been misused and indoor CO<sub>2</sub> concentration measurements have been misinterpreted.

5.4 When the assumptions upon which equilibrium analysis is based are valid, the technique can yield reliable measurements of outdoor air ventilation rates. In addition, indoor CO<sub>2</sub> concentrations can be used to determine other aspects of building ventilation when used properly. By applying a mass balance at an air handler, the percent outdoor air intake in the supply airstream can be determined based on the CO<sub>2</sub> concentrations in the supply, return, and outdoor air. This percentage can be multiplied by the supply airflow rate of the air handler to yield the outdoor air intake rate of the air handler. In addition, the decay of indoor CO<sub>2</sub> concentrations can be monitored in a building after the occupants have left to determine the outdoor air change rate of the building.

5.5 Continuous monitoring of indoor and outdoor CO<sub>2</sub> concentrations can be used to study some aspects of ventilation system performance, the quality of outdoor air, and building occupancy patterns.

## 6. CO<sub>2</sub> Generation Rates

6.1 Human metabolism consumes oxygen and generates CO<sub>2</sub> at rates that depend on the level of physical activity, body size, and diet.

6.2 The rate of oxygen consumption  $V_{O_2}$  in L/s of a person is given by Eq 1:

$$V_{O_2} = \frac{0.00276 A_D M}{(0.23 RQ + 0.77)} \quad (1)$$

where:

$A_D$  = DuBois surface area m<sup>2</sup>,

$M$  = metabolic rate per unit of surface area, met (1 met = 58.2 W/m<sup>2</sup>), and

$RQ$  = respiratory quotient.

The DuBois surface area<sup>5</sup> equals about 1.8 m<sup>2</sup> for an average-sized adult and ranges from about 0.8 to 1.4 m<sup>2</sup> for elementary school aged children. Additional information on body surface area is available in the EPA Exposure Factors Handbook (2). The respiratory quotient,  $RQ$ , is the ratio of the volumetric rate at which CO<sub>2</sub> is produced to the rate at which oxygen is consumed. Therefore, the CO<sub>2</sub> generation rate of an individual is equal to  $V_{O_2}$  multiplied by  $RQ$ .

6.3 Chapter 8 of the ASHRAE Fundamentals Handbook, Thermal Comfort (1), contains typical met levels for a variety of activities. Some of these values are reproduced in Table 1.

6.4 The value of the respiratory quotient  $RQ$  depends on diet, the level of physical activity and the physical condition of the person. It is equal to 0.83 for an average adult engaged in light or sedentary activities.  $RQ$  increases to a value of about 1

<sup>5</sup> The body surface area  $A_D$  in m<sup>2</sup> can be estimated from the formula  $A_D = 0.203H^{0.725}W^{0.425}$  where  $H$  is the body height in m and  $W$  is the body mass in kg (1).

TABLE 1 Typical Met Levels for Various Activities

Activity	met
Seated, quiet	1.0
Reading and writing, seated	1.0
Typing	1.1
Filing, seated	1.2
Filing, standing	1.4
Walking, at 0.89 m/s	2.0
House cleaning	2.0-3.4
Exercise	3.0-4.0

for heavy physical activity, about 5 met. Based on the expected variation in  $RQ$ , it has only a secondary effect on  $CO_2$  generation rates.

6.5 Fig. 1 shows the dependence of oxygen consumption and  $CO_2$  generation rates on physical activity in units of mets for average adults with a surface area of  $1.8\text{ m}^2$ .  $RQ$  is assumed to equal 0.83 in Fig. 1.

6.6 Based on Eq 1 and Fig. 1, the  $CO_2$  generation rate corresponding to an average-sized adult ( $A_D = 1.8\text{ m}^2$ ) engaged in office work (1.2 met) is about 0.0052 L/s. Based on Eq 1, the  $CO_2$  generation rate for a child ( $A_D = 1\text{ m}^2$ ) with a physical activity level of 1.2 met is equal to 0.0029 L/s.

6.7 Eq 1 can be used to estimate  $CO_2$  generation rates based on information on body surface area that is available in the EPA Exposure Factors Handbook (2) and other sources. However, these data do not generally apply to the elderly and sick and, therefore, the user must exercise caution when dealing with buildings with such occupants.

### 7. $CO_2$ as an Indicator of Body Odor Acceptability

7.1 This section describes the use of  $CO_2$  to evaluate indoor air quality in terms of human body odor acceptability and therefore, the adequacy of the ventilation rate to control body odor. The material in this section is based on a number of

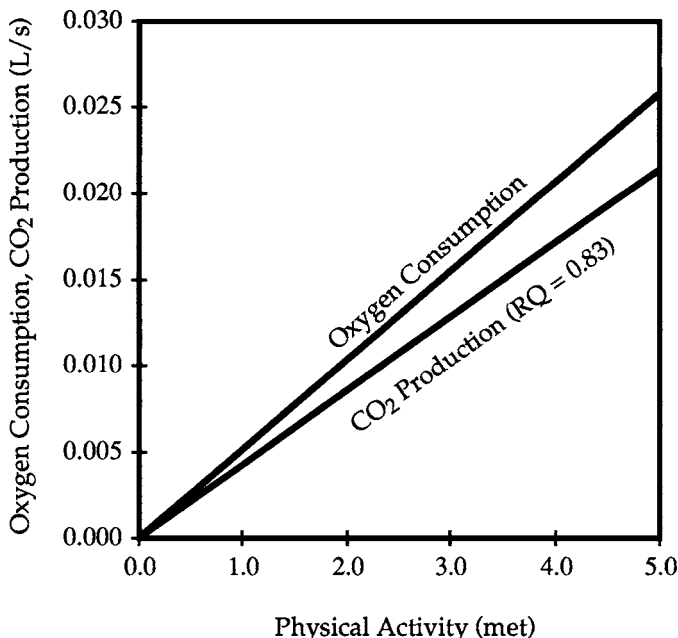


FIG. 1  $CO_2$  Generation and Oxygen Consumption as a Function of Physical Activity


experimental studies in both chambers and real buildings and is the most well-established link between indoor  $CO_2$  concentrations and indoor air quality.

7.2 At the same time people are generating  $CO_2$  they are also producing odor-causing bioeffluents. Similar to  $CO_2$  generation, the rate of bioeffluent generation depends on the level of physical activity. Bioeffluent generation also depends on personal hygiene such as the frequency of baths or showers. Because both  $CO_2$  and bioeffluent generation rates depend on physical activity, the concentrations of  $CO_2$  and the odor intensity from human bioeffluents in a space exhibit a similar dependence on the number of occupants and the outdoor air ventilation rate.

7.3 Experimental studies have been conducted in chambers and in occupied buildings in which people evaluated the acceptability of the air in terms of body odor (3-7). These experiments studied the relationship between outdoor air ventilation rates and odor acceptability, and the results of these studies were considered in the development of most ventilation standards and guidelines (including ASHRAE Standard 62). This entire section is based on the results of these studies.

7.3.1 These studies concluded that about 7.5 L/s of outdoor air ventilation per person will control human body odor such that roughly 80 % of unadapted persons (visitors) will find the odor at an acceptable level. These studies also showed that the same level of body odor acceptability was found to occur at a  $CO_2$  concentration that is about 650 ppm(v) above the outdoor concentration.

7.3.2 Fig. 2 shows the percent of unadapted persons (visitors) who are dissatisfied with the level of body odor in a space as a function of the  $CO_2$  concentration above outdoors (8). This figure accounts only for the perception of body odor and does not account for other environmental factors that may influence the dissatisfaction of visitors to the space, such as the concentrations of other pollutants and thermal parameters. Based on the relationship in Fig. 2, the difference between indoor and outdoor  $CO_2$  concentrations can be used as an indicator of the acceptability of the air in a space in terms of body odor and, therefore, as an indicator of the adequacy of the ventilation rate to control the level of body odor. However, the relationship

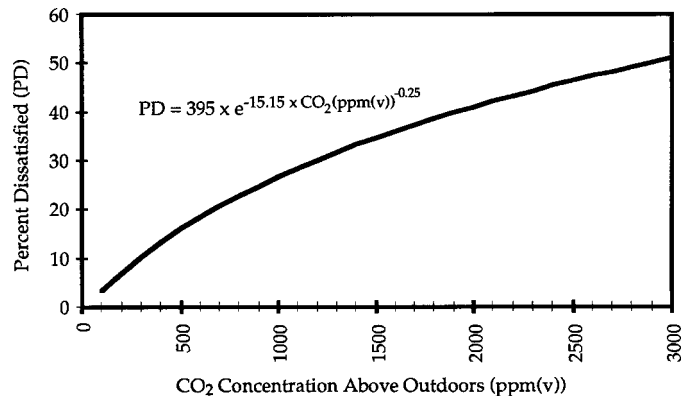

NOTE 1—This figure applies to spaces where human bioeffluents are the only sensory contaminants in the air.

FIG. 2 Percent of Visitors Dissatisfied as a Function of  $CO_2$  Concentration (8)



between percent dissatisfied and CO<sub>2</sub> concentration is also dependent on the personal hygiene of the occupants of a space, that is, their frequency of bathing, and the societal expectations of the visitors to the space. The individuals involved in the experiments on which Fig. 2 is based were office workers and university students with modern habits of personal hygiene from the United States, Denmark, and Japan. If the occupants of a space have different levels of personal hygiene and if the visitors have different expectations, than Fig. 2 would not necessarily apply.

7.3.3 The relationship between percent dissatisfied and CO<sub>2</sub> concentrations in Fig. 2 was seen experimentally (3, 5, 7) and the correlation was not strongly dependent on the level of physical activity. In addition, the relationship did not require that the indoor CO<sub>2</sub> concentration be at equilibrium.

7.3.4 The relationship described in Fig. 2 can also be derived based on the experimentally-determined relationship between percent dissatisfied and outdoor air ventilation rates in L/s. Based on a typical level of CO<sub>2</sub> generation per person and an assumption that the indoor CO<sub>2</sub> concentrations are at equilibrium, the outdoor air ventilation rates determined experimentally to result in a particular value of percent dissatisfied can be converted into indoor CO<sub>2</sub> concentrations to derive the relationship in Fig. 2.

7.3.5 The cited research has shown that if the difference between the indoor and outdoor CO<sub>2</sub> concentrations is less than about 650 ppm(v), then at least 80 % of unadapted persons (visitors) will find the level of body odor acceptable. This concentration difference corresponds to the indoor CO<sub>2</sub> concentration at equilibrium at a ventilation rate of 7.5 L/s per person. This ventilation rate also corresponds to 80 % acceptability based on experiment. The 650 ppm(v) concentration difference, combined with a typical outdoor CO<sub>2</sub> concentration of 350 ppm(v), is the basis of the commonly-referenced guideline value for CO<sub>2</sub> of 1000 ppm(v).

7.4 People adapt to bioeffluents over time, and adapted persons (occupants) will find a space acceptable at a higher level of body odor than unadapted persons (visitors). For adapted persons (occupants), the ventilation rate per person to provide the same acceptance is approximately one-third of the value for unadapted persons (visitors), and the corresponding CO<sub>2</sub> concentrations above outdoors are three times higher. While such a reduction in the ventilation rate may result in levels of body odor that are acceptable to adapted persons, the concentrations of other contaminants with indoor sources will increase which may result in poorer indoor air quality.

7.5 The use of CO<sub>2</sub> concentration differences as an indicator of body odor acceptability requires that the outdoor CO<sub>2</sub> concentration be measured. Paragraph 12.3 discusses these measurements.

7.6 This approach also requires the consideration of other sources of CO<sub>2</sub> 10.5. The existence of other sources will increase CO<sub>2</sub> concentrations, and these elevated concentrations could be interpreted as a lower level of acceptability in terms of body odor. The existence of removal mechanisms will decrease CO<sub>2</sub> concentrations, and lead to the conclusion that the acceptability in terms of body odor is higher than its actual value. There is no practical way to adjust for the existence of

significant sources or removal mechanisms, and therefore, CO<sub>2</sub> concentrations measured in these circumstances can not generally be used as a reliable indicator of body odor acceptability. Situations in which there might be significant indoor CO<sub>2</sub> sources are predominantly restricted to industrial processes. Significant indoor removal can occur when there are large numbers of plants in a building. However, no clear guidance exists on when CO<sub>2</sub> removal by plants is an issue.<sup>6</sup> Nonetheless, the user needs to be aware of the possibilities of indoor CO<sub>2</sub> source and removal mechanisms and avoid the misinterpretation of indoor CO<sub>2</sub> concentrations when these situations exist.

7.7 The use of CO<sub>2</sub> concentrations as an indicator of human body odor is distinct from any health effects associated with the CO<sub>2</sub> itself. Adverse health effects from elevated CO<sub>2</sub> have not been observed until the concentration reaches a value of 7000 ppm(v) to 20 000 ppm(v) (8, 9), and these studies involved continuous exposure for at least 30 days. The threshold limit value (TLV) issued by the ACGIH for CO<sub>2</sub> is currently 5000 ppm(v) (10).

7.8 While CO<sub>2</sub> concentrations can be an appropriate means of characterizing the acceptability of a space in terms of body odor, they do not provide information on the control of contaminants from other indoor pollutant sources such as building materials, furnishings, occupant activities, or from outdoor sources. On the other hand, indoor CO<sub>2</sub> concentrations may be useful to track other contaminants with source strengths related to occupancy. And while maintaining CO<sub>2</sub> concentrations within 650 ppm(v) above outdoors should maintain body odor at an acceptable level, the air quality may not be acceptable if there are other sources of sensory pollutants in the space. In addition, there may be other pollutant sources that are not sensory irritants but have adverse health effects on the occupants.

## 8. Percent Outdoor Air Intake


8.1 The percentage of outdoor air in the supply airstream of an air handler can be determined using CO<sub>2</sub> as a tracer gas based on mass balances of air and tracer at the air handler.

8.2 The percent outdoor air intake of an air handler % OA is equal to the volumetric airflow rate of outdoor air intake into the air handler  $Q_o$  divided by the airflow rate of supply air being delivered by the air handler  $Q_s$ . These airflow rates, and the recirculation airflow rate  $Q_r$ , are shown schematically in Fig. 3

8.3 Based on a mass balance of air and CO<sub>2</sub> at the air handler, the percent outdoor air intake is given by the following equation

$$\% OA = 100 \times (C_r - C_s) / (C_r - C_{out}) \quad (2)$$

<sup>6</sup> An indication of the importance of this removal mechanism may be obtained by measuring the indoor concentration after the building has been unoccupied for some period of time. If the concentration is well below the outdoor concentration, then removal may be significant.

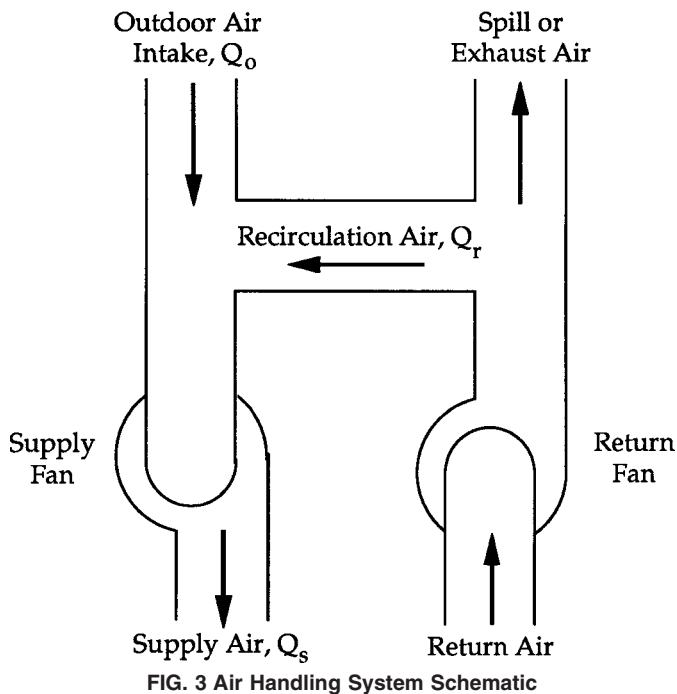

where:

% OA = % outdoor air intake,

$C_r$  = CO<sub>2</sub> concentration in the recirculation airstream of the air handler, ppm(v),

$C_s$  = CO<sub>2</sub> concentration in the supply airstream of the air handler, ppm(v), and

$C_{out}$  = CO<sub>2</sub> concentration in the outdoor air, ppm(v).

8.3.1 Eq 2 assumes that the indoor and outdoor air densities are equal. An alternative form of the equation can be derived that accounts for density differences between the indoor and outdoor air.

8.3.2  $C_r$  can be measured in the return duct, which is often more accessible than the recirculation duct.  $C_r$  should be measured in a main return duct of the air handler, not a return vent in the occupied space or in a ceiling return air plenum.

8.3.3  $C_s$  should be measured at the air handler, downstream to maximize mixing of the outdoor and return airstream.  $C_s$  should not be measured at a supply air outlet in the space.

8.3.4 Typical variations over time in indoor CO<sub>2</sub> concentrations are not a problem in the determination of % OA, however,  $C_s$  and  $C_r$  should be measured as close in time to each other as possible. Measuring these two concentrations within about 15 min of each other will generally be sufficient.

8.4 The precision of the percent outdoor air intake % OA determined with Eq 2 can be estimated using Eq 3.

$$\Delta\% = \% OA [(\Delta C_r^2 + \Delta C_{out}^2)/(C_r - C_{out})^2 + (\Delta C_r^2 + \Delta C_s^2)/(C_r - C_s)^2]^{0.5} \quad (3)$$

where:

$\Delta\%$  = precision of the percent outdoor air intake,

$\Delta C_r$  = precision of the measured CO<sub>2</sub> concentration in the recirculation air, ppm(v),

$\Delta C_s$  = precision of the measured CO<sub>2</sub> concentration in the supply air, ppm(v), and

$\Delta C_{out}$  = precision of the measured CO<sub>2</sub> concentration in the outdoor air, ppm(v).

8.4.1 Eq 3 only accounts for the precision of the measured concentrations and neglects any bias due to calibration and operator errors.

8.4.2 The magnitude of the difference between  $C_r$  and  $C_{out}$  relative to the precision of the measured CO<sub>2</sub> concentrations, is the main factor affecting the precision in % OA, with large values of this difference increasing the precision of % OA. This difference can be maximized by making the concentration measurements well into the occupied period of the day when the indoor CO<sub>2</sub> concentration has built up well above the outdoor concentration.

8.5 Using the value of % OA determined with Eq 2, the outdoor airflow rate being brought into the building by the air handler can be determined by multiplying % OA by the supply airflow rate. The supply airflow rate can be determined through an independent measurement procedure such as a pitot tube traverse of the supply airstream.

## 9. Tracer Gas Decay using Occupant-Generated CO<sub>2</sub>

9.1 Whole building air change rates can be measured using the tracer gas decay technique in which occupant-generated CO<sub>2</sub> is used as a tracer gas and the measurement is conducted after the occupants leave the building.

9.2 Test Method E 741 contains a test method for tracer gas decay measurements of air change rates in a single zone. An air change rate measurement performed in accordance with Test Method E 741 determines the total rate at which outdoor air enters a single-zone space divided by the volume of that space. The outdoor air entry includes both infiltration through leaks and other openings in the building envelope and intentional outdoor air intake through mechanical ventilation systems. This test method applies to single-zone spaces, defined in Test Method E 741 as a space or set of spaces wherein the tracer gas concentration can be maintained at a uniform level and which exchanges air only with the outdoors.

9.2.1 The requirements of Test Method E 741 should be followed when performing a measurement using occupant-generated CO<sub>2</sub> as a tracer gas.

9.2.2 The requirements of Test Method E 741 cover apparatus, sampling duration and frequency, uniformity of tracer gas concentration in the space being tested, and calculation methods.

9.3 Using the tracer gas decay technique with occupant-generated CO<sub>2</sub> as the tracer gas involves some considerations not explicitly covered in Test Method E 741.

9.3.1 The decay technique is based on the assumption that there is no source of tracer gas in the building, which in the case of CO<sub>2</sub> means that the building is no longer occupied. In practice, an occupancy density of one person per 1000 m<sup>2</sup> or less will not impact the measurement results.

9.3.2 The tracer gas decay technique as described in Test Method E 741 assumes that the outdoor tracer gas concentration is zero, which is not the case with CO<sub>2</sub>. However, if the outdoor concentration is constant during the decay measurement, then the tracer gas decay technique can be used by substituting the difference between the indoor and the outdoor

concentration for the indoor concentration in the analysis contained in Test Method E 741.

9.3.3 Test Method E 741 requires that the concentration measurement precision be better than  $\pm 5\%$  of the concentrations during the decay. When using  $\text{CO}_2$  as a tracer gas, this precision requirement must be applied to the difference between the indoor and outdoor  $\text{CO}_2$  concentrations, that is, the precision of this difference must be better than  $\pm 5\%$  of its value throughout the decay.

9.3.4 In most buildings it takes some time for all of the occupants to leave the building, and during this time the indoor  $\text{CO}_2$  concentration will decay. The indoor  $\text{CO}_2$  concentration when the building is finally unoccupied depends on the concentration in the building when the occupants start leaving, the amount of time it takes for them to leave, and the outdoor air change rate of the building. Depending on the values of these parameters, the indoor  $\text{CO}_2$  concentration may be too low once the building is unoccupied (based on the precision requirement in 9.3.3) to perform a reliable tracer gas decay measurement.

9.3.5 Test Method E 741 requires that the indoor tracer gas concentration at multiple points within the building differs by less than  $10\%$  of the average concentration in the building. When using  $\text{CO}_2$  this concentration uniformity requirement should be applied to the difference between the indoor and outdoor concentration. It may be difficult to meet this uniformity requirement in buildings with large spatial variations in occupancy or outdoor air delivery rates, or both.

9.4  $\text{CO}_2$  can also be released into an unoccupied building to perform a tracer gas decay test when occupant generation of  $\text{CO}_2$  is insufficient to increase the indoor concentration. In this case, Test Method E 741 should be referred to for guidance on tracer gas injection.

## 10. Estimating Ventilation Rates using Equilibrium $\text{CO}_2$ Analysis

10.1 Under some circumstances indoor  $\text{CO}_2$  concentrations can be used to estimate outdoor air ventilation rates based on the constant injection tracer gas technique. The application of the constant injection technique using occupant-generated  $\text{CO}_2$  is sometimes referred to as equilibrium  $\text{CO}_2$  analysis. Test Method E 741 contains a test method for constant injection tracer gas decay measurements of air change rates in a single zone. Equilibrium  $\text{CO}_2$  analysis is a special case of the constant injection approach described in this guide.

### 10.2 Constant Injection Technique and Equilibrium $\text{CO}_2$ Analysis:

10.2.1 The constant injection technique, described in Test Method E 741, involves injecting tracer gas into a single-zone space at a constant and known rate. The gas is distributed in the zone such that it meets the concentration uniformity criteria from Test Method E 741. The tracer gas concentration in the zone is then measured in real-time. The average outdoor airflow rate into the zone during some time interval is calculated from the average concentration during that interval, the tracer gas injection rate, the zone volume, the length of the time interval, and the tracer gas concentrations measured at the beginning and end of the interval.

10.2.2 A constant injection tracer gas measurement performed in accordance with Test Method E 741 determines the total rate at which outdoor air enters a single-zone space. The outdoor air entry includes both infiltration through leaks and other openings in the building envelope and intentional outdoor air intake through mechanical ventilation systems. This test method applies to single-zone spaces, defined in Test Method E 741 as a space or set of spaces wherein the tracer gas concentration can be maintained at a uniform level and which exchanges air only with the outdoors.

10.2.3 The equilibrium  $\text{CO}_2$  analysis approach is a special case of the constant injection technique described in Test Method E 741 in which the outdoor airflow rate is constant, the outdoor tracer gas concentration is nonzero and constant, the indoor  $\text{CO}_2$  concentration is at equilibrium, there is a constant generation rate of  $\text{CO}_2$  in the space, and there are no mechanisms of  $\text{CO}_2$  loss, other than ventilation. In this approach, the outdoor airflow rate is given by Eq 4.

$$Q_o = 10^6 \times G / (C_{in,eq} - C_{out}) \quad (4)$$

where:

$Q_o$  = outdoor airflow rate into the zone, L/s,

$G$  =  $\text{CO}_2$  generation rate in the zone, L/s,

$C_{in,eq}$  = equilibrium  $\text{CO}_2$  concentration in the zone, ppm(v), and

$C_{out}$  = outdoor  $\text{CO}_2$  concentration, ppm(v).

10.2.4 Eq 4 can be written in terms of the outdoor airflow rate per person by substituting the  $\text{CO}_2$  generation rate per person for  $G$ . In this case, the outdoor airflow rate per person is given by Eq 5.

$$Q_p = 10^6 \times G_p / (C_{in,eq} - C_{out}) \quad (5)$$

where:

$Q_p$  = outdoor airflow rate per person into the zone, L/s per person, and

$G_p$  =  $\text{CO}_2$  generation rate in the zone per person, L/s per person.

### 10.3 Requirements and Assumptions:

10.3.1 The validity of Eq 4 and Eq 5 is based on several requirements and assumptions related to the single-zone tracer gas mass balance on which the equations are based.

10.3.2 Eq 4 and Eq 5 are based on the assumption that the zone to which the procedure is being applied acts as a single-zone with respect to  $\text{CO}_2$  concentration, that is, the  $\text{CO}_2$  concentration in that zone is uniform. Test Method E 741 specifies that the tracer gas concentration at representative locations throughout the zone differ by less than  $10\%$  of the average concentration for the zone. The existence of concentration uniformity must be verified by measuring the indoor  $\text{CO}_2$  concentration throughout the zone being tested. The measurement points must be well-distributed both horizontally and vertically in the zone being tested, including points in the individual rooms comprising the zone and multiple locations within the individual rooms. Based on these measurements, the uniformity criteria is evaluated based on the difference between the measured concentrations and the outdoor concentration.

10.3.3 Eq 4 and Eq 5 also require that the zone being tested is isolated from any other zones in the building in terms of airflow, unless those zones are at the same  $\text{CO}_2$  concentration