

INTERNATIONAL STANDARD

Industrial-process control valves –
Part 4: Inspection and routine testing

Standards
(<https://standards.iteh.ai>)
Document Preview

[IEC 60534-4:2021](#)

<https://standards.iteh.ai/catalog/standards/iec/fa58a137-3219-4fa1-aa50-9c8e1e26f74b/iec-60534-4-2021>



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2021 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

IEC online collection - oc.iec.ch

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 18 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

International Standards
standards.iteh.ai
Document Preview

[IEC 60534-4:2021](https://standards.iteh.ai/catalog/standards/iec/fa58a137-3219-4fa1-aa50-9c8e1e26f74b/iec-60534-4-2021)

<https://standards.iteh.ai/catalog/standards/iec/fa58a137-3219-4fa1-aa50-9c8e1e26f74b/iec-60534-4-2021>



IEC 60534-4

Edition 4.0 2021-12
REDLINE VERSION

INTERNATIONAL STANDARD

**Industrial-process control valves –
Part 4: Inspection and routine testing**

iteh Standards
(<https://standards.iteh.ai>)
Document Preview

[IEC 60534-4:2021](#)

<https://standards.iteh.ai/catalog/standards/iec/fa58a137-3219-4fa1-aa50-9c8e1e26f74b/iec-60534-4-2021>

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 23.060

ISBN 978-2-8322-4207-0

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD	4
1 Scope	6
2 Normative references	6
3 Terms and definitions	6
4 Requirements	8
4.1 General	8
4.2 Hydrostatic test	9
4.3 Seat leakage test	9
4.4 Packing test	10
4.5 Rated valve travel test	10
4.6 Dead band tests	10
4.7 Additional tests	10
5 Tests procedures	10
5.1 Measuring instruments	10
5.1.1 General	10
5.1.2 Pressure measuring instruments	10
5.1.3 Flow measuring instruments	10
5.1.4 Travel measuring instruments	11
5.1.5 Calibration	11
5.2 Test medium	11
5.3 Test fixtures	11
5.4 Hydrostatic test	11
5.4.1 Removal of internal components	11
5.4.2 Test pressure	11
5.4.3 Test procedure	11
5.4.4 Acceptance criteria	11
5.4.5 Exclusions from hydrostatic test	11
5.5 Seat leak test	12
5.5.1 Test medium	12
5.5.2 Actuator adjustments	13
5.5.3 Test procedure	13
5.5.4 Leakage specifications	14
5.6 Packing test	16
5.6.1 General	16
5.6.2 Procedure A	16
5.6.3 Procedure B	17
5.7 Rated valve travel test	17
5.7.1 General	17
5.7.2 Control valves with positioners	17
5.7.3 Control valves with spring-opposed actuators without positioners	18
5.7.4 Control valves with double-acting actuators without positioners	18
5.8 Dead band tests	18
5.8.1 General	18
5.8.2 Test equipment	18
5.8.3 Test procedure	18
5.8.4 Acceptance criteria	19

5.9	Stroking time test.....	19
5.9.1	General	19
5.9.2	Test equipment.....	20
5.9.3	Test procedures.....	20
Annex A (informative) Example calculations of seat leakage		21
A.1	General.....	21
A.1.1	Overview	21
A.1.2	Valve description	21
A.1.3	Test differential pressures	21
A.1.4	Calculation of rated valve capacity.....	21
A.1.5	Calculated maximum allowable seat leakages	24
A.2	General.....	24
A.2.1	Overview	24
A.2.2	Valve description	24
A.2.3	Test differential pressure	24
A.2.4	Calculation of class VI maximum allowable seat leakage	25
Annex B (informative) Inspection and routine testing checklist (per IEC 60534-4)		26
Bibliography.....		26
Figure 1 – Hysteresis and dead band.....		7
Table 1 – Tests.....		9
Table 2 – Minimum duration of hydrostatic tests of shell		14
Table 2 – Maximum seat leakage for each leakage class		14
Table 3 – Maximum recommended values of dead band error		19
Table A.1 – Maximum seat leakage for each leakage class.....		24

INTERNATIONAL ELECTROTECHNICAL COMMISSION

INDUSTRIAL-PROCESS CONTROL VALVES –

Part 4: Inspection and routine testing

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

This redline version of the official IEC Standard allows the user to identify the changes made to the previous edition IEC 60534-4:2006. A vertical bar appears in the margin wherever a change has been made. Additions are in green text, deletions are in strikethrough red text.

IEC 60534-4 has been prepared by subcommittee 65B: Measurement and control devices, of IEC technical committee 65: Industrial-process measurement, control and automation. It is an International Standard.

This fourth edition cancels and replaces the third edition published in 2006. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) remove details about hydrostatic test but state that to be performed according to valve design code;
- b) include mandatory test for valve packing;
- c) put in evidence limits of reduced differential pressure seat leakage test procedure;
- d) introduce details about low temperature seat leakage test;
- e) extend dimensional range for leakage class VI to less than 25 mm and over 400 mm seat diameter;
- f) include stroking time tests.

The text of this International Standard is based on the following documents:

Draft	Report on voting
65B/1208/FDIS	65B/1211/RVD

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this International Standard is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/standardsdev/publications.

A list of all parts in the IEC 60534 series, published under the general title *Industrial-process control valves*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INDUSTRIAL-PROCESS CONTROL VALVES –

Part 4: Inspection and routine testing

1 Scope

This part of IEC 60534 specifies the requirements for the inspection and routine testing of control valves manufactured in conformity with the other parts of IEC 60534.

This document is applicable to valves with pressure ratings not exceeding Class 2500. The requirements for actuators apply only to pneumatic actuators.

This document does not apply to the types of control valves where radioactive service, fire safety testing, or other hazardous service conditions are encountered. If a standard for hazardous service conflicts with the requirements of this document, the standard for hazardous service should take precedence.

NOTE This document can be extended to higher pressure ratings by agreement between the purchaser and the manufacturer.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60534 (all parts), *Industrial-process control valves*

<https://standards.iteh.ai/catalog/standards/iec/fa58a137-3219-4fa1-aa50-9c8e1e26f74b/iec-60534-4-2021>

~~IEC 61298 (all parts), *Process measurement and control devices – General methods and procedures for evaluating performance*~~

3 Terms and definitions

~~For the purposes of this document, the following definitions, as well as those given in IEC 60534-1 and other parts of IEC 60534, apply.~~

For the purposes of this document, the terms and definitions given in the IEC 60534 series and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>


3.1 bench range

range of pressures to the actuator within which the nominal travel is performed in both directions, with no pressure in the valve, but including friction forces


Note 1 to entry: The actuator operating range, i.e. when the valve is installed under actual process conditions, will be different from the bench range.

3.2 dead band


finite range of values within which reversal of the input variable does not produce any noticeable change in the output variable (see Figure 1)

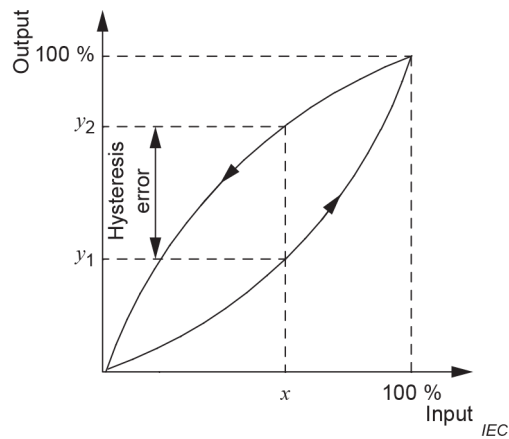

a) Hysteresis

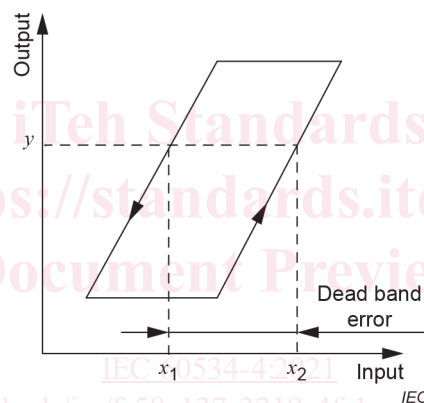

b) Dead band

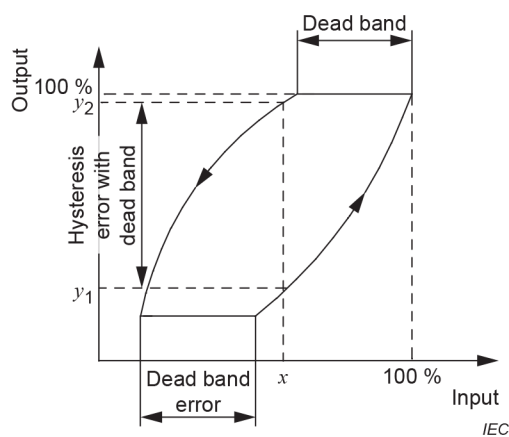

c) Hysteresis with dead band

Figure 1 – Hysteresis and dead band

3.3 dead band error

maximum value of the span of the dead band (over the measuring range)

3.4 hysteresis

property of a device or instrument whereby it gives different output values in relation to its input values depending on the directional sequence in which the input values have been applied (see Figure 1)

3.5 hysteresis error

maximum deviation between the two calibration curves of the measured variable as obtained by an upscale going traverse and a downscale going traverse over the full range and subtracting the value of the dead band

3.6 type inspection and testing

inspection and testing carried out by the manufacturer in accordance with its own procedures to assess whether products made by the same manufacturing process meet the requirements of the purchase order

Note 1 to entry: The products inspected and tested need not necessarily be the products actually supplied.

3.7 actual inspection and testing

inspection and testing carried out, before delivery, according to the technical requirements of the purchase order, on the products to be supplied or on test units of which the product supplied is part, in order to verify whether these products comply with the requirements of the purchase order

4 Requirements

4.1 General

Each valve shall be submitted to the mandatory tests specified in Table 1. Supplementary tests given are subject to agreement between manufacturer and purchaser. An inspection and routine testing check list as specified by the present document is given in Annex B.

Table 1 – Tests

Test	Category	Reference
1. Shell hydrostatic test	M	4.2 and 5.4
2. Seat leakage test	M	4.3 and 5.5
3. Packing test	M ^b	4.4 and 5.6.2
	S ^b	4.4 and 5.6.3
4. Rated valve travel ^a	M	4.5 and 5.7
5. Dead band ^a	S	4.6 and 5.8
6. Flow capacity	S	4.7 and IEC 60534-2-3
7. Flow characteristic	S	4.7 and IEC 60534-2-4
8. Stroking time test	S	5.9

M = Mandatory
S = Supplementary

The shell hydrostatic test shall be performed first for safety reasons. Other tests should be done in the sequence given above.

^a The results of tests of a valve under static conditions in a factory generally do not correspond to performance under working conditions. This document is intended only to provide guidance for negotiations between the manufacturer and the purchaser relative to tests of a specific valve.

^b The packing test shall be performed during the shell hydrostatic test if packing is installed during that test in accordance with 4.4 and 5.6.2. The supplementary packing test can also be performed in accordance with 4.4 and 5.6.3 if desired or specified by the customer.

4.2 Hydrostatic test

All control valve assemblies, excluding welded on fittings ~~(see 5.4.5)~~, with or without the actuator fitted, shall be subject to a hydrostatic test ~~at the pressure stated in 5.4~~ as specified in 5.4.

4.3 Seat leakage test

The manufacturer shall advise if the ~~minimum~~ achievable leak rate is less than the maximum allowed leak rate. If agreed to by the manufacturer and the user, the actual leak rate and allowed leak rate and the corresponding test pressure may be reported on the final certification.

Leakage shall be specified by the following code:

X	X	X
↓	↓	↓
Leakage class as shown in Table 3: I to VI	Test fluid G: air or nitrogen L: water	Test procedure 1 or 2

Example: III L 1

The seat leakage test as described in 5.5 shall be performed on each valve.

These seat leakage provisions do not apply to control valves with rated flow coefficients less than the following:

$$K_v = 0,086; \quad C_v = 0,1$$

Class VI is intended to apply to resilient seated valves only.

NOTE 1 This part of the standard cannot be used as a basis for predicting leakage when the control valve is installed under actual operating conditions.

NOTE 2 The actual and allowed leak rates, along with the corresponding test pressure, can also be included in the test certification upon agreement between the manufacturer and the buyer.

4.4 Packing test

This test, as described in 5.6, applies to the main valve packing. Secondary packing of the bellows ~~is~~ may be excluded from this test when it is not under pressure during the hydrostatic test.

4.5 Rated valve travel test

Travel adjustment of control valves shall be verified by test in the factory as described in 5.7.

4.6 Dead band tests

The purpose of the dead band test is to measure the change in operating signal required to produce a reversal of stem (or shaft) movement at approximately 25 %, 50 % and 75 % of the rated travel of the valve actuator. ~~This test as described in 5.8 may be performed on the valve and actuator assembly (with or without positioner) or the actuator only (with or without positioner).~~ These tests as described in 5.8 shall be performed on the assembly as it will be supplied.

4.7 Additional tests

Additional tests such as flow capacity, flow characteristic, stroking time, hysteresis, etc. (which are outside the scope of this standard), if required, shall be the subject of agreement between the manufacturer and the purchaser.

5 Tests procedures

IEC 60534-4:2021

<https://standards.iteh.ai/catalog/standards/iec/fa58a137-3219-4fa1-aa50-9c8e1e26f74b/iec-60534-4-2021>

5.1 Measuring instruments

5.1.1 General

Performance of measuring instruments is based on IEC 61298. The installation of all instruments shall be capable of meeting the requested accuracy.

5.1.2 Pressure measuring instruments

The analogue or digital pressure measuring instruments used in testing shall be of the indicating or recording type but shall be installed in such a manner that they represent the actual pressure in the component under test. The measuring equipment shall be capable of measuring the test pressure with a limit deviation of ± 5 % of the required test pressure. For dead band testing, the inaccuracy of the instruments shall not exceed $\pm 0,5$ % of full range, and the maximum signal shall be not less than 50 % of the instrument range. The readout of attached digital positioners can be used for the pressure measurement if the stated accuracy is maintained.

5.1.3 Flow measuring instruments

The accuracy of the instruments used for measuring seat leakage shall be within ± 10 % of full scale and shall be used within 20 % to 80 % of the scale range.

5.1.4 Travel measuring instruments

The accuracy of the instruments used to measure travel shall be within $\pm 0,5$ % of the rated travel. Digital positioners may be used for deadband measurements if the repeatability is $\pm 0,5$ % or better.

5.1.5 Calibration

It shall be the valve manufacturer's responsibility to maintain the accuracy of the measuring instruments. Calibration records shall be made available upon request.

5.2 Test medium

The test medium ~~may~~ shall be liquid or gas ~~at ambient temperature~~, as specified in each test description.

- a) Liquid: water at a temperature between 5 °C and 50 °C. The water may contain soluble oil or a ~~rust~~ corrosion inhibitor.
- b) Gas: air or nitrogen in clean condition, at a temperature between 5 °C and 50 °C. Clean helium gas or nitrogen gas may also be used for low temperature seat leakage test using the pressure and temperature corrections given in Table 2, footnote c.

5.3 Test fixtures

Test fixtures shall not subject the valve to externally applied stresses that may affect the results of the tests.

NOTE The test equipment can apply external loads sufficient to react the forces resulting from the test pressure.

When using different test equipment and procedures to those detailed in this document, the manufacturer shall be able to demonstrate the equivalence of its test procedures and acceptance criteria with the requirements of this document.

For butt welding end valves when end plugs are used, the seal point shall be as close to the weld end as practical without over-stressing the weld preparation.

5.4 Hydrostatic test

~~5.4.1 Removal of internal components~~

~~Components such as bellows, diaphragms, backseats or stem packing which may be damaged by the hydrostatic test pressure may be temporarily removed.~~

~~5.4.2 Test pressure~~

~~Hydrostatic shell test pressure shall be according to the design code or standard for the valve body or, alternatively, shall be not less than 1,5 times the 20 °C rated pressure, whichever is appropriate.~~

~~If a valve is dual pressure rated (inlet rating higher than outlet rating), it may be necessary to separate the high pressure portion of the valve from the low pressure portion with a temporary barrier and test each portion with its respective pressure.~~

~~5.4.3 Test procedure~~

~~The test liquid shall meet the specifications of 5.2 a).~~

~~The body ends shall be sealed in such a way that all cavities pressurised in service shall be simultaneously subjected to the test pressure for not less than the duration stated in Table 2.~~

Table 2 — Minimum duration of hydrostatic tests of shell

Nominal size	Test duration s
Up to and including DN 50 / NPS 2	15
DN 65 / NPS 2,5 to DN 200 / NPS 8	60
DN 250 / NPS 10 and over	180

~~During this test, the control valve shall be in the partially or fully open position.~~

~~Precautions shall be taken to first purge the valve of any residual air.~~

~~By agreement with the purchaser, hydrostatic tests may be conducted on components. If hydrostatic tests are conducted on the individual components, the full assembled valve shall be subjected to an air test at a pressure not to exceed 6 bar.~~

~~Tightening torques applied to the body bolting shall be as intended for use.~~

5.4.4 — Acceptance criteria

~~Visually detectable leakage from any external surface of the shell is not permitted.~~

~~Unless otherwise specified in the appropriate valve product standard, leakage from the stem seal is permitted at the shell test pressure provided that there is no visually detectable leakage when the test pressure is reduced to 1,1 times the allowable pressure at room temperature.~~

~~If equipment such as a volume lost measurement device is used for the test, the manufacturer shall be capable of demonstrating the equivalency of the system with the requirements of this standard.~~

5.4.5 — Exclusions from hydrostatic test

A hydrostatic shell test shall be performed according to the valve design code (or standard) and/or to the applicable local regulations.

If a valve is dual pressure rated (inlet rating higher than outlet rating), it may be necessary to separate the high pressure portion of the valve from the low pressure portion with a temporary barrier, and test each portion with its respective test pressure.

Components such as bellows, diaphragms, backseats or stem packing which may be damaged by the hydrostatic test pressure may be temporarily removed. If packing is present during the hydro test, it shall be tested during the hydro test in accordance with the procedures given in 5.6.

Welded-on fittings (nipples, reducers and/or expanders) shall not be considered as part of the valve assembly and, therefore, need not be included in the hydrostatic test. If it is not practical to hydrostatically test the valve alone, the valve plus fitting assembly may be tested at the valve hydrostatic pressure provided the fittings are adequate to sustain the said pressure. If agreed upon between the manufacturer and the purchaser, the valve may be retested after the fittings are welded on at a pressure in accordance with the applicable piping specifications.

5.5 Seat leak test

5.5.1 Test medium

The test medium shall meet the requirements of 5.2.