



SLOVENSKI STANDARD
SIST EN 13793:2004

01-september-2004

Thermal insulating products for building applications - Determination of behaviour under cyclic loading

Thermal insulating products for building applications - Determination of behaviour under cyclic loading

Wärmedämmstoffe für das Bauwesen - Bestimmung des Verhaltens unter zyklischer Belastung

iTeh STANDARD PREVIEW
(standards.iteh.ai)

Produits isolants thermiques destinés aux applications du bâtiment - Détermination du comportement sous charge cyclique

[SIST EN 13793:2004](#)

<https://standards.iteh.ai/catalog/standards/sist/e2458779-d919-4042-8b78-6da6df93162f/sist-en-13793-2004>

Ta slovenski standard je istoveten z: **EN 13793:2003**

ICS:

91.100.60 Thermal and sound insulating materials

SIST EN 13793:2004 en

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 13793:2004

<https://standards.iteh.ai/catalog/standards/sist/e2458779-d919-4042-8b78-6da6df93162f/sist-en-13793-2004>

EUROPEAN STANDARD

EN 13793

NORME EUROPÉENNE

EUROPÄISCHE NORM

September 2003

ICS 91.100.60

English version

Thermal insulating products for building applications - Determination of behaviour under cyclic loading

Produits isolants thermiques destinés aux applications du
bâtiment - Détermination du comportement sous charge
cyclique

Wärmedämmstoffe für das Bauwesen - Bestimmung des
Verhaltens unter zyklischer Belastung

This European Standard was approved by CEN on 1 August 2003.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Slovakia, Spain, Sweden, Switzerland and United Kingdom.

[SIST EN 13793:2004](https://standards.iteh.ai/catalog/standards/sist/e2458779-d919-4042-8b78-6da6df93162f/sist-en-13793-2004)

<https://standards.iteh.ai/catalog/standards/sist/e2458779-d919-4042-8b78-6da6df93162f/sist-en-13793-2004>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Contents

	page
Foreword.....	3
1 Scope	4
2 Normative references	4
3 Terms and definitions.....	4
4 Principle	5
5 Apparatus	5
5.1 Testing machine.....	5
5.2 Measurement of displacement	5
5.3 Measurement of force.....	6
5.4 Recording device	6
6 Test specimens	6
6.1 Dimensions of test specimens	6
6.2 Number of test specimens	6
6.3 Preparation of test specimens.....	7
6.4 Conditioning of test specimens	7
7 Procedure	7
7.1 Test conditions	7
7.2 Stress selection	7
7.3 Frequency selection	7
7.4 Number of load cycles.....	8
7.5 Test procedure	8
8 Calculation and expression of results	8
9 Accuracy of measurement	10
10 Test report	10

STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 13793:2004

<https://standards.iteh.ai/catalog/standards/sist/c2458779-d919-4042-8b76-6da6d93162f8/sist-en-13793-2004>

8b76-6da6d93162f8/sist-en-13793-2004

Foreword

This document (EN 13793:2003) has been prepared by Technical Committee CEN /TC 88, "Thermal insulating materials and products", the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by March 2004, and conflicting national standards shall be withdrawn at the latest by March 2004.

This European Standard is one of a series of standards which specify test methods for determining dimensions and properties of thermal insulating materials and products. It supports a series of product standards for thermal insulating materials and products which derive from the Council Directive of 21 December 1988 on the approximation of laws, regulations and administrative provisions of the Member States relating to construction products (Directive 89/106/EEC) through the consideration of the essential requirements.

This European Standard has been drafted for applications in buildings but may also be used in other areas where it is relevant.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Slovakia, Spain, Sweden, Switzerland and the United Kingdom.

SIST EN 13793:2004

<https://standards.itech.ai/catalog/standards/sist/e2458779-d919-4042-8b78-6da6df93162f/sist-en-13793-2004>

EN 13793:2003 (E)

1 Scope

This European Standard specifies equipment and procedures for determining behaviour of test specimens under cyclic loading conditions. It is applicable to thermal insulating products.

The selection of the conditions of the test shall be derived from the specific requirements of the intended application.

2 Normative references

This European Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies (including amendments).

EN 826, *Thermal insulating products for building applications - Determination of compression behaviour.*

EN 12085, *Thermal insulating products for building applications - Determination of linear dimensions of test specimens.*

3 Terms and definitions

STANDARD PREVIEW
(standards.iteh.ai)

For the purposes of this European Standard, the following terms and definitions apply.

3.1

thickness, d_s

initial thickness of the test specimen

[SIST EN 13793:2004](https://standards.iteh.ai/catalog/standards/sist/e2458779-d919-4042-8b78-6da6df93162f/sist-en-13793-2004)

<https://standards.iteh.ai/catalog/standards/sist/e2458779-d919-4042-8b78-6da6df93162f/sist-en-13793-2004>

3.2

compressive stress, σ_c

compressive force referred to the initial area of the cross section of the test specimen

— σ_{\min} : Lower stress level of one load cycle;

— σ_{\max} : Upper stress level of one load cycle.

3.3

deformation, X

reduction in thickness of the test specimen equal to $X_i - X_0$ both for $X_{i, \min}$ and $X_{i, \max}$

— $X_{i, \min}$: Reduction in thickness of the test specimen under the lower stress level, σ_{\min} , at a given number of load cycles, i ;

— $X_{i, \max}$: Reduction in thickness of the test specimen under the upper stress level, σ_{\max} , at a given number of load cycles, i .

3.4

relative deformation, ϵ

quotient of the deformation X of the test specimen and its thickness d_s

3.5

load cycle

cycle during which the compressive force is applied to the test specimen, starting at σ_{\min} , to be increased to σ_{\max} and then reduced back to σ_{\min} , so that the cycle of loading and unloading describes a type of sine wave, where σ_{\min} is the bottom and σ_{\max} is the top of the wave

4 Principle


The vertical deformation of test specimens subjected to repetitive load cycles is determined.

5 Apparatus

5.1 Testing machine

A testing machine appropriate for the range of force and displacement involved with two rigid, polished, square or circular plane parallel plates of which the length of one side (or the diameter) is at least as large as the test specimen side (or diagonal) to be tested. One of the plates shall be fixed and the other movable with a centrally positioned ball joint, if appropriate, to ensure that only axial force is applied to the test specimen. The movable plate shall be capable of following a sinusoidal waveform displacement in accordance with the conditions laid down in clause 7 and illustrated in Figure 1.

NOTE The load cycle should be considered as a sinusoidal waveform if the deviation of the actual curve compared to the theoretical sine curve at every point following the time axis does not exceed 5 % of the duration of one cycle.

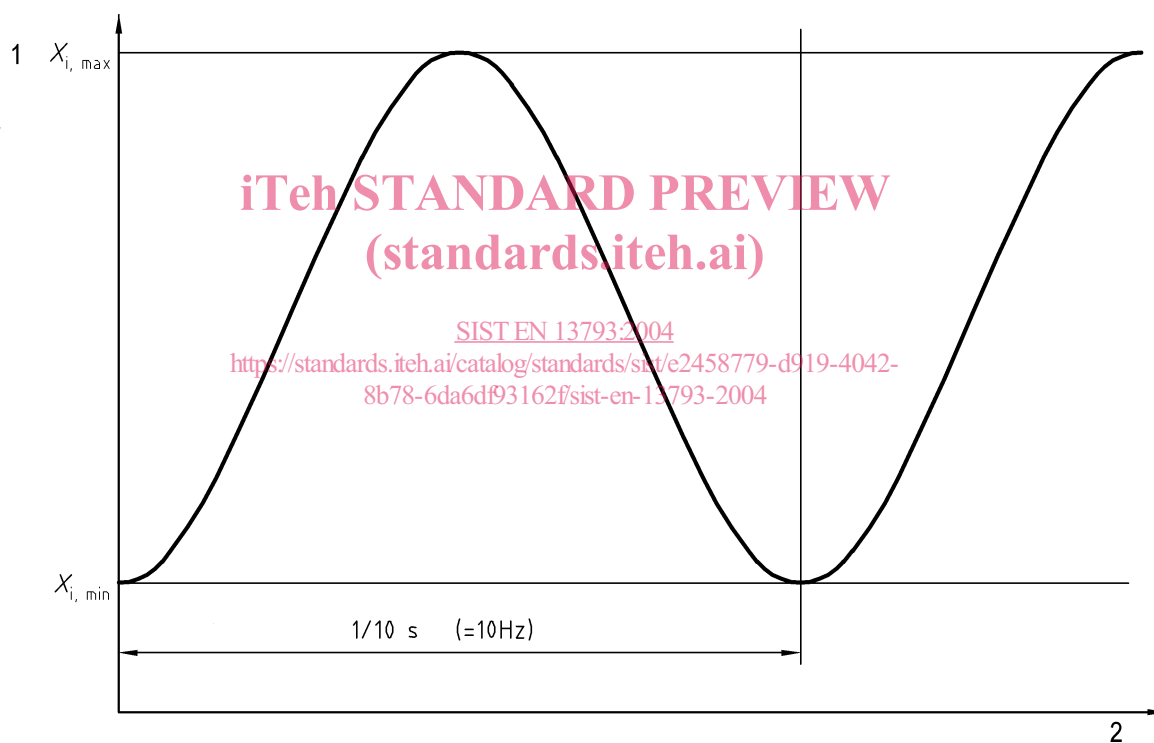

Key

1 Displacement
2 Time

Figure 1 — Illustration of a load cycle

5.2 Measurement of displacement

Device for the measurement of the displacement fitted to the compression testing machine which allows continuous measurement of the displacement of the movable plate or of the distance between the two plates and which permits reading to $\pm 5\%$ or $\pm 0,1$ mm, whichever is the smaller (see 5.3).

EN 13793:2003 (E)

5.3 Measurement of force

Sensor fitted to one of the machine plates to measure the force produced by the reaction of the test specimen upon the plates. This sensor shall be such that its own deformation during the course of the measuring operation is negligible compared with that being measured or if not, it shall be taken into account by calculation. The sensor shall allow the continuous measurement of the force permitting reading to $\pm 3\%$.

5.4 Recording device

Device for the simultaneous recording of the force, F , and the displacement, X , which provides a curve of F as a function of X .

NOTE It is most likely that only those machines, which incorporate a high precision aligned loading frame with a servo-hydraulic system control and a computer controlled actuator will comply with the required level of accuracy.

The measuring devices for displacement and force are likely to comprise electronic transducers and sensors. In order to achieve the maximum level of accuracy, it is desirable that all test controlling, data generation and data management (including all output of tables and plots) are concentrated in one computer system.

6 Test specimens

6.1 Dimensions of test specimens

The test specimens shall be at the original product thickness. The width of the test specimens shall not be less than the thickness. Products with integrally moulded skins which are retained in use shall be tested with these skins intact.

Test specimens shall not be layered to produce a greater thickness for testing.

Test specimens shall be squarely cut and square with recommended cross section areas as follows:

50 mm × 50 mm or
100 mm × 100 mm or
150 mm × 150 mm or
200 mm × 200 mm or
300 mm × 300 mm.

The choice of dimensions to be used shall be as specified in the relevant product standard.

In the absence of a product standard or any other European technical specification the dimensions of test specimens may be agreed between parties.

The linear dimensions shall be determined in accordance with EN 12085 with a limit deviation of $\pm 0,5\%$.

The tolerance on parallelism and flatness between the two faces of the test specimen shall not be greater than 0,5 % of the specimen side with a maximum of 0,5 mm.

If the test specimens are not flat, they shall be ground flat or an appropriate levelling layer shall be applied to prepare the surface for the test. No significant deformation shall occur in the levelling layer during the test.

In case that a gypsum levelling layer is used, the determination of the dimensions shall occur prior to the application of the layers.

NOTE The accuracy of the test result is reduced if the test specimens have a thickness of less than 20 mm.

6.2 Number of test specimens

The number of test specimens shall be as specified in the relevant product standard. In the absence of such a specification, five test specimens shall be used for each stress selected.

NOTE In the absence of a product standard or any other European technical specification the number of test specimens may be agreed between parties.

6.3 Preparation of test specimens

The test specimens shall be cut so that they do not include product edges. The test specimens shall be prepared by methods that do not change the original structure of the product. Any skins, facings and/or coatings shall be retained.

NOTE Special methods of preparation, when needed, are given in the relevant product standard or any other European technical specification.

6.4 Conditioning of test specimens

The test specimens shall be stored for at least 6 h at (23 ± 5) °C. In case of dispute they shall be stored at (23 ± 2) °C and (50 ± 5) % relative humidity, for the time specified in the relevant product standard, for a minimum of 6 h.

7 Procedure

7.1 Test conditions

The test shall be carried out at (23 ± 2) °C. In case of dispute it shall be carried out at (23 ± 2) °C and (50 ± 5) % relative humidity.

7.2 Stress selection

The test is carried out at one or more different stresses.

<https://standards.iteh.ai/catalog/standards/sist/e2458779-d919-4042-8b78-6de6d93162f8/sist-en-13793-2004>

The different stresses, σ_{\max} , for the cyclic load investigation shall be based on either the compressive strength, σ_m , or the compressive stress at 10 % deformation, σ_{10} , measured in accordance with EN 826, and shall be calculated as follows:

$$\text{— } \sigma_{\max} = 0,15 \times \sigma_m \quad \text{or} \quad \sigma_{\max} = 0,15 \times \sigma_{10}$$

$$\text{— } \sigma_{\max} = 0,20 \times \sigma_m \quad \text{or} \quad \sigma_{\max} = 0,20 \times \sigma_{10}$$

$$\text{— } \sigma_{\max} = 0,25 \times \sigma_m \quad \text{or} \quad \sigma_{\max} = 0,25 \times \sigma_{10}$$

$$\text{— } \sigma_{\max} = 0,30 \times \sigma_m \quad \text{or} \quad \sigma_{\max} = 0,30 \times \sigma_{10}$$

$$\text{— } \sigma_{\max} = 0,35 \times \sigma_m \quad \text{or} \quad \sigma_{\max} = 0,35 \times \sigma_{10}$$

If appropriate other values of σ_{\max} may be chosen.

The corresponding stresses σ_{\min} shall be 5 % of the respective σ_{\max} .

7.3 Frequency selection

The test is carried out at a frequency within the range of 0,5 Hz to 10 Hz.

The frequency shall be selected so that any possible increase of the temperature in the center of the test specimen will not affect the test result.

The load cycle, following a sinusoidal waveform, is applied at a required number of cycles per second. The frequency of the wave shall be given in the relevant product standard or may be agreed upon between parties within the range given above.

NOTE Different frequencies can lead to different results.