

---

**Prenapetostni odvodniki - 8. del: Kovinsko-oksadni prenapetostni odvodniki z zunanjim zaporedno vezanim iskriščem (EGLA) za nadzemne prenosne in razdelilne vode v izmeničnih sistemih nad 1 kV (IEC 60099-8:2011)**

Surge arresters - Part 8: Metal-oxide surge arresters with external series gap (EGLA) for overhead transmission and distribution lines of a.c. systems above 1 kV

Überspannungsableiter - Teil 8: Metalloxid-Überspannungsableiter mit externer Serienfunkenstrecke (EGLA) für Übertragungs- und Verteilungsleitungen von Wechselstromsystemen über 1 kV

Parafoudres - Partie 8: Parafoudres à oxyde métallique avec éclateur extérieur en série (EGLA) pour lignes aériennes de transmission et de distribution de réseaux à courant alternatif de plus de 1 kV

**Ta slovenski standard je istoveten z: EN 60099-8:2011**

---

**ICS:**

29.240.10	Transformatorske postaje. Prenapetostni odvodniki	Substations. Surge arresters
-----------	--	------------------------------

**SIST EN 60099-8:2011**

**en**

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

SIST EN 60099-8:2011

<https://standards.iteh.ai/catalog/standards/sist/4d7f2e7a-6b35-4970-9a3d-c5e52055373d/sist-en-60099-8-2011>

EUROPEAN STANDARD  
NORME EUROPÉENNE  
EUROPÄISCHE NORM

# EN 60099-8

April 2011

ICS 29.240.10

English version

## Surge arresters - Part 8: Metal-oxide surge arresters with external series gap (EGLA) for overhead transmission and distribution lines of a.c. systems above 1 kV (IEC 60099-8:2011)

Parafoudres -

Partie 8: Parafoudres à oxyde métallique  
avec éclateur extérieur en série (EGLA)  
pour lignes aériennes de transmission et  
de distribution de réseaux à courant  
alternatif de plus de 1 kV  
(CEI 60099-8:2011).

Überspannungsableiter – Teil 8:

Metalloxid-Überspannungsableiter mit  
externer Serienfunkenstrecke (EGLA) für  
Übertragungs- und Verteilungsleitungen  
von Wechselstromsystemen über 1 kV  
(IEC 60099-8:2011)

**ITeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

This European Standard was approved by CENELEC on 2011-03-03. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the Central Secretariat has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and the United Kingdom.

# CENELEC

European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**Management Centre: Avenue Marnix 17, B - 1000 Brussels**

## Foreword

The text of document 37/370/FDIS, future edition 1 of IEC 60099-8, prepared by IEC TC 37, Surge arresters, was submitted to the IEC-CENELEC parallel vote and was approved by CENELEC as EN 60099-8 on 2011-03-03.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN and CENELEC shall not be held responsible for identifying any or all such patent rights.

The following dates were fixed:

- |  |       |            |
|--|-------|------------|
| – latest date by which the EN has to be implemented at national level by publication of an identical national standard or by endorsement | (dop) | 2011-12-03 |
| – latest date by which the national standards conflicting with the EN have to be withdrawn   | (dow) | 2014-03-03 |

Annex ZA has been added by CENELEC.

---

## Endorsement notice

The text of the International Standard IEC 60099-8:2011 was approved by CENELEC as a European Standard without any modification.

**(standards.iteh.ai)**

SIST EN 60099-8:2011

<https://standards.iteh.ai/catalog/standards/sist/4d7f2e7a-6b35-4970-9a3d-c5e52055373d/sist-en-60099-8-2011>

## Annex ZA (normative)

### Normative references to international publications with their corresponding European publications

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

NOTE When an international publication has been modified by common modifications, indicated by (mod), the relevant EN/HD applies.

<u>Publication</u>	<u>Year</u>	<u>Title</u>	<u>EN/HD</u>	<u>Year</u>
IEC 60060-1	1989	High-voltage test techniques - Part 1: General definitions and test requirements	HD 588.1 S1 <sup>1)</sup>	1991
IEC 60060-2	1994	High-voltage test techniques - Part 2: Measuring systems	EN 60060-2 <sup>2)</sup>	1994
IEC 60068-2-11	1981	Environmental testing - Part 2-11: Tests - Test Ka: Salt mist	EN 60068-2-11	1999
IEC 60068-2-14	2009	Environmental testing - Part 2-14: Tests - Test N: Change of temperature	EN 60068-2-14	2009
IEC 60099-4 (mod) + A1 + A2	2004 2006 2009	Surge arresters - Part 4: Metal-oxide surge arresters without gaps for a.c. systems	EN 60099-4 + A1 + A2	2004 2006 2009
IEC 60270	2000	High-voltage test techniques - Partial discharge measurements	EN 60270	2001
IEC 60507	1991	Artificial pollution tests on high-voltage insulators to be used on a.c. systems	EN 60507	1993
IEC/TS 60815-1	2008	Selection and dimensioning of high-voltage insulators intended for use in polluted conditions - Part 1: Definitions, information and general principles	-	-
IEC 62217	2005	Polymeric insulators for indoor and outdoor use with a nominal voltage > 1 000 V - General definitions, test methods and acceptance criteria	EN 62217	2006
ISO 3274	-	Geometrical Product Specifications (GPS) - Surface texture: Profile method - Nominal characteristics of contact (stylus) instruments	EN ISO 3274	-
ISO 4287	-	Geometrical Product Specifications (GPS) - Surface texture: Profile method - Terms, definitions and surface texture parameters	EN ISO 4287	-

<sup>1)</sup> HD 588.1 S1 is superseded by EN 60060-1:2010, which is based on IEC 60060-1:2010.

<sup>2)</sup> EN 60060-2 is superseded by EN 60060-2:2011, which is based on IEC 60060-2:2010.

<u>Publication</u>	<u>Year</u>	<u>Title</u>	<u>EN/HD</u>	<u>Year</u>
ISO 4892-1	-	Plastics - Methods of exposure to laboratory light sources - Part 1: General guidance	EN ISO 4892-1	-
ISO 4892-2	-	Plastics - Methods of exposure to laboratory light sources - Part 2: Xenon-arc lamps	EN ISO 4892-2	-
ISO 4892-3	-	Plastics - Methods of exposure to laboratory light sources - Part 3: Fluorescent UV lamps	EN ISO 4892-3	-

## iTeh STANDARD PREVIEW (standards.iteh.ai)

SIST EN 60099-8:2011

<https://standards.iteh.ai/catalog/standards/sist/4d7f2e7a-6b35-4970-9a3d-c5e52055373d/sist-en-60099-8-2011>



IEC 60099-8

Edition 1.0 2011-01

# INTERNATIONAL STANDARD

## NORME INTERNATIONALE



### Surge arresters – iTeh STANDARD PREVIEW

Part 8: Metal-oxide surge arresters with external series gap (EGLA) for overhead transmission and distribution lines of a.c. systems above 1 kV

[SIST EN 60099-8:2011](https://standards.iteh.ai/catalog/standards/sist/4d7f2e7a-6b35-4970-9a3d-528655100000/sist-en-60099-8-2011)

Parafoudres – <https://standards.iteh.ai/catalog/standards/sist/4d7f2e7a-6b35-4970-9a3d-528655100000/sist-en-60099-8-2011>

Partie 8: Parafoudres à oxyde métallique avec éclateur extérieur en série (EGLA) pour lignes aériennes de transmission et de distribution de réseaux à courant alternatif de plus de 1 kV

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

COMMISSION  
ELECTROTECHNIQUE  
INTERNATIONALE

PRICE CODE  
CODE PRIX

**XB**

ICS 29.240.10

ISBN 978-2-88912-312-4

## CONTENTS

FOREWORD.....	5
INTRODUCTION.....	7
1 Scope.....	8
2 Normative references .....	8
3 Terms and definitions .....	9
4 Identification and classification .....	11
4.1 EGLA identification.....	11
4.2 EGLA classification .....	12
5 Standard ratings and service conditions .....	12
5.1 Standard rated voltages .....	12
5.2 Standard rated frequencies .....	13
5.3 Standard nominal discharge currents .....	13
5.4 Service conditions .....	13
5.4.1 Normal service conditions.....	13
5.4.2 Abnormal service conditions .....	13
6 Requirements.....	13
6.1 Insulation withstand of the SVU and the complete EGLA .....	13
6.1.1 Insulation withstand of the housing of the SVU .....	13
6.1.2 Insulation withstand of EGLA with shorted (failed) SVU .....	13
6.2 Residual voltages.....	14
6.3 High current duty.....	14
6.4 Lightning discharge capability.....	14
6.5 Short-circuit performance of the SVU.....	14
6.6 Mechanical performance .....	14
6.7 Weather aging of SVU.....	15
6.8 Reference voltage of the SVU .....	15
6.9 Internal partial discharges .....	15
6.10 Coordination between insulator withstand and EGLA protective level .....	15
6.11 Follow current interrupting.....	15
6.12 Electromagnetic compatibility .....	15
6.13 End of life.....	16
7 General testing procedure .....	16
7.1 Measuring equipment and accuracy .....	16
7.2 Test samples.....	16
8 Type tests .....	16
8.1 General.....	16
8.2 Insulation withstand tests on the SVU housing and on the EGLA with failed SVU .....	17
8.2.1 General .....	17
8.2.2 Insulation withstand test on the SVU housing .....	17
8.2.3 Insulation withstand tests on EGLA with failed SVU.....	18
8.3 Residual voltage tests .....	19
8.3.1 General .....	19
8.3.2 Procedure for correction and calculation of inductive voltages .....	19
8.3.3 Lightning current impulse residual voltage test .....	20



8.3.4	High current impulse residual voltage test .....	21
8.4	Standard lightning impulse sparkover test .....	21
8.5	High current impulse withstand test .....	22
8.5.1	Selection of test samples .....	22
8.5.2	Test procedure .....	22
8.5.3	Test evaluation .....	22
8.6	Lightning discharge capability test .....	23
8.6.1	Selection of test samples .....	23
8.6.2	Test procedure .....	23
8.6.3	Test parameters for the lightning impulse discharge capability test .....	23
8.6.4	Measurements during the lightning impulse discharge capability test .....	24
8.6.5	Rated lightning impulse discharge capability .....	24
8.6.6	List of rated charge values .....	24
8.7	Short-circuit tests .....	24
8.7.1	General .....	24
8.7.2	Preparation of the test samples .....	25
8.7.3	Mounting of the test sample .....	26
8.7.4	High-current short-circuit tests .....	27
8.7.5	Low-current short-circuit test .....	29
8.7.6	Evaluation of test results .....	29
8.8	Follow current interrupting test .....	34
8.8.1	General .....	34
8.8.2	"Test method A" .....	34
8.8.3	"Test method B" .....	36
8.9	Mechanical load tests on the SVU .....	38
8.9.1	Bending test .....	38
8.9.2	Vibration test .....	47
8.10	Weather aging tests .....	48
8.10.1	General .....	48
8.10.2	Sample preparation .....	48
8.10.3	Test procedure .....	48
8.10.4	Test evaluation .....	48
8.10.5	Additional test procedure for polymer (composite and cast resin) housed SVUs .....	48
9	Routine tests .....	49
9.1	General .....	49
10	Acceptance tests .....	50
10.1	General .....	50
10.2	Reference voltage measurement of SVU .....	50
10.3	Internal partial discharge test of SVU .....	50
10.4	Radio interference voltage (RIV) test .....	50
10.5	Test for coordination between insulator withstand and EGLA protective level .....	51
10.5.1	General .....	51
10.5.2	Front-of-wave impulse sparkover test .....	51
10.5.3	Standard lightning impulse sparkover test .....	51
10.6	Follow current interrupting test .....	52
10.6.1	General .....	52
10.6.2	Test procedure .....	52
10.6.3	Test sequence .....	52

10.6.4 Test evaluation .....	52
10.7 Vibration test on the SVU with attached electrode .....	52
10.7.1 Test procedure and test condition .....	53
10.7.2 Test evaluation .....	53
Annex A (informative) Example of a test circuit for the follow current interrupting test .....	54
Annex B (normative) Mechanical considerations .....	55
Bibliography .....	60
Figure 1 – Configuration of an EGLA with insulator and arcing horn .....	7
Figure 2 – Examples of SVU units .....	32
Figure 3 – Short-circuit test setup .....	33
Figure 4 – Example of a test circuit for re-applying pre-failing circuit immediately before applying the short-circuit test current .....	34
Figure 5 – Thermo-mechanical test .....	43
Figure 6 – Example of the test arrangement for the thermo-mechanical test and direction of the cantilever load .....	44
Figure 7 – Test sequence of the water immersion test .....	45
Figure A.1 – Example of a test circuit for the follow current interrupting test .....	54
Figure B.1 – Bending moment – Multi-unit SVU .....	55
Figure B.2 – SVU unit .....	57
Figure B.3 – SVU dimensions .....	58
Table 1 – EGLA classification – “Series X” and “Series Y” .....	12
Table 2 – Steps of rated voltages (r.m.s. values) .....	12
Table 3 – Type tests (all tests to be performed without insulator assembly) .....	17
Table 4 – Test requirements .....	30
Table 5 – Required currents for short-circuit tests .....	31
Table 6 – Acceptance tests .....	50
Table 7 – Virtual steepness of wave front of front-of-wave lightning impulses .....	51

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**SURGE ARRESTERS –****Part 8: Metal-oxide surge arresters with external series gap (EGLA)  
for overhead transmission and distribution lines  
of a.c. systems above 1 kV**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 60099-8 has been prepared by IEC technical committee 37: Surge arresters.

The text of this standard is based on the following documents:

FDIS	Report on voting
37/370/FDIS	37/377/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of IEC 60098 series, under the general title *Surge arresters* can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

**IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**

## iTeh STANDARD PREVIEW (standards.iteh.ai)

SIST EN 60099-8:2011

<https://standards.iteh.ai/catalog/standards/sist/4d7f2e7a-6b35-4970-9a3d-c5e52055373d/sist-en-60099-8-2011>


## INTRODUCTION

This part of IEC 60099 applies to the externally gapped line arrester (EGLA)

This type of surge arrester is connected directly in parallel with an insulator assembly. It comprises a series varistor unit (SVU), made up from non-linear metal-oxide resistors encapsulated in a polymer or porcelain housing, and an external series gap, see Figure 1.

The purpose of an EGLA is to protect the parallel-connected insulator assembly from lightning-caused overvoltages. The external series gap, therefore, should spark over only due to fast-front overvoltages. The gap should withstand all power-frequency and slow-front overvoltages occurring on the system.

In the event of SVU failure, the external series gap should be able to isolate the SVU from the system.

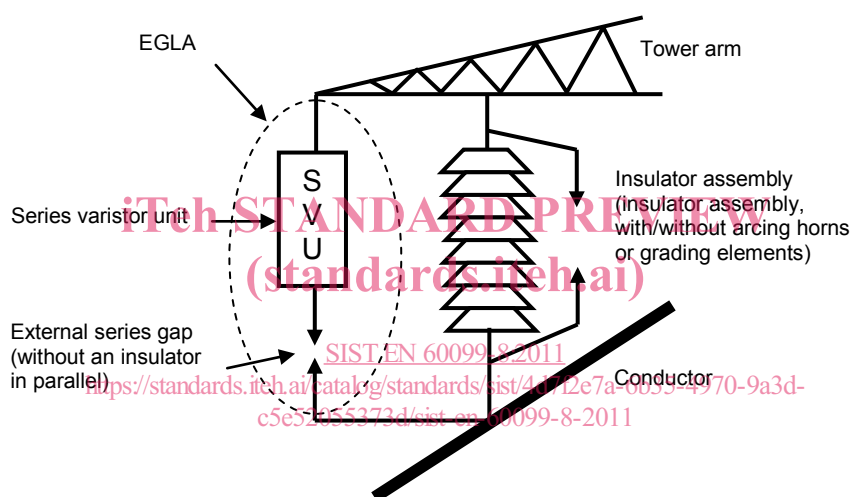

IEC 2896/10

**Figure 1 – Configuration of an EGLA with insulator and arcing horn**

## SURGE ARRESTERS –

### Part 8: Metal-oxide surge arresters with external series gap (EGLA) for overhead transmission and distribution lines of a.c. systems above 1 kV

#### 1 Scope

This part of IEC 60099 covers metal-oxide surge arresters with external series gap (externally gapped line arresters (EGLA) that are applied on overhead transmission and distribution lines, only to protect insulator assemblies from lightning-caused flashovers.

This standard defines surge arresters to protect the insulator assembly from lightning-caused overvoltages only. Therefore, and since the metal-oxide resistors are not permanently connected to the line, the following items are not considered for this standard:

- switching impulse sparkover voltage;
- residual voltage at steep current and switching current impulse;
- thermal stability;
- long-duration current impulse withstand duty;
- power-frequency voltage versus time characteristics of an arrester;
- disconnecter test;
- aging duties by power-frequency voltage.

Considering the particular design concept and the special application on overhead transmission and distribution lines, some unique requirements and tests are introduced, such as the verification test for coordination between insulator withstand and EGLA protective level, the follow current interrupting test, mechanical load tests, etc.

Designs with the EGLA's external series gap installed in parallel to an insulator are not covered by this standard.

#### 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60060-1:1989, *High-voltage test techniques – Part 1: General definitions and test requirements*

IEC 60060-2:1994, *High-voltage test techniques – Part 2: Measuring systems*

IEC 60068-2-11:1981, *Environmental testing – Part 2: Tests. Test kA: Salt mist*

IEC 60068-2-14:2009, *Environmental testing – Part 2-14: Tests – Test N: Change of temperature*

IEC 60099-4:2009, *Surge arresters – Part 4: Metal-oxide surge arresters without gaps for a.c. systems*

IEC 60270:2000, *High-voltage test techniques – Partial discharge measurements*

IEC 60507:1991, *Artificial pollution tests on high-voltage insulators to be used on a.c. systems*

IEC/TS 60815-1:2008, *Selection and dimensioning of high-voltage insulators intended for use in polluted conditions – Part 1: Definitions, information and general principles*

IEC 62217:2005, *Polymeric insulators for indoor and outdoor use with a nominal voltage > 1 000 V – General definitions, test methods and acceptance criteria*

ISO 3274, *Geometric product specifications (GPS) – Surface texture: Profile method – Nominal characteristics of contact (stylus) instruments*

ISO 4287, *Geometrical Product Specifications (GPS) – Surface texture: Profile method – Terms, definitions and surface texture parameters*

ISO 4892-1, *Plastics – Methods of exposure to laboratory light sources – Part 1: General Guidance*

ISO 4892-2, *Plastics – Methods of exposure to laboratory light sources – Part 2: Xenon-arc sources*

ISO 4892-3, *Plastics – Methods of exposure to laboratory light sources – Part 3: Fluorescent UV lamps*

**ITeH STANDARD PREVIEW**  
**(standards.iteh.ai)**

### 3 Terms and definitions

SIST EN 60099-8:2011

<https://standards.iteh.ai/catalog/standards/sist/4d7f2e7a-6b35-4970-9a3d-c2125f104a00/en-60099-8-2011>

For the purposes of this document, the following terms and definitions apply.

#### 3.1

##### **externally gapped line arrester**

##### **EGLA**

arrester designed for installation on overhead lines to protect an insulator assembly from lightning-caused fast-front overvoltages only

NOTE This is accomplished by rising the sparkover level of the external series gap to a level that isolates the arrester from power-frequency overvoltages and from the worst case slow-front overvoltages due to switching and fault events expected on the line to which it is applied.

#### 3.2

##### **series varistor unit**

##### **SVU**

non-linear metal-oxide resistor part, contained in a housing, which must be connected with an external series gap to construct the complete arrester

NOTE The series varistor unit may include several units.

#### 3.3

##### **section of an EGLA**

complete, suitably assembled part of a complete EGLA necessary to represent the behaviour of a complete EGLA with respect to a particular test

#### 3.4

##### **section of an SVU**

complete, suitably assembled part of an SVU unit necessary to represent the behaviour of an SVU with respect to a particular test