

# SLOVENSKI STANDARD

## SIST EN ISO 10077-1:2001

01-september-2001

Hcd`cHbY`Uglbcghj`c\_Ybžj fUhjb`dc`\_Yb!`nfU i b`hcd`cHbY`dfY cXbcghj`!`%`XY.  
DcYbcghUj`YbUa YrcXUfIGC`%\$++!%&\$\$\$L

Thermal performance of windows, doors and shutters -Calculation of thermal transmittance - Part 1: Simplified method (ISO 10077-1:2000)

Wärmetechnisches Verhalten von Fenstern, Türen und Abschlüssen - Berechnung des Wärmedurchgangskoeffizienten - Teil 1: Vereinfachtes Verfahren (ISO 10077-1:2000)

Performance thermique des fenêtres, portes et fermetures -Calcul du coefficient de transmission thermique - Partie 1: Méthode simplifiée (ISO 10077-1:2000)

<https://standards.iteh.ai/catalog/standards/sist/3e4ea9a6-4327-4c5b-ac8c-dc0a8d60dde7/sist-en-iso-10077-1-2001>

Ta slovenski standard je istoveten z: EN ISO 10077-1:2000

### ICS:

91.060.50	Vrata in okna	Doors and windows
91.120.10	Toplotna izolacija stavb	Thermal insulation

SIST EN ISO 10077-1:2001

en

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

SIST EN ISO 10077-1:2001

<https://standards.iteh.ai/catalog/standards/sist/3e4ea9a6-4327-4c5b-ac8c-dc0a8d60dde7/sist-en-iso-10077-1-2001>

EUROPEAN STANDARD  
NORME EUROPÉENNE  
EUROPÄISCHE NORM

EN ISO 10077-1

July 2000

ICS 91.060.50; 91.120.10

English version

Thermal performance of windows, doors and shutters -  
Calculation of thermal transmittance - Part 1: Simplified method  
(ISO 10077-1:2000)

Performance thermique des fenêtres, portes et fermetures -  
Calcul du coefficient de transmission thermique - Partie 1:  
Méthode simplifiée (ISO 10077-1:2000)

Wärmetechnisches Verhalten von Fenstern, Türen und  
Abschlüssen - Berechnung des  
Wärmedurchgangskoeffizienten - Teil 1: Vereinfachtes  
Verfahren (ISO 10077-1:2000)

This European Standard was approved by CEN on 21 July 1999.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

Central Secretariat: rue de Stassart, 36 B-1050 Brussels

## Contents

	Page
Foreword	3
Introduction	3
1 Scope	4
2 Normative references	5
3 Definitions, symbols and units	6
4 Geometrical characteristics	7
5 Calculation of thermal transmittance	9
6 Input data	15
7 Report	15
Annex A (normative) Internal and external surface thermal resistances	17
Annex B (informative) Thermal conductivity of glass	17
Annex C (informative) Thermal resistance of air spaces between glazing and thermal transmittance of coupled or double glazing	18
Annex D (informative) Thermal transmittance of frames	20
Annex E (informative) Linear thermal transmittance of frame/glazing junction	25
Annex F (informative) Thermal transmittance of windows	26
Annex G (informative) Additional thermal resistance for windows with closed shutters	28
Annex H (informative) Permeability of shutters	29
Annex ZA (informative) A-deviations	31

## Foreword

The text of EN ISO 10077-1:2000 has been prepared by Technical Committee CEN/TC 89 "Thermal performance of buildings and building components", the secretariat of which is held by SIS, in collaboration with Technical Committee ISO/TC 163 "Thermal insulation".

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by January 2001, and conflicting national standards shall be withdrawn at the latest by January 2001.

For relationship with EU Directive(s), see informative Annex ZA, which is an integral part of this standard.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

This standard is one of a series of standards on calculation methods for the design and evaluation of the thermal performance of buildings and building components.

It contains two parts. Part 1 deals with the simplified calculation of the thermal transmittance of windows and doors with or without shutters. Part 2 covers the numerical calculation (two-dimensional) of the thermal transmittance of frame profiles.

## Introduction

The method described in this standard is used to evaluate the thermal transmittance of windows and doors, or as part of the determination of the energy use of a building.

An alternative to this calculation method is testing according to EN ISO 12567 "Thermal performance of windows and doors – Determination of thermal transmittance by hot box methods".

In some countries the calculation of the thermal transmittance of windows forms part of their national regulations. Information about national deviations from this standard due to regulations are given in annex ZA.

## 1 Scope

This standard specifies methods for the calculation of the thermal transmittance of windows and doors consisting of glazed or opaque panels fitted in a frame, with and without shutters.

It allows for:

- different types of glazing (glass or plastics; single or multiple glazing; with or without low emissivity coatings; with spaces filled with air or other gases);
- various types of frames (wood; plastic; metallic with and without thermal barrier; metallic with pinpoint metallic connections or any combination of materials);
- where appropriate, the additional thermal resistance introduced by different types of shutters, depending on their air permeability.

Curtain walls and other structural glazings, which are not fitted in a frame, are excluded from this standard. Roof windows are also excluded because of their complex geometrical frame sections.

Default values for glazings, frames and shutters are given in the informative annexes. Thermal bridge effects at the rebate or joint between the window or door frame and the rest of the building envelope are excluded from the calculation.

The calculation does not include:

- effects of solar radiation;
- heat transfer caused by air leakage;
- calculation of condensation;
- ventilation of air spaces in double and coupled windows.

## 2 Normative references

This standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publications referred to applies.

EN 673	Glass in building – Determination of thermal transmittance ( $U$ value) – Calculation method
EN 674	Glass in building – Determination of thermal transmittance ( $U$ value) – Guarded hot plate method
EN 675	Glass in building – Determination of thermal transmittance ( $U$ value) – Heat flow meter method
prEN 1098	Measuring method for the determination of the thermal transmittance of multiple glazing ( $U$ value) – Calibrated and guarded hot box method
prEN 1279-1	Glass in building - Insulating glass units - Part 1: Generalities and dimensional tolerances
prEN 1279-3	Glass in building - Insulating glass units - Part 3: Initial type testing on gas-filled insulating glass units; gas leakage rate
prEN 12412-2	Windows, doors and shutters - Determination of thermal transmittance by hot box method – Part 2: Frames
EN 12524	Building materials and products – Hygrothermal properties – Tabulated design values
EN ISO 6946	Building components and building elements – Thermal resistance and thermal transmittance – Calculation method (ISO 6946)
EN ISO 7345	Thermal insulation – Physical quantities and definitions (ISO 7345)
prEN ISO 10077-2	Thermal performance of windows, doors and shutters - Calculation of thermal transmittance - Part 2: Numerical method for frames (ISO/DIS 10077-2)
EN ISO 10211-2	Thermal bridges in building construction - Calculation of heat flows and surface temperatures - Part 2: Linear thermal bridges (ISO 10211-2)
ISO 8302	Thermal insulation – Determination of steady-state thermal resistance and related properties – Guarded hot plate apparatus

### 3 Definitions, symbols and units

#### 3.1 Definitions

For the purposes of this standard, the definitions given in EN 673 and EN ISO 7345 apply.

In clause 4 of this standard, descriptions are given of a number of geometrical characteristics of glazing and frame.

#### 3.2 Symbols

Symbol	Quantity	Unit
$A$	area	$\text{m}^2$
$R$	thermal resistance	$\text{m}^2 \cdot \text{K}/\text{W}$
$T$	temperature	K
$U$	thermal transmittance	$\text{W}/(\text{m}^2 \cdot \text{K})$
$b$	width	m
$d$	distance / thickness	m
$l$	length	m
$q$	density of heat flow rate	$\text{W}/\text{m}^2$
$\Psi$	linear thermal transmittance	$\text{W}/(\text{m} \cdot \text{K})$
$\lambda$	thermal conductivity	$\text{W}/(\text{m} \cdot \text{K})$

#### 3.3 Subscripts

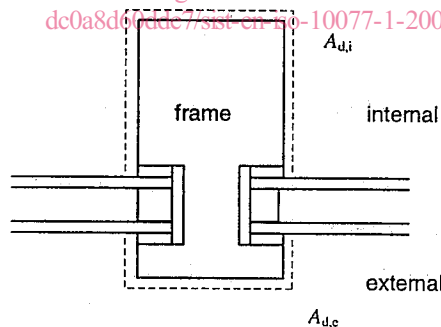


Figure 1 - Internal and external developed area

D	door		
W	window		
WS	window with closed shutter	-	
d	developed	$j$	summation index
e	external	p	panel (opaque)
f	frame	s	space (air or gas space)
g	glazing	se	external surface
i	internal	sh	shutter
sa	sash	si	internal surface



## 4 Geometrical characteristics

### 4.1 Glazed area, opaque panel area

The glazed area  $A_g$  or the opaque panel area  $A_p$  of a window or door is the smaller of the visible areas seen from both sides, see figure 2. Any overlapping of gaskets is ignored.

### 4.2 Total visible perimeter of the glazing

The total perimeter of the glazing  $l_g$  (or the opaque panel  $l_p$ ) is the sum of the visible perimeter of the glass panes (or opaque panels) in the window or door. If the perimeters are different on either side of the pane or panel then the larger of the two shall be used, see figure 2.

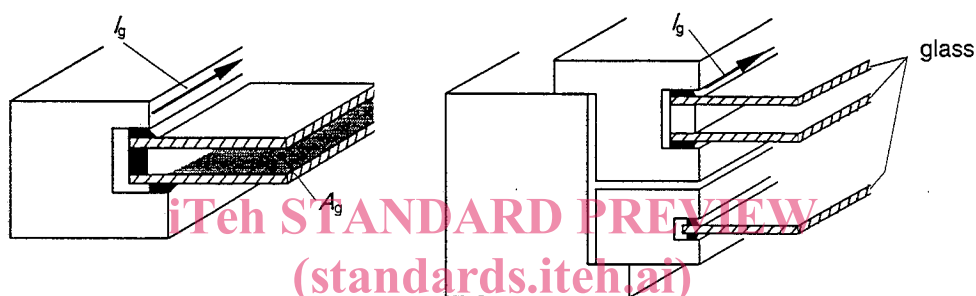


Figure 2 - Illustration of glazed area and perimeter

<https://standards.iteh.ai/catalog/standards/sist/3e4ea9a6-4327-4c5b-ac8c-dc0a8d60dde7/sist-en-iso-10077-1-2001>

### 4.3 Frame areas

For the definition of the areas see also figure 3.

$A_{f,i}$  Internal projected frame area

The internal projected frame area is the area of the projection of the internal frame on a plane parallel to the glazing panel.

$A_{f,e}$  External projected frame area

The external projected frame area is the area of the projection of the external frame on a plane parallel to the glazing panel.

$A_f$  Frame area

The frame area is the larger of the two projected areas seen from both sides.

$A_{d,i}$  Internal developed frame area


The internal developed frame area is the area of the frame in contact with the internal air (see figure 1).

$A_{d,e}$  External developed frame area

The external developed frame area is the area of the frame in contact with the external air (see figure 1).

#### 4.4 Window area

The window area  $A_w$  is the sum of the frame area  $A_f$  and the glazing area  $A_g$  (or the panel area  $A_p$ ).

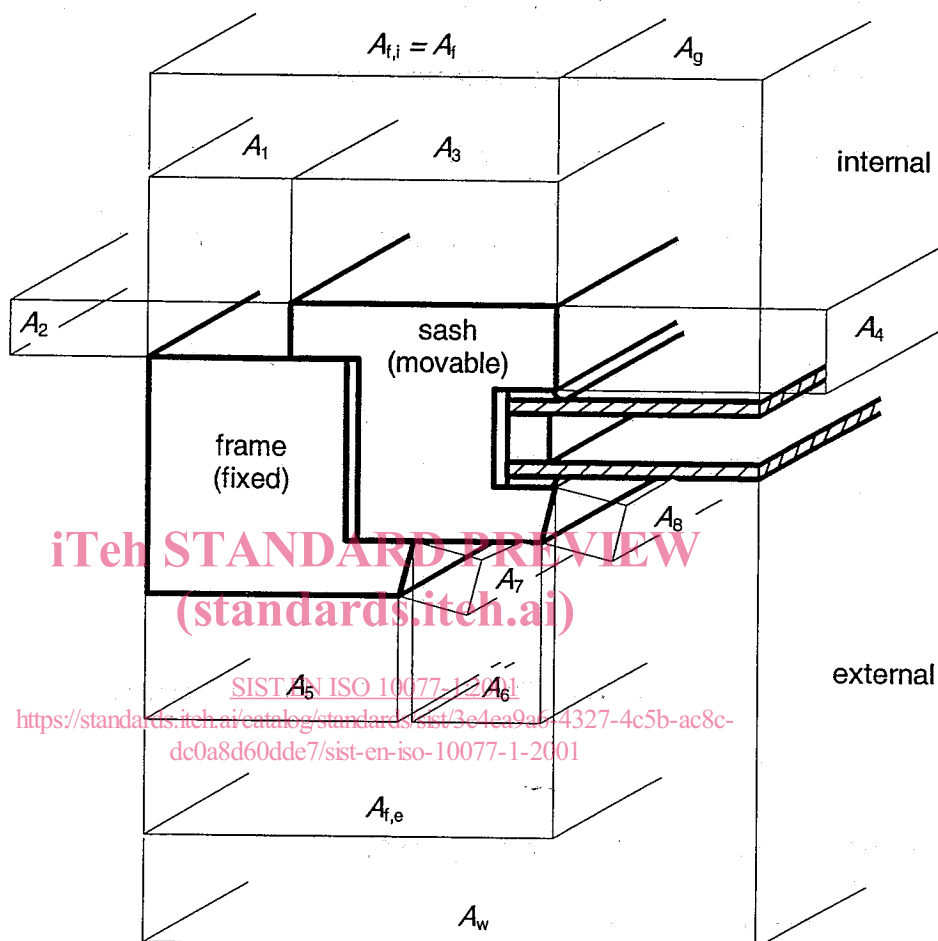

- NOTE  $A_f = \max(A_{f,i}; A_{f,e})$

$$A_w = A_f + A_g$$

$$A_{d,i} = A_1 + A_2 + A_3 + A_4$$

$$A_{d,e} = A_5 + A_6 + A_7 + A_8$$

Figure 3 - Illustration of the various areas

## 5 Calculation of thermal transmittance

### 5.1 Windows

#### 5.1.1 Single windows

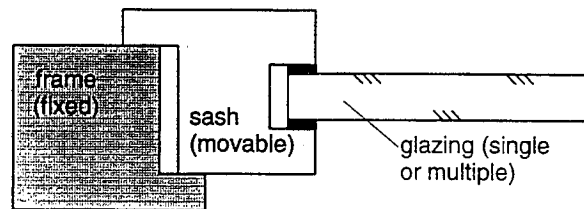


Figure 4 - Illustration of single window

The thermal transmittance of a single window  $U_w$  shall be calculated using equation (1):

$$U_w = \frac{A_g U_g + A_f U_f + l_g \Psi_g}{A_g + A_f} \quad (1)$$

where

$U_g$  is the thermal transmittance of the glazing;

$U_f$  is the thermal transmittance of the frame;

$\Psi_g$  is the linear thermal transmittance due to the combined thermal effects of glazing, spacer and frame;

and the other symbols are defined in clause 4.

<https://standards.iteh.ai/catalog/standards/sist/3e4ea9a6-4327-4c5b-ac8c-dc0a8d60ddc7/sist-en-iso-10077-1-2001>

In the case of single glazing the last term of the numerator in equation (1) shall be taken as zero (no spacer effect) because any correction is negligible.

When opaque panels are used instead of some of the glazing,  $U_w$  is calculated as follows:

$$U_w = \frac{A_g U_g + A_p U_p + A_f U_f + l_g \Psi_g + l_p \Psi_p}{A_g + A_p + A_f} \quad (2)$$

where

$U_p$  is the thermal transmittance of the opaque panel(s);

$\Psi_p$  is the linear thermal transmittance for the opaque panel(s).

If the opaque panel is thermally bridged at the edge by a less insulating spacer, the effect of the bridging shall be taken into account in the same way as for glazing; otherwise  $\Psi_p = 0$ .

NOTE Typical values of the linear thermal transmittance are given in annex E.  
prEN ISO 10077-2 gives a method for calculating linear thermal transmittance.  
prEN 12412-2 gives a method for measuring the linear thermal transmittance.

### 5.1.2 Double windows

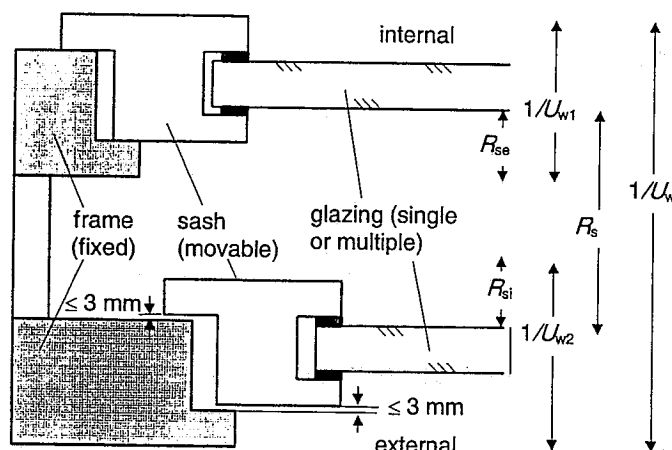


Figure 5 - Illustration of double window

The thermal transmittance  $U_w$  of a system consisting of two separate windows shall be calculated by the following equation:

$$U_w = \frac{1}{1/U_{w1} - R_{si} + R_s - R_{se} + 1/U_{w2}} \quad (3)$$

(standards.iteh.ai)  
SIST EN ISO 10077-1:2001  
<https://standards.iteh.ai/catalog/standards/sist/3e4ea9a6-4327-4c5b-ac8c-dc0a8d60dde7/sist-en-iso-10077-1-2001>

where

- $U_{w1}$ ,  $U_{w2}$  are the thermal transmittances of the external and internal window; respectively, calculated according to equation (1);
- $R_{si}$  is the internal surface resistance of the external window when used alone;
- $R_{se}$  is the external surface resistance of the internal window when used alone;
- $R_s$  is the thermal resistance of the space between the glazing in the two windows.

Typical values of  $R_{si}$  and  $R_{se}$  are given in normative annex A and of  $R_s$  in the informative annex C.

NOTE If the gap exceeds 3 mm and measures have not been taken to prevent excessive air exchange with external air, the method does not apply.