
Toplotne lastnosti oken in vrat - Ugotavljanje toplotne prehodnosti z metodo komorne naprave - 1. del: Celotna okna in vrata (ISO 12567-1:2000)

Thermal performance of windows and doors - Determination of thermal transmittance by hot box method - Part 1: Complete windows and doors (ISO 12567-1:2000)

Wärmetechnisches Verhalten von Fenstern und Türen -Bestimmung des Wärmedurchgangskoeffizienten mittels des Heizkastenverfahrens Teil 1: Komplette Fenster und Türen (ISO 12567-1:2000)

Isolation thermique des fenetres et portes - Détermination de la transmission thermique par la méthode a la boîte chaude -Partie 1: Fenetres et portes completes (ISO 12567-1:2000)

Ta slovenski standard je istoveten z: EN ISO 12567-1:2000

ICS:

91.060.50	Vrata in okna	Doors and windows
91.120.10	Toplotna izolacija stavb	Thermal insulation

SIST EN ISO 12567-1:2001 en

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN ISO 12567-1:2001](https://standards.iteh.ai/catalog/standards/sist/729faf98-b144-4344-ab4d-423e664a467f/sist-en-iso-12567-1-2001)

<https://standards.iteh.ai/catalog/standards/sist/729faf98-b144-4344-ab4d-423e664a467f/sist-en-iso-12567-1-2001>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN ISO 12567-1

September 2000

ICS

English version

Thermal performance of windows and doors - Determination of
thermal transmittance by hot box method - Part 1: Complete
windows and doors (ISO 12567-1:2000)

Isolation thermique des fenêtres et portes - Détermination
de la transmission thermique par la méthode à la boîte
chaude - Partie 1: Fenêtres et portes complètes (ISO
12567-1:2000)

This European Standard was approved by CEN on 1 September 2000.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

423e664a467f/sist-en-iso-12567-1-2001



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Page 2
EN ISO 12567-1:2000

Foreword

The text of the International Standard ISO 12567-1:2000 has been prepared by Technical Committee ISO/TC 163 "Thermal insulation" in collaboration with Technical Committee CEN/TC 89 "Thermal performance of buildings and building components", the secretariat of which is held by SIS.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by March 2001, and conflicting national standards shall be withdrawn at the latest by December 2001.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

NOTE FROM CEN/CS: The foreword is susceptible to be amended on reception of the German language version. The confirmed or amended foreword, and when appropriate, the normative annex ZA for the references to international publications with their relevant European publications will be circulated with the German version.

Endorsement notice

The text of the International Standard ISO 12567-1:2000 was approved by CEN as a European Standard without any modification.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN ISO 12567-1:2001
<https://standards.iteh.ai/catalog/standards/sist/729faf98-b144-4344-ab4d-423e664a467f/sist-en-iso-12567-1-2001>

INTERNATIONAL
STANDARD

ISO
12567-1

First edition
2000-09-01

**Thermal performance of windows and
doors — Determination of thermal
transmittance by hot box method —**

Part 1:
Complete windows and doors

iTeh STANDARD PREVIEW

*Isolation thermique des fenêtres et portes — Détermination de la
transmission thermique par la méthode à la boîte chaude —*

Partie 1 : Fenêtres et portes complètes

[SIST EN ISO 12567-1:2001](https://standards.iteh.ai/catalog/standards/sist/729fa98-b144-4344-ab4d-423e664a467f/sist-en-iso-12567-1-2001)

<https://standards.iteh.ai/catalog/standards/sist/729fa98-b144-4344-ab4d-423e664a467f/sist-en-iso-12567-1-2001>



Reference number
ISO 12567-1:2000(E)

© ISO 2000

ISO 12567-1:2000(E)**PDF disclaimer**

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST EN ISO 12567-1:2001](https://standards.iteh.ai/catalog/standards/sist/729fa98-b144-4344-ab4d-423e664a467f/sist-en-iso-12567-1-2001)

<https://standards.iteh.ai/catalog/standards/sist/729fa98-b144-4344-ab4d-423e664a467f/sist-en-iso-12567-1-2001>

© ISO 2000

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.ch
Web www.iso.ch

Printed in Switzerland

Contents

	Page
Foreword.....	iv
Introduction	v
1 Scope	1
2 Normative references	1
3 Terms, definitions and symbols.....	2
4 Principle.....	3
5 Requirements for test specimens and apparatus	7
6 Test procedure	11
7 Test report	15
Annex A (normative) Environmental temperatures	17
Annex B (normative) Linear thermal transmittance of the edge zone.....	21
Annex C (informative) Design of calibration transfer standard (CTS).....	24
Annex D (informative) Example of calibration test and measurement of window specimen.....	28
Annex E (informative) Analytical calibration procedure using heat balance equations.....	39
Bibliography	41

[SIST EN ISO 12567-1:2001](https://standards.iteh.ai/catalog/standards/sist/729fa98-b144-4344-ab4d-423e664a467f/sist-en-iso-12567-1-2001)

<https://standards.iteh.ai/catalog/standards/sist/729fa98-b144-4344-ab4d-423e664a467f/sist-en-iso-12567-1-2001>

ISO 12567-1:2000(E)

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 3.

Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this International Standard may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

International Standard ISO 12567-1 was prepared by Technical Committee ISO/TC 163, *Thermal insulation*, Subcommittee SC 1, *Test and measurement methods*.

ISO 12567 consists of the following parts, under the general title *Thermal performance of windows and doors — Determination of thermal transmittance by hot box method*:

— Part 1: *Complete windows and doors*

— Part 2: *Roof windows and other projecting windows*

Annexes A and B are a normative part of this International Standard. Annexes C, D and E are for information only.

Introduction

The method specified in this part of ISO 12567 is based on ISO 8990. It is designed to provide both standardized tests, which enable a fair comparison of different products to be made, and specific tests on products for practical application purposes. The former specifies standardized specimen sizes and applied test criteria.

The determination of the aggregate thermal transmittance is performed for conditions which are similar to the actual situation of the window and door in practice.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST EN ISO 12567-1:2001](https://standards.iteh.ai/catalog/standards/sist/729fa98-b144-4344-ab4d-423e664a467f/sist-en-iso-12567-1-2001)

<https://standards.iteh.ai/catalog/standards/sist/729fa98-b144-4344-ab4d-423e664a467f/sist-en-iso-12567-1-2001>

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN ISO 12567-1:2001](#)

<https://standards.iteh.ai/catalog/standards/sist/729faf98-b144-4344-ab4d-423e664a467f/sist-en-iso-12567-1-2001>

Thermal performance of windows and doors — Determination of thermal transmittance by hot box method —

Part 1: Complete windows and doors

1 Scope

This part of ISO 12567 specifies a method to measure the thermal transmittance of a door or window system. This includes all effects of frames, sashes, shutters, door leaves and fittings.

It does not include:

- edge effects occurring outside the perimeter of the specimen;
- energy transfer due to solar radiation on the specimen;
- effects of air leakage through the specimen;
- roof windows and projecting products, where the glass layer projects beyond the cold side roof surface.

NOTE For roof windows and projecting units, the procedure given in ISO 12567-2 (under preparation, see Bibliography [4]) should be used.

Annex A gives methods for the calculation of environmental temperatures.

2 Normative references

The following normative documents contain provisions which, through reference in this text, constitute provisions of this part of ISO 12567. For dated references, subsequent amendments to, or revisions of, any of these publications do not apply. However, parties to agreements based on this part of ISO 12567 are encouraged to investigate the possibility of applying the most recent editions of the normative documents indicated below. For undated references, the latest edition of the normative document referred to applies. Members of ISO and IEC maintain registers of currently valid International Standards.

ISO 7345, *Thermal insulation — Physical quantities and definitions.*

ISO 8301, *Thermal insulation — Determination of steady-state thermal resistance and related properties — Heat flow meter apparatus.*

ISO 8302, *Thermal insulation — Determination of steady-state thermal resistance and related properties — Guarded hot plate apparatus.*

ISO 8990:1994, *Thermal insulation — Determination of steady-state thermal transmission properties — Calibrated and guarded hot box.*

ISO 9288, *Thermal insulation — Heat transfer by radiation — Physical quantities and definitions.*

ISO 12567-1:2000(E)

IEC 60584-1, *Thermocouples — Part 1: Reference tables.*

EN 12898, *Glass in building — Determination of the emissivity.*

3 Terms, definitions and symbols

3.1 Terms and definitions

For the purposes of this part of ISO 12567 the terms and definitions given in ISO 7345, ISO 8990 and ISO 9288 apply.

3.2 Symbols

For the purposes of this part of ISO 12567 the quantities given in ISO 7345 and ISO 9288 apply, together with those given in Tables 1 and 2.

Table 1 — Symbols and units

Symbol	Physical quantity	Unit
A	area	m^2
d	thickness (depth)	m
F	fraction	—
f	view factor	—
h	surface coefficient of heat transfer	$W/(m^2 \cdot K)$
H	height	m
L	perimeter length	m
q	density of heat flow rate	W/m^2
R	thermal resistance	$m^2 \cdot K/W$
T	thermodynamic temperature	K
U	thermal transmittance	$W/(m^2 \cdot K)$
w	width	m
α	radiant factor	—
$\Delta T, \Delta \theta$	temperature difference	K
ε	total hemispherical emissivity	—
θ	Celsius temperature	$^{\circ}C$
λ	thermal conductivity	$W/(m \cdot K)$
σ	Stefan-Boltzmann constant	$W/(m^2 \cdot K^4)$
Φ	heat flow rate	W
Ψ	linear thermal transmittance	$W/(m \cdot K)$

Table 2 — Subscripts

Subscript	Significance
b	baffle
c	convection (air)
cal	calibration
e	external, usually cold side
i	internal, usually warm side
in	input
m	measured
me	mean
n	environmental (ambient)
ne	environmental (ambient) external
ni	environmental (ambient) internal
p	reveal of surround panel
r	radiation (mean)
s	surface
sp	specimen
st	standardized
sur	surround panel
t	total

STANDARD PREVIEW
(standards.iteh.ai)

4 Principle

SIST EN ISO 12567-1:2001

The thermal transmittance, U , of the specimen is measured by means of the calibrated or guarded hot box method in accordance with ISO 8990.

The determination of the thermal transmittance involves two stages. First, measurements are made on two or more calibration panels with accurately known thermal properties, from which the surface coefficient of the heat transfer (radiative and convective components) on both sides of the calibration panel and the thermal resistance of the surround panel are determined. Secondly, measurements are made with the window or door specimens in the aperture and the hot box apparatus is used with the same fan settings on the cold side as during the calibration procedure.

The surround panel is used to keep the specimen in a given position. It is constructed with outer dimensions of appropriate size for the apparatus, having an aperture to accommodate the specimen (see Figures 1 and 2).


The principal heat flows through the surround panel and the calibration panel (or test specimen) are shown in Figure 3. The boundary edge heat flow due to the location of the calibration panel in the surround panel is determined separately by a linear thermal transmittance, Ψ .

The procedure in this part of ISO 12567 includes a correction for the boundary edge heat flow, so that standardized and reproducible thermal transmittance properties are obtained.

The magnitude of the boundary edge heat flow as a function of geometry, calibration panel thickness and thermal conductivity is determined by tabulated values given in annex B.

Measurement results are corrected to standardized surface heat transfer coefficients by an interpolation or analytical iteration procedure, derived from the calibration measurements.

Measures are taken (e.g. pressure equalization between the warm and cold side or sealing of the joints on the inside) to ensure that the air permeability of the test specimen does not influence the measurements.

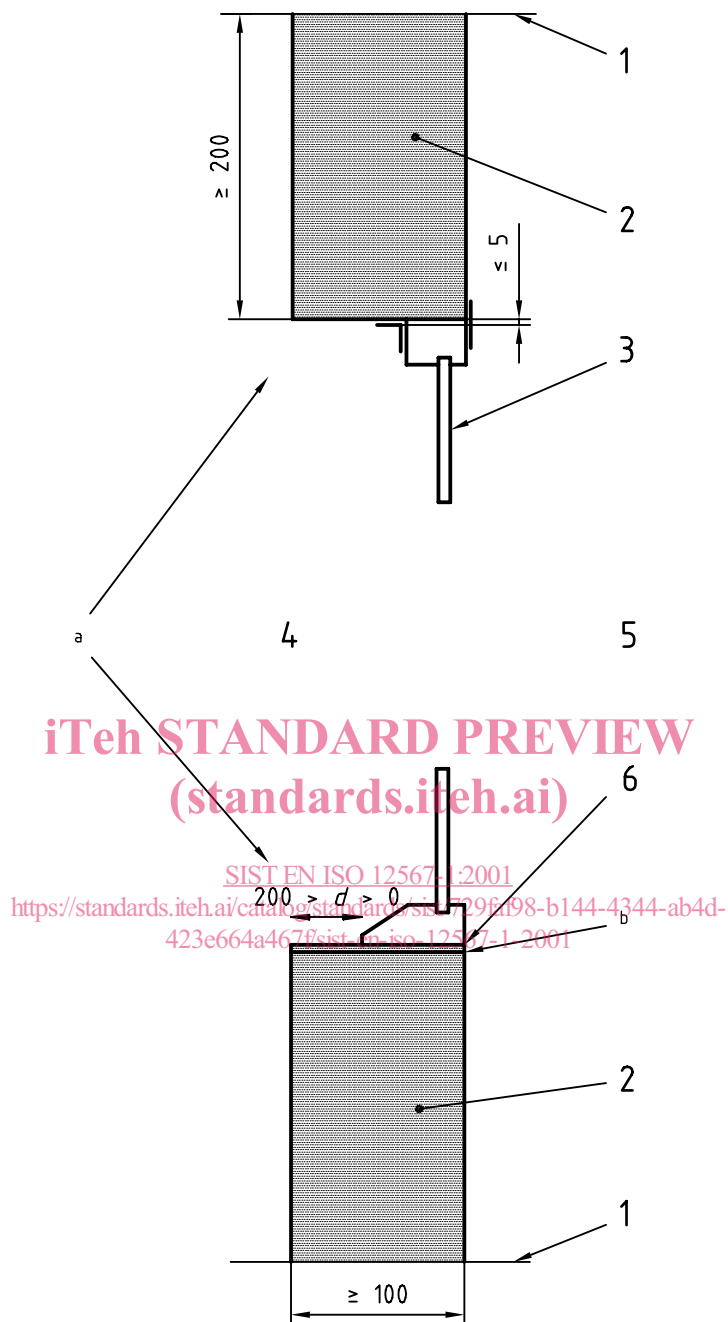


The total gap width between the top and bottom of the specimen and the surround panel aperture shall not exceed 5 mm. It shall be sealed with non-metallic tape or mastic material. The total gap width on both sides between the specimen and the surround panel aperture shall not exceed 5 mm.

Key

- | | | | |
|---|--|---|--|
| 1 | Border of metering area | a | Recommended to be centrally located. |
| 2 | Surround panel, $\lambda \leq 0,04 \text{ W/(m}\cdot\text{K)}$ | b | Use fill material with same thermal properties as surround panel core. |
| 3 | Glazing | | |
| 4 | Cold side | | |
| 5 | Warm side | | |
| 6 | Flush sill | | |

Figure 1 — Window system in surround panel

Dimensions in millimetres

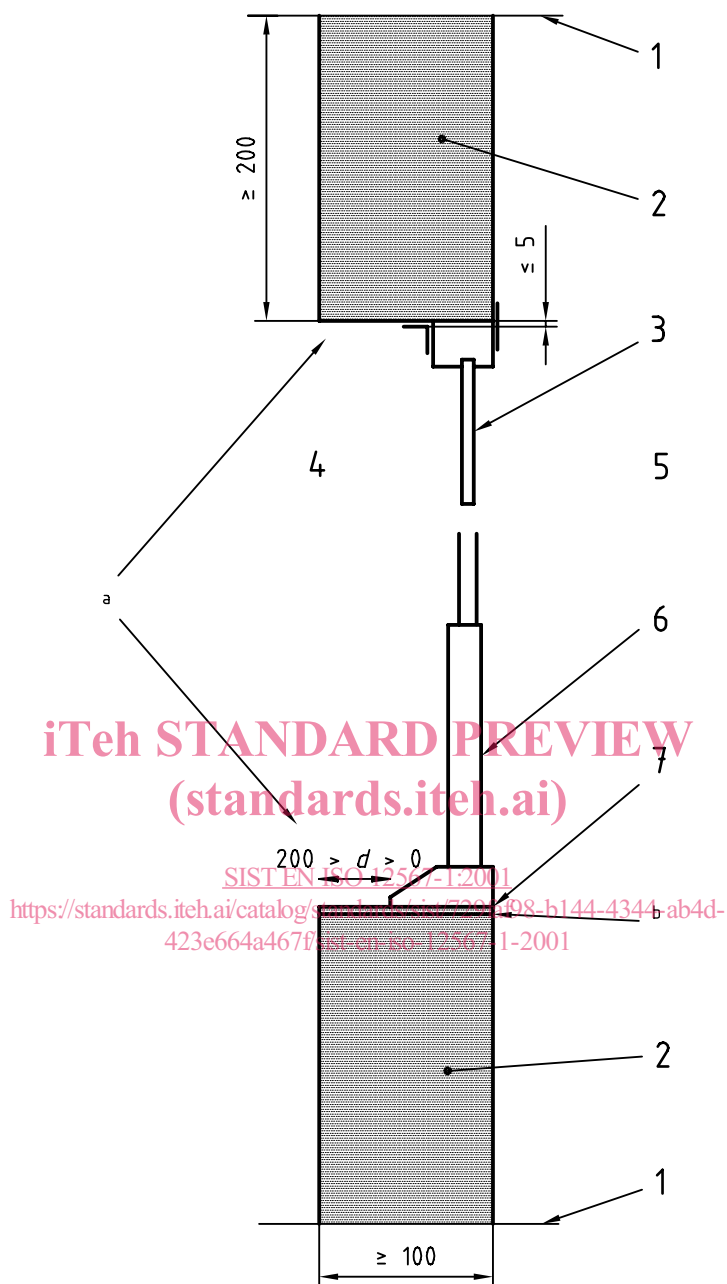

The total gap width between the top and bottom of the specimen and the surround panel aperture shall not exceed 5 mm. It shall be sealed with non-metallic tape or mastic material. The total gap width on both sides between the specimen and the surround panel aperture shall not exceed 5 mm.

Key

- | | | | |
|---|---|---|--|
| 1 | Border of metering area | a | Recommended to be centrally located. |
| 2 | Surround panel, $\lambda \leq 0,04 \text{ W}/(\text{m}\cdot\text{K})$ | b | Use fill material with same thermal properties as surround panel core. |
| 3 | Infill (glass, panel) | | |
| 4 | Cold side | | |
| 5 | Warm side | | |
| 6 | Door leaf | | |
| 7 | Flush frame/threshold | | |

Figure 2 — Door system in surround panel