

INTERNATIONAL ELECTROTECHNICAL COMMISSION
COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

IEC 62271-202
Edition 2.0 2014-03

IEC 62271-202
Édition 2.0 2014-03

High-voltage switchgear and controlgear –
Part 202: High-voltage/low-voltage prefabricated
substation

Appareillage à haute tension –
Partie 202: Postes préfabriqués haute
tension/basse tension

CORRIGENDUM 1

Corrections to the French version appear after the English text.

Les corrections à la version française sont données après le texte anglais.


(<https://standards.iteh.ai>)

Figure AA.6 – Selection of tests on high voltage interconnections for class IAC-A

Replace the existing figure by the following new figure:

<https://standards.iteh.ai/catalog/standards/iec/5bc2c470-ac93-4bc1-8e84-e7f3c7fddedb/iec-62271-202-2014-cor1-2015>

<https://standards.iteh.ai/catalog/standards/iec/5bc2c470-ac93-4bc1-8e84-e7f3c7fddedb/iec-62271-202-2014-cor1-2015>

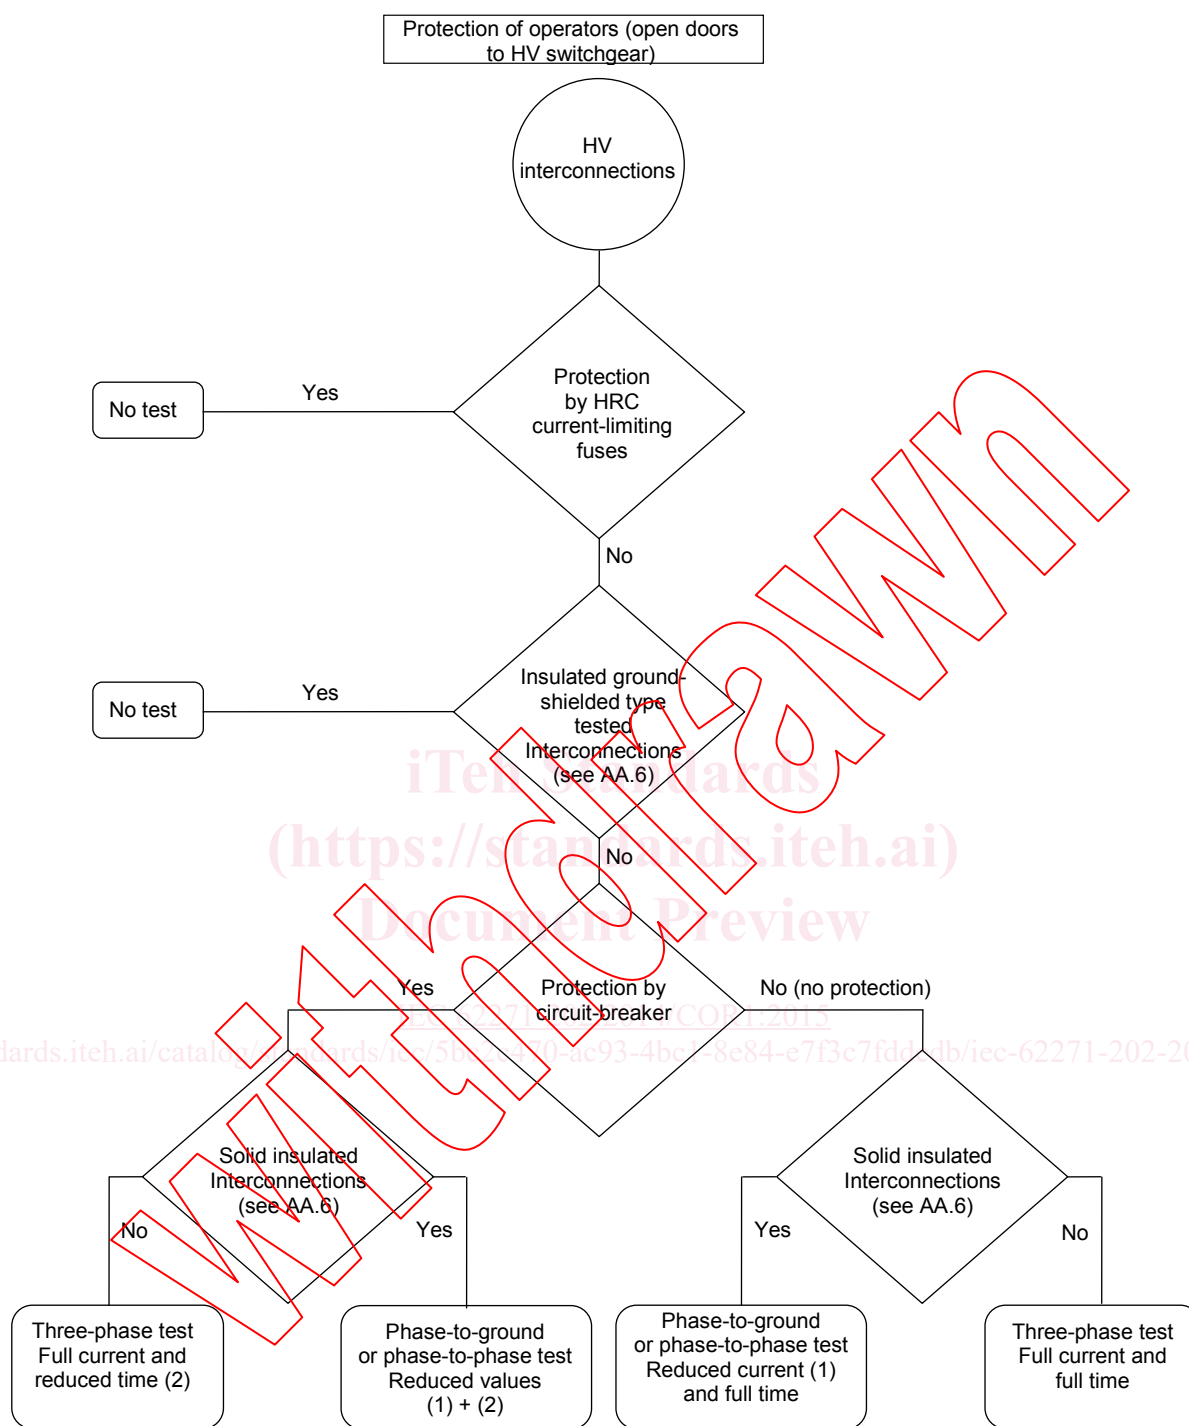

(1) IEC 62271-200:2011.

* For phase to ground test the current value to be stated by the manufacturer.

* For phase to phase test the current will be 87 % of the rated short-time withstand current.

(2) The time may be stated by the manufacturers, taking into account the time-setting of the protection.

Figure AA.6 – Selection of tests on high voltage interconnections for class IAC-A

Figure AA.7 – Selection of tests on high voltage interconnections for class IAC-B


Replace the existing figure by the following new figure:



iTech Standards
(<https://standards.iteh.ai>)
Document Preview

[IEC 62271-202:2014/COR1:2015](https://standards.iteh.ai/catalo/standards/iec/5bc2c470-ac93-4bc1-8e84-e7f3c7fddedb/iec-62271-202-2014-cor1-2015)

<https://standards.iteh.ai/catalo/standards/iec/5bc2c470-ac93-4bc1-8e84-e7f3c7fddedb/iec-62271-202-2014-cor1-2015>

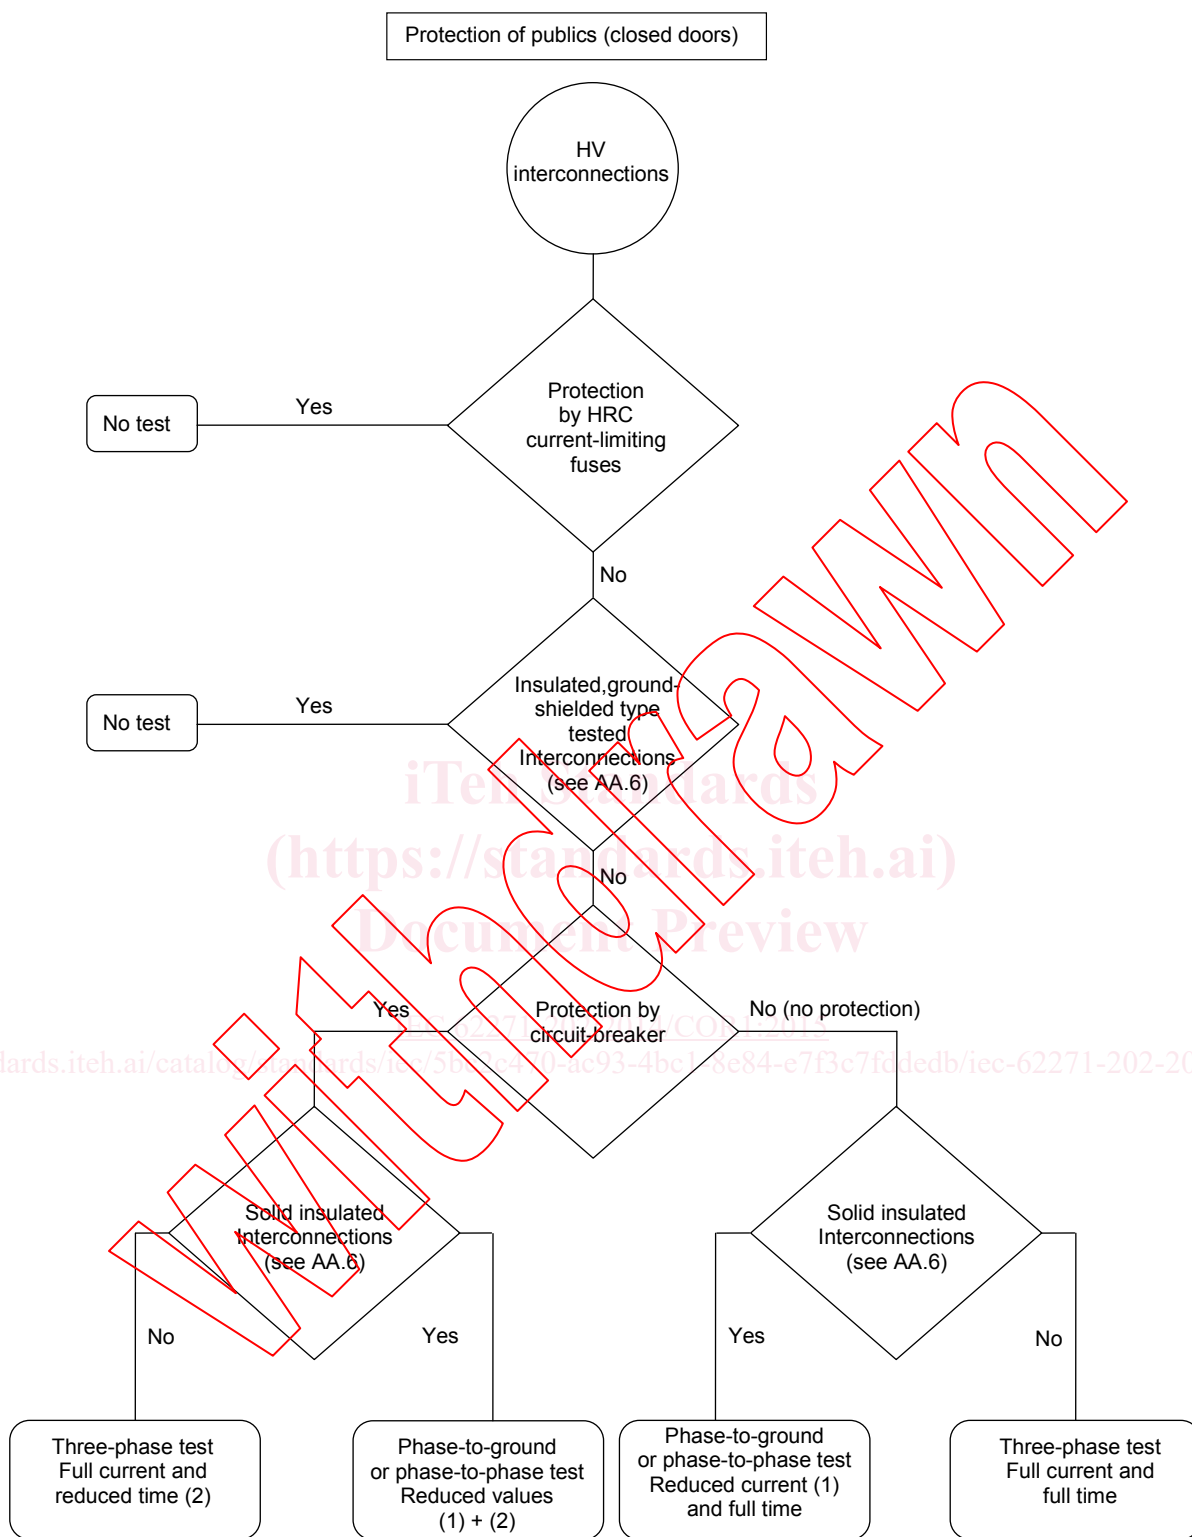

IECIE

(1) Applicability of phase to ground or phase to phase test according to the criteria in AA.5.2.1 of IEC 62271-200:2011.

* For phase to ground test the current value to be stated by the manufacturer.

* For phase to phase test the current will be 87 % of the rated short-time withstand current.

(2) The time may be stated by the manufacturers, taking into account the time-setting of the protection.

Figure AA.7 – Selection of tests on high voltage interconnections for class IAC-B