



Designation: C 1090 – 01

## Standard Test Method for Measuring Changes in Height of Cylindrical Specimens of Hydraulic-Cement Grout<sup>1</sup>

This standard is issued under the fixed designation C 1090; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

### 1. Scope

1.1 This test method covers measurement of the changes in height of hydraulic-cement grout by the use of 75 by 150-mm (3 by 6-in.) cylinders, when the cylinders are protected so that the tendency to change in height does not include evaporation so as to cause drying, uptake of moisture, carbonation, or exposure to temperatures outside the range  $23 \pm 2.0^\circ\text{C}$  ( $73 \pm 3^\circ\text{F}$ ) or, optionally, to another specified temperature controlled within  $\pm 2.0^\circ\text{C}$  ( $\pm 3^\circ\text{F}$ ).

1.2 If desired, this test method can be adapted to studies of changes in height involving either schedules or environmental treatment different from the standard procedures prescribed by this test method.

1.3 The values stated in SI units are to be regarded as the standard.

1.4 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

### 2. Referenced Documents

#### 2.1 ASTM Standards:

- C 125 Terminology Relating to Concrete and Concrete Aggregates<sup>2</sup>
- C 172 Practice for Sampling Freshly Mixed Concrete<sup>2</sup>
- C 305 Practice for Mechanical Mixing of Hydraulic Cement Pastes and Mortars of Plastic Consistency<sup>3</sup>
- C 511 Specification for Moist Cabinets, Moist Rooms, and Water Storage Tanks Used in the Testing of Hydraulic Cements and Concretes<sup>2,3</sup>
- C 670 Practice for Preparing Precision and Bias Statements

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee C09 on Concrete and Concrete Aggregates and is the direct responsibility of Subcommittee C09.68 on Volume Change of Concrete.

Current edition approved June 10, 2001. Published September 2001. Originally published as C 1090 – 88. Last previous edition C 1090 – 96.

<sup>2</sup> *Annual Book of ASTM Standards*, Vol 04.02.

<sup>3</sup> *Annual Book of ASTM Standards*, Vol 04.01.

- for Test Methods for Construction Materials<sup>2</sup>
- C 827 Test Method for Change in Height at Early Ages of Cylindrical Specimens from Cementitious Mixtures<sup>2</sup>
- C 939 Test Method for Flow of Grout for Preplaced-Aggregate Concrete (Flow Cone Method)<sup>2</sup>
- C 1107 Specification for Packaged Dry, Hydraulic-Cement Grout (Nonshrink)<sup>2</sup>

### 3. Terminology

#### 3.1 Definition of Term Specific to This Standard:

3.1.1 *change in height*—either an increase or decrease in the vertical dimension of a test specimen, provided the change has been caused by factors other than externally applied forces, changes in ambient temperature not conforming to the specified range, drying caused by evaporation, carbonation, or uptake of moisture.

### 4. Significance and Use

4.1 This test method is intended to provide a means of assessing the ability of a hydraulic-cement grout to retain a stable volume during the stipulated testing period of 28 days, provided that the tendency to change height does not include the effects of drying caused by evaporation, uptake of moisture, carbonation, or exposure to temperatures outside the range  $23.0 \pm 2.0^\circ\text{C}$  ( $73 \pm 3^\circ\text{F}$ ) (Note 1). An exception is made when the options described in the section on test conditions are exercised.

NOTE 1—This test method does not measure the change in height before hardening (see Test Method C 827).

### 5. Apparatus

5.1 *Cylinder Molds*<sup>4</sup> steel cylindrical molds with minimum wall thickness of 6 mm ( $\frac{1}{4}$  in.) fitted with clamp assemblies for closing, 75 mm (3 in.)  $\pm 1\%$  in inside diameter by 150 mm (6 in.)  $\pm 2\%$  in height (Note 2)), fitted with a removable 6-mm

<sup>4</sup> Humboldt Mfg. Co., 7302 Agatite Ave., Chicago, IL 60656, Catalog Numbers H-2902 Depth Micrometer, H-2904 Tapered Cylinder Mold, H-2931.2 Glass Plate, H-2931.3 Weight, and H-2903 Set (including all the preceding items) have been found satisfactory.

(1/4-in.) steel base plate that can be clamped in place with the cylinder molds, top edge machined to a narrow rim as shown in Fig. 1.

NOTE 2—Satisfactory molds can be made from lengths of steel tubing or pipe that is slit on one side parallel to the longitudinal axis and fitted with a means of closing the vertical slit as well as a means of attaching a base plate.

5.2 *Glass Plate*<sup>4</sup> approximately 100 mm (4 in.) square by 6 mm (1/4 in.) thick, coated as thinly as possible on one surface with a silicone-base spray<sup>5</sup> or other inert material such as mineral oil, and permitted to dry before use.

5.3 *Hold-Down Weight*<sup>4</sup> having a mass of 1.5 kg (3 lb.) ± 1 %.

5.4 *Micrometer Bridge*<sup>4</sup> designed to support and hold one cylinder in a level, firm position (Fig. 2), with steel rods, and a top made of noncorroding metal, not more than 1 mm (3/64 in.) larger than the diameter of the measuring shaft of the micrometer depth gage, and numbered 1 to 4 (Note 3).


NOTE 3—The four holes should be 30 ± 2 mm (1 1/4 ± 1/16 in.) from the center of the hold-down device.

5.5 *Micrometer Depth Gage*<sup>4</sup> having a range from 25 to 50 mm. (1.000 to 2.000 in) graduated in units not larger than 0.02 mm (0.001 in.) (Note 4).

NOTE 4—The diameter of the shaft of the depth micrometer should be 3.0 ± 0.4 mm (1/8 ± 1/64 in.).

5.6 *Outside Micrometer Caliper*, used to measure the thickness of the plate, with a capacity of at least 12 mm (1/2 in.) and graduated in units not larger than 0.02 mm (0.001 in.) having throat depth of at least 50 mm (2.0 in.).

5.7 *Tamping Rod*, a straight steel rod with at least the tamping end rounded to a hemispherical tip of the same diameter as the rod, 10 mm (3/8 in.) in diameter and at last 250 mm (10 in.) long.

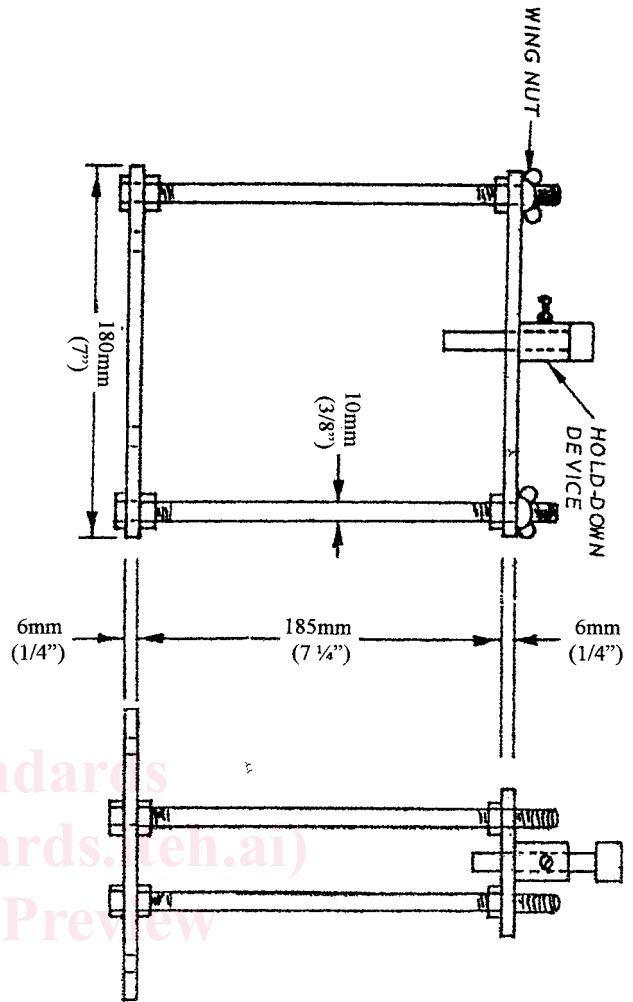

NOTE 1—All parts of this bridge shall be made of a noncorroding metal.  
 NOTE 2—The diameter of the measuring shaft of the depth micrometer shall be 3.0 ± 0.4 mm (1/8 ± 1/64 in.). The four holes should be 25 ± 1 mm (1 ± 1/16 in.) from the center of the cylinder as shown in Fig. 1.

FIG. 2 Dimensions of Micrometer Bridge

<sup>5</sup> Borden Chemical Co., No. 1325 Silicone Spray in aerosol cans has been found satisfactory.

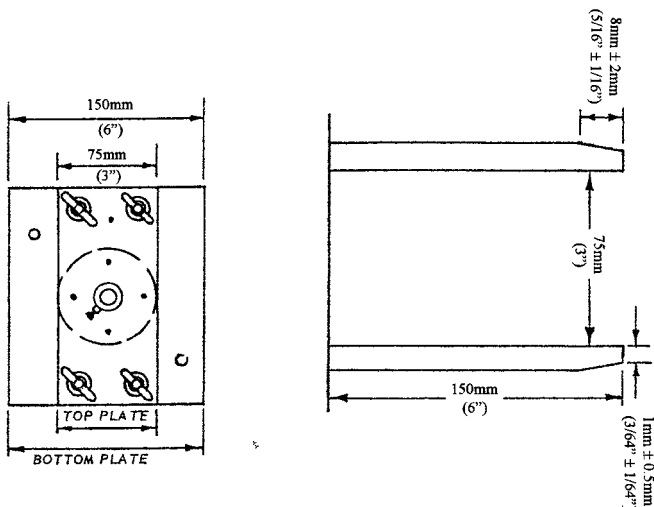


FIG. 1 Cylinder Mold with Machined (Tapered) Top Edge

5.8 *Mechanical Mixer*, as described in Practice C 305 (Note 5).

NOTE 5—This mixer has clearances between paddle and bowl that are suitable only for mortars made with fine aggregates that are finer than the 850-µm (No. 20) sieve. Mortars made with aggregates containing particles coarser than the 850-µm sieve may require special clearance or a different type of paddle to permit the mixer to operate freely and avoid damage to the paddle and bowl.

6. Preparation of Sample

6.1 Take a sample of the freshly mixed grout to be tested either in accordance with Practice C 172 or prepared in sufficient quantity to permit molding at least one test specimen for height-change measurements and such additional tests as may be required or specified.

6.2 If the grout to be tested is blended from individual components, mix in accordance with Practice C 305 (Note 6). If the grout is made using a packaged product, proceed as follows, unless otherwise recommended by the manufacturer.