

# INTERNATIONAL STANDARD

# NORME INTERNATIONALE

**Tests for electric cables under fire conditions – circuit integrity –  
Part 2: Test method for fire with shock at a temperature of at least 830 °C for  
cables of rated voltage up to and including 0,6/1,0 kV and with an overall  
diameter not exceeding 20 mm**

[IEC 60331-2:2018](#)

<https://standards.iteh.ai/catalog/standards/sist/2740c2d9-7e8d-43ba-aac0->

**Essais pour câbles électriques soumis au feu – intégrité des circuits –  
Partie 2: Méthode d'essai au feu avec chocs pour les câbles de tension assignée  
au plus égale à 0,6/1,0 kV et de diamètre externe inférieur ou égal à 20 mm, à une  
température d'au moins 830 °C**



## THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2018 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Central Office  
3, rue de Varembe  
CH-1211 Geneva 20  
Switzerland

Tel.: +41 22 919 02 11  
[info@iec.ch](mailto:info@iec.ch)  
[www.iec.ch](http://www.iec.ch)

### About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

### About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

#### IEC Catalogue - [webstore.iec.ch/catalogue](http://webstore.iec.ch/catalogue)

The stand-alone application for consulting the entire bibliographical information on IEC International Standards, Technical Specifications, Technical Reports and other documents. Available for PC, Mac OS, Android Tablets and iPad.

#### IEC publications search - [webstore.iec.ch/advsearchform](http://webstore.iec.ch/advsearchform)

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

#### IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and also once a month by email.

#### Electropedia - [www.electropedia.org](http://www.electropedia.org)

The world's leading online dictionary of electronic and electrical terms containing 21 000 terms and definitions in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

#### IEC Glossary - [std.iec.ch/glossary](http://std.iec.ch/glossary)

67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

#### IEC Customer Service Centre - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: [sales@iec.ch](mailto:sales@iec.ch).

### A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

### A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

#### Catalogue IEC - [webstore.iec.ch/catalogue](http://webstore.iec.ch/catalogue)

Application autonome pour consulter tous les renseignements bibliographiques sur les Normes internationales, Spécifications techniques, Rapports techniques et autres documents de l'IEC. Disponible pour PC, Mac OS, tablettes Android et iPad.

#### Recherche de publications IEC - [webstore.iec.ch/advsearchform](http://webstore.iec.ch/advsearchform)

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études,...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

#### IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et aussi une fois par mois par email.

#### Electropedia - [www.electropedia.org](http://www.electropedia.org)

Le premier dictionnaire en ligne de termes électroniques et électriques. Il contient 21 000 termes et définitions en anglais et en français, ainsi que les termes équivalents dans 16 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

#### Glossaire IEC - [std.iec.ch/glossary](http://std.iec.ch/glossary)

67 000 entrées terminologiques électrotechniques, en anglais et en français, extraites des articles Termes et Définitions des publications IEC parues depuis 2002. Plus certaines entrées antérieures extraites des publications des CE 37, 77, 86 et CISPR de l'IEC.

#### Service Clients - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: [sales@iec.ch](mailto:sales@iec.ch).

# INTERNATIONAL STANDARD

## NORME INTERNATIONALE

**Tests for electric cables under fire conditions – circuit integrity –  
Part 2: Test method for fire with shock at a temperature of at least 830 °C for  
cables of rated voltage up to and including 0,6/1,0 kV and with an overall  
diameter not exceeding 20 mm**

IEC 60331-2:2018

<https://standards.iteh.ai/catalog/standards/sist/2740c2d9-7e8d-43ba-aac0-38576071-2018-2018>

**Essais pour câbles électriques soumis au feu – intégrité des circuits –  
Partie 2: Méthode d'essai au feu avec chocs pour les câbles de tension assignée  
au plus égale à 0,6/1,0 kV et de diamètre externe inférieur ou égal à 20 mm, à  
une température d'au moins 830 °C**

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

COMMISSION  
ELECTROTECHNIQUE  
INTERNATIONALE

ICS 29.060.20

ISBN 978-2-8322-6151-4

**Warning! Make sure that you obtained this publication from an authorized distributor.  
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

## CONTENTS

CONTENTS .....	2
FOREWORD .....	4
INTRODUCTION .....	6
1 Scope .....	7
2 Normative references .....	7
3 Terms and definitions .....	8
4 Test environment .....	8
5 Test apparatus .....	8
5.1 Test equipment .....	8
5.2 Test wall and mounting .....	11
5.3 Source of heat .....	13
5.3.1 Burner .....	13
5.3.2 Flow meters and flow rates .....	14
5.3.3 Verification .....	15
5.4 Shock-producing device .....	15
5.5 Positioning of source of heat .....	16
5.6 Continuity checking arrangements for electric power and control cables with rated voltage up to and including 600 V/1 000 V .....	16
5.7 Fuses .....	16
6 Test specimen (electric power and control cables with rated voltage up to and including 600 V/1 000 V) .....	16
6.1 Test specimen preparation .....	16
6.2 Test specimen mounting .....	17
7 Test procedure (electric power and control cables with rated voltage up to and including 600 V/1 000 V) .....	17
7.1 Test equipment and arrangement .....	17
7.2 Electrical connections .....	17
7.3 Flame and shock application .....	19
7.4 Electrification .....	19
8 Performance requirements (electric power and control cables with rated voltage up to and including 600 V/1 000 V) .....	20
8.1 Flame application time .....	20
8.2 Acceptance criteria .....	20
9 Retest procedure .....	20
10 Test report (electric power and control cables with rated voltage up to and including 600 V/1 000 V) .....	20
11 Cable marking .....	20
Annex A (normative) Verification procedure for the source of heat .....	21
A.1 Measuring equipment .....	21
A.2 Procedure .....	21
A.3 Evaluation .....	21
A.4 Further verification .....	22
A.5 Verification report .....	22

Annex B (informative) Guidance on the choice of recommended test apparatus.....	23
B.1 Burner and venturi .....	23
B.2 Test wall material.....	23
Bibliography.....	24
Figure 1 – Schematic diagram of test configuration.....	9
Figure 2 – Plan view of fire test equipment .....	10
Figure 3 – End elevation of fire test equipment (not to scale).....	11
Figure 4 – Typical rubber bush (hardness: 50-60 shore A) for fastening wall.....	13
Figure 5 – Burner face .....	14
Figure 6 – Schematic diagram of an example of a burner control system .....	15
Figure 7 – Example of method of mounting a sample for test .....	17
Figure 8 – Basic circuit diagram – Electric power and control cables with rated voltage up to 600 V/1 000 V .....	19
Figure A.1 – Temperature measuring arrangement .....	21

## iTeh STANDARD PREVIEW (standards.iteh.ai)

[IEC 60331-2:2018](https://standards.iteh.ai/catalog/standards/sist/2740c2d9-7e8d-43ba-aac0-ef2ffe17fd2c/iec-60331-2-2018)

<https://standards.iteh.ai/catalog/standards/sist/2740c2d9-7e8d-43ba-aac0-ef2ffe17fd2c/iec-60331-2-2018>

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**TESTS FOR ELECTRIC CABLES UNDER FIRE CONDITIONS –  
CIRCUIT INTEGRITY –****Part 2: Test method for fire with shock at a temperature of at least 830 °C  
for cables of rated voltage up to and including 0,6/1,0 kV and with  
an overall diameter not exceeding 20 mm**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 60331-2 has been prepared by IEC technical committee 20: Electric cables.

This bilingual version (2018-11) corresponds to the monolingual English version, published in 2018-03.

This second edition cancels and replaces the first edition published in 2009. It constitutes a technical revision.

The significant technical changes with respect to the previous edition are as follows:

- extension of the scope with metallic data and telecom cables and optical fibre cables, although details for the specific point of failure, continuity checking arrangement, test sample, test procedure and test report relevant to metallic data and telecom cables and optical fibre cables are not given by IEC 60331-2;
- improved description of the test environment;
- mandatory use of mass flow meters/controllers as the means of controlling accurately the input flow rates of fuel and air to the burner;
- improved figure illustrating method of mounting of the sample regarding bending radius;
- improved description of the information to be included in the test report.

The text of this International Standard is based on the following documents:

FDIS	Report on voting
20/1783A/FDIS	20/1793/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

The French version of this document has not been voted upon.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

It has the status of a group safety publication in accordance with IEC Guide 104.

A list of all parts of the IEC 60331 series, published under the title: *Tests for electric cables under fire conditions – Circuit integrity*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC website under "http://webstore.iec.ch" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

## INTRODUCTION

IEC 60331 consists of the following parts under the general title: *Tests for Electric cables under fire conditions – Circuit integrity*:

Part 1: *Test method for fire with shock at a temperature of at least 830 °C for cables of rated voltage up to and including 0,6/1,0 kV and with an overall diameter exceeding 20 mm*

Part 2: *Test method for fire with shock at a temperature of at least 830 °C for cables of rated voltage up to and including 0,6/1,0 kV and with an overall diameter not exceeding 20 mm*

Part 3: *Test method for fire with shock at a temperature of at least 830 °C for cables of rated voltage up to and including 0,6/1,0 kV tested in a metal enclosure*

Part 11: *Apparatus – Fire alone at a flame temperature of at least 750 °C*

Part 21: *Procedures and requirements – Cables of rated voltage up to and including 0,6/1,0 kV*

Part 23: *Procedures and requirements – Electric data cables*

Part 25: *Procedures and requirements – Optical fibre cables*

NOTE 1 Parts 21, 23 and 25 relate to fire-only conditions at a flame temperature of at least 750 °C.

NOTE 2 Parts 11, 21, 23 and 25 are no longer subject to maintenance. IEC 60331 Parts 1 and 2 are the recommended test procedures

Since its first edition (1970), IEC 60331 has been extended and has introduced a range of test apparatus in order that a test may be carried out on large and small power, control, data and optical fibre cables.

Successful tests carried out in accordance with this standard will enable an identification to be marked on the product.



## TESTS FOR ELECTRIC CABLES UNDER FIRE CONDITIONS – CIRCUIT INTEGRITY –

### Part 2: Test method for fire with shock at a temperature of at least 830 °C for cables of rated voltage up to and including 0,6/1,0 kV and with an overall diameter not exceeding 20 mm

#### 1 Scope

This part of IEC 60331 specifies the test method for cables which are required to maintain circuit integrity when subject to fire and mechanical shock under specified conditions.

This document is applicable to cables of rated voltage not exceeding 600 V/1 000 V, including those of rated voltage below 80 V, metallic data and telecom cables and optical fibre cables.

It is intended for use when testing cables of not greater than 20 mm overall diameter.

Cables of larger diameter are intended to be tested using the apparatus, procedure and requirements of IEC 60331-1.

This document includes details for the specific point of failure, continuity checking arrangement, test sample, test procedure and test report relevant to electric power and control cables with rated voltage up to and including 600 V/1000 V. Details for the specific point of failure, continuity checking arrangement, test sample, test procedure and test report relevant to metallic data and telecom cables and optical fibre cables are not given by IEC 60331-2.

IEC 60331-2:2018

Although the scope is restricted to cables with rated voltage up to and including 0,6/1,0 kV, the procedure can be used, with the agreement of the manufacturer and the purchaser, for cables with rated voltage up to and including 1,8/3 (3,3) kV, provided that suitable fuses are used.

Annex A provides the method of verification of the burner and control system used for the test.

Requirements are stated for an identification that may optionally be marked on the cable to signify compliance with this standard.

**CAUTION – The test given in this standard may involve the use of dangerous voltages and temperatures. Suitable precautions should be taken against the risk of shock, burning, fire and explosion that may be involved, and against any noxious fumes that may be produced.**

#### 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60584-1, *Thermocouples – Part 1: EMF specifications and tolerances*

IEC 60269-3, *Low-voltage fuses – Part 3: Supplementary requirements for fuses for use by unskilled persons (fuses mainly for household and similar applications) – Examples of standardized systems of fuses A to F*

### 3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

#### 3.1

##### **circuit integrity**

ability of an electric cable to continue to operate in the designated manner whilst subjected to a specified flame source for a specified period of time under specified conditions

#### 3.2

##### **draught-free environment**

space in which the results of tests are not significantly affected by the local air speed

### 4 Test environment

The test shall be carried out in a draught-free environment within a suitable chamber, of minimum volume 20 m<sup>3</sup>, with facilities for disposing of any noxious gases resulting from the burning. Sufficient ventilation shall be available to sustain the flame for the duration of the test. Air inlets and the exhaust chimney should be located in such a way that the burner flame remains stable during the verification procedure and test. If necessary, the burner shall be shielded from any draughts by the use of draught shields. Windows may be installed in the walls of the chamber in order to observe the behaviour of the cable during the test. Fume exhaust should be achieved by means of natural draught through a chimney located at least 1 m from the burner. A damper may be used for adjustment of ventilation conditions.

NOTE Experience has shown a chamber similar to the "3 m cube" specified in IEC 61034-1 to be suitable.

The chamber and test apparatus shall be at a temperature of between 10 °C and 40 °C at the start of each test.

The same ventilation and shielding conditions shall be used in the chamber during both the verification and cable test procedures.


### 5 Test apparatus

#### 5.1 Test equipment

The test equipment shall consist of the following:

- a) a test wall onto which the cable is mounted, comprising a board manufactured from heat-resistant, non-combustible material suitable for the temperatures involved fastened to steel supports and mounted on a rigid support as described in 5.2;
- b) a source of heat comprising a horizontally mounted ribbon burner as described in 5.3;
- c) a shock-producing device as described in 5.4;
- d) a test wall equipped with thermocouples for verification of the source of heat as described in Annex A;
- e) a continuity checking arrangement as described in 5.6;
- f) fuses as described in 5.7.

A general arrangement of the test equipment is shown in Figure 1, Figure 2 and Figure 3.

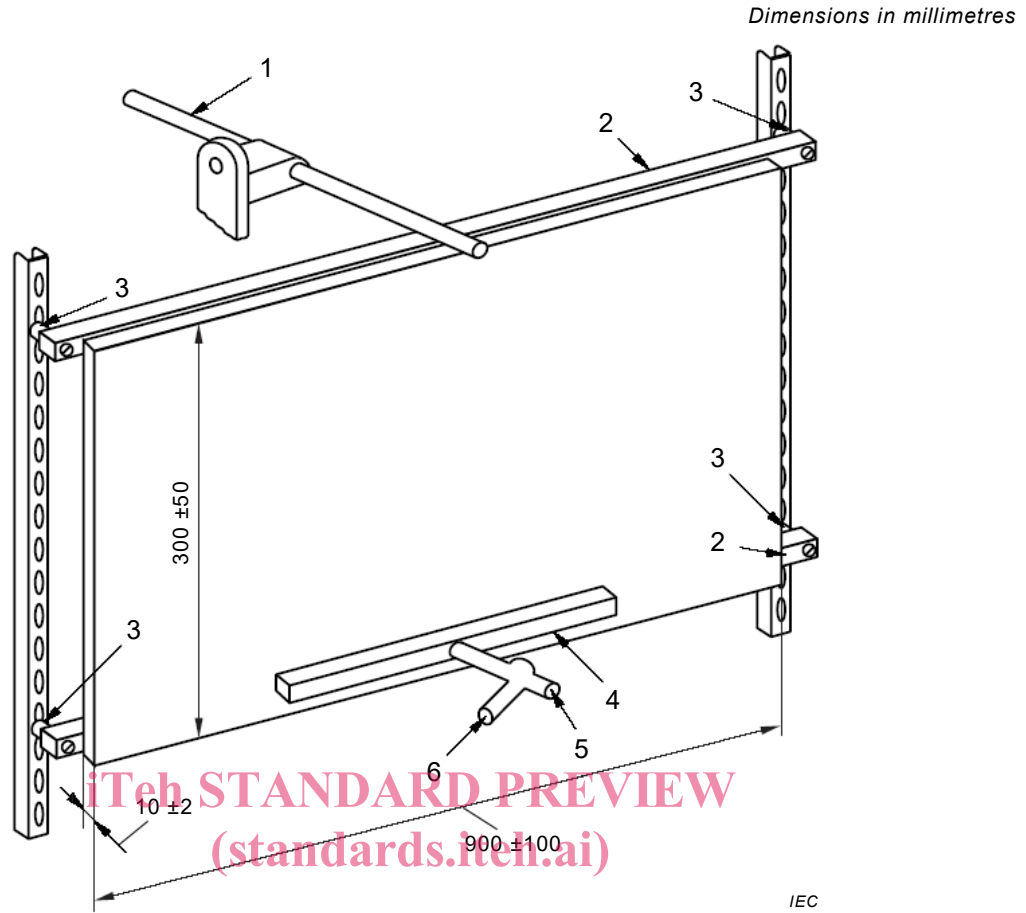

iTech STANDARD PREVIEW  
(standards.itech.ai)

IEC 60331-2:2018

<https://standards.itech.ai/catalog/standards/sist/2740c2d9-7e8d-43ba-aac0-ef2ffe17fd2c/iec-60331-2-2018>


IEC

**Key**

- |   |  |
|---|--|
| <p>1 shock-producing device</p> <p>2 steel support</p> <p>3 rubber bush</p> | <p>4 ribbon gas burner</p> <p>5 air inlet pipe</p> <p>6 propane inlet pipe</p> |
|---|--|

**Figure 1 – Schematic diagram of test configuration**


Dimensions in millimetres

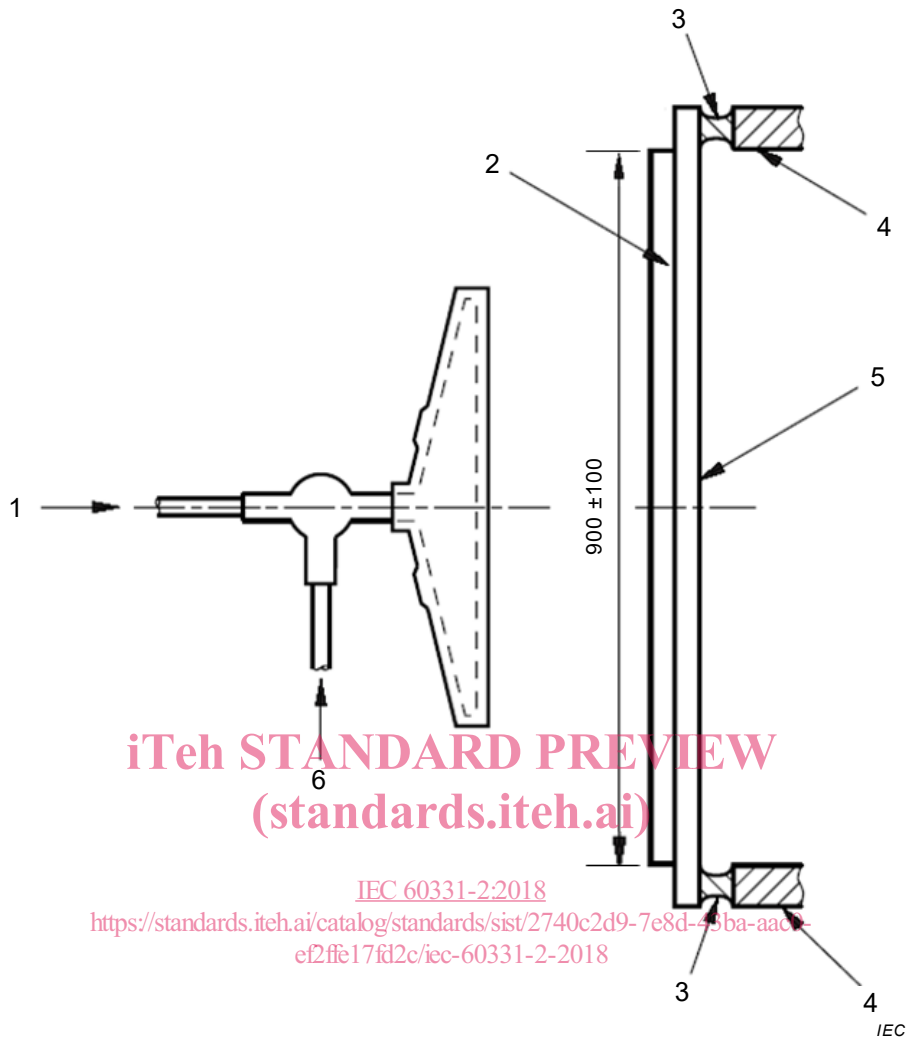

**Key**

- |   |               |   |                                    |
|---|---------------|---|------------------------------------|
| 1 | entry for air | 4 | support framework                  |
| 2 | board         | 5 | horizontal steel support for board |
| 3 | rubber bush   | 6 | entry for propane gas              |

**Figure 2 – Plan view of fire test equipment**

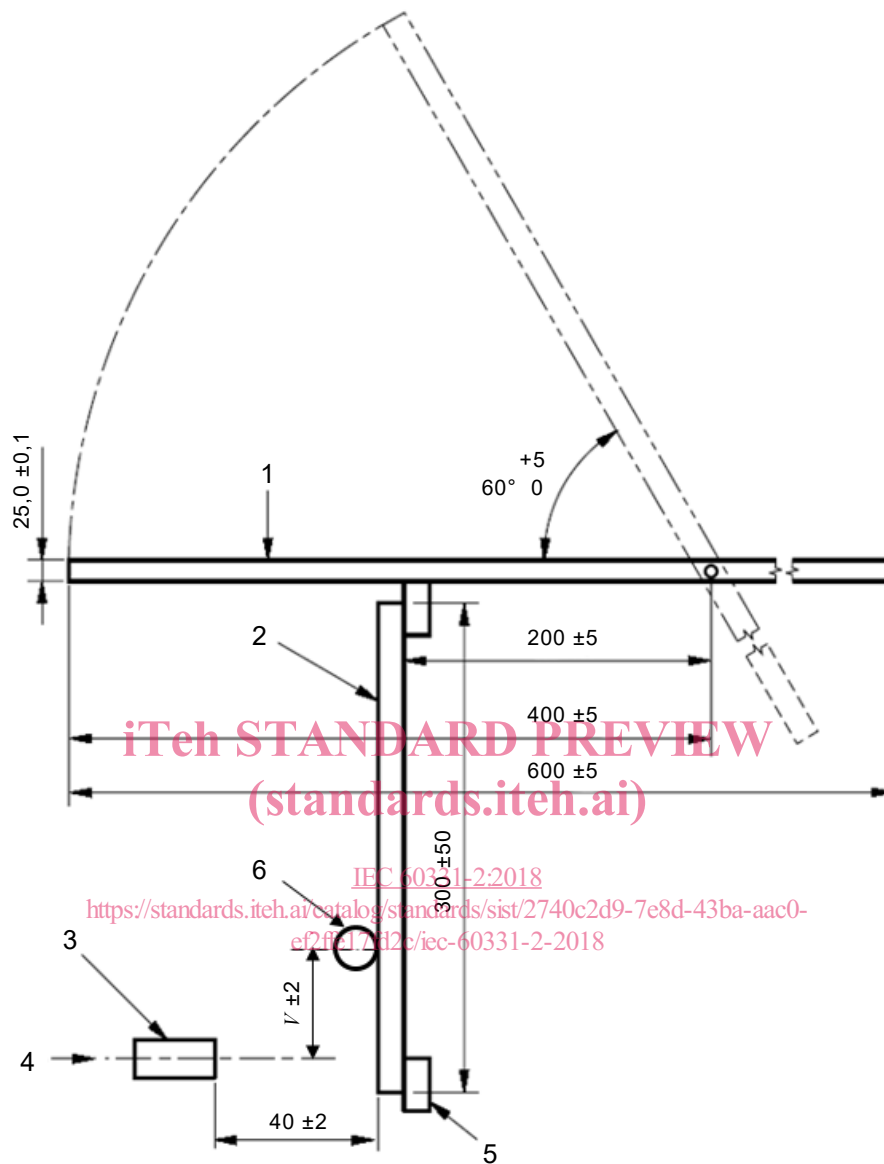

IEC

**Key**

1	shock-producing device	4	centre line of burner face
2	board	5	support framework
3	gas burner	6	test sample
<i>V</i>	Vertical distance from centre line of burner to the centre of the test specimen		

**Figure 3 – End elevation of fire test equipment**  
(not to scale)

## 5.2 Test wall and mounting

The test wall shall consist of a board of heat-resistant, non-combustible and non-metallic material fastened rigidly to two horizontal steel supports, one at the top of the board and the other at the bottom, as shown in Figure 1. Vertical supports may also be used. The board shall be  $(900 \pm 100)$  mm long,  $(300 \pm 50)$  mm high and  $(10 \pm 2)$  mm thick and the total mass of the test wall (i.e. board and steel supports) shall be  $(10,0 \pm 0,5)$  kg. Ballast, if required, shall be placed on the steel supports.

In case of dispute, a new board should be used for each test.

NOTE 1 Supports made from square section steel tube approximately 25 mm x 25 mm and approximately 1 m long have been found to be suitable.

The top support should be fastened to the board so that its upper face is slightly above the upper edge of the board, so that the shock-producing device impacts on the support and not the board.

Each horizontal support shall have a mounting hole at each end, not more than 100 mm from the edge of the board, the exact position and diameter being determined by the particular supporting bush and supporting framework used. The test wall shall be fastened to a rigid support by four bonded rubber bushes of hardness 50–60 Shore A fitted between the horizontal steel supports of the wall and the support framework, as shown in Figure 1 and Figure 2 so as to allow movement under impact.

NOTE 2 A typical rubber bush, which has been found to be suitable, is shown in Figure 4.

In order to check the mounting of the wall, the static deflection following application of a mass to the centre of the upper support of the wall shall periodically be measured.

The values of mass and deflection shall comply with the following:

Mass kg	Deflection mm
25,0 ± 0,2	1,5 ± 0,3

iTeh STANDARD PREVIEW  
(standards.iteh.ai)

[IEC 60331-2:2018](https://standards.iteh.ai/catalog/standards/sist/2740c2d9-7e8d-43ba-aac0-ef2ffe17fd2c/iec-60331-2-2018)

<https://standards.iteh.ai/catalog/standards/sist/2740c2d9-7e8d-43ba-aac0-ef2ffe17fd2c/iec-60331-2-2018>

Dimensions in millimetres



Figure 4 – Typical rubber bush (hardness: 50-60 shore A) for fastening wall

### 5.3 Source of heat

#### 5.3.1 Burner

The source of heat shall be a ribbon type propane gas burner with a nominal burner face length of 500 mm (outer distance between outer holes) with a venturi mixer. The nominal burner face width shall be 10 mm. The face of the burner shall have three staggered rows of drilled holes, nominally 1,32 mm in diameter and drilled at centres 3,2 mm from one another, as shown in Figure 5.

A centre-feed burner is recommended.

A row of small holes milled on each side of the burner plate, to serve as pilot holes for keeping the flame burning, is permitted.

Guidance on the choice of a recommended burner system is given in Annex B.