

SLOVENSKI STANDARD
oSIST prEN 50600-2-4:2014
01-januar-2014

Informacijska tehnologija - Naprave in infrastruktura podatkovnega centra - 2-4.
del: Pokabljenje za telekomunikacije

Information technology - Data centre facilities and infrastructures -- Part 2-4:
Telecommunications Cabling Infrastructure

Informationstechnik - Einrichtungen und Infrastrukturen von Rechenzentren -- Teil 2-4:
Infrastruktur der Telekommunikationsverkabelung

Technologie de l'information - Installation et infrastructures de centres de traitement de
données -- Partie 2-4: Infrastructure du câblage dédié télécommunications

Ta slovenski standard je istoveten z: prEN 50600-2-4:2013

<https://standards.iteh.ai/catalog/standards/sist/6d623e1b-465e-4135-a462-95b3226721d3/sist-en-50600-2-4-2015>

ICS:

33.020	Telekomunikacije na splošno	Telecommunications in general
35.110	Omreževanje	Networking

oSIST prEN 50600-2-4:2014 **en**

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

DRAFT
prEN 50600-2-4

December 2013

ICS 35.020; 35.110; 35.160

English version

**Information technology -
Data centre facilities and infrastructures -
Part 2-4: Telecommunications Cabling Infrastructure**

Technologie de l'information -
Installation et infrastructures de centres de
traitement de données -
Partie 2-4: Infrastructure du câblage dédié
télécommunications

Informationstechnik -
Einrichtungen und Infrastrukturen von
Rechenzentren -
Teil 2-4: Infrastruktur der
Telekommunikationsverkabelung

This draft European Standard is submitted to CENELEC members for CENELEC enquiry.
Deadline for CENELEC: 2014-05-09.

It has been drawn up by CLC/TC 215.

If this draft becomes a European Standard, CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

This draft European Standard was established by CENELEC in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Recipients of this draft are invited to submit, with their comments, notification of any relevant patent rights of which they are aware and to provide supporting documentation.

Warning : This document is not a European Standard. It is distributed for review and comments. It is subject to change without notice and shall not be referred to as a European Standard.

CENELEC

European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Avenue Marnix 17, B - 1000 Brussels

Content

Foreword	4
Introduction.....	4
1 Scope and conformance	7
1.1 Scope	7
1.2 Conformance.....	7
2 Normative references.....	7
3 Terms, definitions and abbreviations	8
3.1 Terms and definitions	8
3.2 Abbreviations.....	9
4 Telecommunications cabling within the data centre.....	10
4.1 General.....	10
4.2 Information technology and network telecommunications cabling in the computer room space.....	12
4.3 Structured cabling for other data centre spaces and application specific structured cabling	15
5 Availability design principles for telecommunications cabling infrastructure	15
5.1 General.....	15
5.2 Details	16
6 Availability classification for telecommunications cabling infrastructure	16
6.1 General.....	16
6.2 Telecommunications cabling for the computer room	16
6.3 Telecommunications cabling for offices.....	20
6.4 Telecommunications cabling for monitoring and control.....	20
7 Pathways and pathways systems for telecommunications cabling.....	20
7.1 General.....	20
7.2 Pathways.....	20
7.3 Pathways systems.....	23
8 Cabinets and racks for the computer room space	24
8.1 General Requirements	24
8.2 Requirements for dimensions	25
8.3 Recommendations	25
9 Documentation and quality plan.....	25
9.1 Requirements for documentation	25
9.2 Recommendations for documentation	26
9.3 Requirements for the quality plan	26
10 Management and operation of the telecommunications cabling infrastructure	26
10.1 General.....	26
10.2 Automated infrastructure management systems	26
10.3 Fibre optic cabling	26

Annex A (normative) Cabling design concepts	27
Annex B (informative) Energy efficiency considerations for the telecommunications cabling infrastructure	29
Bibliography	36

Figures

Figure 1 - Schematic relationship between the EN 50600 standards	6
Figure 2 – Impact of growth in an unstructured point-to-point cabling infrastructure	11
Figure 3 – Example of point-to-point cabling	11
Figure 4 – Structured cabling infrastructure: setup and growth	12
Figure 5 – Data centre cabling subsystems according to EN 50173-5	13
Figure 6 – Office cabling subsystems according to EN 50173-2	14
Figure 9 – Telecommunication cabling Class 1 using direct attached cords	17
Figure 10 – ENI redundancy for Class 1 and 2	17
Figure 11 - Telecommunication cabling Class 2	17
Figure 12 – Managing moves, adds and changes	18
Figure 13 - Redundant multipath telecommunication cabling Class 3	18
Figure 14 - Redundant multipath telecommunication cabling Class 4	19
Figure A.1 – Symbols of network elements	27
Figure A.2 – Example for Class 2 EoR cabling implementation	28
Figure A.3 – Example for Class 2 MoR cabling implementation	29
Figure A.4 – Example for Class 2 ToR cabling implementation	30
Figure A.5 – Example for Class 3 EoR cabling implementation	31
Figure A.6 – Example for Class 3 ToR cabling implementation	32
Figure A.7 – Example for Class 4 EoR cabling implementation	33
Figure A.8 – Example for Class 4 ToR cabling implementation	34

Tables

Table 1 – Telecommunication cabling availability classes per space architecture and overall data centre availability class for facilities and infrastructures	16
---	----

Foreword

This document (prEN 50600-2-4:2013) has been prepared by CLC/TC 215 "Electrotechnical aspects of telecommunication equipment".

This document is currently submitted to the Enquiry.

EN 50600-2-4 is part of the EN 50600 series of European Standards, which will comprise the following parts:

Part 1: General concepts

Part 2-1: Building construction

Part 2-2: Power distribution

Part 2-3: Environmental control

Part 2-4: Telecommunications Cabling Infrastructure

Part 2-5: Security systems

Part 2-6: Management and operational information

iTeh Standards
(<https://standards.iteh.ai>)
Document Preview

[SIST EN 50600-2-4:2015](https://standards.iteh.ai/catalog/standards/sist/6d623e1b-465e-4135-a462-95b3226721d3/sist-en-50600-2-4-2015)

<https://standards.iteh.ai/catalog/standards/sist/6d623e1b-465e-4135-a462-95b3226721d3/sist-en-50600-2-4-2015>

Introduction

The unrestricted access to internet-based information demanded by the information society has led to an exponential growth of both internet traffic and the volume of stored/retrieved data. Data centres are housing and supporting the information technology and network telecommunications equipment for data processing, data storage and data transport. They are required both by network operators (delivering those services to customer premises) and by enterprises within those customer premises.

Data centres need to provide modular, scalable and flexible facilities and infrastructures to easily accommodate the rapidly changing requirements of the market. In addition, energy consumption of data centres has become critical both from an environmental point of view (reduction of carbon footprint) and with respect to economical considerations (cost of energy) for the data centre operator.

The implementation of data centres varies in terms of:

- a) purpose (enterprise, co-location, co-hosting or network operator facilities);
- b) security level;
- c) physical size;
- d) accommodation (mobile, temporary and permanent constructions).

The needs of data centres also vary in terms of availability of service, the provision of security and the objectives for energy efficiency. These needs and objectives influence the design of data centres in terms of building construction, power distribution, environmental control and physical security. Effective management and operational information is required to monitor achievement of the defined needs and objectives.

This series of European Standards specifies requirements and recommendations to support the various parties involved in the design, planning, procurement, integration, installation, operation and maintenance of facilities and infrastructures within data centres. These parties include:

- 1) owners, facility managers, ICT managers, project managers, main contractors;
- 2) architects, building designers and builders, system and installation designers;
- 3) facility and infrastructure integrators, suppliers of equipment;
- 4) installers, maintainers.

At the time of publication of this European Standard, EN 50600 series will comprise the following standards:

EN 50600-1: *Information technology - Data centre facilities and infrastructures - Part 1: General concepts*

EN 50600-2-1: *Information technology - Data centre facilities and infrastructures - Part 2-1: Building construction*

EN 50600-2-2: *Information technology - Data centre facilities and infrastructures - Part 2-2: Power distribution*

EN 50600-2-3: *Information technology - Data centre facilities and infrastructures - Part 2-3: Environmental control*

EN 50600-2-4: *Information technology - Data centre facilities and infrastructures - Part 2-4: Telecommunications cabling infrastructure*

EN 50600-2-5: *Information technology - Data centre facilities and infrastructures - Part 2-5: Security systems*

EN 50600-2-6: *Information technology - Data centre facilities and infrastructures - Part 2-6: Management and operational information*

The inter-relationship of the standards within the EN 50600 series is shown in Figure 1.

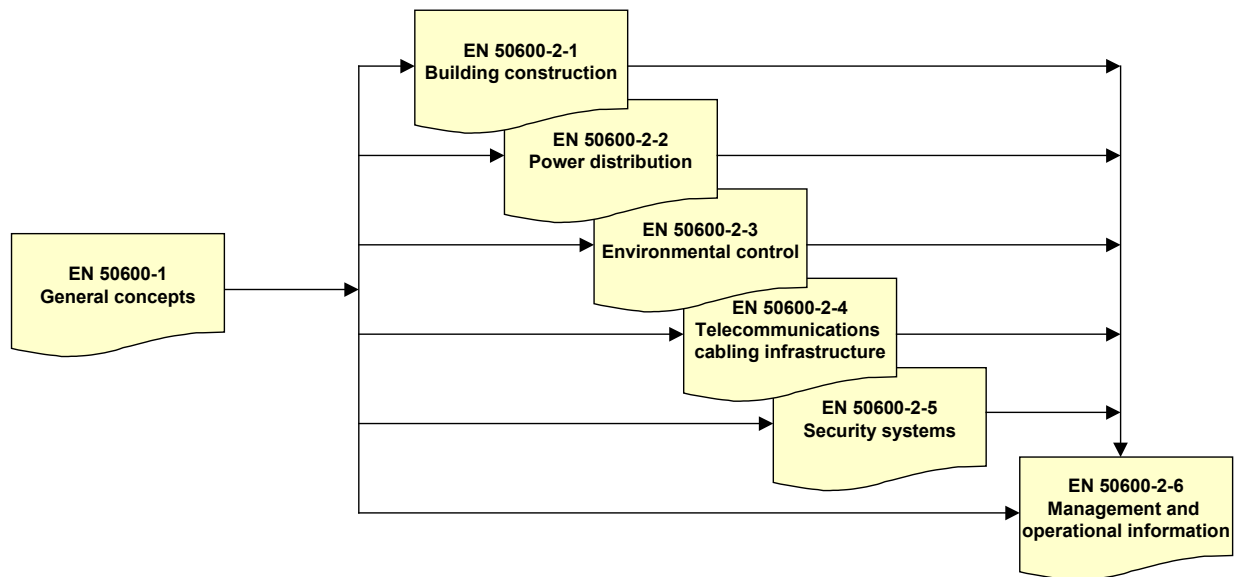


Figure 1 - Schematic relationship between the EN 50600 standards

EN 50600-2-X standards specify requirements and recommendations for particular facilities and infrastructures to support the relevant classification for “availability”, “security” and “energy efficiency enablement” selected from EN 50600-1.

This European Standard addresses the specific requirements for the telecommunications cabling infrastructure in data centres used for the purpose of IT networking and building services (in accordance with the requirements of EN 50600-1).

This European Standard is intended for use by and collaboration between architects, building designers and builders, system and installation designers.

NOTE The “intended for” text above needs to be reviewed and definitions need to be created for each of the “responsible persons”.

This series of European Standards does not address the selection of information technology and network telecommunications equipment, software and associated configuration issues.

<https://standards.iteh.ai/catalog/standards/sist/6d623e1b-465e-4135-a462-95b3226721d3/sist-en-50600-2-4-2015>

1 Scope and conformance

1.1 Scope

This European Standard addresses the wide range of telecommunications cabling infrastructures within data centres based upon the criteria and classifications for “availability” within EN 50600-1.

This European Standard specifies requirements and recommendations for the following:

- a) information technology and network telecommunications cabling (e.g. SAN and LAN);
- b) general information technology cabling to support the operation of the data centre,
- c) telecommunications cabling to monitor and control, as appropriate, power distribution, environmental control and physical security of the data centre;
- d) other building automation cabling;
- e) pathways, spaces and enclosures for the telecommunications cabling infrastructures.

Safety and electromagnetic compatibility (EMC) requirements are outside the scope of this European Standard and are covered by other standards and regulations. However, information given in this European Standard may be of assistance in meeting these standards and regulations.

1.2 Conformance

For a data centre to conform to this European Standard:

- a) the cabling design meets the requirements of clause 4 of this standard;
- b) cabling design for the selected availability class shall be in accordance with clause 6 of this standard;
- c) pathways and spaces design shall be in accordance with Clauses 7 and 8;
- d) installation planning shall be in accordance with clause 7 and 8 of this standard;
- e) information technology cabling to support the operation of the data centre shall be in accordance with EN 50173-2;
- f) information technology cabling to support the IT networking function of the data centre shall be in accordance with EN 50173-5;
- g) telecommunications cabling for monitoring/control of power distribution, environmental control and physical security shall be in accordance with EN 50173-6;
- h) installation specification, quality assurance, installation planning and practice of cabling shall be in accordance with EN 50174 series;
- i) national and local regulations, including safety, shall be met.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 50173-1, *Information technology - Generic cabling systems - Part 1: General requirements*

EN 50173-2, *Information technology - Generic cabling systems - Part 2: Office Premises*

EN 50173-5, *Information technology - Generic cabling systems - Part 5: Data Centres*

EN 50173-6, *Information technology - Generic cabling systems – Part 6: Distributed building services*

EN 50174-1, *Information technology - Cabling installation - Part 1: Installation specification and quality assurance*

EN 50174-2, *Information technology - Cabling installation - Part 2 Installation planning and practices inside buildings*

EN 50600-1:2012, *Information technology - Data centre facilities and infrastructures - Part 1: General concepts*

EN 50600-2-1 ¹⁾, *Information technology - Data centre facilities and infrastructures – Part 2-1: Building construction*

EN 50600-2-3 ²⁾, *Information technology - Data centre facilities and infrastructures - Part 2-3: Environmental control*

EN 50600-2-6 ³⁾, *Information technology - Data centre facilities and infrastructures - Part 2-6: Management and operational information*

3 Terms, definitions and abbreviations

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 50600-1 and the following apply.

3.1.1

central patching location

passive cross-connect to connect different functional elements of a data centre

Note 1 to entry: A central patching location can be located in the main distribution area and/or the intermediate distribution area and is therefore a special configuration of an MD and/or an ID.

3.1.2

cross-connect

method of connecting a cabling subsystem to equipment (or another cabling subsystem) by the use of a patch cord or jumper

3.1.3

data centre information technology equipment

equipment in the computer room space of a data centre that transports and/or stores and/or processes information

3.1.4

fixed cabling

cabling subsystem between closures which may have a either peer-to-peer or hierarchical structure which enable the installation of cross-connects or interconnects

3.1.5

office networks information technology equipment

equipment in data centre spaces that transports and/or stores and/or processes information

¹⁾ Circulated for Formal Vote.

²⁾ Circulated for CENELEC Enquiry.

³⁾ At draft stage.

3.1.6**point-to-point connection**

direct connection of two pieces of IT equipment using a dedicated cable rather than a generic cabling system

3.1.7**zone patching location**

passive crossconnect to connect different function elements of a data centre zone. A zone patching location can be located in the zone distribution area and is therefore a special configuration of a ZD.

3.2 Abbreviations

For the purposes of this document, the abbreviations given in EN 50600-1 and the following abbreviations apply.

BEF Building Entrance Facility

BD Building Distributor

C Connection

CD Campus Distributor

CP Consolidation Point

CPL Central Patching Location

ENI External Network Interface

EO Equipment Outlet

EQP Transmission Equipment

FD Floor Distributor

ID Intermediate Distributor

LDP Local Distribution Point

MD Main Distributor

SCP Service Concentration Point

SD Service Distributor

SO Service Outlet

TE Terminal Equipment

TO Telecommunications Outlet

ZD Zone Distributor

ZPL Zone Patching Location

iTeh Standards
(<https://standards.iteh.ai>)
Document Preview

SIST EN 50600-2-4:2015

<https://standards.iteh.ai/catalog/standards/sist/6d623e1b-465e-4135-a462-95b3226721d3/sist-en-50600-2-4-2015>