

TECHNICAL REPORT



iTeh STANDARD
Electromagnetic performance of high voltage direct current (HVDC) overhead
transmission lines

PREVIEW
(standards.iteh.ai)

[IEC TR 62681:2022](https://standards.iteh.ai/catalog/standards/sist/7f74aaf6-3497-477b-a889-7c7d2c920f52/iec-tr-62681-2022)

<https://standards.iteh.ai/catalog/standards/sist/7f74aaf6-3497-477b-a889-7c7d2c920f52/iec-tr-62681-2022>



THIS PUBLICATION IS COPYRIGHT PROTECTED
Copyright © 2022 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Secretariat
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

IEC Products & Services Portal - products.iec.ch

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 300 terminological entries in English and French, with equivalent terms in 19 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

INTERNATIONAL
STANDARDS
PREVIEW
(standards.iteh.ai)

[IEC TR 62681:2022](https://standards.iteh.ai/catalog/standards/sist/7f74aaf6-3497-477b-a889-7c7d2c920f52/iec-tr-62681-2022)

<https://standards.iteh.ai/catalog/standards/sist/7f74aaf6-3497-477b-a889-7c7d2c920f52/iec-tr-62681-2022>

TECHNICAL REPORT



iTeh STANDARD
PREVIEW
(standards.iteh.ai)

Electromagnetic performance of high voltage direct current (HVDC) overhead transmission lines

[IEC TR 62681:2022](https://standards.iteh.ai/catalog/standards/sist/7f74aaf6-3497-477b-a889-7c7d2c920f52/iec-tr-62681-2022)
<https://standards.iteh.ai/catalog/standards/sist/7f74aaf6-3497-477b-a889-7c7d2c920f52/iec-tr-62681-2022>

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 29.240.20

ISBN 978-2-8322-3130-2

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD.....	6
INTRODUCTION.....	8
1 Scope.....	9
2 Normative references	9
3 Terms and definitions	9
4 Electric field and ion current	10
4.1 Description of the physical phenomena	10
4.2 Calculation methods	14
4.2.1 General	14
4.2.2 Semi-analytic method	15
4.2.3 Finite element method	17
4.2.4 BPA method	18
4.2.5 Empirical methods of EPRI	18
4.2.6 Recent progress	19
4.3 Experimental data	20
4.3.1 General	20
4.3.2 Instrumentation and measurement methods.....	20
4.3.3 Experimental results for electric field and ion current.....	22
4.3.4 Discussion.....	22
4.4 Implication for human and nature	23
4.4.1 General	23
4.4.2 Static electric field	23
4.4.3 Research on space charge.....	24
4.4.4 Scientific review.....	29
4.5 Design practice of different countries.....	31
5 Magnetic field	32
5.1 Description of physical phenomena.....	32
5.2 Magnetic field of HVDC transmission lines	32
6 Radio interference	33
6.1 Description of radio interference phenomena of HVDC transmission system	33
6.1.1 General	33
6.1.2 Physical aspects of DC corona	33
6.1.3 Mechanism of formation of a noise field of DC line.....	34
6.1.4 Characteristics of radio interference from DC line	34
6.1.5 Factors influencing the RI from DC line.....	35
6.2 Calculation methods	37
6.2.1 EPRI empirical formula	37
6.2.2 IREQ empirical method.....	38
6.2.3 CISPR bipolar line RI prediction formula.....	39
6.3 Experimental data.....	40
6.3.1 Measurement apparatus and methods	40
6.3.2 Experimental results for radio interference.....	40
6.4 Criteria of different countries.....	40
7 Audible noise.....	41
7.1 Basic principles of audible noise	41

7.2	Description of physical phenomena.....	43
7.2.1	General	43
7.2.2	Lateral profiles.....	44
7.2.3	Statistical distribution	47
7.2.4	Influencing factors	48
7.2.5	Effect of altitude above sea level	50
7.2.6	Concluding remarks	50
7.3	Calculation methods	50
7.3.1	General	50
7.3.2	Theoretical analysis of audible noise propagation	50
7.3.3	Empirical formulas of audible noise	51
7.3.4	Semi-empirical formulas of audible noise.....	52
7.3.5	Concluding remarks	55
7.4	Experimental data	55
7.4.1	Measurement techniques and instrumentation	55
7.4.2	Experimental results for audible noise	55
7.5	Design practice of different countries	56
7.5.1	General	56
7.5.2	The effect of audible noise on people	56
7.5.3	The audible noise level and induced complaints	56
7.5.4	Limit values of audible noise of HVDC transmission lines in different countries	60
7.5.5	General national noise limits.....	60
Annex A (informative)	Experimental results for electric field and ion current.....	62
A.1	Bonneville Power Administration ± 500 kV HVDC transmission line.....	62
A.2	FURNAS ± 600 kV HVDC transmission line.....	62
A.3	Manitoba Hydro ± 450 kV HVDC transmission line.....	63
A.4	Hydro-Québec, New England, ± 450 kV HVDC transmission line.....	65
A.5	IREQ test line study of ± 450 kV HVDC line configuration	66
A.6	HVTRC test line study of ± 400 kV HVDC line configuration	67
A.7	Test study in China	68
Annex B (informative)	Experimental results for radio interference	71
B.1	Bonneville power administration's 1 100 kV direct current test project.....	71
B.1.1	General	71
B.1.2	Lateral profile	71
B.1.3	Influence of conductor gradient.....	72
B.1.4	Percent cumulative distribution	73
B.1.5	Influence of wind	75
B.1.6	Spectrum	75
B.2	Hydro-Québec institute of research	77
B.2.1	General	77
B.2.2	Cumulative distribution	77
B.2.3	Spectrum	78
B.2.4	Lateral profiles.....	78
B.3	DC lines of China	79
Annex C (informative)	Experimental results for audible noise	82
Bibliography	86

Figure 1 – Monopolar and bipolar space charge regions of an HVDC transmission line [1]....	11
Figure 2 – Lateral profile of magnetic field on the ground of ±800 kV HVDC lines	33
Figure 3 – The corona current <i>I</i> and radio interference magnetic field <i>H</i>	34
Figure 4 – RI tolerance tests: reception quality as a function of signal-to-noise ratio.....	41
Figure 5 – Attenuation of different weighting networks used in audible-noise measurements [16]	42
Figure 6 – Comparison of typical audible noise frequency spectra [131].....	44
Figure 7 – Lateral profiles of the AN	45
Figure 8 – Lateral profiles of the AN from a bipolar HVDC-line equipped with 8 × 4,6 cm (8 × 1,8 in) conductor bundles energized with ±1 050 kV [133]	45
Figure 9 – Lateral profiles of fair-weather A-weighted sound level [131].....	46
Figure 10 – All weather distribution of AN and RI at +15 m lateral distance of the positive pole from the upgraded Pacific NW/SW HVDC Intertie [34]	47
Figure 11 – Statistical distributions of fair weather A-weighted sound level measured at 27 m lateral distance from the line center during spring 1980.....	48
Figure 12 – Audible noise complaint guidelines [14] in USA	57
Figure 13 – Measured lateral profile of audible noise on a 330 kV AC transmission line [151]	57
Figure 14 – Subjective evaluation of DC transmission line audible noise; EPRI test center study 1974 [14]	58
Figure 15 – Subjective evaluation of DC transmission line audible noise; OSU study 1975 [14]	58
Figure 16 – Results of the operators' subjective evaluation of AN from HVDC lines	59
Figure 17 – Results of subjective evaluation of AN from DC lines	59
Figure A.1 – Electric field and ion current distributions for Manitoba Hydro ±450 kV Line [39]	64
Figure A.2 – Cumulative distribution of electric field for Manitoba Hydro ±450 kV Line [39] ...	64
Figure A.3 – Cumulative distribution of ion current density for Manitoba Hydro ±450 kV line [39]	65
Figure A.4 – Test result for total electric field at different humidity [119]	69
Figure A.5 – Comparison between the calculation result and test result for the total electric field (minimum conductor height is 18 m) [119].....	70
Figure B.1 – Connection for 3-section DC test line [123]	71
Figure B.2 – Typical RI lateral profile at ±600 kV, 4 × 30,5 mm conductor, 11,2 m pole spacing, 15,2 m average height [14]	72
Figure B.3 – Simultaneous RI lateral, midspan, in clear weather and light wind for three configurations, bipolar ±400 kV [123]	72
Figure B.4 – RI at 0,834 MHz as a function of bipolar line voltage 4 × 30,5 mm conductor, 11,2 m pole spacing, 15,2 m average height.....	73
Figure B.5 – Percent cumulative distribution for fair weather, 2 × 46 mm, 18,3 m pole spacing, ±600 kV	73
Figure B.6 – Percent cumulative distribution for rainy weather, 2 × 46 mm, 18,3 m pole spacing, ±600 kV	74
Figure B.7 – Percent cumulative distribution for fair weather, 4 × 30,5 mm, 13,2 m pole spacing, ±600 kV	74
Figure B.8 – Percent cumulative distribution for rainy weather, 4 × 30,5 mm, 13,2 m pole spacing, ±600 kV.....	75
Figure B.9 – Radio interference frequency spectrum.....	76

Figure B.10 – RI vs. frequency at ± 400 kV [123]	76
Figure B.11 – Cumulative distribution of RI measured at 15 m from the positive pole [124] ...	77
Figure B.12 – Conducted RI frequency spectrum measured with the line terminated at one end [124].....	78
Figure B.13 – Lateral profile of RI [124]	79
Figure B.14 – Comparison between calculation result and test result for RI lateral profile [119]	80
Figure B.15 – The curve with altitude of the RI on positive reduced-scale test lines	81
Figure C.1 – Examples of statistical distributions of fair weather audible noise. dB(A) measured at 27 m from line center of a bipolar HVDC test line [16].....	83
Figure C.2 – AN under the positive polar test lines varying with altitude.....	85
Table 1 – Electric field and ion current limits of ± 800 kV DC lines in China	31
Table 2 – Electric field limits of DC lines in United States of America [121]	31
Table 3 – Electric field and ion current limits of DC lines in Canada	31
Table 4 – Electric field limits of DC lines in Brazil	31
Table 5 – Parameters of the IREQ excitation function (Monopolar) [122].....	39
Table 6 – Parameters of the IREQ excitation function (Bipolar) [122]	39
Table 7 – Parameters defining regression equation for generated acoustic power density [8].....	54
Table 8 – Typical sound attenuation (in decibels) provided by buildings [157]	61
Table A.1 – BPA ± 500 kV line: statistical summary of all-weather ground-level electric field intensity and ion current density [34]	62
Table A.2 – FURNAS ± 600 kV line: statistical summary of ground-level electric field intensity and ion current density [38].....	63
Table A.3 – Hydro-Québec–New England ± 450 kV HVDC transmission line. Bath, NH; 1990-1992 (fair weather), 1992 (rain). All-season measurements of static electric E-field in kV/m [41]	66
Table A.4 – Hydro-Québec – New England ± 450 kV HVDC Transmission Line. Bath, NH; 1990-1992, All-season fair-weather measurements of ion concentrations in kions/cm^3 [41]	66
Table A.5 – IREQ ± 450 kV test line: statistical summary of ground-level electric field intensity and ion current density [43].....	67
Table A.6 – HVTRC ± 400 kV test line: statistical summary of peak electric field and ion currents [44]	68
Table A.7 – Statistical results for the test data of total electric field at ground (50 % value) [119].....	69
Table B.1 – Influence of wind on RI	75
Table B.2 – Statistical representation of the long term RI performance of the tested conductor bundle [124]	78
Table B.3 – RI at 0,5 MHz at lateral 20 m from positive pole (fair weather)	79
Table B.4 – The parameters of test lines.....	80
Table B.5 – Measured results of 0,5 MHz RI for the full-scale test lines at different altitudes.....	81
Table C.1 – Audible Noise Levels of HVDC Lines according to [121] and [152]	84
Table C.2 – Test results of 50 % AN statistics for full-scale test lines.....	85

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**ELECTROMAGNETIC PERFORMANCE OF HIGH VOLTAGE DIRECT
CURRENT (HVDC) OVERHEAD TRANSMISSION LINES**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

IEC TR 62681 has been prepared by IEC technical committee 115: High Voltage Direct Current (HVDC) transmission for DC voltages above 100 kV. It is a Technical Report.

This second edition cancels and replaces the first edition, published in 2014. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) the limits of total electric field in some countries have been supplemented and improved;
- b) the definition of 80 %/80 % criteria of radio interference has been clarified;
- c) a table has been added for bipolar excitation which shows the parameters of the IREQ radio interference excitation function;
- d) the clause of CEPRI research results of audible noise has been deleted;
- e) the clause of main conclusion of audible noise has been deleted.

The text of this Technical Report is based on the following documents:

Draft	Report on voting
115/289/DTR	115/292/RVDTR

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this Technical Report is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/publications.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

**iTeh STANDARD
PREVIEW
(standards.iteh.ai)**

IMPORTANT – The “colour inside” logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this publication using a colour printer.

<https://standards.iteh.ai/catalog/standards/sist/7f74aaf6-3497-477b-a889-7c7d2c920f52/iec-tr-62681-2022>

INTRODUCTION

Electric fields and magnetic fields are produced in the vicinity of a High Voltage Direct Current (HVDC) overhead transmission line. When the electric field at the conductor surface exceeds a critical value, known as the corona onset gradient, positive or negative free charges leave the conductor and interact with the surrounding air and ionization takes place in the layer of surrounding air, leading to the formation of corona discharges. The corona discharge will result in corona loss but also change the electro-magnetic properties around the HVDC overhead transmission lines.

The parameters used to describe the electromagnetic performance of an HVDC overhead transmission line mainly include the:

- 1) electric field,
- 2) ion current,
- 3) magnetic field,
- 4) radio interference,
- 5) audible noise.

To control these parameters in a reasonable and acceptable range, for years, a great deal of theoretical and experimental research was conducted in many countries, and relevant national standards or enterprise standards were developed. This document collects and records the status of study and progress of electric fields, ion current, magnetic fields, radio interference, and audible noise of HVDC overhead transmission lines. It is recognised that general technical discussion given in this document would be applicable for HVDC sub-stations as well; However, since layout of a station differs very differently, expressions given for HVDC overhead transmission line cannot be directly used as many assumptions would not hold good. Furthermore, an HVDC sub-station is not accessible to the general public, thus the numbers and limits given in this document are not applicable for HVDC sub-stations.

[IEC TR 62681:2022](https://standards.iteh.ai/catalog/standards/sist/7f74aaf6-3497-477b-a889-7c7d2c920f52/iec-tr-62681-2022)

<https://standards.iteh.ai/catalog/standards/sist/7f74aaf6-3497-477b-a889-7c7d2c920f52/iec-tr-62681-2022>

ELECTROMAGNETIC PERFORMANCE OF HIGH VOLTAGE DIRECT CURRENT (HVDC) OVERHEAD TRANSMISSION LINES

1 Scope

This document provides general guidance on the electromagnetic environment issues of HVDC overhead transmission lines. It concerns the major parameters adopted to describe the electromagnetic properties of an HVDC overhead transmission line, including electric fields, ion current, magnetic fields, radio interference, and audible noise generated as a consequence of such effects. If the evaluation method and/or criteria of electromagnetic properties are not yet regulated, engineers in different countries can refer to this document to:

- support/guide the electromagnetic design of HVDC overhead transmission lines,
- limit the influence on the environment within acceptable ranges, and
- optimize engineering costs.

2 Normative references

There are no normative references in this document.

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1

corona

set of partial discharges in a gas, immediately adjacent to an uninsulated or lightly insulated conductor which creates a highly divergent field remote from other conductors

[SOURCE: IEC 60050-212:2010, 212-11-44, modified – Note 1 has been deleted.]

3.2

electric field

constituent of an electromagnetic field which is characterized by the electric field strength E together with the electric flux density D

Note 1 to entry: In the context of HVDC transmission lines, the electric field is affected not only by the geometry of the line and the potential of the conductor, but also by the space charge generated as a result of corona; consequently, electric field distribution may vary non-linearly with the line potential.

[SOURCE: IEC 60050-121:1998, 121-11-67, modified – The original note has been deleted and Note 1 to entry has been added.]

3.3

space-charge-free electric field

electric field due to a system of energized electrodes, excluding the effect of space charge present in the inter-electrode space

3.4

ion current

flow of electric charge resulting from the motion of ions

3.5

magnetic field

constituent of an electromagnetic field which is characterized by the magnetic field strength H together with the magnetic flux density B

[SOURCE: IEC 60050-121:1998, 121-11-69, modified – Note 1 has been deleted.]

3.6

audible noise

unwanted sound with frequency range from 20 Hz to 20 kHz

[SOURCE: IEC 61973:2012, 3.1.14]

4 Electric field and ion current

4.1 Description of the physical phenomena

Electric fields are produced in the vicinity of an HVDC transmission line, with the highest electric fields existing at the surface of the conductor. When the electric field at the conductor surface exceeds a critical value, the air in the vicinity of the conductor becomes ionized, forming a corona discharge. Ions of both polarities are formed, but ions of opposite polarity to the conductor potential are attracted back towards the conductor, while ions of the same polarity as the conductor are repelled away from the conductor. Space charges include air ions and charged aerosols. Under the action of an electric field, space charge will move directionally, and ion current will be formed. The physical phenomena of electric field and ion current are described in this Subclause 4.1.

[IEC TR 62681:2022](https://standards.iteh.ai/catalog/standards/sist/7f74aaf6-3497-477b-a889-7c/d/c920f52/iec-tr-62681-2022)

The electric field and ion current in the vicinity of an HVDC transmission line are defined mainly by the operating voltage, line configuration, conductor radius and conductor surface. The voltage applied to line conductors produces an electric field distribution. Unlike High-Voltage Alternating Current (HVAC) transmission lines, the electric field produced by HVDC transmission lines does not vary with time and, consequently, does not produce any significant currents in humans or objects immersed in these fields.

The electric field is another aspect of the electrical property around an overhead HVDC transmission line. An electric field is present around any charged conductor, irrespective of whether corona discharge is taking place. However, the space charge created by corona discharge under DC conditions modifies the distribution of an electric field. The effect of space charge on electric fields is significant.

For the same HVDC transmission lines, the corona onset gradients of positive or negative polarities are different and the intensity and characteristics of corona discharges on positive or negative conductors are also different. Consequently, during the design of HVDC transmission lines, special consideration needs to be paid to the allowable values of the maximum ground-level electric field and ion current density [1]¹.

¹ Numbers in square brackets refer to the bibliography.

Corona on a conductor of either positive or negative polarity produces ions of either the positive or negative polarities in a thin layer of air surrounding each conductor [1]. However, ions with a polarity opposite to that of the conductor are drawn to it and are neutralized on contact. Thus, a positive conductor in corona acts as a source of positive ions and vice-versa. For a monopolar DC transmission line, ions having the same polarity as the conductor voltage fill the entire inter-electrode space between the conductors and ground. For a bipolar DC transmission line, the ions generated on the conductors of each polarity are subject to an electric field driven drift motion either towards the conductor of opposite polarity or towards the ground plane, as shown in Figure 1. The influence of wind or the formation of charged aerosols are not considered at this stage. Three general space charge regions are created in this case:

- a) a positive monopolar region between the positive conductor and ground,
- b) a negative monopolar region between the negative conductor and ground,
- c) a bipolar region between the positive and negative conductors.

For practical bipolar HVDC lines, most of the ions are directed toward the opposite polarity conductor, but a significant fraction is also directed toward the ground. The ion drift velocity is such that it will take at least a few seconds for them to reach ground. Actually, the molecules travelling along ion paths are not always the same ions. In fact, collisions between ions and air molecules occur during the travel at a rate of billions per second and cause charge transfer and reactions between ions and neutral molecules, so the ions reaching the ground are quite different from those that were originally formed by corona near the conductor surface. The exact chemical identity of the ions, after a few seconds, will depend on the chemical composition and trace gases at the location.

Electric field is another component of the electrical property around an overhead HVDC transmission line. Electric field is caused by electrical charges, both those residing on conductive surfaces (the transmission line conductors, the ground, and conducting objects) and the space charges. The effect of space charge on electric field is significant.

A nonlinear interaction takes place between electric field and space charge distributions in all three general space regions identified above in a), b), c). The nonlinearity arises because ions flow from each conductor to ground or to the conductor of opposite polarity along the flux lines of the electric field distribution: while at the same time, the electric field distribution is influenced by the ionic space charge distribution. In addition to the nonlinear interaction described above, the space charge field in the bipolar region is affected by other factors. Mixing of ions of both polarities in the bipolar region leads firstly to a reduction in the net space charge density and, secondly, to recombination and neutralization of ions of both polarities.

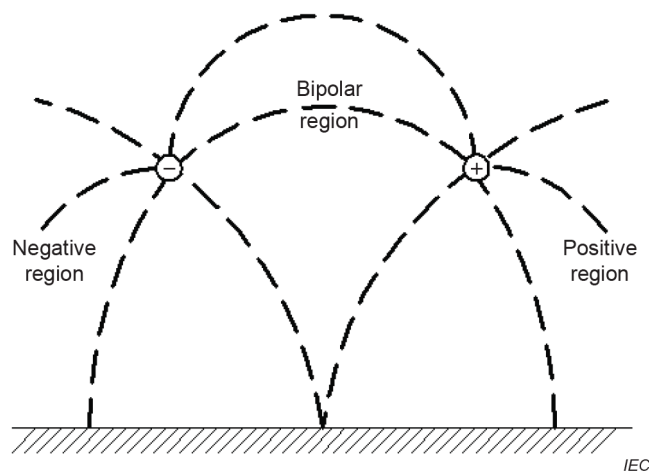


Figure 1 – Monopolar and bipolar space charge regions of an HVDC transmission line [1]

The corona-generated space charge, being of the same polarity as the conductor, produces a screening effect on the conductor by lowering the electric field in the vicinity of the conductor surface and consequently reducing the intensity of corona discharges occurring on the conductor. In the monopolar regions, the space charge enhances the electric field at the ground surface. The extent of electric field reduction at the conductor surface and field enhancement at the ground surface depend on the conductor voltage as well as on the corona intensity at the conductor surface. In the case of the bipolar region, however, the mixture of ions of opposite polarity and ion recombination tend to reduce the screening effect on the conductor surface. This leads to a smaller reduction in the intensity of corona activity near the conductors than in the monopolar regions.

The electrical environment at ground level under a bipolar HVDC transmission line is, therefore defined mainly by three quantities:

- 1) electric field, E ,
- 2) ion current density, J ,
- 3) space charge density, ρ .

The electric field produced by HVDC overhead transmission lines is a vector defined by its components along three orthogonal axes. The space charge density is a scalar. The ion current density is also a vector, and it is affected by the electric field and space charge density.

Very small currents in some cases can flow through an object or person located under the line because of exposure to the electric field and ion space charge. From the point of view of environmental impact on persons and objects located under the line, the main consideration is the combined exposure to the electric fields and ion currents. The scientific literature indicates that exposure to the levels of DC electric field and ion current density existing under operating HVDC transmission lines poses no risk to public health, but may cause some induced current and annoyance effects to humans.

Design of HVDC transmission lines requires the ability to predict ground-level electric field and ion current distribution as functions of line design parameters such as the number and diameter of sub-conductors in the bundle, height above ground of conductors and pole spacing. Prediction methods are based on a combination of analytical techniques to calculate the space charge fields and accurate long-term measurements under experimental as well as operating HVDC transmission lines.

As described and illustrated in Figure 1, the ground-level electric field and ion current property under a bipolar HVDC transmission line can be thought primarily as a monopolar space charge field under each pole. The bipolar space charge field between the positive and negative conductors, however, has no significant impact on the ground-level electrical property. For the purpose of calculating the ground-level electric field and ion current distributions, therefore, analytical treatment of the monopolar space charge field between each of the positive and negative conductors and the ground plane is adequate.

Monopolar DC space charge fields are defined by the following equations:

$$\nabla \cdot E = \frac{\rho}{\epsilon_0} \quad (1)$$

$$J = \mu\rho E \quad (2)$$

$$\nabla \cdot J = 0 \quad (3)$$

where

E and J are the electric field and ion current density vectors at any point in space,

ρ is the space charge density,

μ is the ionic mobility,

ε_0 is the permittivity of free space.

The first Equation (1) is Poisson's equation, the second Equation (2) defines the relationship between the current density and electric field vectors, and the third Equation (3) is the continuity equation for ions. Since electrons are existent in the zone very close to the conductors and attached to air molecules forming negative ions, they are not considered. The solution of these equations, along with appropriate boundary conditions, for the conductor-ground-plane geometry of the HVDC transmission line, determines the ground-level electric field and ion current distributions [1].

Corona activity on conductors and the resulting space charge field are influenced, in addition to the line voltage and geometry, by ambient weather conditions such as temperature, pressure, humidity, precipitation and wind velocity as well as by the presence of any aerosols and atmospheric pollution. It is difficult, if not impossible, to take all these factors into account in any analytical treatment of space charge fields. Information on the corona onset gradients of conductors, which is an essential input in the analytical determination of electric field and ion current density, is also difficult to obtain under practical operating conditions. For these reasons, analytical methods are employed in combination with accurate long-term measurements of ground-level electric field and ion current distributions under experimental as well as operating HVDC transmission lines, in order to develop prediction methods. Some of the information required in the analytical treatment, such as corona onset gradients of conductors, can be obtained only through experimental studies. Reliable experimental data are also essential in validating the accuracy of analytical or semi-analytical methods for predicting the ground-level electric field and ion current distributions under HVDC transmission lines.

NOTE 1 Industry consensus and standards have not been reached on appropriate analytical methods to capture all effects of weather in the calculation of enhanced fields due to space charge.

NOTE 2 As described in reference [4], the conditions most conducive to enhanced fields due to space charge (wet conductor conditions in fog, with zero wind) occur for a very small percentage of time over a given year.

NOTE 3 As further pointed out in reference [4], to attempt to address very rare conditions in the design of an HVDC transmission line is not fully justifiable, given the lack of clear standards, analytical methods, and consensus on the subject.

The atmosphere has a large quantity of aerosol particles. When such particles are present in the ion flow around a stressed HVDC conductor, the ions will be captured by the particle because of Brownian motion and the motion driven by electric force. A charging process dictated by ions diffusing to particles is called diffusion charging [2]. This mechanism does not involve any external electric fields and some experiments indicate that it has insignificant relations with electrical properties of particles. Electrical properties are characterized by electrical conductivity and permittivity. As the charge accumulates on the particle surface, the electric field around the particle gets stronger, leading to a reduction of diffusion charging rate. The other charging process controlled by electric field is named field charging [2]. Unlike diffusion charging, several experiments show that the charging process relies heavily on the electrical parameters. The physical mechanism behind this phenomenon is Maxwell-Wagner relaxation of the electric field around the particle in the presence of an external electric field [3].