



SLOVENSKI STANDARD

SIST EN 15154-1:2007

01-februar-2007

Varnostne prhe za prvo pomoč - 1. del: Prhe za spiranje telesa s stalnim priključkom na vodovod v laboratorijih

Emergency safety showers - Part 1: Plumbed-in body showers for laboratories

Sicherheitsnotduschen - Teil 1: Körperduschen mit Wasseranschluss für Laboratorien

Douches de sécurité - Partie 1 : Douches pour le corps raccordées au réseau d'eau utilisées en laboratoire

ITeH STANDARD PREVIEW
(standards.iteh.ai)

Ta slovenski standard je istoveten z: EN 15154-1:2006

SIST EN 15154-1:2007
<https://standards.iteh.ai/catalog/standards/sist/6516c18f-e679-4fd7-9b54-cad46b59dcec/sist-en-15154-1-2007>

ICS:

11.160	Prva pomoč	First aid
71.040.10	Kemijski laboratoriji. Laboratorijska oprema	Chemical laboratories. Laboratory equipment

SIST EN 15154-1:2007

en,fr,de

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 15154-1:2007

<https://standards.iteh.ai/catalog/standards/sist/6516cf8f-e679-4fd7-9b54-cad46b59dcec/sist-en-15154-1-2007>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 15154-1

September 2006

ICS 71.040.10

English Version

Emergency safety showers - Part 1: Plumbed-in body showers for laboratories

Douches de sécurité - Partie 1 : Douches pour le corps
raccordées au réseau d'eau utilisées en laboratoire

Sicherheitsnotduschen - Teil 1: Körperduschen mit
Wasseranschluss für Laboratorien

This European Standard was approved by CEN on 19 August 2006.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

[SIST EN 15154-1:2007](https://standards.iteh.ai/catalog/standards/sist/6516cf8f-e679-4fd7-9b54-cad46b59dcec/sist-en-15154-1-2007)

<https://standards.iteh.ai/catalog/standards/sist/6516cf8f-e679-4fd7-9b54-cad46b59dcec/sist-en-15154-1-2007>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Contents		Page
Foreword.....		3
Introduction		4
1 Scope		5
2 Normative references		5
3 Terms and definitions		5
4 Performance		5
5 Design requirements for installation		7
6 Valve.....		7
7 Shower head.....		7
8 Manufacturer's information		7
9 Marking		8
Annex A (informative) Water temperature.....		9

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 15154-1:2007](https://standards.iteh.ai/catalog/standards/sist/6516cf8f-e679-4fd7-9b54-cad46b59dcec/sist-en-15154-1-2007)

<https://standards.iteh.ai/catalog/standards/sist/6516cf8f-e679-4fd7-9b54-cad46b59dcec/sist-en-15154-1-2007>

Foreword

This document (EN 15154-1:2006) has been prepared by Technical Committee CEN/TC 332 "Laboratory equipment", the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by March 2007, and conflicting national standards shall be withdrawn at the latest by March 2007.

EN 15154 consists of the following parts, under the general title *Emergency safety showers*

- Part 1: Plumbed-in body showers for laboratories
- Part 2: Plumbed-in eye wash units
- Part 3: Portable body showers (in preparation)
- Part 4: Portable eye wash units (in preparation)
- Part 5: Plumbed-in body showers for production facilities (in planning)

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

<https://standards.iteh.ai/catalog/standards/sist/6516cf8f-e679-4fd7-9b54-cad46b59dcec/sist-en-15154-1-2007>

Introduction

Plumbed-in body showers are designed and intended to be installed in close range of persons working in a potentially hazardous area. The main purpose of these devices is to immediately deliver a flushing fluid in a sufficient volume to extinguish flames and/or to flush the body following exposure to injurious substances or heat. With this accomplished the injured person can proceed to medical care.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST EN 15154-1:2007](https://standards.iteh.ai/catalog/standards/sist/6516cf8f-e679-4fd7-9b54-cad46b59dcec/sist-en-15154-1-2007)

<https://standards.iteh.ai/catalog/standards/sist/6516cf8f-e679-4fd7-9b54-cad46b59dcec/sist-en-15154-1-2007>

1 Scope

This document is a product specification, giving performance requirements for emergency safety body showers connected to the water supply. It is applicable to plumbed-in body showers only, located in laboratory facilities. It is not applicable to emergency safety showers used on industrial sites or in other such areas.

Requirements are given in respect of the performance, installation, adjustment and marking of the showers as well as installation, operation and maintenance instructions to be given by the manufacturer.

NOTE Attention is drawn to national regulations which may apply in respect of the installation and use of emergency safety showers.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 420, *Protective gloves — General requirements and test methods*

ISO 3864-1, *Graphical symbols — Safety colours and safety signs — Part 1: Design principles for safety signs in workplaces and public areas*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1

emergency safety shower

device specially designed and intended to deliver a flushing fluid to extinguish flames and to sufficiently wash away contaminants or to dilute them, rendering them harmless

3.2

plumbed-in body shower

emergency safety shower that is permanently connected to a continuous water supply and designed to deliver water sufficient to flush the whole body

4 Performance

4.1 Flow rate of water

The water supplied by the body shower shall be of constant flow rate in accordance with national regulations at a flow pressure to be specified by the manufacturer. The flow pressure shall be specified and measured where the shower is connected to the water system. The body shower shall be capable of delivering this supply for a minimum of 15 minutes.

NOTE When no national or local regulations apply, a constant flow rate of min. 60 l/min is suitable.

4.2 Water distribution

The water distribution of the emergency body shower shall be measured by the following type test procedure.

As shown in Figure 1, at a distance 700 mm below the shower head, (50 ± 10) % of the volume of water delivered shall fall in a circle with a radius of 200 mm; the water level in the individual compartments in this circle shall not deviate by more than 30 % from the mean value.

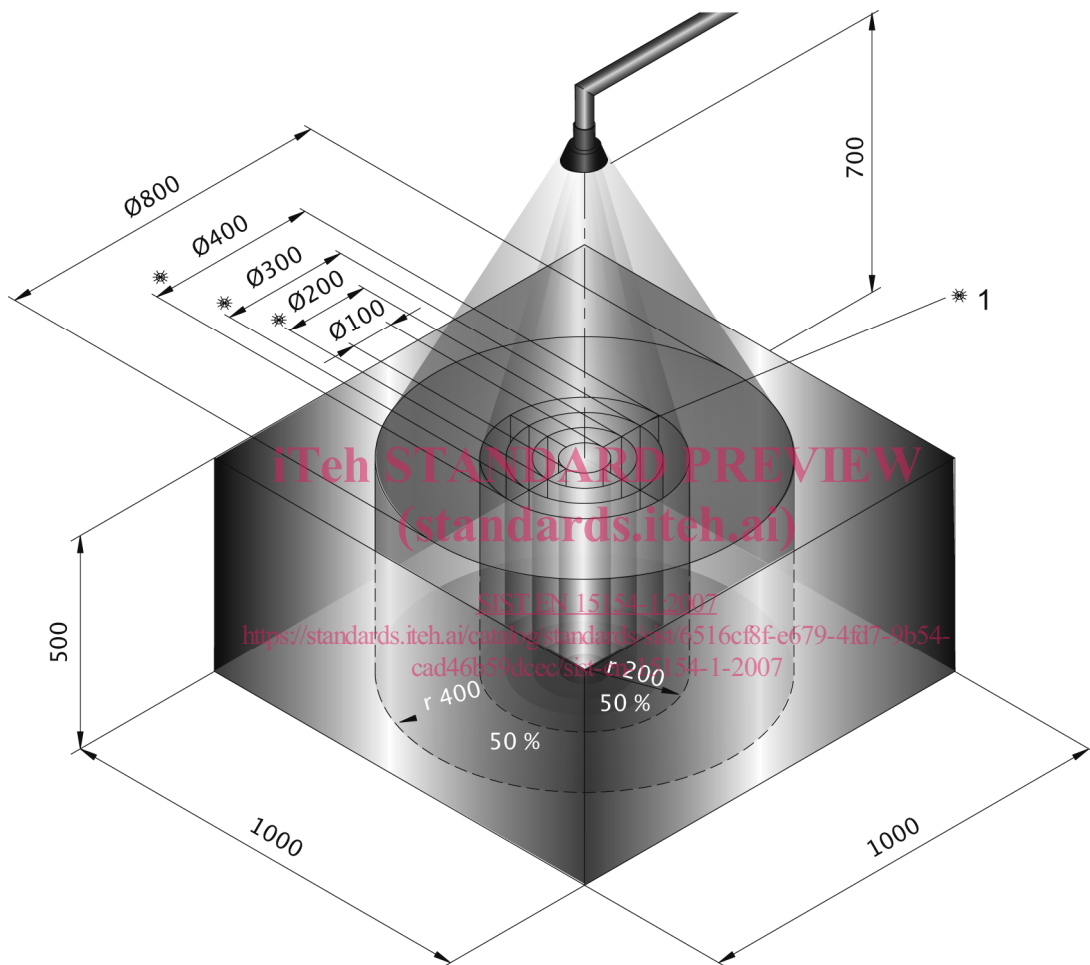
EN 15154-1:2006 (E)

At this measuring level, the area reached by a minimum of 95 % of the water shall be limited to a circle with a radius of 400 mm.

The velocity of the water spray shall be low enough to be non-injurious to the user.

NOTE A hand held shower with flexible hose mounted on the body shower can be incorporated.

Dimensions in millimeters

**Key**

- 1 Cylinder shall be divided into 4 compartments.

Figure 1 — Type testing of water distribution

4.3 Water quality

Potable water or water of a similar quality complying with European or national standards is required for body showers.

Materials used in the construction of the shower shall not affect the water quality or contaminate the water supply.

4.4 Water temperature

Information on water temperature is given in Annex A (informative).

5 Design requirements for installation

5.1 Installation height

The shower head shall be designed to be installed so that its lower edge is $(2\ 200 \pm 100)$ mm above the level on which the user stands.

5.2 Free space

The free space between the centre line of the shower head and the nearest obstruction (wall, vertical supply tube or similar) shall be a circle with a minimum radius of 400 mm.

Only the valve control element and/or the eyewash station and/or the hand held shower on a combination shower shall project into this space by a maximum of 200 mm. Other parts or components shall not project into this space.

6 Valve

For manual operation, the valve shall be opened in a single operation by turning or moving a valve actuator to maximum 90° or maximum 200 mm stroke. The maximum force for the operation shall be 100 N or the maximum torque 7 Nm. By using this force/torque, the valve shall be fully open within 1 s.

Also for automatic operation, the valve shall be fully open within 1 s.

The valve shall not close automatically once it has been opened. The direction of operating the valve actuator shall be clearly visible and unmistakable.

The valve actuator shall be large enough to be easily located and operated by the user even when wearing protective gloves, with a maximum size in accordance with EN 420. The valve actuator shall be positioned between floor level and a maximum of 1 750 mm above that level.

NOTE Attention is drawn to national regulations in some European countries, e. g. Sweden, requesting the actuator to be operable at floor level.

7 Shower head

It shall only be possible to make adjustments with a tool to the direction of spray or the water distribution of a shower head.

The shower head shall be self-draining between the valve and the outlet. The shower head shall be removable for maintenance but only by use of a tool.

8 Manufacturer's information

The manufacturer shall supply with the emergency body shower information on installation, operation and maintenance as well as the method and frequency of routine testing.

NOTE Attention is drawn to national regulations that may apply for installation, maintenance and routine testing.