

INTERNATIONAL STANDARD

NORME INTERNATIONALE



**Fibre-optic communication subsystem test procedures –
Part 4-5: Installed cabling plant – Attenuation measurement of MPO terminated
fibre optic cabling plant using test equipment with MPO interfaces**

**Procédures d'essai des sous-systèmes de télécommunication fibroniques –
Partie 4-5: Installation câblée – Mesurage de l'affaiblissement de l'installation
câblée à fibres optiques à terminaisons MPO utilisant un équipement d'essai
avec interfaces MPO**



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2020 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22,000 terminological entries in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

67,000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Recherche de publications IEC -

webstore.iec.ch/advsearchform

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études,...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

IEC Just Published - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et une fois par mois par email.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: sales@iec.ch.

Electropedia - www.electropedia.org

Le premier dictionnaire d'électrotechnologie en ligne au monde, avec plus de 22 000 articles terminologiques en anglais et en français, ainsi que les termes équivalents dans 16 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

Glossaire IEC - std.iec.ch/glossary

67 000 entrées terminologiques électrotechniques, en anglais et en français, extraites des articles Termes et Définitions des publications IEC parues depuis 2002. Plus certaines entrées antérieures extraites des publications des CE 37, 77, 86 et CISPR de l'IEC.

INTERNATIONAL STANDARD

NORME INTERNATIONALE



**Fibre-optic communication subsystem test procedures –
Part 4-5: Installed cabling plant – Attenuation measurement of MPO terminated
fibre optic cabling plant using test equipment with MPO interfaces**

IEC 61280-4-5:2020

**Procédures d'essai des sous-systèmes de télécommunication fibroniques –
Partie 4-5: Installation câblée – Mesurage de l'affaiblissement de l'installation
câblée à fibres optiques à terminaisons MPO utilisant un équipement d'essai
avec interfaces MPO**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

ICS 33.180.01

ISBN 978-2-8322-9165-8

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

CONTENTS

FOREWORD.....	7
1 Scope.....	9
2 Normative references	9
3 Terms, definitions, graphical symbols and abbreviated terms.....	10
3.1 Terms and definitions.....	10
3.2 Graphical symbols	12
3.3 Abbreviated terms.....	14
4 Test methods.....	14
4.1 General.....	14
4.2 Cabling configurations and applicable test methods	15
5 Overview of uncertainties	16
5.1 General.....	16
5.2 Sources of significant uncertainties.....	16
5.3 Consideration of the PM.....	17
5.4 Consideration of test cord connector grade	17
5.5 Typical uncertainty values for multimode testing	17
5.6 Typical uncertainty values for single-mode testing	19
6 Apparatus.....	20
6.1 General.....	20
6.2 Light source	20
6.2.1 General	20
6.2.2 Stability	20
6.2.3 Spectral characteristics (LSPM measurement).....	21
6.3 Launch cord.....	21
6.4 Receive or tail cord.....	22
6.5 Substitution cord.....	22
6.6 Adapter cord	23
6.7 Power meter – LSPM methods only.....	23
6.8 OTDR apparatus.....	24
6.9 Connector end face cleaning and inspection equipment	24
6.10 Adapters	24
7 Procedures.....	24
7.1 General.....	24
7.2 Common procedures.....	25
7.2.1 Care of the test cords	25
7.2.2 Take reference measurements.....	25
7.2.3 Inspect and clean the ends of the optical fibres in the cabling.....	25
7.2.4 Take the measurements	25
7.2.5 Make the calculations	25
7.2.6 Multi-fibre and bi-directional testing	25
7.3 Calibration	26
7.4 Safety	26
8 Calculations.....	26
9 Documentation	26
9.1 Information for each test	26
9.2 Information to be available.....	26

ITeH STANDARD PREVIEW

(standards.iteh.ai)

IEC 61280-4-5:2020

<https://standards.iteh.ai/catalog/standards/sist/68ec8849-f8a4-4d47-8530-2a1879ee400b/iec-61280-4-5-2020>

Annex A (normative) One-cord method	27
A.1 Applicability of the test method	27
A.2 Apparatus	27
A.3 Procedure for unpinned to unpinned cabling with unpinned power meter.....	27
A.4 Procedure for unpinned to pinned cabling with unpinned power meter	28
A.5 Procedure for pinned to pinned cabling with pinned power meter	29
A.6 Procedure for unpinned to unpinned cabling with pinned power meter and gender-neutral test cord	30
A.7 Calculation.....	31
A.8 Components of reported attenuation	31
Annex B (normative) Three-cord method.....	32
B.1 Applicability of the test method	32
B.2 Apparatus	32
B.3 Procedure for unpinned to unpinned cabling	32
B.4 Procedure for unpinned to pinned cabling	33
B.5 Procedure for pinned to pinned cabling	34
B.6 Procedure, channel test (general)	35
B.7 Calculations	36
B.8 Components of reported attenuation	36
Annex C (normative) Adapter-cord method	37
C.1 Applicability of the test method	37
C.2 Apparatus	37
C.3 Procedure for unpinned to unpinned cabling with pinned power meter	37
C.4 Procedure for unpinned to pinned cabling with pinned power meter	38
C.5 Procedure for pinned to unpinned cabling with unpinned power meter	39
C.6 Procedure for pinned to pinned cabling with unpinned power meter	40
C.7 Calculations	41
C.8 Components of reported attenuation	42
Annex D (normative) Equipment cord method	43
D.1 Applicability of the test method	43
D.2 Apparatus	43
D.3 Procedure	43
D.4 Calculation.....	44
D.5 Components of reported attenuation	44
D.6 Typical uncertainty values.....	45
Annex E (normative) Optical time domain reflectometer	46
E.1 Applicability of the test method	46
E.2 Apparatus	46
E.2.1 General	46
E.2.2 OTDR	46
E.2.3 Test cords	47
E.3 Procedure (test method)	47
E.4 Calculation.....	48
E.4.1 General	48
E.4.2 Connection location	48
E.4.3 Definition of the power levels F_1 and F_2	49
E.4.4 Alternative calculation.....	50
E.5 OTDR uncertainties	52

Annex F (normative) Requirements for the multimode source characteristics	53
Annex G (informative) OTDR configuration information	54
G.1 General.....	54
G.2 Other measurement configurations	54
G.2.1 General	54
G.2.2 Measurement with low return loss connectors or short length cabling	54
G.2.3 Measurement with APC connectors	56
Annex H (informative) Test cord, breakout cord, and cassette attenuation verification	58
H.1 General.....	58
H.2 Apparatus	58
H.3 General procedure	58
H.3.1 Overview	58
H.3.2 Test cord verification	59
H.3.3 Cassette and breakout cord verification	60
H.4 Test cord verification prior to cabling measurement	61
H.4.1 General	61
H.4.2 Procedure for unpinned to unpinned cabling measurement	61
H.4.3 Procedure for unpinned to pinned cabling measurement.....	62
H.4.4 Procedure for pinned to pinned cabling measurement.....	63
Annex I (normative) On the use of low attenuation grade test cords.....	66
I.1 General.....	66
I.2 Practical configurations and assumptions.....	66
I.2.1 Component specifications.....	66
I.2.2 Conventions	67
I.2.3 Reference planes	67
I.3 Impact of using low attenuation grade test cords for recommended LSPM methods.....	68
I.4 Examples for LSPM measurements.....	68
I.4.1 Example 1: Configuration Au-u, 1-C method (Annex A).....	68
I.4.2 Example 2: Configuration Du-u, EC method (Annex D)	69
I.5 Impact of using reference grade test cords for different configurations using the OTDR test method	69
I.5.1 Cabling configurations Au-u, Ap-u and Ap-p	69
I.5.2 Cabling configuration Du-u	70
Bibliography.....	72
Figure 1 – Connector and apparatus symbols	13
Figure 2 – Symbol for cabling under test.....	14
Figure 3 – OTDR schematic with external optical switch	24
Figure A.1 – Reference measurement for unpinned to unpinned cabling using unpinned power meter.....	28
Figure A.2 – Test measurement for unpinned to unpinned cabling using unpinned power meter.....	28
Figure A.3 – Reference measurement for unpinned to pinned cabling using unpinned power meter.....	29
Figure A.4 – Test measurement for unpinned to pinned cabling using unpinned power meter.....	29
Figure A.5 – Reference measurement for pinned to pinned cabling using pinned power meter.....	30

Figure A.6 – Test measurement for pinned to pinned cabling using pinned power meter	30
Figure A.7 – Reference measurement for unpinned to unpinned cabling using pinned power meter.....	31
Figure A.8 – Test measurement for unpinned to unpinned cabling (gender-neutral TC1) using pinned power meter.....	31
Figure B.1 – Reference measurement for unpinned to unpinned cabling using pinned power meter.....	33
Figure B.2 – Test measurement for unpinned to unpinned cabling using pinned power meter.....	33
Figure B.3 – Reference measurement for unpinned to pinned cabling using pinned power meter.....	34
Figure B.4 – Test measurement for unpinned to pinned cabling using pinned power meter.....	34
Figure B.5 – Reference measurement for pinned to pinned cabling using unpinned power meter.....	35
Figure B.6 – Test measurement for pinned to pinned cabling using unpinned power meter.....	35
Figure B.7 – Reference measurement for channel test using unpinned power meter	36
Figure B.8 – Test measurement for channel test using unpinned power meter	36
Figure C.1 – Reference measurement for unpinned to unpinned cabling using pinned power meter.....	38
Figure C.2 – Test measurement for unpinned to unpinned cabling using pinned power meter.....	38
Figure C.3 – Reference measurement for unpinned to pinned cabling using pinned power meter.....	39
Figure C.4 – Test measurement for unpinned to pinned cabling using pinned power meter.....	39
Figure C.5 – Reference measurement for unpinned to pinned cabling using unpinned power meter.....	40
Figure C.6 – Test measurement for unpinned to pinned cabling using unpinned power meter.....	40
Figure C.7 – Reference measurement for unpinned to pinned cabling using unpinned power meter.....	41
Figure C.8 – Test measurement for unpinned to pinned cabling using unpinned power meter.....	41
Figure D.1 – Reference measurement using pinned power meter.....	44
Figure D.2 – Test measurement using pinned power meter	44
Figure E.1 – OTDR method.....	48
Figure E.2 – Location of the ports of the cabling under test.....	49
Figure E.3 – Graphic construction of F_1 and F_2	50
Figure E.4 – Graphic construction of F_1 , F_{11} , F_{12} and F_2	51
Figure G.1 – Attenuation measurement with low return loss connectors	55
Figure G.2 – Attenuation measurement of a short length cabling.....	56
Figure G.3 – Attenuation measurement with APC MPO connections	57
Figure H.1 – Obtaining reference power level P_1	59
Figure H.2 – Obtaining power level P_2	59
Figure H.3 – Obtaining reference power level P_1	60

Figure H.4 – Obtaining power level P_2	60
Figure H.5 – Test measurement for unpinned to unpinned cabling	61
Figure H.6 – Step 1: obtaining reference power level P_1	61
Figure H.7 – Step 2: verification cords, obtaining power level P_2	62
Figure H.8 – Test measurement for unpinned to pinned cabling	62
Figure H.9 – Step 1: obtaining reference power level P_1	63
Figure H.10 – Step 2: obtaining power level P_2	63
Figure H.11 – Test measurement for pinned to pinned cabling	63
Figure H.12 – Step 1: obtaining reference power level P_1	64
Figure H.13 – Step 2: verification of cords, obtaining power level P_2	64
Figure H.14 – Step 3: verification of receive cord, obtaining power level P_3	65
Figure I.1 – Cabling configurations Au-u, Ap-u and Ap-p tested with OTDR method	69
Figure I.2 – Cabling configuration Du-u tested with OTDR method	71
Table 1 – Cabling configurations	16
Table 2 – Test methods and configurations	16
Table 3 – Measurements bias related to test cord connector grade	17
Table 4 – Uncertainty for a given attenuation at 850 nm using same photodetector	18
Table 5 – Uncertainty for a given attenuation at 850 nm using different photodetectors	19
Table 6 – Uncertainty for a given attenuation at 1 310 nm using same photodetector	19
Table 7 – Uncertainty for a given attenuation at 1 310 nm using different photodetectors	20
Table 8 – Spectral requirements	21
Table D.1 – Uncertainty for a given attenuation when equipment cord method is used	45
Table I.1 – Measurement bias adjustment when using low attenuation grade test cords	68
Table I.2 – Acceptance figure adjustment using low attenuation grade test cords – OTDR method	70

INTERNATIONAL ELECTROTECHNICAL COMMISSION

FIBRE-OPTIC COMMUNICATION SUBSYSTEM TEST PROCEDURES –**Part 4-5: Installed cabling plant –
Attenuation measurement of MPO terminated fibre
optic cabling plant using test equipment with MPO interfaces**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61280-4-5 has been prepared by subcommittee 86C: Fibre optic systems and active devices, of IEC technical committee 86: Fibre optics.

The text of this International Standard is based on the following documents:

FDIS	Report on voting
86C/1669/FDIS	86C/1679/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

A list of all the parts in the IEC 61280 series, under the general title *Fibre-optic communication subsystem test procedures*, can be found on the IEC website.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[IEC 61280-4-5:2020](#)

<https://standards.iteh.ai/catalog/standards/sist/68ec8849-f8a4-4d47-8530-2a1879ee400b/iec-61280-4-5-2020>

FIBRE-OPTIC COMMUNICATION SUBSYSTEM TEST PROCEDURES –

Part 4-5: Installed cabling plant – Attenuation measurement of MPO terminated fibre optic cabling plant using test equipment with MPO interfaces

1 Scope

This part of IEC 61280 is applicable to the measurement of attenuation and determination of polarity and length of installed multimode and single-mode optical fibre cabling plant, terminated with MPO connectors, using test equipment having an MPO interface. This cabling plant can include multimode or single-mode optical fibres, connectors, adapters, splices, and other passive devices. The cabling can be installed in a variety of environments including residential, commercial, industrial, and data centre premises, as well as outside plant environments.

In this document, the optical fibres that are addressed include sub-categories A1-OM_x, where $x = 2, 3, 4$ and 5 (50/125 μm) multimode optical fibres, as specified in IEC 60793-2-10, and category B-652 and B-657 (9/125 μm) single-mode optical fibres, as specified in IEC 60793-2-50. The attenuation measurements of the other multimode and single-mode categories can also be made using a light source and power meter (LSPM) or optical time domain reflectometer (OTDR) utilising an internal or external optical switch having one MPO interface. Multimode measurements are made with an 850 nm source because transceivers used for parallel optics applications having an MPO interface only operate at 850 nm; 1 300 nm measurements are optional. Single-mode measurements are made with a 1 310 nm and/or 1 550 nm source because transceivers used for parallel optics applications having an MPO interface operate at these wavelengths. This document does not include descriptions of cabling that is not exclusively MPO to MPO.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60825 (all parts), *Safety of laser products*

IEC 61280-1-3, *Fibre optic communication subsystem test procedures – Part 1-3: General communication subsystems – Central wavelength and spectral width measurement*

IEC 61280-4-1:2019, *Fibre-optic communication subsystem test procedures – Part 4-1: Installed cabling plant – Multimode attenuation measurement*

IEC 61300-3-35, *Fibre optic interconnecting devices and passive components – Basic test and measurement procedures – Part 3-35: Examinations and measurements – Visual inspection of fibre optic connectors and fibre-stub transceivers*

IEC 61315, *Calibration of fibre-optic power meters*

IEC 61746-1, *Calibration of optical time-domain reflectometers (OTDR) – Part 1: OTDR for single mode fibres*

IEC 61746-2, *Calibration of optical time-domain reflectometers (OTDR) – Part 2: OTDR for multimode fibres*

3 Terms, definitions, graphical symbols and abbreviated terms

For the purposes of this document, the following terms, definitions, graphical symbols and abbreviated terms apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1 Terms and definitions

3.1.1

adapter

female-part of a connector in which one or two plugs are inserted and aligned

[SOURCE: IEC TR 61931:1998, 2.6.4]

3.1.2

alternative test method

ATM

test method for measuring a given characteristic in a manner consistent with the definition of this characteristic, and giving results which are reproducible and relatable to the reference test method and to practical use

<https://standards.iteh.ai/catalog/standards/sist/68ec8849-f8a4-4d47-8530-2a1629cc4000/iec-61280-4-5-2020>

[SOURCE: IEC TR 61931:1998, 2.8.2, modified – The alternative term "practical test method (for optical fibres)" has been removed.]

3.1.3

attenuation

A

reduction of optical power induced by transmission through a medium such as cabling, given as *A*:

$$A = 10 \log_{10}(P_{in}/P_{out})$$

where

P_{in} and P_{out} are the power, typically measured in mW, into and out of the cabling

Note 1 to entry: Attenuation is expressed in dB.

3.1.4

bi-directional measurement

two measurements of the same optical fibre made by launching light into opposite ends of that fibre

3.1.5

channel

end-to-end transmission path connecting any two pieces of application-specific equipment

[SOURCE: ISO/IEC 11801-1:2017, 3.1.26]

3.1.6 configuration

form or arrangements of parts or elements such as terminations, connections and splices

3.1.7 connector

component normally attached to an optical cable or piece of apparatus for the purpose of providing frequent optical interconnection/disconnection of optical fibres or cables

[SOURCE: IEC TR 61931:1998, 2.6.1, modified – The words in brackets "optical" and "fibre" have been omitted from the term.]

3.1.8 encircled flux EF

fraction of cumulative near-field power to total output power as a function of radial distance from the optical centre of the core

[SOURCE: IEC TR 62614-2:2015, 3.3, modified – The words "radial-weighted" have been deleted from the definition.]

3.1.9 light source power meter LSPM

test system consisting of a light source (LS) and power meter (PM) used to measure the attenuation of installed cabling plant

3.1.10 low attenuation grade

connector and plug whose attenuation of a connection formed by mating two such assemblies is lower and more repeatable than a "standard grade" termination (grade B in this document)

Note 1 to entry: An adapter required to assure the reduced attenuation can be considered to be part of the low attenuation grade where required by the test configuration.

3.1.11 measurement bias

estimate of a systematic measurement error

Note 1 to entry: A systematic error is a component of measurement error that in repeated measurements remains constant or varies in a predictable manner.

[SOURCE: ISO/IEC Guide 99:2007, 2.18, modified – Note 1 to entry has been added.]

3.1.12 MPO connector

multi-fibre component consisting of pinned or unpinned plug and mating adapter, normally attached to an optical fibre cable, for the purpose of providing high density termination capability, and frequent interconnection or disconnection

Note 1 to entry: See IEC 61754-7 (all parts) for description.

3.1.13 optical switch

passive component processing one or more ports which selectively transmits, redirects or blocks optical power in an optical fibre transmission line

[SOURCE: IEC 60876-1:2014, 3.2.1]

3.1.14
optical time domain reflectometer
OTDR

test system consisting of an optical time-domain reflectometer used to characterize and measure the attenuation of installed cabling plant and specific elements within that cabling plant

3.1.15
plug
male-type part of a connector

[SOURCE: IEC TR 61931:1998, 2.6.2]

3.1.16
polarity
means of positioning optical fibres between MPO plugs to ensure a specific connectivity or mapping of the cabling

3.1.17
reference plane
theoretical plane without thickness or tolerances

Note 1 to entry: The reference plane is used to define spaces in mechanical structures.

[SOURCE: IEC 60050-581:2008, 581-25-30]

3.1.18
reference test method
RTM

test method for measuring a given characteristic strictly according to the definition of this characteristic, and giving results which are accurate, reproducible and relatable to practical use

[SOURCE: IEC TR 61931:1998, 2.8.1, modified – The words in brackets "for optical fibres" have been omitted from the term.]

3.1.19
test cord
terminated optical fibre cord used to connect the optical source or detector to the cabling, or to provide suitable interfaces to the cabling under test

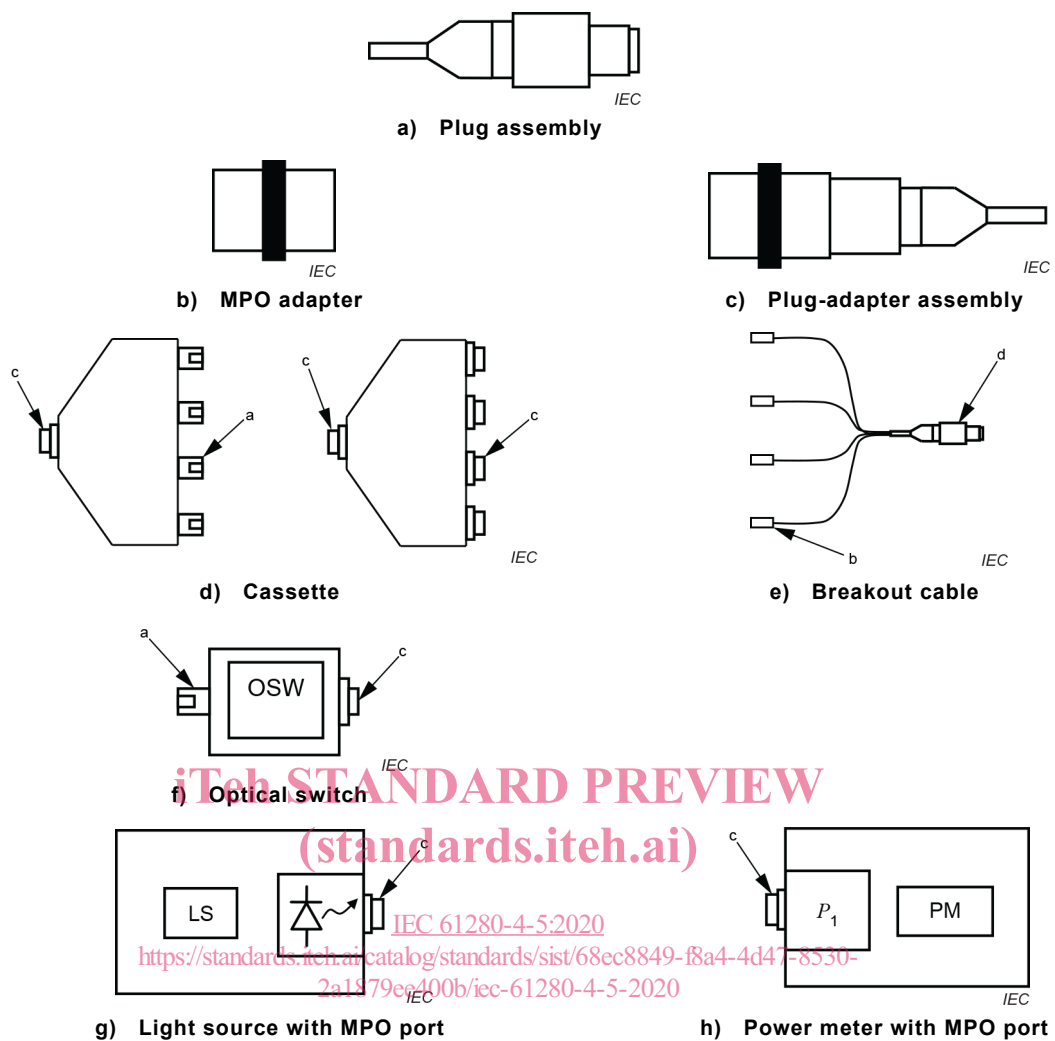
Note 1 to entry: There are five types of test cords:

- launch cord: used to connect the light source to the cabling;
- receive cord: used to connect the cabling to the power meter (LSPM only);
- tail cord: attached to the far end of the cabling when an OTDR is used at the near end; this provides a means of evaluating attenuation of the whole of the cabling including the far end connection;
- adapter cord: used to transition between incompatible connectors in a required test configuration;
- substitution cord: a test cord used within a reference measurement which is replaced during the measurement of the attenuation of the cabling under test.

3.2 Graphical symbols

Graphical symbols for different connection options, which have been adapted from IEC TR 61282-15 and IEC 61280-4-1, and illustrate plug variability, are shown in Figure 1 a) to h). Refer to IEC TR 61930 for other graphical symbols used within this document.

NOTE Low attenuation MPO plugs are terminated on test cords but not marked or shaded differently in the graphical symbols or in testing examples within this document.

**Key**

a	single-fibre socket	d	MPO plug assembly
b	single-fibre plug	LS	light source
c	MPO adapter/socket	PM	power meter

NOTE In the figures above, the MPO plugs and jacks are shown generically, neither as pinned nor unpinned, and neither as key-up nor key-down, for simplicity.

Figure 1 – Connector and apparatus symbols

In the figures that illustrate the measurement configurations in Annexes A through C, the cabling under test is illustrated by a loop and connectors as shown in Figure 2. It can contain additional splices and connectors. For purposes of measuring the attenuation of this cabling, the attenuation associated with the near and far end connectors are considered separately from the cabling itself.

In Figure 2, the cabling is shown with adapters pre-attached.