
**Plastics piping systems for renovation of
underground water supply networks —**

**Part 1:
General**

*Systèmes de canalisations en matières plastiques pour la rénovation
des réseaux enterrés d'alimentation en eau —*

Partie 1: Généralités

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 11298-1:2010

<https://standards.iteh.ai/catalog/standards/sist/59995faa-4a23-4918-924b-2a5786ec2e45/iso-11298-1-2010>



Reference number
ISO 11298-1:2010(E)

PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 11298-1:2010

<https://standards.iteh.ai/catalog/standards/sist/59995faa-4a23-4918-924b-2a5786ec2e45/iso-11298-1-2010>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2010

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword	v
Introduction.....	vi
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
3.1 General	1
3.2 Techniques.....	3
3.3 Geometrics	4
3.4 Materials	5
3.5 Product stages.....	6
3.6 Service conditions.....	6
3.7 Joints	6
4 Symbols and abbreviated terms	6
4.1 Symbols.....	6
4.2 Abbreviated terms	7
5 Pipes at the “M” stage	7
5.1 Materials	7
5.2 General characteristics.....	7
5.3 Material characteristics.....	7
5.4 Geometric characteristics	7
5.5 Mechanical characteristics.....	7
5.6 Physical characteristics.....	7
5.7 Jointing.....	7
5.8 Marking.....	8
6 Fittings at the “M” stage	8
6.1 Materials	8
6.2 General characteristics.....	8
6.3 Material characteristics.....	8
6.4 Geometric characteristics	8
6.5 Mechanical characteristics.....	8
6.6 Physical characteristics.....	9
6.7 Jointing.....	9
6.8 Marking.....	9
7 Ancillary components	9
8 Fitness for purpose of the installed lining system at the “I” stage	9
8.1 Materials	9
8.2 General characteristics.....	10
8.3 Material characteristics.....	10
8.4 Geometric characteristics	10
8.5 Mechanical characteristics.....	10
8.6 Physical characteristics.....	11
8.7 Additional characteristics.....	11
8.8 Sampling.....	11
9 Installation practice	11
9.1 Preparatory work	11
9.2 Storage, handling and transport of pipes and fittings	11
9.3 Equipment	11

9.4 Installation12

9.5 Process-related inspection and testing13

9.6 Lining termination.....13

9.7 Reconnection to the existing pipeline system13

9.8 Final inspection and testing13

9.9 Documentation.....13

Bibliography14

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 11298-1:2010
<https://standards.iteh.ai/catalog/standards/sist/59995faa-4a23-4918-924b-2a5786ec2e45/iso-11298-1-2010>

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 11298-1 was prepared by Technical Committee ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*.

ISO 11298 consists of the following parts, under the general title *Plastics piping systems for renovation of underground water supply networks*:

— Part 1: General

[ISO 11298-1:2010](https://standards.iteh.ai/catalog/standards/sist/59995faa-4a23-4918-924b-2a5786ec2e45/iso-11298-1-2010)

— Part 3: Lining with close-fit pipes

<https://standards.iteh.ai/catalog/standards/sist/59995faa-4a23-4918-924b-2a5786ec2e45/iso-11298-1-2010>

Lining with continuous pipes is to form the subject of a part 2; lining with cured-in-place pipes is to form the subject of a part 4; lining with adhesive-backed hoses is to form the subject of a part 6.

Introduction

This part of ISO 11298 is a part of a System Standard for plastics piping systems of various materials used for the renovation of existing pipelines in a specified application area. System Standards for renovation deal with the following applications:

- Plastics piping systems for renovation of underground non-pressure drainage and sewerage networks;
- Plastics piping systems for renovation of underground water supply networks;
- Plastics piping systems for renovation of underground gas supply networks;
- Plastics piping systems for renovation of underground drainage and sewerage networks under pressure.

These System Standards are distinguished from those for conventionally installed plastics piping systems by the requirement to verify certain characteristics in the as-installed condition, after site processing. This is in addition to specifying requirements for plastics piping system components as manufactured.

This System Standard comprises a:

- Part 1: General

and all applicable renovation technique family-related parts from the following:

- Part 2: Lining with continuous pipes [ISO 11298-1:2010](https://standards.iteh.ai/catalog/standards/sist/59995faa-4a23-4918-924b-2a5786ec2e45/iso-11298-1-2010)
- Part 3: Lining with close-fit pipes <https://standards.iteh.ai/catalog/standards/sist/59995faa-4a23-4918-924b-2a5786ec2e45/iso-11298-1-2010>
- Part 4: Lining with cured-in-place pipes
- Part 6: Lining with adhesive-backed hoses

The requirements for any given renovation technique family are given in part 1, applied in conjunction with the relevant other part. For example, this part of ISO 11298 and ISO 11298-3 together specify the requirements relating to lining with close-fit pipes. For complementary information, see ISO 11295. Not all technique families are pertinent to every area of application and this is reflected in the part numbers included in each System Standard.

A consistent structure of clause headings has been adopted for all parts of ISO 11298, in order to facilitate direct comparisons across renovation technique families.

Figure 1 shows the common part and clause structure and the relationship between ISO 11298 and the System Standards for other application areas.

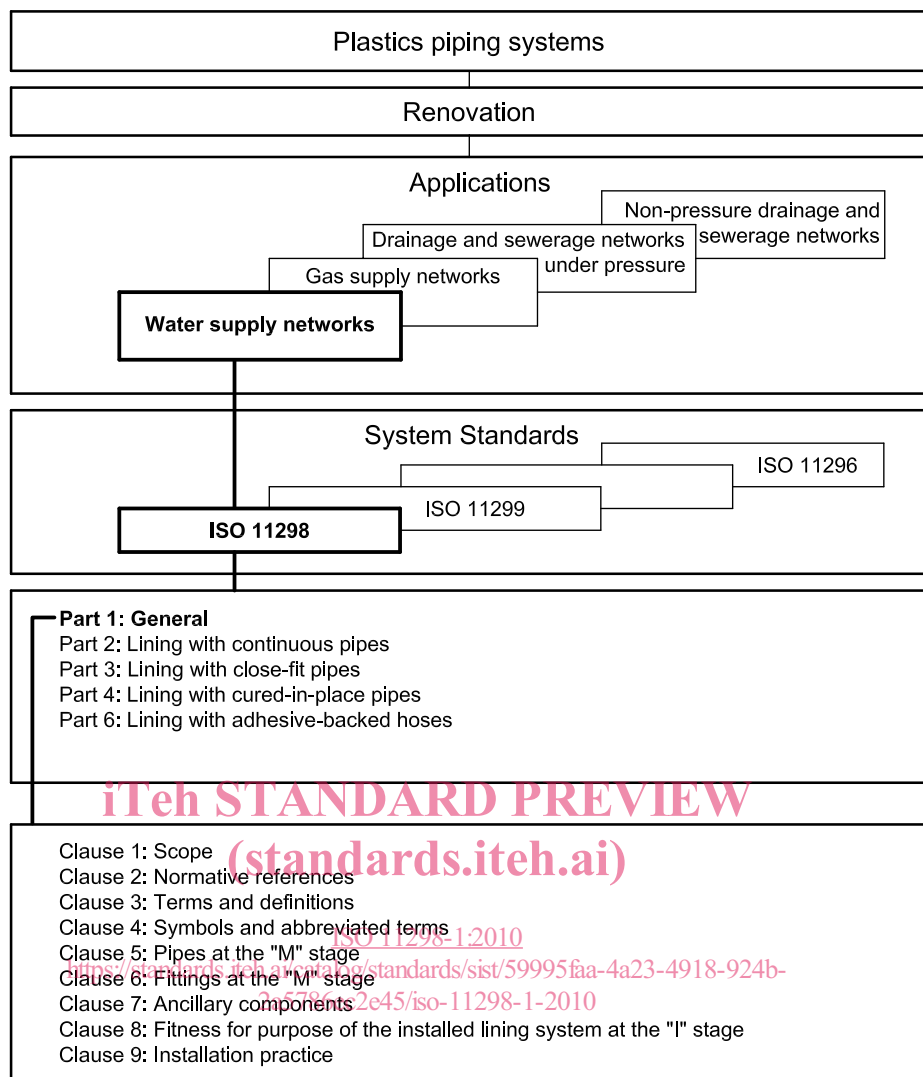


Figure 1 — Format of the renovation System Standards

iTeh STANDARD PREVIEW **(standards.iteh.ai)**

ISO 11298-1:2010

<https://standards.iteh.ai/catalog/standards/sist/59995faa-4a23-4918-924b-2a5786ec2e45/iso-11298-1-2010>

Plastics piping systems for renovation of underground water supply networks —

Part 1: General

1 Scope

This part of ISO 11298 specifies the requirements and test methods for plastics piping systems intended to be used for the renovation of underground water supply networks, which transport water intended for human consumption, including raw water intake pipelines. It is applicable to pipes and fittings, as manufactured, as well as to the installed lining system. It is not applicable to cover sprayed coatings, the existing pipeline or any annular filler.

This part of ISO 11298 gives the general requirements common to all relevant renovation techniques.

2 Normative references (standards.iteh.ai)

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 681-1, *Elastomeric seals — Material requirements for pipe joint seals used in water and drainage applications — Part 1: Vulcanized rubber*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1 General

3.1.1

pipeline system

interconnecting pipe network for the conveyance of fluids

3.1.2

rehabilitation

all measures for restoring or upgrading the performance of an existing pipeline system

3.1.3

renovation

work incorporating all or part of the original fabric of the pipeline, by means of which its current performance is improved

3.1.4

replacement

rehabilitation of an existing pipeline system by the installation of a new pipeline system, without incorporating the original fabric

3.1.5

maintenance

keeping an existing pipeline system operational without the installation of additional fabric

3.1.6

repair

rectification of local damage

3.1.7

lining pipe

pipe inserted for renovation purposes

3.1.8

liner

lining pipe after installation

3.1.9

lining system

lining pipe and all relevant fittings for insertion into an existing pipeline for the purposes of renovation

3.1.10

renovated pipeline system

existing pipeline system plus the installed lining system used to renovate it, as well as any grout or other annular filling material used

3.1.11

characteristic

property, dimension or other feature of a material or component

3.1.12

declared value

limiting value of a characteristic declared in advance by the lining system supplier, which becomes the requirement for the purposes of assessment of conformity

3.1.13

annular filler

material for grouting annular space between existing pipeline and lining system

3.1.14

grouting

process of filling voids around the lining system

3.1.15

system test pressure

hydrostatic pressure applied to the installed pipeline system in order to ensure its integrity and leaktightness

3.1.16

simulated installation

installation of a lining system into a simulated host pipeline, using representative equipment and processes, to provide samples for testing which are representative of an actual installation

iTeh STANDARD PREVIEW

(standards.iteh.ai)

ISO 11298-1:2010

[https://standards.iteh.ai/catalog/standards/sist/59995faa-4a23-4918-924b-](https://standards.iteh.ai/catalog/standards/sist/59995faa-4a23-4918-924b-2a5786ec2e45/iso-11298-1-2010)

[2a5786ec2e45/iso-11298-1-2010](https://standards.iteh.ai/catalog/standards/sist/59995faa-4a23-4918-924b-2a5786ec2e45/iso-11298-1-2010)

3.1.17**simulated host pipeline**

section of pipeline, which is not part of an operational network, but which replicates the environment of an operational network

3.1.18**technique family**

group of renovation techniques which are considered to have common characteristics for standardization purposes

3.1.19**independent pressure pipe liner**


liner which is capable on its own of resisting without failure all applicable internal loads throughout its design life

3.1.20**interactive pressure pipe liner**

liner which relies on the host pipe for some measure of radial support in order to resist without failure all applicable internal loads throughout its design life

3.2 Techniques

The various techniques for renovation of underground water supply networks, within the scope of pipeline rehabilitation techniques generally, are shown schematically in Figure 2. For definitions of standardized renovation techniques shown in Figure 2, but outside the scope of this part of ISO 11298, see ISO 11295.

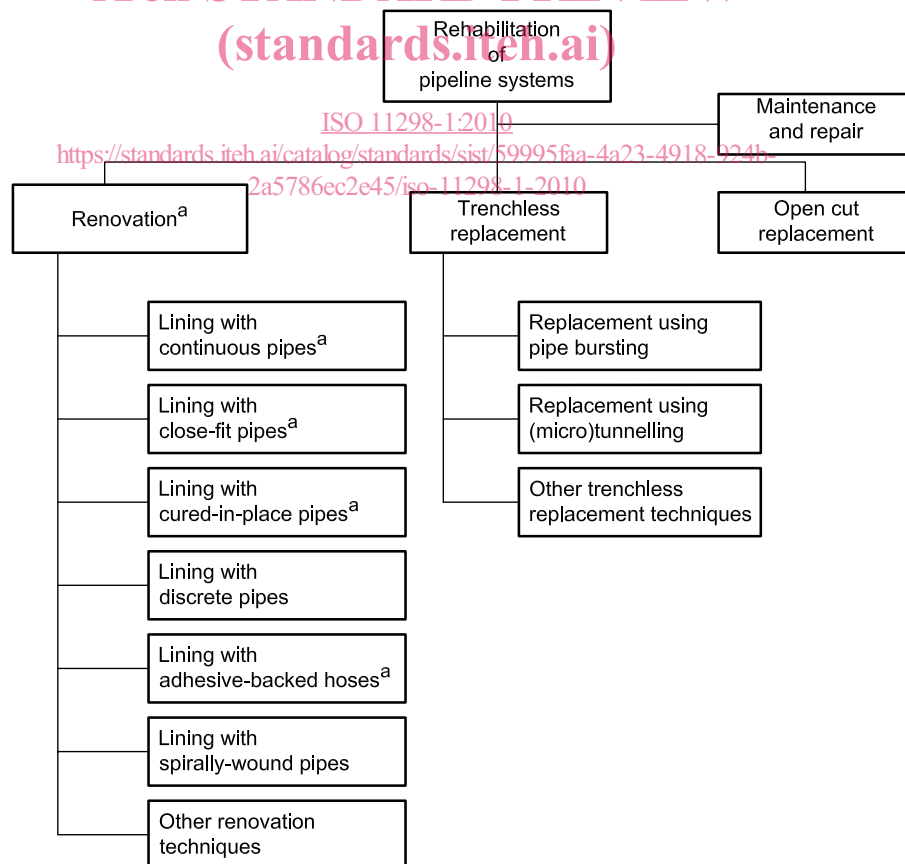

^a This part of ISO 11298 is applicable.

Figure 2 — Technique families for renovation of underground water supply networks using plastics pipes, within the scope of pipeline rehabilitation techniques