
Električna varnost v nizkonapetostnih razdelilnih sistemih izmenične napetosti do 1 kV in enosmerne napetosti do 1,5 kV - Oprema za preskušanje, merjenje ali nadzorovanje zaščitnih ukrepov - 15. del: Zahteve za funkcionalno varnost za naprave za nadzorovanje izolacije in opremo za ugotavljanje mesta izolacijske okvare v sistemih IT (IEC 61557-15:2014)

Electrical safety in low voltage distribution systems up to 1 000 V a.c. and 1 500 V d.c. - Equipment for testing, measuring or monitoring of protective measures - Part 15: Functional safety requirements for insulation monitoring devices and for equipment for insulation fault location in IT systems (IEC 61557-15:2014)

Elektrische Sicherheit in Niederspannungsnetzen bis AC 1 000 V und DC 1 500 V - Geräte zum Prüfen, Messen oder Überwachen von Schutzmaßnahmen - Teil 15: Anforderungen zur Funktionalen Sicherheit von Isolationsüberwachungsgeräten in IT-Systemen und von Einrichtungen zur Isolationsfehlersuche in IT-Systemen (IEC 61557-15:2014)

Sécurité électrique dans les réseaux de distribution basse tension de 1 000 V c.a. et 1 500 V c.c. - Dispositifs de contrôle, de mesure ou de surveillance de mesures de protection - Partie 15: Exigences de sécurité fonctionnelle pour les contrôleurs d'isolement de réseaux IT et les dispositifs de localisation de défauts d'isolement pour réseaux IT (CEI 61557-15:2014)

Ta slovenski standard je istoveten z: EN 61557-15:2014

ICS:

17.220.20	Merjenje električnih in magnetnih veličin	Measurement of electrical and magnetic quantities
29.080.01	Električna izolacija na splošno	Electrical insulation in general
29.240.01	Omrežja za prenos in distribucijo električne energije na splošno	Power transmission and distribution networks in general

SIST EN 61557-15:2014

en

ITeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 61557-15:2014](https://standards.iteh.ai/catalog/standards/sist/a85abc38-4e8f-4581-ad18-9829ac9aa8eb/sist-en-61557-15-2014)

<https://standards.iteh.ai/catalog/standards/sist/a85abc38-4e8f-4581-ad18-9829ac9aa8eb/sist-en-61557-15-2014>

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 61557-15:2014](#)

<https://standards.iteh.ai/catalog/standards/sist/a85abe38-4e8f-4581-ad18-9829ac9aa8eb/sist-en-61557-15-2014>

EUROPEAN STANDARD

EN 61557-15

NORME EUROPÉENNE

EUROPÄISCHE NORM

May 2014

ICS 17.220.20; 29.080.01; 29.240.01

English Version

Electrical safety in low voltage distribution systems up to 1 000 V a.c. and 1 500 V d.c. - Equipment for testing, measuring or monitoring of protective measures - Part 15: Functional safety requirements for insulation monitoring devices in IT systems and equipment for insulation fault location in IT systems
(IEC 61557-15:2014)

Sécurité électrique dans les réseaux de distribution basse tension de 1 000 V c.a. et 1 500 V c.c. - Dispositifs de contrôle, de mesure ou de surveillance de mesures de protection - Partie 15: Exigences de sécurité fonctionnelle pour les contrôleurs d'isolement de réseaux IT et les dispositifs de localisation de défauts d'isolement pour réseaux IT
(CEI 61557-15:2014)

Elektrische Sicherheit in Niederspannungsnetzen bis AC 1 000 V und DC 1 500 V - Geräte zum Prüfen, Messen oder Überwachen von Schutzmaßnahmen - Teil 15: Anforderungen zur Funktionalen Sicherheit von Isolationsüberwachungsgeräten in IT-Systemen und von Einrichtungen zur Isolationsfehlersuche in IT-Systemen
(IEC 61557-15:2014)

iteh STANDARD PREVIEW
(standards.iteh.ai)

This European Standard was approved by CENELEC on 2014-03-19. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.
<https://standards.iteh.ai/catalog/standards/sist/a85abe38-4e8f-4581-ad18->

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

Foreword

The text of document 85/465/FDIS, future edition 1 of IEC 61557-15, prepared by IEC/TC 85 "Measuring equipment for electrical and electromagnetic quantities" was submitted to the IEC-CENELEC parallel vote and approved by CENELEC as EN 61557-15:2014.

The following dates are fixed:

- latest date by which the document has to be implemented at national level by publication of an identical national standard or by endorsement (dop) 2014-12-19
- latest date by which the national standards conflicting with the document have to be withdrawn (dow) 2017-03-19

This standard is to be used in conjunction with EN 61557-8 and EN 61557-9.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC [and/or CEN] shall not be held responsible for identifying any or all such patent rights.

This standard covers the Principle Elements of the Safety Objectives for Electrical Equipment Designed for Use within Certain Voltage Limits (LVD).

Endorsement notice

The text of the International Standard IEC 61557-15:2014 was approved by CENELEC as a European Standard without any modification.

In the official version, for Bibliography, the following notes have to be added for the standards indicated:

IEC 60300-3-1	NOTE	Harmonized as EN 60300-3-1.
IEC 60335-1:2001	NOTE	Harmonized as EN 60335-1:2002 ¹⁾ (not modified).
IEC 60335-1:2001/A1:2004	NOTE	Harmonized as EN 60335-1:2002/A1:2004 ¹⁾ (not modified).
IEC 60335-1:2001/A2:2006 + Corr. 08-2006	NOTE	Harmonized as EN 60335-1:2002/A2:2006 ¹⁾ (not modified).
IEC 60364-4-41:2005	NOTE	Harmonized as HD 60364-4-41:2007 (modified).
IEC 60364-5-55:2011	NOTE	Harmonized as HD 60364-5-55:2012 (modified).
IEC 60364-7-710:2002	NOTE	Harmonized as HD 60364-7-710:2012 (modified).
IEC 60730-1:2010	NOTE	Harmonized as EN 60730-1:2011 (modified).
IEC 60812:2006	NOTE	Harmonized as EN 60812:2006 (not modified).
IEC 61010-1:2010 + Corr. 05-2011	NOTE	Harmonized as EN 61010-1:2010 (not modified).
IEC 61025	NOTE	Harmonized as EN 61025.
IEC 61078	NOTE	Harmonized as EN 61078.
IEC 61165	NOTE	Harmonized as EN 61165.
IEC 61508-7:2010	NOTE	Harmonized as EN 61508-7:2010 (not modified).
IEC 61709:1996	NOTE	Harmonized as EN 61709:1998 ²⁾ (not modified).
IEC 61784-3:2007	NOTE	Harmonized as EN 61784-3:2008 ³⁾ (not modified).
IEC 61800-5-2:2007	NOTE	Harmonized as EN 61800-5-2:2007 (not modified).
IEC/ISO 31010:2009	NOTE	Harmonized as EN 31010:2010 (not modified).
ISO 9001:2008	NOTE	Harmonized as EN ISO 9001:2008 (not modified).

¹⁾ Superseded by EN 60335-1:2012 (IEC 60335-1:2010, mod.)

²⁾ Superseded by EN 61709:2011 (IEC 61709:2011).

³⁾ Superseded by EN 61784-3:2010 (IEC 61784-3:2010).

Annex ZA (normative)

Normative references to international publications with their corresponding European publications

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

NOTE 1 When an International Publication has been modified by common modifications, indicated by (mod), the relevant EN/HD applies.

NOTE 2 Up-to-date information on the latest versions of the European Standards listed in this annex is available here: www.cenelec.eu

<u>Publication</u>	<u>Year</u>	<u>Title</u>	<u>EN/HD</u>	<u>Year</u>
IEC 61326-2-4	2012	Electrical equipment for measurement, control and laboratory use - EMC requirements - Part 2-4: Particular requirements - Test configurations, operational conditions and performance criteria for insulation monitoring devices according to IEC 61557-8 and for equipment for insulation fault location according to IEC 61557-9	EN 61326-2-4	2013
IEC 61326-3-1 + corr. August	2008 2008	Electrical equipment for measurement, control and laboratory use - EMC requirements - Part 3-1: Immunity requirements for safety-related systems and for equipment intended to perform safety-related functions (functional safety) - General industrial applications	EN 61326-3-1	2008
IEC 61508-1	2010	Functional safety of electrical/electronic/programmable electronic safety-related systems - Part 1: General requirements	EN 61508-1	2010
IEC 61508-2	2010	Functional safety of electrical/electronic/programmable electronic safety-related systems - Part 2: Requirements for electrical/electronic/programmable electronic safety-related systems	EN 61508-2	2010
IEC 61508-3	2010	Functional safety of electrical/electronic/programmable electronic safety-related systems - Part 3: Software requirements	EN 61508-3	2010
IEC 61508-4	2010	Functional safety of electrical/electronic/programmable electronic safety-related systems - Part 4: Definitions and abbreviations	EN 61508-4	2010
IEC 61508-5	2010	Functional safety of electrical/electronic/programmable electronic safety-related systems - Part 5: Examples of methods for the determination of safety integrity levels	EN 61508-5	2010

<u>Publication</u>	<u>Year</u>	<u>Title</u>	<u>EN/HD</u>	<u>Year</u>
IEC 61508-6	2010	Functional safety of electrical/electronic/programmable electronic safety-related systems - Part 6: Guidelines on the application of IEC 61508-2 and IEC 61508-3	EN 61508-6	2010
IEC 61557-1	-	Electrical safety in low voltage distribution systems up to 1 000 V a.c. and 1 500 V d.c. - Equipment for testing, measuring or monitoring of protective measures - Part 1: General requirements	EN 61557-1	-
IEC 61557-8	-	Electrical safety in low voltage distribution systems up to 1 000 V a.c. and 1 500 V d.c. - Equipment for testing, measuring or monitoring of protective measures - Part 8: Insulation monitoring devices for IT systems	EN 61557-8	-
IEC 61557-9	2009	Electrical safety in low voltage distribution systems up to 1 000 V a.c. and 1 500 V d.c. - Equipment for testing, measuring or monitoring of protective measures - Part 9: Equipment for insulation fault location in IT systems	EN 61557-9	2009

iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST EN 61557-15:2014](#)

<https://standards.iteh.ai/catalog/standards/sist/a85abe38-4e8f-4581-ad18-9829ac9aa8eb/sist-en-61557-15-2014>



IEC 61557-15

Edition 1.0 2014-02

INTERNATIONAL STANDARD

NORME INTERNATIONALE

Electrical safety in low voltage distribution systems up to 1 000 V a.c. and 1 500 V d.c. – Equipment for testing, measuring or monitoring of protective measures –

Part 15: Functional safety requirements for insulation monitoring devices in IT systems and equipment for insulation fault location in IT systems

9829ac9aa8eb/sist-en-61557-15-2014

Sécurité électrique dans les réseaux de distribution basse tension de 1 000 V c.a. et 1 500 V c.c. – Dispositifs de contrôle, de mesure ou de surveillance de mesures de protection –

Partie 15: Exigences de sécurité fonctionnelle pour les contrôleurs d'isolement de réseaux IT et les dispositifs de localisation de défauts d'isolement pour réseaux IT

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

PRICE CODE **XC**
CODE PRIX

ICS 17.220.20, 29.080.01, 29.240.01

ISBN 978-2-8322-1406-0

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

CONTENTS

FOREWORD.....	6
INTRODUCTION.....	8
1 Scope.....	10
2 Normative references	10
3 Terms, definitions and abbreviations	11
3.1 Terms and definitions.....	11
3.2 Abbreviations.....	22
4 Definition of safety functions embedded in IMDs and IFLSs.....	23
4.1 General.....	23
4.2 Definition of safety functions	23
4.2.1 Local insulation warning (LIW).....	23
4.2.2 Remote insulation warning (RIW).....	24
4.2.3 Local location warning (LLW).....	24
4.2.4 Remote location warning (RLW).....	24
4.2.5 Remote enabling / disabling command (REDC).....	25
4.2.6 Local transformer monitoring warning (LTMW).....	25
5 Requirements on products implementing safety-related functions.....	25
5.1 Requirement on non-safety-related functions.....	25
5.2 Additional performance requirements for products implementing safety functions.....	26
5.2.1 General	26
5.2.2 Additional performance requirements for IMDs complying with SIL 1 or SIL 2.....	26
5.2.3 Additional performance requirements for IFLSs complying with SIL 1 or SIL 2	26
6 Management of functional safety during the development lifecycle	26
6.1 Management of functional safety for the IT system.....	26
6.2 Use of IMDs and IFLSs in IT systems.....	27
6.3 Safety lifecycle of IMDs and IFLSs in the realisation phase.....	27
7 Management of functional safety during the realisation lifecycle of IMDs and IFLSs.....	28
7.1 General.....	28
7.2 IMD and IFL design requirement specification (phase 10.1)	29
7.2.1 Specification of functional safety requirements	29
7.2.2 Provisions for the development of safety functions	29
7.2.3 Verification plan for the development of safety functions.....	30
7.2.4 Validation plan for the development of safety functions.....	30
7.2.5 Planning of commissioning, installation and setting into operation	30
7.2.6 Planning of user documentation.....	31
7.3 IMD and IFLS safety validation planning (phase 10.2).....	31
7.3.1 General	31
7.3.2 Functional safety plan.....	31
7.4 IMD and IFLS design and development (phase 10.3)	32
7.4.1 General	32
7.4.2 Design standards.....	32
7.4.3 Realization	32

7.4.4	Safety integrity and fault detection	32
7.4.5	Safety integrity level (SIL) assignment	33
7.4.6	Hardware requirements	33
7.4.7	Software requirements	33
7.4.8	Review of requirements	33
7.4.9	Requirements for the probability of dangerous failure on demand (PFD)	34
7.4.10	Failure rate data	35
7.4.11	Diagnostic test interval	35
7.4.12	Architectural constraints	35
7.4.13	Estimation of safe failure fraction (SFF)	37
7.4.14	Requirements for systematic safety integrity	37
7.5	IMD and IFLS integration (phase 10.4)	40
7.5.1	Hardware integration	40
7.5.2	Software integration	40
7.5.3	Modifications during integration	40
7.5.4	Integration tests	40
7.6	IMD and IFLS documentation related to installation, commissioning, operation and maintenance procedures (phase 10.5)	41
7.6.1	General	41
7.6.2	Functional specification	41
7.6.3	Compliance information	41
7.6.4	Information for commissioning, installation, setting into operation, operation and maintenance	41
7.7	IMD and IFLS safety validation (phase 10.6)	42
7.7.1	General	42
7.7.2	Test	42
7.7.3	Verification	42
7.7.4	Validation	43
7.7.5	EMC requirements	43
8	Requirements for modifications	44
8.1	General	44
8.2	Modification request	44
8.3	Impact analysis	44
8.4	Authorization	44
9	Proven in use approach	44
Annex A (informative)	Risk analysis and SIL assignment for IMDs and IFLSs	45
A.1	General	45
A.2	SIL assignment for IMDs and IFLSs	47
A.3	Example of risk graph	48
A.4	Alternative method of SIL assignment – quantitative method	49
Annex B (informative)	Examples for the determination of PFD, DC and SFF	50
B.1	General	50
B.2	Examples of IMD and IFLS architectures	51
Annex C (informative)	Failure rate databases	52
C.1	General	52
C.2	Failure rate references in current standards	52
Annex D (informative)	Guide to embedded software design and development	53
D.1	General	53

D.2	Software element guidelines	53
D.2.1	General	53
D.2.2	Interface with system architecture.....	53
D.2.3	Software specifications	53
D.2.4	Pre-existent software	54
D.2.5	Software design.....	55
D.2.6	Coding.....	55
D.3	Software development process guidelines.....	55
D.3.1	Development process: software lifecycle	55
D.3.2	Documentation: documentation management.....	55
D.3.3	Configuration and software modification management	56
D.3.4	Configuration and archiving management	56
D.3.5	Software modifications management.....	57
D.4	Development tools	57
D.5	Reproduction of executable code production.....	57
D.6	Software verification and validation	57
D.7	General verification and validation guidelines	57
D.8	Verification and validation review	58
D.9	Software testing	58
D.9.1	General validation	58
D.9.2	Software specification verification: validation tests	59
D.9.3	Software design verification: software integration tests	59
D.9.4	Detailed design verification: module tests	60
Annex E (informative)	Information for the assessment of safety functions	61
E.1	General.....	61
E.2	Documentation management.....	61
E.3	Documentation provided for conformity assessment.....	61
E.4	Documentation of the development lifecycle.....	63
E.5	Design documentation	63
E.6	Documentation of verification and validation	63
E.7	Test documentation	63
E.8	Documentation of modifications	63
E.9	Information for use.....	63
Annex F (informative)	Example of applications.....	64
F.1	Overview.....	64
F.2	Limitation in applications.....	64
F.3	Typical applications covered by IEC 61557-15	64
F.3.1	General	64
F.3.2	Local alarming	64
F.3.3	Local transformer monitoring warning	65
F.3.4	Alarming and processing of remote insulation warning and/or remote location warning.....	66
F.3.5	Automatic disconnection of the complete IT system in case of a first insulation fault	67
F.3.6	Automatic disconnection of an IT system sub-network	69
F.3.7	Management of multiple source system (two incomers or of incomer plus generator).....	71
F.3.8	Management of multiple source systems (two incomers or of incomer plus generator – with a load shedder).....	72
Bibliography.....		74

Figure 1 – Relationship between IEC 61557-15 and related standards	8
Figure 2 – Overall safety lifecycle applicable to an IT system	27
Figure 3 – IMD and IFLS safety lifecycle (in realisation phase)	28
Figure A.1 – Functional elements of an IT system and their relationship to the definitions and abbreviations of the IEC 61508 series	45
Figure A.2 – SIL assignment for IMDs and IFLSs	47
Figure A.2 – Example of risk graph	48
Figure B.1 – Flowchart for PFD, DC, SFF determination	51
Figure F.1 – Local alarming, based on the systematic presence of one person and based on a well-defined alarming management process	65
Figure F.2 – Local transformer monitoring warning, based on the systematic presence of a skilled person, and based on a well-defined alarming management process	66
Figure F.3 – Alarming and processing of the remote insulation warning and/or the remote location warning in a supervisory control system	67
Figure F.4 – Disconnection of the complete IT system in case of insulation fault detection	68
Figure F.5 – Threshold 1 warning information and threshold 2 disconnection of the complete IT system in case of an insulation fault detection	69
Figure F.6 – Automatic disconnection of a faulty feeder via direct signal from the IFLS	70
Figure F.7 – Automatic disconnection of a faulty feeder via a PLC	71
Figure F.8 – Management of multiple source systems (two incomers or of one incomer plus generator)	72
Figure F.9 – Management of multiple source system (two incomers or of one incomer plus generator, with a load shedder)	73
Table 1 – Abbreviations with reference	22
Table 2 – Safety integrity levels (SIL) and probability of a dangerous failure on demand (PFD) of IMDs and IFLSs	29
Table 3 – Hardware safety integrity: architectural constraints on type A and type B safety-related subsystems	37
Table A.1 – IT system risk analysis	46
Table A.3 – Link between minimum risk reduction and SIL	48
Table A.4 – Example of classifications according to risk graph Figure A.1	49
Table E.1 – Documentation to be provided	62

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**ELECTRICAL SAFETY IN LOW VOLTAGE DISTRIBUTION SYSTEMS UP TO
1 000 V AC AND 1 500 V DC – EQUIPMENT FOR TESTING, MEASURING OR
MONITORING OF PROTECTIVE MEASURES –**

**Part 15: Functional safety requirements for insulation monitoring devices
in IT systems and equipment for insulation fault location in IT systems**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61557-15 has been prepared by IEC technical committee 85: Measuring equipment for electrical and electromagnetic quantities.

The text of this standard is based on the following documents:

FDIS	Report on voting
85/465/FDIS	85/470/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

This part of IEC 61557 is to be used in conjunction with Part 8 and Part 9.

A list of all parts of the IEC 61557 series, published under the general title *Electrical safety in low voltage distribution systems up to 1 000 V a.c. and 1 500 V d.c. – Equipment for testing, measuring or monitoring of protective measures*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST EN 61557-15:2014](#)

<https://standards.iteh.ai/catalog/standards/sist/a85abe38-4e8f-4581-ad18-9829ac9aa8eb/sist-en-61557-15-2014>

INTRODUCTION

IEC 61508 deals with functional safety, this topic being of utmost importance for safety related systems. Functional safety may be applicable to IT systems where safety is based on insulation monitoring devices (IMD) and insulation fault location systems (IFLS), and also on additional safety related measures (e.g. circuit-breakers).

Insulation monitoring devices and insulation fault location systems comprise electrical and electronic components and can comprise embedded software.

Product requirements for these devices are defined in IEC 61557-8 and IEC 61557-9. These standards include elementary requirements which need to be taken into account for the functional safety approach according to IEC 61557-15, but do not cover the whole range of requirements which shall be fulfilled for the assignment of a defined level of functional safety and for the respective validation.

IEC 61508 series covers basic aspects to be considered when electrical and electronic systems are used to carry out safety functions. One of the major objectives of this series of standards is to facilitate the development of international application or equipment standards by the responsible technical committee. This will allow the technical committee to take the special requirements of their application fully into account.

It is recognized that there is a great variety of applications of insulation monitoring devices and of insulation fault location systems in IT systems. This part of IEC 61557 defines basic safety functions as well as their related levels of functional safety (SIL) and defines feasible measures and principles to develop and validate these devices and systems under functional safety aspects.

Figure 1 shows the link between IEC 61557-15 and the relevant product, safety and EMC standards as well as the link to the IEC 61508 series.

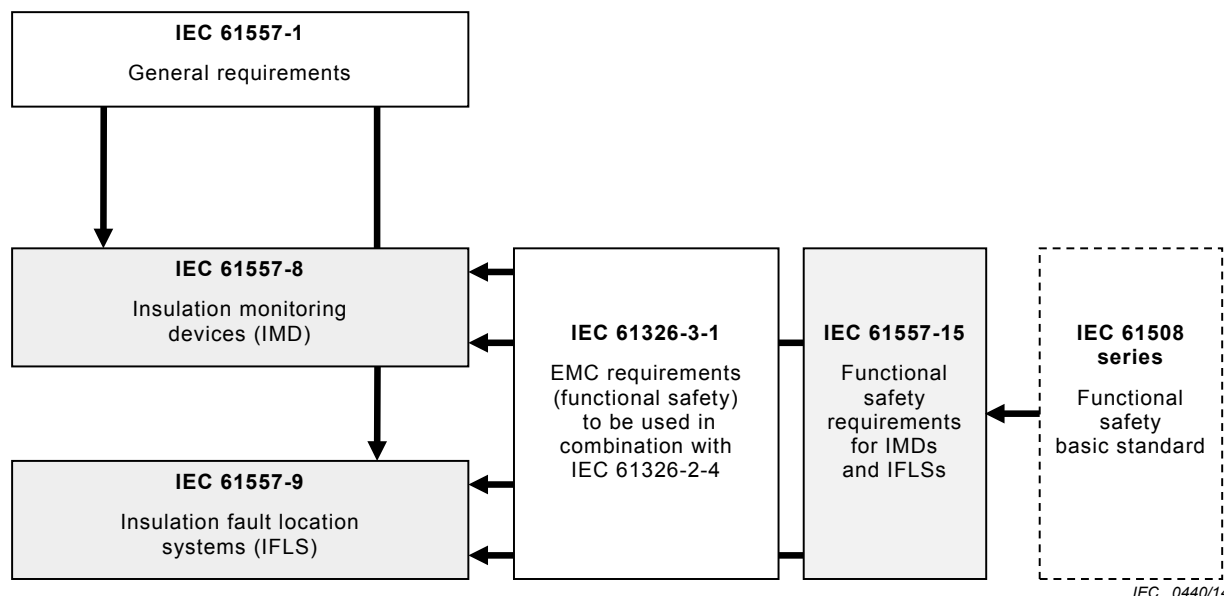


Figure 1 – Relationship between IEC 61557-15 and related standards

This part of IEC 61557 does not cover phases 1 to 9 and 11 to 16 of IEC 61508-1 for the complete IT systems. In particular, this standard does not cover the use of IMDs and IFLSs in customer application.