



SLOVENSKI STANDARD
SIST EN 15304:2008

01-november-2008

8 c`c Ub^cVgfc^bcghj`Uj hc_`Uj]fUbY[UWV] UghY[UVYrcbUdfchj`nUa fncj Ub^f !
HJUb^f

Determination of the freeze-thaw resistance of autoclaved aerated concrete

Bestimmung des Frost-Tau-Widerstandes von dampfgehärtetem Porenbeton

Détermination de la résistance au gel/dégel du béton cellulaire autoclavé

ITeH STANDARD PREVIEW
(standards.iteh.ai)

Ta slovenski standard je istoveten z: EN 15304:2007

<https://standards.iteh.ai/catalog/standards/sist/672dacf2-b713-49c4-81a7-5ca12044e419/sist-en-15304-2008>

ICS:

91.100.30	Beton in betonski izdelki	Concrete and concrete products
-----------	---------------------------	--------------------------------

SIST EN 15304:2008

en,fr,de

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 15304:2008

<https://standards.iteh.ai/catalog/standards/sist/672dacf2-b713-49c4-81a7-5ca12044e419/sist-en-15304-2008>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 15304

June 2007

ICS 91.100.30

English Version

Determination of the freeze-thaw resistance of autoclaved aerated concrete

Détermination de la résistance au gel/dégel du béton
cellulaire autoclavé

Bestimmung des Frost-Tau-Widerstandes von
dampfgehärtetem Porenbeton

This European Standard was approved by CEN on 10 May 2007.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

[SIST EN 15304:2008](https://standards.iteh.ai/catalog/standards/sist/672dacf2-b713-49c4-81a7-5ca12044e419/sist-en-15304-2008)

<https://standards.iteh.ai/catalog/standards/sist/672dacf2-b713-49c4-81a7-5ca12044e419/sist-en-15304-2008>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Contents

Page

Foreword.....	3
1 Scope	4
2 Normative references	4
3 Principle	4
4 Apparatus	4
5 Test specimens	5
6 Testing procedure.....	6
7 Test results	8
8 Test report	9
Annex A (informative) Determination of the loss in mass and compressive strength	10
Annex B (informative) Flow chart of freeze-thaw test.....	13
Bibliography	15
iTeh STANDARD PREVIEW (standards.iteh.ai)	
Figures	
Figure 1 – Cutting scheme	6

[SIST EN 15304:2008](https://standards.iteh.ai/catalog/standards/sist/672dacf2-b713-49c4-81a7-5ca12044e419/sist-en-15304-2008)

<https://standards.iteh.ai/catalog/standards/sist/672dacf2-b713-49c4-81a7-5ca12044e419/sist-en-15304-2008>

Foreword

This document (EN 15304:2007) has been prepared by Technical Committee CEN/TC 177 "Prefabricated reinforced components of autoclaved aerated concrete or light-weight aggregate concrete with open structure", the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by December 2007, and conflicting national standards shall be withdrawn at the latest by December 2007.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom

iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST EN 15304:2008](#)

<https://standards.iteh.ai/catalog/standards/sist/672dacf2-b713-49c4-81a7-5ca12044e419/sist-en-15304-2008>

EN 15304:2007 (E)**1 Scope**

This document specifies a method of determining the freeze-thaw resistance of autoclaved aerated concrete manufactured according to prEN 12602 or EN 771-4.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 678, *Determination of the dry density of autoclaved aerated concrete*

EN 679:2005, *Determination of the compressive strength of autoclaved aerated concrete*

EN 1353, *Determination of the moisture content of autoclaved aerated concrete*

EN 12390-4, *Testing hardened concrete – Part 4: Compressive strength – Specification for testing machines*

3 Principle**iTeh STANDARD PREVIEW**

Cubic test specimens (two equal groups consisting of main test specimens and reference test specimens) are cut from products sampled from normal production, saturated in water for 48 h, removed and then placed in polythene bags or similar protecting against drying for 24 h to equilibrate.

The main test specimens are subjected to repeated freezing at $-15\text{ }^{\circ}\text{C}$ for at least 8 h followed by thawing in an environment of $> 95\%$ relative humidity and $20\text{ }^{\circ}\text{C}$ for at least 8 h. The reference test specimens are stored in a climatic chamber at $20\text{ }^{\circ}\text{C}$ in conditions that prevent drying of the AAC during storage.

After the specified number of freeze-thaw cycles (not less than 15), the mass loss of the main test specimens is determined. The dry density and moisture content is also determined on the reference test specimens. If the loss in compressive strength is also required to be determined, then Annex A should be followed.

NOTE Depending on the conditions at the place of use, the number of freeze-thaw cycles can be specified by national provisions.

4 Apparatus

- a) saw with rotating carborundum or diamond blade or similar equipment for cutting test specimens;
- b) balance, capable of determining the mass of the test specimens to an accuracy of 0,1 %;
- c) callipers, capable of reading the dimensions of the test specimens to an accuracy of 0,1 mm;
- d) container, to store the test specimens under water at $(20 \pm 2)\text{ }^{\circ}\text{C}$;
- e) feeler gauge, capable of measuring 0,1 mm, (if required) 0,5 mm and 1 mm;
- f) conditioned room or cabinet for thawing of the main test specimens able to maintain a relative humidity $> 95\%$ at $(20 \pm 2)\text{ }^{\circ}\text{C}$;
- g) storage room for reference test specimens able to maintain a relative humidity $> 95\%$ at $(20 \pm 5)\text{ }^{\circ}\text{C}$;

- h) freezing chamber with internal air circulation capable of maintaining a uniformly distributed temperature of (-15 ± 2) °C;
- i) ventilated drying oven, capable of maintaining a temperature of (105 ± 5) °C;
- j) straight edge, at least 200 mm long and a square;
- k) compression testing machine, preferably hydraulically operated, which meets the requirements of EN 12390-4.

NOTE The room according to f) needs not necessarily be humidity-controlled. Alternatively it is possible to substitute moisture losses by 2 h prior to the end of the thawing period placing the main test specimens in underwater storage for 1 h at (20 ± 5) °C and subsequently leaving the test specimens to equilibrate in air for 1 h at (20 ± 5) °C before freezing. This procedure is especially appropriate in combination with automatic systems. It should be ensured that the starting moisture content is not exceeded.

5 Test specimens

5.1 Sample

The sample for the preparation of the test specimens shall be taken in such a manner that it is representative of the product to be investigated, and the test specimens shall be cut from the sample as illustrated in Figure 1.

5.2 Shape and size of the test specimens

The test specimens shall be cubes with an edge length of (100 ± 2) mm.

5.3 Number of test specimens

A test set shall consist of 12 test specimens: 6 main test specimens and 6 reference test specimens.

The main test specimens are exposed to a specified number of freeze-thaw cycles in accordance with 6.1, and their loss in mass (see 7.3) and, if required, their loss in compressive strength due to this exposure is determined (see A.3 and A.4).

The reference test specimens are used for determination of the moisture content of the AAC prior to the freeze-thaw test and of the dry density and, if required, for the determination of the (control) compressive strength.

5.4 Preparation of test specimens

The test specimens shall be cut by means of a rotating diamond or carborundum blade or similar equipment. Their surfaces shall not deviate from planeness by more than 0,5 mm. Planeness shall be checked across the two diagonals using a straight edge and, if necessary, a 0,5 mm feeler gauge.

Where test specimens are used for the determination of the compressive strength, their loadbearing surfaces shall not deviate from planeness by more than 0,1 mm and the angle between the load bearing surfaces and adjacent surfaces shall not deviate from a right angle by more than 1 mm/100 mm. If necessary, the latter shall be checked along both orthogonal middle axes of the load bearing surfaces by means of a square and a 1 mm feeler gauge or similar instrument.

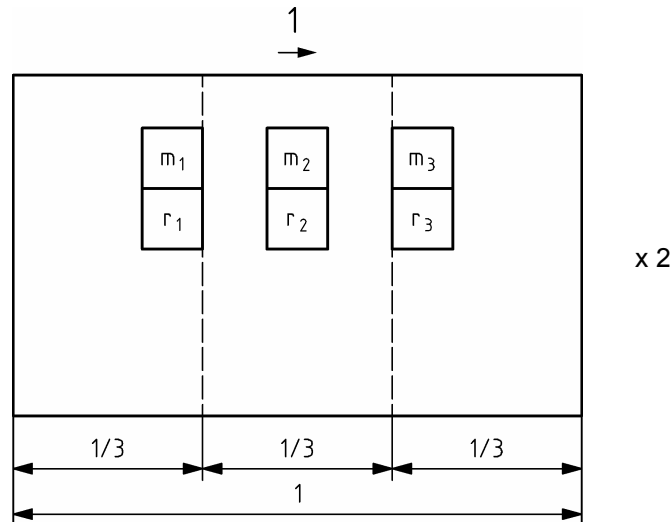
NOTE If the load-bearing surfaces of the main test specimens determined for the compression test are pitted after completion of freeze-thaw cycles, they should be ground to a flatness of 0,1 mm.

The position of the test specimens in the material relative to the rise of the mass shall be shown by the numbering, and the direction of rise shall be marked on the test specimens.

EN 15304:2007 (E)

Equal numbers of test specimens shall be prepared from the upper third of the sample, from the middle and from the lower third in the direction of rise of the mass during manufacture (see Figure 1). The test specimens shall be cut in pairs (main test specimens and reference test specimens) from adjacent areas of the sample to ensure a good comparison.

Test specimens shall be suitably referenced and indicated either as main (m) or reference (r). In addition, the position of the test specimens in the unit and the number of the unit shall be marked.

**Key**

- 1 Direction of rise
- m Main test specimen
- r Reference test specimen

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 15304:2008

<https://standards.iteh.ai/catalog/standards/sist/672dacf2-b713-49c4-81a7-5ca12044e419/sist-en-15304-2008>

Figure 1 – Cutting scheme

5.5 Measurement of test specimens and determination of their volume

The dimensions of the test specimens shall be measured to an accuracy of 0,1 mm, using callipers. Length, height and width shall be measured in mid height at two opposite sides, and the volume V of the test specimens shall be calculated by multiplying the mean values.

5.6 Conditioning of test specimens

After their preparation, the main test specimens and the reference test specimens shall be saturated in water for 48 h at (20 ± 2) °C. For this purpose they shall be stored for 24 h with half of their thickness (50 mm) in water and for 24 h totally under water. Then they shall be removed from the water and placed in a polythene bag or similar protecting against drying for 24 h to allow the specimens to equilibrate.

6 Testing procedure

6.1 Freeze-thaw test

The main test specimens shall be frozen in air at a temperature of (-15 ± 2) °C, preferably placed on wooden bearers or on mesh shelves. The distance between the main test specimens among each other as well as to the lateral chamber walls and to the upper shelves shall be at least 50 mm. The temperature at the centre of the test specimens shall fall to 0 °C within (3 ± 1) h and shall be checked on a control specimen prior to commencing the test. The total duration of the freezing period shall be at least 8 h, until freezing temperature (-15 ± 2) °C is reached in the centre of the test specimens.

NOTE 1 The air temperature in the freezing chamber can be $(-15 \pm 2) ^\circ\text{C}$ from the very beginning of the freezing period or decreased gradually from $(20 \pm 2) ^\circ\text{C}$ to that temperature for automatic systems.

Thawing of the main test specimens after the freezing cycle can take place either in the same freezing chamber, for automatic systems, or in a separate thawing chamber. The main test specimens should be positioned preferably on wooden bearers, and the distance between each other as well as to the lateral container walls and to the upper shelves shall be at least 50 mm. During the thawing period a relative humidity of above 95 % shall be maintained to prevent moisture loss. The final air temperature shall be maintained at $(20 \pm 2) ^\circ\text{C}$. The temperature at the centre of the test specimens shall rise to $0 ^\circ\text{C}$ within (1 to 5) h and shall be checked on a control specimen prior to commencing the test. The test specimens shall be left to thaw for a total of at least 8 h, until a temperature of $(20 \pm 2) ^\circ\text{C}$ is reached in the centre of the test specimens.

NOTE 2 At the initial stage of thawing a lower humidity is permitted for a short period.

NOTE 3 The required rate of temperature rise or fall in the centre of the main test specimens can be obtained by variation in the volume loading and air circulation of the chamber or by an automatic control system.

This completes one freeze-thaw cycle.

In case of a forced interruption of testing, the main test specimens shall be kept in the thawed condition, in a storage room at a temperature of $(20 \pm 5) ^\circ\text{C}$ and a relative humidity of $> 95 \%$, so that drying is excluded.

The reference test specimens shall be kept during the period of freeze-thaw-cycles of the main test specimens in a storage room at a temperature of $(20 \pm 5) ^\circ\text{C}$ and a relative humidity of $> 95 \%$ or alternatively sealed in polythene bags at the same temperature so that they do not lose moisture.

NOTE 4 If not automatised, the freeze-thaw cycles are best programmed such that the placing of the main test specimens in the freezing chamber is undertaken at 17:00 and in the thawing chamber at 09:00 of the following day to fit into the working day. If the test is interrupted at weekends, then the main test specimens should be kept in frozen condition over this period.

After 15 freeze-thaw cycles and at the completion of the test any visual damage to the main test specimens shall be noted.

NOTE 5 Splitting of a main test specimen during the freeze-thaw test should not be considered as frost damage. This test specimen should be disregarded in the test result.

6.2 Determination of actual moisture content and dry density of AAC

6.2.1 The mass $m_{i,0}^m$ of the main test specimens and $m_{i,0}^r$ of the reference test specimens shall be determined immediately after removal from the polythene bags (or similar) prior to commencing the freeze-thaw test.

6.2.2 The mass $m_{i,n}^m$ of the main test specimens shall be determined immediately after completion of the n freeze-thaw cycles.

6.2.3 After the specified number n of freeze-thaw cycles both the reference and the main test specimens shall be dried at $(105 \pm 5) ^\circ\text{C}$ until constant mass to determine $m_{id,n}^r$ and $m_{id,n}^m$ respectively. The dry mass of the reference specimens is used to determine the moisture content of the AAC prior to freeze-thaw tests in accordance with EN 1353 and to calculate the dry density in accordance with EN 678.

6.2.4 If required, the loss of compressive strength shall be determined in accordance with Annex A.