



SLOVENSKI STANDARD

SIST EN 1507:2006

01-junij-2006

DfYnfU Yj Ub^YgHj V!'FUhj cX'nfU_U!'DfUj c_cHb]`d`c Yj]bUgH`nfU b]`_UbU]'
NU hYj YnUcXdcfbch]b hYgbcgh

Ventilation for buildings - Sheet metal air ducts with rectangular section - Requirements for strength and leakage

Lüftung von Gebäuden - Rechteckige Luftleitungen aus Blech - Anforderungen an Festigkeit und Dichtheit
iTeh STANDARD PREVIEW
(standards.iteh.ai)

Ventilation des bâtiments - Conduits aérauliques rectangulaires en tôle - Prescriptions pour la résistance et l'étanchéité
[SIST EN 1507:2006
https://standards.iteh.ai/catalog/standards/sist/13ec81e1-c1e1-4578-bb67-5b459ff862d6/sist-en-1507-2006](https://standards.iteh.ai/catalog/standards/sist/13ec81e1-c1e1-4578-bb67-5b459ff862d6/sist-en-1507-2006)

Ta slovenski standard je istoveten z: EN 1507:2006

ICS:

91.140.30 Úl^: læ^çat) áš Á|ã æ\ã Ventilation and air-conditioning
•áč{ á

SIST EN 1507:2006 en

iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST EN 1507:2006](#)

<https://standards.iteh.ai/catalog/standards/sist/f3ec81ef-c1e1-4578-bb67-5b459ff862d6/sist-en-1507-2006>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 1507

March 2006

ICS 91.140.30

English Version

Ventilation for buildings - Sheet metal air ducts with rectangular section - Requirements for strength and leakage

Ventilation des bâtiments - Conduits aérauliques rectangulaires en tôle - Prescriptions pour la résistance et l'étanchéité

Lüftung von Gebäuden - Rechteckige Luftleitungen aus Blech - Anforderungen an Festigkeit und Dichtheit

This European Standard was approved by CEN on 16 February 2006.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

SIST EN 1507:2006

<https://standards.iteh.ai/catalog/standards/sist/f3ec81ef-c1e1-4578-bb67-5b459ff862d6/sist-en-1507-2006>



EUROPEAN COMMITTEE FOR STANDARDIZATION
 COMITÉ EUROPÉEN DE NORMALISATION
 EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Contents

Page

Foreword	4
Introduction	6
1 Scope	7
2 Normative references	7
3 Terms, definition and symbols	7
4 Requirements	9
4.1 Leakage	9
4.2 Deformation	9
4.3 Deflection of a duct	9
4.4 Deflection of a joint	9
4.5 Bulging and/or caving	9
5 Testing	9
5.1 Test rig specification	9
<i>iTech STANDARD PREVIEW</i>	
5.2 Leakage testing	9
<i>(standards.itech.ai)</i>	
5.2.1 Test object	9
5.2.2 Test procedure	SIST EN 1507:2006
https://standards.itech.ai/catalog/standards/sist/f3ec81ef-c1e1-4578-bb67-5b459ff862d6/sist-en-1507-2006	10
5.2.3 Correction of leakage test result	
5.3 Strength testing	10
5.3.1 Test object	10
5.3.2 Test procedure	10
5.3.3 Determination of deflection of a duct	10
5.3.4 Determination of deflection of a joint	10
5.3.5 Determination of bulging and/or caving	10
6 Measurement accuracy and test reports	11
6.1 Measurement accuracy requirements	11
6.1.1 General requirements	11
6.1.2 Air flow measurement	11
6.1.3 Differential pressure measurement	11
6.1.4 Barometric pressure	11
6.1.5 Temperature measurement	11
6.1.6 Deflection, bulging or carving	11
6.2 Leakage test report	11
6.2.1 General data	11
6.2.2 Test result	12

6.3	Strength test report	12
6.3.1	General data.....	12
6.3.2	Test result	12
	Bibliography	16

iTeh STANDARD PREVIEW (standards.iteh.ai)

SIST EN 1507:2006

[https://standards.iteh.ai/catalog/standards/sist/f3ec81ef-c1e1-4578-bb67-
5b459ff862d6/sist-en-1507-2006](https://standards.iteh.ai/catalog/standards/sist/f3ec81ef-c1e1-4578-bb67-5b459ff862d6/sist-en-1507-2006)

Foreword

This European Standard (EN 1507:2006) has been prepared by Technical Committee CEN/TC 156 "Ventilation for buildings", the secretariat of which is held by BSI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by September 2006, and conflicting national standards shall be withdrawn at the latest by September 2006.

This European Standard is one of a series of standards for ductwork used for ventilation and air conditioning of buildings for human occupancy.

The position of this European Standard in the field of mechanical services is shown in Figure 1.

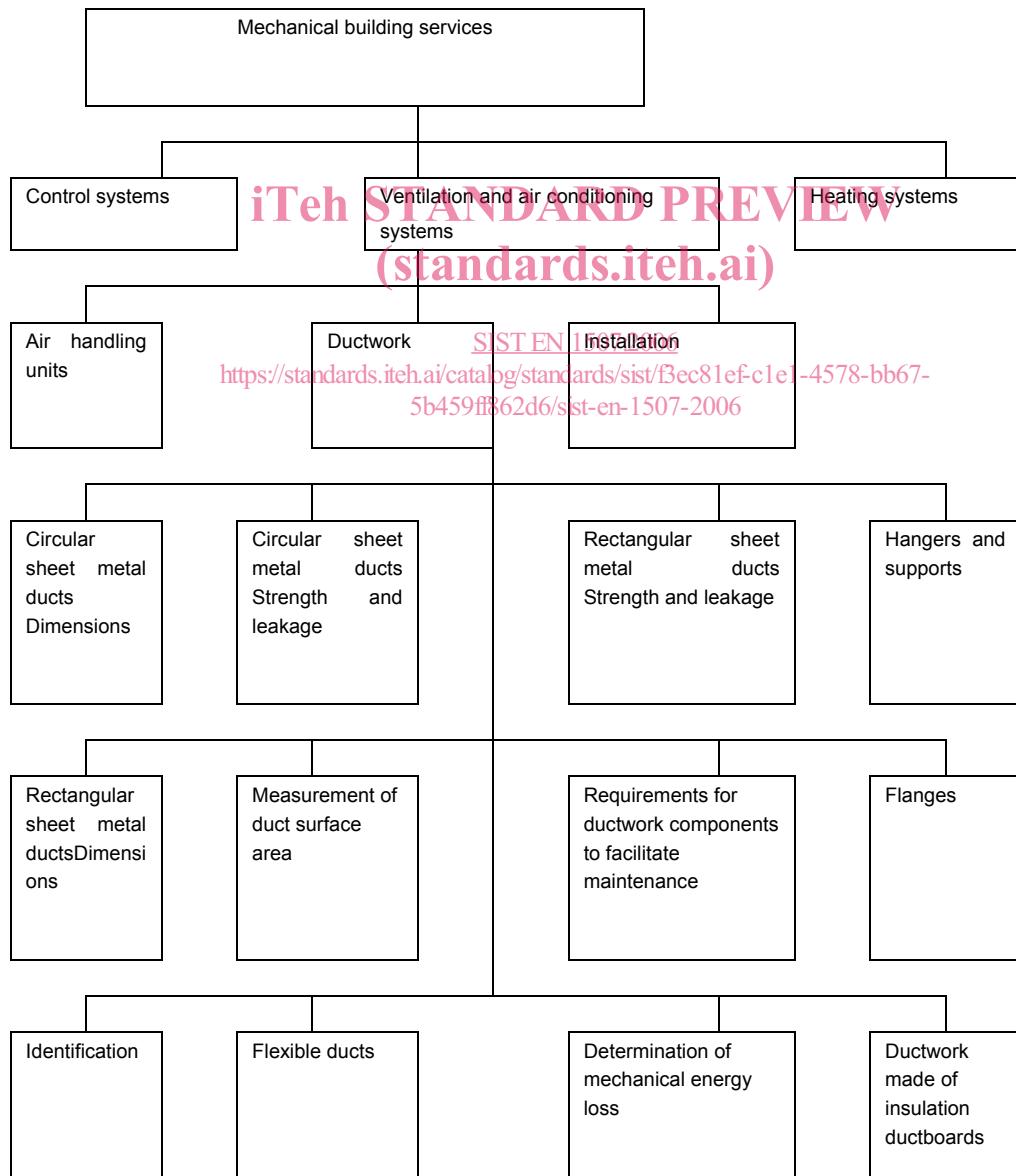


Figure 1 — Position of EN 1507 in the field of mechanical services

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

**iTeh STANDARD PREVIEW
(standards.iteh.ai)**SIST EN 1507:2006

<https://standards.iteh.ai/catalog/standards/sist/f3ec81ef-c1e1-4578-bb67-5b459ff862d6/sist-en-1507-2006>

Introduction

This European Standard specifies requirements and test methods for strength and air leakage of rectangular ductwork. The objective is to establish the mechanical strength and leakage necessary to verify the fitness for the intended service as installed ductwork.

Testing of leakage can be done on site, but testing of strength (deflection, bulging and caving) is confined to laboratories and manufacturers premises.

**iTeh STANDARD PREVIEW
(standards.iteh.ai)**

[SIST EN 1507:2006](#)

<https://standards.iteh.ai/catalog/standards/sist/f3ec81ef-c1e1-4578-bb67-5b459ff862d6/sist-en-1507-2006>

1 Scope

The European Standard applies to rectangular ductwork of sheet metal used in air conditioning and ventilation systems defined in the principal scope of CEN/TC 156.

2 Normative references

The following referenced documents are indispensable for the application of this European Standard. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 14239, *Ventilation for buildings — Ductwork — Measurement of ductwork surface area*

ISO 5221, *Air distribution and air diffusion — Rules to methods of measuring air flow rate in an air handling duct*

3 Terms, definition and symbols

For the purposes of this European Standard, the following terms, definitions and symbols apply.

3.1

ductwork surface area

iTeh STANDARD PREVIEW

A

surface area (m^2) of the ductwork determined according to EN 14239

(standards.iteh.ai)

3.2

total joint length

SIST EN 1507:2006

L

<https://standards.iteh.ai/catalog/standards/sist/f3ec81ef-c1e1-4578-bb67->

length (m) of joints resulting from the installation of the ductwork

<https://standards.iteh.ai/catalog/standards/sist/f3ec81ef-c1e1-4578-bb67->

3.3

test pressure

p_{test}

static air pressure difference (Pa) between the ductwork to be tested and the surrounding air

3.4

design operating pressure

p_{design}

maximum static pressure difference (Pa) for which the installed ductwork is designed to operate under normal conditions

3.5

static gauge pressure limit

p_s

maximum design operating pressure (Pa) for the ductwork according to its air tightness class. The pressure classes and corresponding static pressure limits, positive and negative, are defined in Table 1

3.6

leakage flow rate

q_v air leakage flow rate of the ductwork ($\text{m}^3 \cdot \text{s}^{-1}$) at a given test pressure,

Q_{measured} air leakage flow rate before correction