



# SLOVENSKI STANDARD

## SIST EN 1766:2002

01-september-2002

---

Dfc]nj cX] ]b`g]ghYa ]`nUnUý ]]rc`]b`dcdfUj ]]c`VYfrcbg\_ ]]`\_cbg]fi \_VY^!`DfYg\_i gbY  
a YfrcXY!`FYZfYb b]`VYfrcb]`nUdfYg\_i ýUb^Y

Products and systems for the protection and repair of concrete structures - Test methods  
- Reference concretes for testing

Produkte und Systeme für den Schutz und die Instandsetzung von Betontragwerken -  
Prüfverfahren - Referenzbetone für Prüfungen

Produits et systemes pour la protection et la réparation des structures en béton -  
Méthodes d'essais - Bétons de référence pour essais

<https://standards.iteh.ai/catalog/standards/sist/cb9fa11f-431d-42d8-9218-6740230baa6c/sist-en-1766-2002>

**Ta slovenski standard je istoveten z: EN 1766:2000**

---

### **ICS:**

91.080.40	Betonske konstrukcije	Concrete structures
91.100.30	Beton in betonski izdelki	Concrete and concrete products

**SIST EN 1766:2002**

**en**

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

SIST EN 1766:2002

<https://standards.iteh.ai/catalog/standards/sist/eb9fa11f-431d-42d8-9218-6740230baa6c/sist-en-1766-2002>

EUROPEAN STANDARD

EN 1766

NORME EUROPÉENNE

EUROPÄISCHE NORM

January 2000

ICS 91.080.40; 91.100.30

English version

## Products and systems for the protection and repair of concrete structures - Test methods - Reference concretes for testing

Produits et systèmes pour la protection et la réparation des structures en béton - Méthodes d'essais - Bétons de référence pour essais

Produkte und Systeme für den Schutz und die Instandsetzung von Betontragwerken - Prüfverfahren - Referenzbetone für Prüfungen

This European Standard was approved by CEN on 30 July 1999.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

[SIST EN 1766:2002](https://standards.iteh.ai/catalog/standards/sist/eb9fa11f-431d-42d8-9218-6740230baa6c/sist-en-1766-2002)

<https://standards.iteh.ai/catalog/standards/sist/eb9fa11f-431d-42d8-9218-6740230baa6c/sist-en-1766-2002>



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

Central Secretariat: rue de Stassart, 36 B-1050 Brussels

## Contents

Foreword.....	3
1 Scope .....	4
2 Normative references .....	4
3 Principle .....	4
4 Equipment.....	4
4.1 Concrete mixer (forced action pan mixer).....	4
4.2 Moulds.....	4
4.3 High frequency vibrating table .....	4
4.4 Grit blasting equipment.....	5
4.5 Surface roughness measuring equipment.....	5
5 Materials.....	5
5.1 Aggregates .....	5
5.2 Mixing water .....	5
5.3 Cement .....	6
5.4 Admixtures .....	6
5.5 Grit for surface preparation by blasting .....	6
5.6 Silica sand for measuring roughness.....	6
6 Reference concrete mixes .....	6
6.1 General .....	6
6.2 Reference concrete with 16 mm or 20 mm aggregate (see table 1).....	6
6.3 Reference concrete with 8 mm or 10 mm aggregate (see Table 1).....	7
6.4 Specimen preparation .....	8
6.5 Concrete curing and storage.....	8
7 Surface preparation and roughness index determination.....	9
7.1 Surface preparation .....	9
7.2 Measurement of the Roughness index.....	9
8 Report.....	10
Annex A (informative) Grading curves.....	11

## Foreword

This European Standard has been prepared by Technical Committee CEN/TC 104 "Concrete (performance, production, placing and compliance criteria)", the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by July 2000, and conflicting national standards shall be withdrawn at the latest by December 2002.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

This European Standard describes a method for making consistent reference concrete test specimens with a reproducible surface texture. Specifications for the products and systems for the repair and the protection of concrete structures will be subject of separate standards.

For the time being, five types of reference concrete are needed. With further experience of test methods, it is anticipated that they can be modified and that the number of reference concretes will be reduced.

## iTeh STANDARD PREVIEW (standards.iteh.ai)

SIST EN 1766:2002

<https://standards.iteh.ai/catalog/standards/sist/eb9fa11f-431d-42d8-9218-6740230baa6c/sist-en-1766-2002>

## 1 Scope

This European Standard specifies the composition, characteristics and preparation procedure for reference concrete substrates which are to be used in the test methods to measure performance requirements of products and systems for the repair and protection of concrete structures.

The provisions of this standard are applicable to concrete with a maximum aggregate size of 16 mm or 20 mm or with a maximum aggregate size of 8 mm or 10 mm.

## 2 Normative references

This European Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies.

ENV 197-1, *Cement - Composition, specifications and conformity criteria - Part 1: Common cements.*

prEN 206, *Concrete - Performance, production and conformity.*

EN 933-2, *Tests for geometrical properties of aggregates – Part 2: Determination of particle size distribution – Test sieves, nominal size of apertures.*

EN 934-2, *Admixtures for concrete, mortar and grout – Part 2: Concrete admixtures - Definitions, specifications and requirements.*

prEN 1008, *Mixing water for concrete – Specification for sampling, testing and assessing the suitability of water, including wash water from recycling in installations in the concrete industry, as mixing water for concrete.*

EN 1542, *Products and systems for the protection and repair of concrete structures - Test methods – Pull-off test.*

prEN 12390, *Testing concrete - Determination of compressive strength – Specification for compression testing machines.*

## 3 Principle

Reference concrete test specimens with reproducible surface texture and appropriate strength are cast to enable the physical properties of repair materials to be evaluated.

The required surface roughness is obtained by grit blasting the surface of the hardened concrete.

## 4 Equipment

### 4.1 Concrete mixer (forced action pan mixer)

### 4.2 Moulds

Moulds for producing concrete specimens, of non absorbent, rigid material, not attacked by cement paste, of a size 300 mm x 300 mm x 100 mm or other sizes specified in individual test method standards, corresponding to the property to be tested, shall be used.

### 4.3 High frequency vibrating table

Or vibration rod suitable for compaction of the concrete in the moulds.

#### 4.4 Grit blasting equipment

It shall comply with the following:

4.4.1 Air pressure approximately 0,5 MPa.

4.4.2 Nozzle diameter 8 mm to 12 mm.


4.4.3 The spread angle of the nozzle shall be sufficient to prevent the jet from cutting deeply into the concrete surface. This shall be demonstrated by preliminary test.

NOTE As an alternative, high pressure water-blasting equipment, capable of operating with or without the addition of grit, can be used subject to preliminary tests to confirm that the required surface texture can be achieved.

#### 4.5 Surface roughness measuring equipment

4.5.1 Measuring cylinder, of  $(25 \pm 1)$  ml total capacity and 20 mm maximum internal diameter.

4.5.2 Disc, comprising a flat wooden disc  $(65 \pm 5)$  mm in diameter with a hard rubber disc of the same diameter  $(1,5 \pm 0,5)$  mm thick stuck to one face, the reverse face being provided with a handle (see Figure 1).

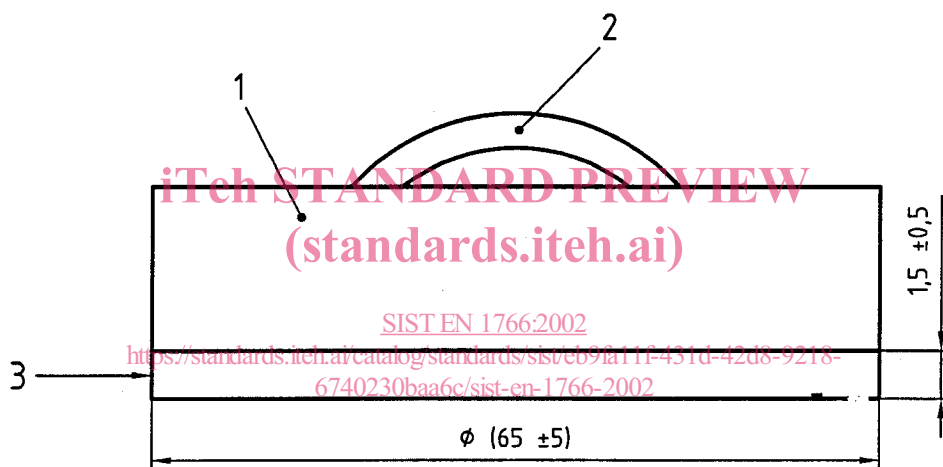

#### Legend

- 1 Wooden disk
- 2 Handle
- 3 Rubber disk

Figure 1 — Disk for surface roughness measurement

## 5 Materials

### 5.1 Aggregates

Aggregates shall be natural and silica-based with low water absorption (less than 2 % by mass). The aggregate grading, measured according to EN 933-2, shall conform to the maximum sizes listed below and have an appropriate size distribution in order to obtain the mechanical properties specified for each type, i.e. tensile strength, tensile bond strength and compressive strength. For instance, typical aggregate gradings for this purpose are given in Annex A (informative).

### 5.2 Mixing water

Water according to prEN 1008 shall be used.

### 5.3 Cement

Portland type CEM I 42,5 R according to ENV 197-1 shall be used.

### 5.4 Admixtures

Admixtures according to EN 934-2 shall be used.

### 5.5 Grit for surface preparation by blasting

Commercial grit for grit-blasting of concrete shall be used, with grain size within the range of 0,25 mm to 1,0 mm. The grit shall not contain ferrous components such as chilled cast iron slag which are prone to rusting.

### 5.6 Silica sand for measuring roughness

Silica sand with a grain size of 0,05 mm to 0,1 mm, dried to a constant weight, shall be used.

## 6 Reference concrete mixes

### 6.1 General

This standard specifies five types of reference concrete, defined by the maximum size of the aggregate and mix proportions. The reference concrete is chosen according to the type of product or system for the protection and repair of concrete structures and to the related test methods standards.

NOTE 1 The water taken into account hereafter in the water/cement ratio is the added water plus the water already contained in the admixtures and the additions.

NOTE 2 Workability should be appropriate to achieve adequate placing of concrete with freedom from bleeding or segregation. Any special requirements for surface finish of placed specimens for particular test methods using reference concrete samples will be stated in those test methods.

Admixtures conforming to EN 934-2 are permitted to give a workable concrete mix to meet the requirements of Table 1, or to confer adequate freeze-thaw resistance by entrainment of air.

NOTE 3 The application of a suitable plasticizer or superplasticizer conforming to EN 934-2 is likely to be required to achieve optimum compaction, as described in 6.4.

### 6.2 Reference concrete with 16 mm or 20 mm aggregate (see table 1)

#### 6.2.1 Compositions and properties

##### 6.2.1.1 Type C (0,40)

The mix shall contain 410 kg/m<sup>3</sup> cement and have a water/cement ratio of 0,40. Mixes shall have a 28 day mean compressive strength measured according to prEN 12390 of (60 ± 5) N/mm<sup>2</sup> for cubes and (50 ± 5) N/mm<sup>2</sup> for cylinders.

##### 6.2.1.2 Type C (0,45)

The mix shall contain 360 kg/m<sup>3</sup> cement and have a water/cement ratio of 0,45. Mixes shall have a 28 day mean compressive strength measured according to prEN 12390 of (50 ± 5) N/mm<sup>2</sup> for cubes and (40 ± 5) N/mm<sup>2</sup> for cylinders and, when applicable, a tensile strength measured according to EN 1542 of not less than 2,5 N/mm<sup>2</sup>.

##### 6.2.1.3 Type C (0,70)

The mix shall contain 260 kg/m<sup>3</sup> cement and a water/cement ratio of 0,70 ± 0,05. Mixes shall have a 28 day mean compressive strength measured according to prEN 12390 of (30 ± 5) N/mm<sup>2</sup> for cubes and (25 ± 5) N/mm<sup>2</sup> for cylinders and, when applicable, a tensile strength measured according to EN 1542 of not less than 1,5 N/mm<sup>2</sup>.



### 6.3 Reference concrete with 8 mm or 10 mm aggregate (see Table 1)

#### 6.3.1 Compositions and properties

##### 6.3.1.1 Type MC (0,40)

The mix shall contain 455 kg/m<sup>3</sup> cement and have a water/cement ratio of 0,40.

The reference concrete shall have an average surface tensile strength determined by the pull-off test according to EN 1542 with a minimum value of 3,0 N/mm<sup>2</sup>, but not for any individual result. The pull-off test shall be carried out on the prepared concrete surface immediately before applying the material to be tested, using at least one substrate specimen from each batch of concrete. At least one in every 15 specimens shall be tested.

NOTE The requirements are usually met by a concrete with a compressive strength which satisfies class C 60 for cubes and C 50 for cylinders (C50/60), as specified in prEN 206.

##### 6.3.1.2 Type MC (0,45)

The mix shall contain 395 kg/m<sup>3</sup> cement and have a water/cement ratio of 0,45.

The reference concrete shall have an average surface tensile strength determined by the pull-off test, according to EN 1542 with a minimum value of 2,5 N/mm<sup>2</sup>, but not for any individual result. The pull-off test shall be carried out on the prepared concrete surface immediately before applying the material to be tested, using at least one substrate specimen from each batch of concrete. At least one in every 15 specimens shall be tested.

NOTE The requirements are usually met by a concrete with a compressive strength which satisfies class C 50 for cubes and C 40 for cylinders (C 40/50), as specified in prEN 206.

THE STANDARD PREVIEW  
(standards.iteh.ai)

SIST EN 1766:2002

<https://standards.iteh.ai/catalog/standards/sist/eb9fa11f-431d-42d8-9218-6740230baa6c/sist-en-1766-2002>