



SLOVENSKI STANDARD

SIST EN 1543:1998

01-maj-1998

Proizvodi in sistemi za zaščito in obnovo betonskih konstrukcij - Preskusne metode - Določevanje razvoja natezne trdnosti polimerov

Products and systems for the protection and repair of concrete structures - Test methods - Determination of tensile strength development for polymers

Produkte und Systeme für den Schutz und die Instandsetzung von Betontragwerken - Prüfverfahren - Bestimmung der Zugfestigkeitsentwicklung von Polymeren

Produits et systemes pour la protection et la réparation des structures en béton - Méthodes d'essais - Détermination du développement de la résistance en traction des polymères

<https://standards.iteh.ai/catalog/standards/sist/9e692aca-9112-4eb6-967d-43d2cb47d1f5/sist-en-1543-1998>

Ta slovenski standard je istoveten z: EN 1543:1998

ICS:

91.080.40 Betonske konstrukcije Concrete structures

SIST EN 1543:1998 en

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1543:1998

<https://standards.iteh.ai/catalog/standards/sist/9e692aca-9112-4eb6-967d-43d2cb47d1f5/sist-en-1543-1998>

EUROPEAN STANDARD

EN 1543

NORME EUROPÉENNE

EUROPÄISCHE NORM

January 1998

ICS 91.080.40

Descriptors: concrete structures, repairs, protection, materials, polymers, epoxy resins, products for concrete construction, tests, determination, tensile strength, hardening

English version

Products and systems for the protection and repair of concrete structures - Test methods - Determination of tensile strength development for polymers

Produits et systèmes pour la protection et la réparation des structures en béton - Méthodes d'essais - Détermination du développement de la résistance en traction des polymères

Produkte und Systeme für den Schutz und die Instandsetzung von Betontragwerken - Prüfverfahren - Bestimmung der Zugfestigkeitsentwicklung von Polymeren

This European Standard was approved by CEN on 20 December 1997.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Central Secretariat: rue de Stassart, 36 B-1050 Brussels

Contents

Foreword	3
1 Scope	4
2 Test principle	4
3 General requirements for testing	4
3.1 Laboratory	4
3.2 Apparatus	4
3.3 Materials	4
4 Test procedure for the determination of the development of strength	5
4.1 Preparation of the resin.....	5
4.2 Mixing	5
4.3 Preparation of the moulds.....	5
4.4 Cleaning of the piston and of the rising main	5
4.5 Filling the moulds.....	5
5 Measurement of the development of strength	5
6 Calculation	6
7 Test report	6
Annex A (informative) Bibliography	10

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1543:1998

<https://standards.iteh.ai/catalog/standards/sist/9e692aca-9112-4eb6-967d-43d2cb47d1f5/sist-en-1543-1998>

Foreword

This European Standard has been prepared by Technical Committee CEN/TC 104 "Concrete (performance, production, placing and compliance criteria)", the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by July 1998, and conflicting national standards shall be withdrawn at the latest by July 1998.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

iTeh STANDARD PREVIEW (standards.iteh.ai)

SIST EN 1543:1998

<https://standards.iteh.ai/catalog/standards/sist/9e692aca-9112-4eb6-967d-43d2cb47d1f5/sist-en-1543-1998>

1 Scope

This European Standard specifies the method for determining the development of tensile strength during cure of resins, such as epoxy resins.

2 Test principle

The development of tensile strength is determined by measuring the tensile strength of the resin system at various ages of cure, and by interpolation arriving at the time to achieve the strength of 3 N/mm².

This test deals with two component resins for injection.

3 General requirements for testing

3.1 Laboratory

- the laboratory in which these tests will be done shall be equipped with a testing machine (see Annex A). A self aligning tensile strength test shall be carried out with a deformation velocity of 0,1 mm/min ;

- a conditioning room for resins before testing ;

- the testing machine shall be equipped with a temperature controlled cabinet which allows the maintenance of a constant temperature from $(5 \pm 1) ^\circ\text{C}$ to $(21 \pm 2) ^\circ\text{C}$, or other temperatures, providing all parties concerned agree.

3.2 Apparatus

a) Testing machine (see Annex A) , by means of a centric tensile test at a deformation rate of 0,1 mm/min ;

b) stopwatch.

The development of strength is measured with the apparatus shown in figure 1.

The apparatus consists of at least six moulds: cavities and pistons as dimensioned in figure 1.

The upper fixing device shall be constructed with universal joints in the tensile rod. All parts shall be made of steel.

The mould has a depth of $2_0^{+0,05}$ mm and a diameter of $25_0^{+0,05}$ mm (see figure 2).

The piston shall have a diameter of $25_{-0,05}^0$ mm (see figure 3).

3.3 Materials

Two component epoxy resins or other, as specified.

4 Test procedure for the determination of the development of strength

4.1 Preparation of the resin

The two components shall be prepared in accordance with the technical data sheet of the manufacturer of the product.

The two component resins and the test apparatus shall be maintained at the selected test temperature for a minimum of 24 h before mixing the resins. The temperature designated for the tests are $(5 \pm 1) ^\circ\text{C}$, $(15 \pm 2) ^\circ\text{C}$, $(21 \pm 2) ^\circ\text{C}$, but other suitable temperatures may be selected providing all parties concerned agree.

4.2 Mixing

The base and hardener components shall be carefully mixed together, by means of a slowly rotating electric stirrer and paddle, in accordance with the manufacturer's recommendations. To complete the mixing process, the resin shall be poured from one can to another and mixed again for 30 s. Start the stopwatch at the end of the mixing.

4.3 Preparation of the moulds

The cavity of the mould and the faces of the piston shall be abraded to provide a mechanical key. To prevent adhesion of excess of resin, the upper face of the mould plate shall be lightly smeared with a release agent.

4.4 Cleaning of the piston and of the rising main

Remaining resin at the piston shall be removed by solvent (e. g. 70 % dichloromethane, 20 % formic acid, 10% trichlorethylene) or other suitable solvent.

4.5 Filling the moulds

Immediately after mixing, the resin shall be poured into a 2 mm deep, 25 mm diameter recess to fill up about 1 mm.

The piston shall then be carefully lowered into position until its shoulder rests upon the upper face of the mould plate displacing excess resin through the central hole.

Storing and testing of the prepared specimen shall be done at the same temperature as described in 4.1.

5 Measurement of the development of strength

The time of cure shall be measured from the completion of the mixing.

For the validity of the test, it is necessary to get at least six correct results at each temperature.

At various ages of cure, the resin mould and piston shall be fixed to the tensile machine and the tensile strength measured, a tensile load is applied until failure occurs. The velocity of the deformation is 0,1 mm/min.

The maximum value of the tensile force shall be recorded. The tensile strength shall be calculated in relation to the surface area of the piston.

The time interval between tests shall be adjusted to give a spread of at least six results within the range "0 N/mm² to > 5,0 N/mm²" (one below 1 N/mm² and one above 5 N/mm²).

6 Calculation

The results shall be plotted as a graph tensile strength against cure time.

The time to reach 3 N/mm² is determined from the graph by interpolation and given to an accuracy of 1 min, this being done for each temperature.

7 Test report

The report shall contain the following informations :

- the identity and source of the product ;
- reference to this European Standard ;
- the date and place of sampling and testing ;
- the temperature of testing ;
- the mixing time ;
- a plot of tensile strength against cure time for each test temperature ;
- the rate of development of strength of 3 N/mm² ;
- the diameter and depth of each mould ;
- the interpolated cure time in minutes to reach a tensile strength of 3 N/mm².

- 1 tension device with universal joint
 - 2 connecting bolt
 - 3 centring screw
 - 4 detail "A"
 - 5 upper part : tensile machine
 - 6 lower part : mould clamping device and tensile machine
 - 7 connecting piece
 - 8 test piston
 - 9 clamping device
 - 10 mould
- EP epoxy resins

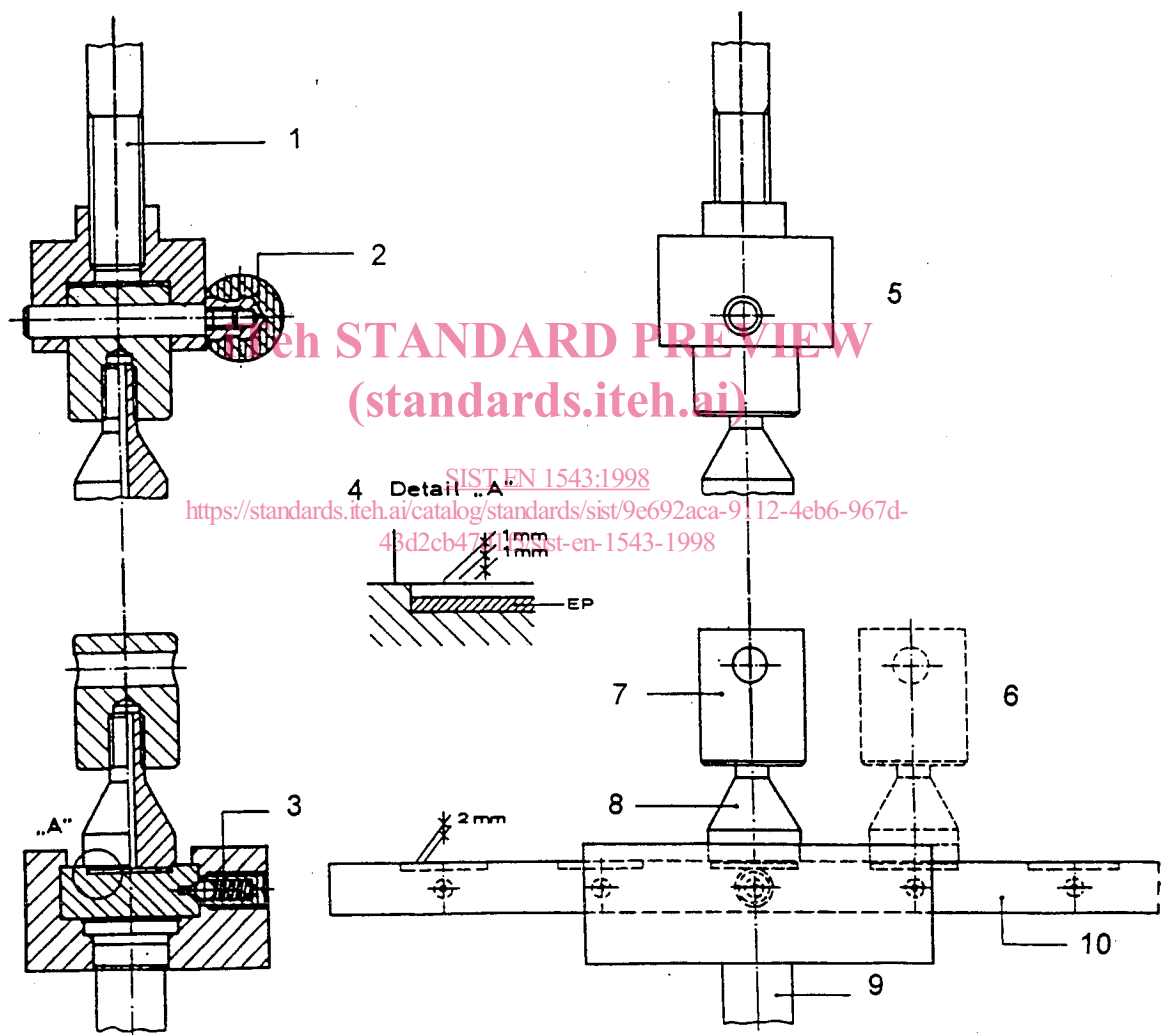


Figure 1 :Equipment for the determination of the strength development