



SLOVENSKI STANDARD

SIST EN 14566:2008

01-april-2008

A Y Ubg_Udf]fX]bUgfYXghj UnUg]ghYa Y]n'a Uj b] 'd`cý '!`8 YZ]b]W]YžnU H]j Y]b
dfYg_i gbY'a YrcXY

Mechanical fasteners for gypsum plasterboard systems - Definitions, requirements and test methods

Mechanische Befestigungsmittel für Gipsplattensysteme - Begriffe, Anforderungen und Prüfverfahren

iTeh STANDARD PREVIEW

Fixations mécaniques pour systèmes en plaques de plâtre - Définitions, spécifications et méthodes d'essai

[SIST EN 14566:2008](https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-6da02c789280/sist-en-14566-2008)

Ta slovenski standard je istoveten z: <https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-6da02c789280/sist-en-14566-2008> EN 14566:2008

ICS:

21.060.99

91.100.10

SIST EN 14566:2008

en,de

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 14566:2008

<https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-6da62c789280/sist-en-14566-2008>

ICS 21.060.99; 91.100.10

English Version

Mechanical fasteners for gypsum plasterboard systems - Definitions, requirements and test methods

Fixations mécaniques pour systèmes en plaques de plâtre -
Définitions, spécifications et méthodes d'essai

Mechanische Befestigungsmittel für Gipsplattensysteme -
Begriffe, Anforderungen und Prüfverfahren

This European Standard was approved by CEN on 25 November 2007.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

[SIST EN 14566:2008](https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-6da62c789280/sist-en-14566-2008)

<https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-6da62c789280/sist-en-14566-2008>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Contents

	page
Foreword.....	3
Introduction	4
1 Scope	6
2 Normative references	6
3 Terms and definitions	7
4 Requirements	8
4.1 Reaction to fire.....	8
4.2 Flexural strength (bending behaviour).....	8
4.3 Release of (regulated) dangerous substances.....	8
4.4 Additional requirements	8
5 Test methods.....	10
5.1 General.....	10
5.2 Number of samples.....	11
5.3 Dimensional measurement.....	11
5.4 Determination of withdrawal force.....	11
5.5 Determination of bending behaviour.....	12
5.6 Drilling time test.....	13
5.7 Determination of the thickness and/or mass of coating	14
5.8 Determination of pull-through force.....	14
6 Evaluation of conformity.....	15
6.1 General.....	15
6.2 Type testing.....	16
6.3 Factory production control (FPC)	16
7 Designation	18
7.1 Nails	18
7.2 Screws	18
7.3 Staples	18
8 Marking, labelling and packaging	19
Annex A (informative) Examples of fixing types.....	20
Annex B (informative) Sampling procedure for testing.....	23
Annex ZA (informative) Clauses of this European Standard addressing the provisions of the EU Construction Products Directive.....	25
Bibliography	29

Foreword

This document (EN 14566:2008) has been prepared by Technical Committee CEN/TC 241 “Gypsum and gypsum based products”, the secretariat of which is held by AFNOR.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by July 2008, and conflicting national standards shall be withdrawn at the latest by July 2008.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directive(s).

For relationship with EU Directive(s), see informative Annex ZA, which is an integral part of this document.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

(standards.iteh.ai)

SIST EN 14566:2008

<https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-6da62c789280/sist-en-14566-2008>

Introduction

Figures 1 and 2 show the relationship between this European Standard and the package of standards prepared to support the family of gypsum and ancillary products.

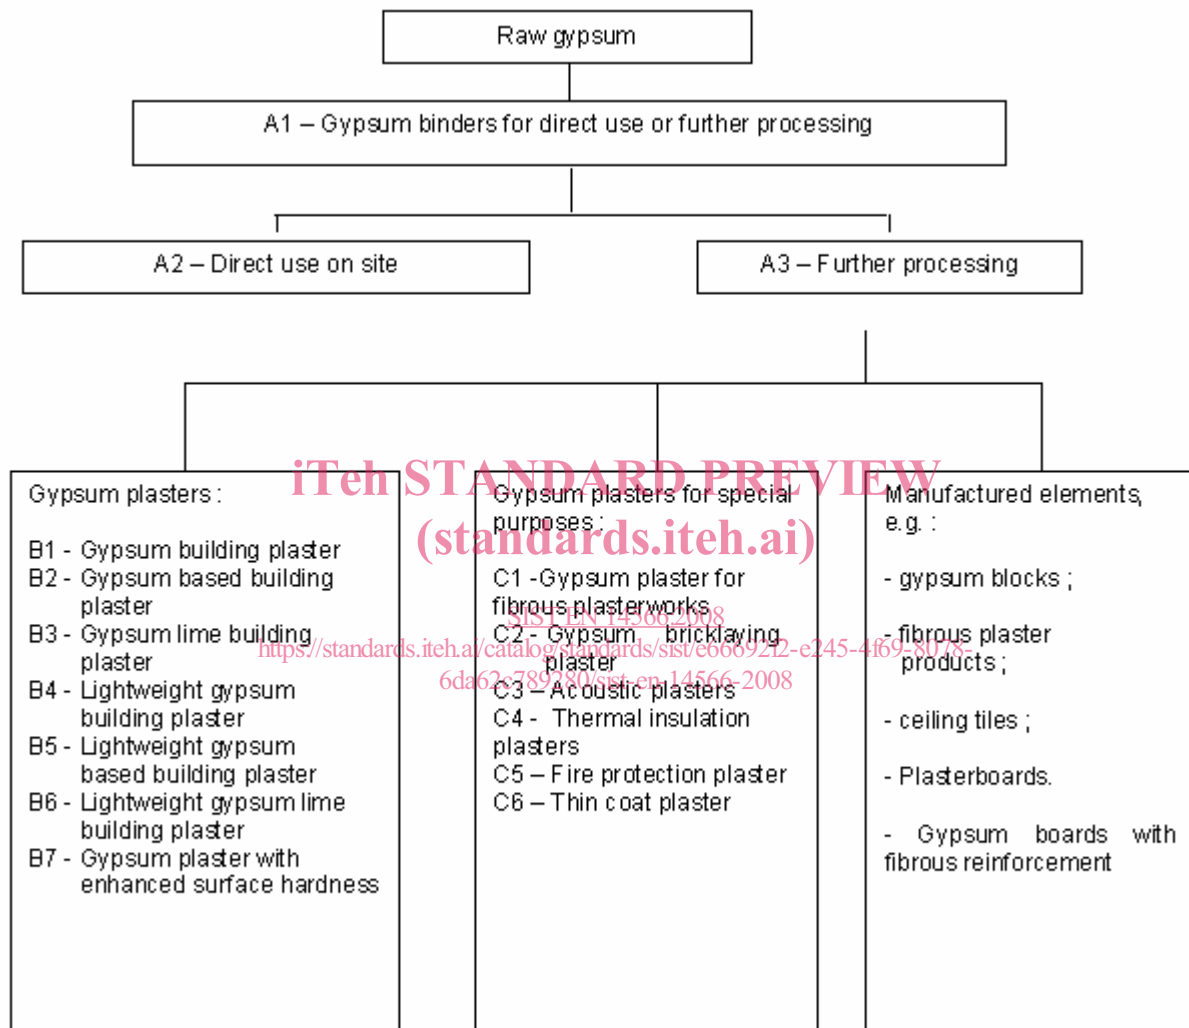


Figure 1 — Family of gypsum products

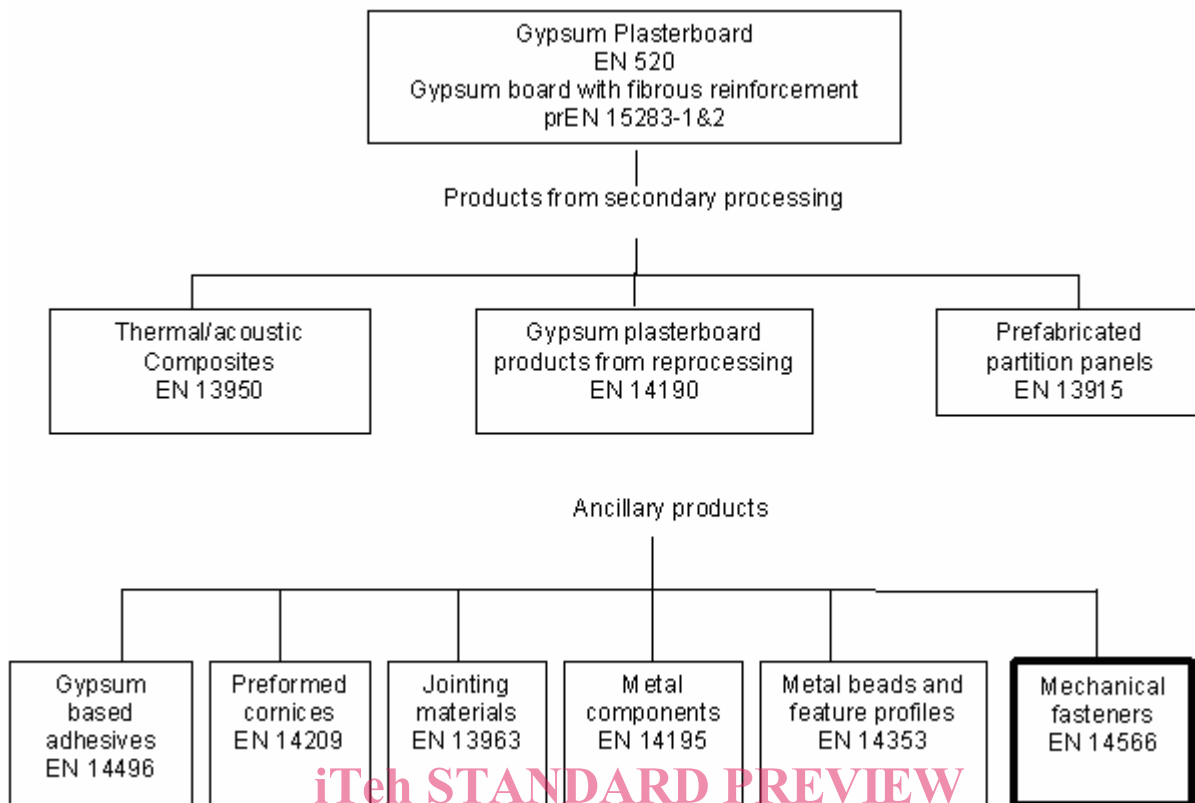


Figure 2 — Family of ancillary products

[SIST EN 14566:2008](https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-6da62c789280/sist-en-14566-2008)

<https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-6da62c789280/sist-en-14566-2008>

1 Scope

This European Standard specifies the characteristics and performance of mechanical fasteners, including nails, screws and staples, intended to be used for the fixing of gypsum plasterboard, gypsum boards with fibrous reinforcement, products from secondary processing and suitable ancillary products as shown in Figure 2, to timber and metal, as appropriate, in building construction works. The fasteners secure the board to the framing enabling its surface to be finished by jointing or plastering to receive decoration. They can also be used for the construction of the framing and for the connection between substructure and load bearing components and for fixing boards together. Mechanical fasteners contribute to the stability of the assembly.

This European Standard covers the following product performance characteristics: reaction to fire and flexural strength to be measured according to the corresponding European test methods.

It provides for the evaluation of conformity of the product to this European Standard.

This European Standard also covers the additional technical characteristics that are of importance for the use and acceptance of the products by the construction industry and the reference tests for these characteristics.

This European Standard does not cover nails, screws and staples intended for use with materials other than plasterboard and the plasterboard based products referred to above and their associated system components.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

- EN 338, *Structural timber — Strength classes* [SIST EN 14566:2008](https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-61af2e789280/sist-en-14566-2008)
<https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-61af2e789280/sist-en-14566-2008>
- EN 520, *Gypsum plasterboards — Definitions, requirements and test methods*
- EN 10016 (all parts), *Non-alloy steel rod for drawing and/or cold rolling*
- EN 10230-1, *Steel wire nails — Part 1: Loose nails for general applications*
- EN 10327, *Continuously hot-dip coated strip and sheet of low carbon steels for cold forming — Technical delivery conditions*
- EN 14195, *Metal framing components for gypsum plasterboard systems — Definitions, requirements and test methods*
- EN ISO 6508-1, *Metallic materials — Rockwell hardness test — Part 1: Test method (scales A, B, C, D, E, F, G, H, K, N, T) (ISO 6508-1:2005)*
- EN ISO 7049, *Cross recessed pan head tapping screws (ISO 7049:1983)*
- EN ISO 7050, *Cross recessed countersunk (flat) head tapping screws (common head style) (ISO 7050:1983)*
- EN ISO 9001:2000, *Quality management system — Requirements (ISO 9001:2000)*
- EN ISO 9227, *Corrosion tests in artificial atmospheres — Salt spray tests (ISO 9227:2006)*
- EN ISO 12777-3:2002, *Methods of test for pallet joints — Part 3: Determination of strength of pallet joints (ISO 12777-3:2002)*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1

plasterboard nail

corrosion resistant steel wire nail with purpose made head, shank and point

NOTE Nails can vary in head profile, material and level of corrosion resistance. See Table 1 and Table A.1.

3.2

plasterboard screw

screw used without pilot holes for the assembly of plasterboard systems

NOTE Screws which go directly into plasterboard usually have a trumpet head. They are straight and free from burrs and capable of being driven by a power operated screwdriver. See Table A.2.

3.3

head

wide part of nail or screw used to drive the nail or screw into the materials to be joined

NOTE The head of nails can be one of two types according to function (see Table A.1). The surface can be smooth or chequered. The head of screws can be domed, flat or concave depending upon its use (see Table A.2).

3.4

point

sharp end opposite to the head which first penetrates the materials to be joined

NOTE The style and shape of the nail point is formed to permit entry and penetration of the timber.

3.5

shank

connection between the head and the point

NOTE Nails have a straight shank. The diameter of the round shank can vary according to length, function and thickness of the corrosion resistant treatment. It may be plain, have indentations, be annular ring rolled or may be separately treated to improve resistance to withdrawal.

3.6

thread

spiral extension to the shank of specific pitch and diameter appropriate to its function and use

NOTE The thread may be of single or multiple lead design.

3.7

plasterboard staple

double right angle, fastener, made from round, oval, square or rectangular wire, with two legs (shanks) usually of the same length connected by its crown (head) with the tips inclined, see Table A.4

NOTE Staples are U shaped, neatly formed and free from defects. Staples can be resin coated to increase withdrawal strength. The legs are straight and parallel and can be designed, in conjunction with the tip, to provide additional holding power when driven into substrate. The style and shape of the tips permit entry and guide and control the line and shape of the penetration of the timber or substrate. The tips have an inclined plane on one or both sides.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

<https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-6da62c789280/sist-en-14566-2008>

4 Requirements

4.1 Reaction to fire

Plasterboard nails, screws and staples made from steel are classified A1 (EN 13501-1) (no contribution to fire) without testing when they are not coated.

When they have an organic coating, their contribution to reaction to fire in end use condition is so small in the total assembly that they have no influence on the classification of the system tested.

4.2 Flexural strength (bending behaviour)

When tested in accordance with 5.5 no fastener shall show signs of breakage or cracking.

4.3 Release of (regulated) dangerous substances

NOTE See Annex ZA.

4.4 Additional requirements

4.4.1 Protective treatment

Where the producer is using a protective coating to achieve durability, the coating shall be sufficient to provide a satisfactory level of protection against corrosion. It shall reflect the condition where the fastener is subjected to temporary exposure during storage, construction and its remaining life in an unexposed cavity of the completed building.

Fasteners protected with coating other than zinc shall satisfy one of the three classes of performance given in Table 1, when tested in accordance with EN ISO 9227. This class shall be stated by the producer in its technical literature.

Table 1 — Classes of corrosion protection

Classification	Test duration	Criterion
	In hours	
Class 24	24	No visible rusting
Class 48	48	No visible rusting
Class 96	96	No visible rusting

Fasteners protected with zinc coating shall have a minimum coating thickness of 5 µm (35 g/m²) for screws and nails and 3 µm (21 g/m²) for staples when tested in accordance with 5.7.

4.4.2 Requirements for plasterboard nails

4.4.2.1 Materials

Plasterboard nails shall be produced from wire drawn from rods produced in accordance with EN 10016-1 to -4.

4.4.2.2 Head - Dimensions and tolerances

The diameter and tolerance of the head shall be stated by the producer in its technical literature.

When measured in accordance with 5.3.3.3, no more than five nails shall fail.

4.4.2.3 Shank

The shank diameter and tolerance shall be stated by the producer in its technical literature.

When measured in accordance with 5.3.3.1, no more than five nails shall fail.

4.4.2.4 Length

The nominal length and tolerance shall be stated by the producer in its technical literature.

When measured in accordance with 5.3.3.2, no more than five nails shall fail.

4.4.2.5 Withdrawal force

The withdrawal force from wood shall be at least 200 N when tested in accordance with 5.4. Not more than five nails shall fail.

4.4.3 Requirements for plasterboard screws**4.4.3.1 Materials and manufacture**

Plasterboard screws shall be manufactured from carbon steel either to EN ISO 7049 or EN ISO 7050.

4.4.3.2 Withdrawal force

The diameter and pitch of the threaded portion shall also be capable of providing sufficient withdrawal force to allow the screw to achieve a minimum value of 450 N when tested in accordance with 5.4. Not more than five screws shall fail.

[SIST EN 14566:2008](https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-6da62c789280/sist-en-14566-2008)

4.4.3.3 Point

<https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-6da62c789280/sist-en-14566-2008>

The points shall be designed to be self tapping (designation N) or self drilling (designation D) (see Table A.2 for examples of fastener types).

For type N screws, the points shall be designed with suitable thread to be capable of penetrating 0,6 mm galvanised steel sheet to EN 10327 when screws are tested in accordance with 5.6. No more than 5 screws shall exceed a penetration time of 1 s.

For type D screws, the points shall be designed to allow penetration of sections made from steel sheet to EN 10327 up to a thickness of 2 mm when screws are tested in accordance with 5.6. No more than 5 screws shall exceed a penetration time of 4 s.

4.4.3.4 Length

The nominal length and tolerances shall be stated by the producer in its technical literature.

When measured in accordance with 5.3.3.2, no more than five screws shall be outside the stated tolerances.

4.4.3.5 Hardness

The surface of the screws shall be case hardened to a minimum depth of 0,05 mm with a case hardness of 55 HRC to Rockwell cone according to EN ISO 6508-1. Not more than five screws shall fail.

4.4.4 Requirements for plasterboard staples

4.4.4.1 Materials and manufacture

Staples shall be manufactured from steel wire to EN 10230-1 by rolling to form a rectangular profile with oval edges having a minimum tensile strength of 950 N/mm² for wires of 1 mm to 1,3 mm and of 680 N/mm² for wires greater than 1,3 mm.

4.4.4.2 Withdrawal force

The withdrawal force of the staple from timber shall be 100 N when tested in accordance with 5.4. Not more than five staples shall fail.

4.4.4.3 Length

The nominal length and tolerances shall be stated by the producer.

When measured in accordance with 5.3.3.2, no more than five staples shall be outside the stated tolerances.

4.4.4.4 Crown width

The nominal width and tolerances of the crown shall be stated by the producer.

When measured in accordance with 5.3.3.3, no more than five staples shall be outside the stated tolerances.

iteh STANDARD PREVIEW
(standards.iteh.ai)

5 Test methods

5.1 General

[SIST EN 14566:2008
https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-6da62c789280/sist-en-14566-2008](https://standards.iteh.ai/catalog/standards/sist/e66692f2-e245-4f69-8078-6da62c789280/sist-en-14566-2008)

Not all tests specified in Clause 4 are appropriate to every type of fastener. Those tests which results from the requirements of clause 4 shall be carried out. For convenience, these are summarised in the Table 2 below.

Table 2 — Test methods

Tests to be done	Nails	Screws	Staples
5.3.3.1 Diameter of shank	4.4.2.3		
5.3.3.2 Length	4.4.2.4	4.4.3.4	4.4.4.3
5.3.3.3 Head diameter or Crown width	4.4.2.2		4.4.4.4
5.4 Withdrawal force	4.4.2.5	4.4.3.2	4.4.4.2
5.5 Bending behaviour	4.2	4.2	4.2
5.6 Drilling performance test		4.4.3.3	
5.7 Determination of coating thickness/mass	4.4.1	4.4.1	4.4.1
EN ISO 6508-1 Hardness		4.4.3.5	