
**Pipes and fittings made of unplasticized
poly(vinyl chloride) (PVC-U) for water
supply — Specifications —**

Part 4:

Valves and ancillary equipment

iTeh STANDARD PREVIEW

*Tubes et raccords en poly(chlorure de vinyle) non plastifié (PVC-U) pour
l'adduction d'eau — Spécifications —*

Partie 4: Robinets et accessoires

ISO 4422-4:1997

<https://standards.iteh.ai/catalog/standards/sist/a545af53-ef41-44d2-83ea-9c23aa781422/iso-4422-4-1997>



Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

iTeh STANDARD PREVIEW

International Standard ISO 4422-4 was prepared by Technical Committee ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*, Subcommittee SC 2, *Plastics pipes and fittings for water supplies*.

ISO 4422-4:1997

Together with the other parts, this part of ISO 4422 cancels and replaces ISO 4422:1990, which has been technically revised.

ISO 4422 consists of the following parts, under the general title *Pipes and fittings made of unplasticized poly(vinyl chloride) (PVC-U) for water supply — Specifications*:

- Part 1: General
- Part 2: Pipes (with or without integral sockets)
- Part 3: Fittings and joints
- Part 4: Valves and ancillary equipment
- Part 5: Fitness for purpose of the system

© ISO 1997

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

International Organization for Standardization
Case postale 56 • CH-1211 Genève 20 • Switzerland
Internet central@iso.ch
X.400 c=ch; a=400net; p=iso; o=isocs; s=central

Printed in Switzerland

ISO 4422 is one of a series of system standards for plastics piping systems which are being prepared within ISO/TC 138. Each system standard is based on a specific material for a specific application.

They conform to a standard multi-part format, each part dealing with a specific aspect of the overall system.

NOTE — At the present time, the reference document for the installation code is ISO/TR 4191, and this document will ultimately form part 6 of this International Standard.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[ISO 4422-4:1997](https://standards.iteh.ai/catalog/standards/sist/a545af53-ef41-44d2-83ea-9c23aa781422/iso-4422-4-1997)

<https://standards.iteh.ai/catalog/standards/sist/a545af53-ef41-44d2-83ea-9c23aa781422/iso-4422-4-1997>

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 4422-4:1997

<https://standards.iteh.ai/catalog/standards/sist/a545af53-ef41-44d2-83ea-9c23aa781422/iso-4422-4-1997>

Pipes and fittings made of unplasticized poly(vinyl chloride) (PVC-U) for water supply — Specifications —

Part 4: Valves and ancillary equipment

1 Scope

This part of ISO 4422 specifies the characteristics and properties of valves and ancillary equipment made of unplasticized poly(vinyl chloride) (PVC-U), to be used for buried water mains and services and for water supplies above ground, both inside and outside buildings.

The valves and ancillary equipment covered by this part of ISO 4422 are intended for the conveyance of cold water under pressure at temperatures up to 20 °C, for general purposes and for the supply of drinking water. This part of ISO 4422 is also applicable to water up to and including 45 °C (see figure 1 in ISO 4422-2:1996).

The following ancillaries are included:

— tapping saddles. <https://standards.iteh.ai/catalog/standards/sist/a545af53-ef41-44d2-83ea-9c23aa781422/iso-4422-4-1997>

2 Normative references

The following standards contain provisions which, through reference in this text, constitute provisions of this part of ISO 4422. At the time of publication, the editions indicated were valid. All standards are subject to revision, and parties to agreements based on this part of ISO 4422 are encouraged to investigate the possibility of applying the most recent editions of the standards indicated below. Members of IEC and ISO maintain registers of currently valid International Standards.

ISO 7-1:1994, *Pipe threads where pressure-tight joints are made on the threads — Part 1: Dimensions, tolerances and designation.*

ISO 580:1990, *Injection-moulded unplasticized poly(vinyl chloride) (PVC-U) fittings — Oven test — Test method and basic specification.*

ISO 2507-2:1995, *Thermoplastics pipes and fittings — Vicat softening temperature — Part 2: Test conditions for unplasticized poly(vinyl chloride) (PVC-U) or chlorinated poly(vinyl chloride) (PVC-C) pipes and fittings and for high impact resistance poly(vinyl chloride) (PVC-HI) pipes.*

ISO 2536:1974, *Unplasticized polyvinyl chloride (PVC) pressure pipes and fittings, metric series — Dimensions of flanges.*

ISO/TR 4191:1989, *Unplasticized polyvinyl chloride (PVC-U) pipes for water supply — Recommended practice for laying.*

ISO 4422-1:1996, *Pipes and fittings made of unplasticized poly(vinyl chloride) (PVC-U) for water supply — Specifications — Part 1: General.*

ISO 4422-2:1996, *Pipes and fittings made of unplasticized poly(vinyl chloride) (PVC-U) for water supply — Specifications — Part 2: Pipes (with or without integral sockets).*

ISO 4422-3:1996, *Pipes and fittings made of unplasticized poly(vinyl chloride) (PVC-U) for water supply — Specifications — Part 3: Fittings and joints.*

ISO 5752:1982, *Metal valves for use in flanged pipe systems — Face-to-face and centre-to-face dimensions.*

ISO 6708:1995, *Pipework components — Definition and selection of DN (nominal size).*

ISO 7349:1983, *Thermoplastics valves — Connection references.*

ISO 7508:1985, *Unplasticized polyvinyl chloride (PVC-U) valves for pipes under pressure — Basic dimensions — Metric series.*

ISO 8233:1988, *Thermoplastics valves — Torque — Test method.*

ISO 8659:1989, *Thermoplastics valves — Fatigue strength — Test method.*

ISO 9393-1:1994, *Thermoplastics valves — Pressure test methods and requirements — Part 1: General.*

ISO 9393-2:1997, *Thermoplastics valves — Pressure test methods and requirements — Part 2: Test conditions and basic requirements for PE, PP, PVC-U and PVDF valves.*

ISO 9853:1991, *Injection-moulded unplasticized poly(vinyl chloride) (PVC-U) fittings for pressure pipe systems — Crushing test.*

iteh STANDARD PREVIEW
(standards.iteh.ai)

[ISO 4422-4:1997](https://standards.iteh.ai/catalog/standards/sist/a545af53-ef41-44d2-83ea-9c23aa781422/iso-4422-4-1997)

<https://standards.iteh.ai/catalog/standards/sist/a545af53-ef41-44d2-83ea-9c23aa781422/iso-4422-4-1997>

3 Definitions

For the purposes of this part of ISO 4422, the definitions given in ISO 4422-1 apply.

4 Material

4.1 Valve bodies and ancillaries

The material from which the valve bodies and the main components of the ancillaries which are in contact with the conveyed water are made shall be PVC-U and shall comply with the requirements specified in ISO 4422-3.

4.2 Use of reworked material

Clean reworked material produced during the manufacture and works testing of products conforming to this part of ISO 4422 may be used in limited amounts, provided it is derived from the same compound as used for the relevant production, and does not prevent conformity to this part of ISO 4422.

5 General requirements

5.1 Appearance

When viewed without magnification, the internal and external surfaces of valves and ancillaries shall be smooth, clean and free from scoring, cavities and other surface defects which would prevent conformity with this part of ISO 4422.

5.2 Temperature derating

The temperature derating factor for working temperatures between 25 °C and 45 °C shall be the same as that specified for pipes in 5.4 of ISO 4422-2:1996.

6 Geometrical characteristics

6.1 Design of valves and ancillaries

6.1.1 Diameter

The nominal outside diameter d_n of valves and ancillaries shall correspond to and be designated by the nominal outside diameter of the pipes for which they are designed.

6.2 Valves

6.2.1 Types of valve

Valves covered by this part of ISO 4422 shall be categorized by the valve design, i.e. “gate”, “ball”, “diaphragm”, “plug” or “butterfly”, and by the type of connection, i.e. solvent-cementing, elastomeric sealing ring joints or flange joints.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

6.2.2 Joint dimensions

6.2.2.1 Sockets and spigots for solvent cement type valves

ISO 4422-4:1997

The socket and spigot dimensions of the valves and ancillary equipment shall be the same as for pipes and fittings conforming to ISO 4422-2 or ISO 4422-3, as applicable.

6.2.2.2 Sockets and spigots for sealing ring type valves

The socket and spigot dimensions of the valves shall be the same as for pipes and fittings conforming to ISO 4422-2 or ISO 4422-3, as applicable.

6.2.2.3 Mating dimensions for flange type valves

The mating dimensions of the flanges used on valves shall be in accordance with ISO 2536.

6.2.3 Laying lengths

Recommended laying lengths are given in manufacturers' catalogues.

6.2.3.1 Valves with plain socket ends

See figure 1.

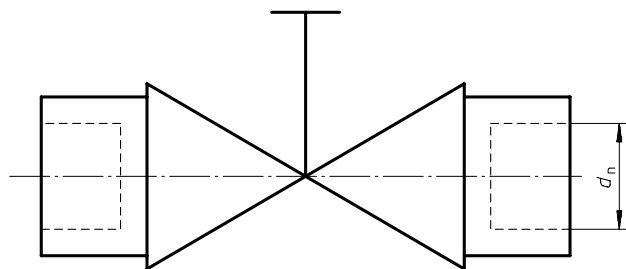


Figure 1 — Valve with plain socket ends

6.2.3.2 Valves with plain spigot ends

See figure 2.



ISO 4422-4:1997
<https://standards.iteh.ai/catalog/standards/sist/a545af53-ef11-44d2-83ea-9c23aa781422/iso-4422-4-1997>
Figure 2 — Valve with plain spigot ends

6.2.3.3 Valves with sealing ring type sockets

See figure 3.

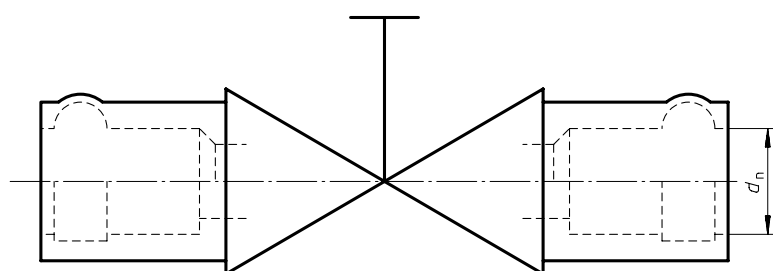


Figure 3 — Valve with sealing ring type sockets

6.2.3.4 Valves with flanged ends

6.2.3.4.1 Gate valves

See figure 4 and table 1.

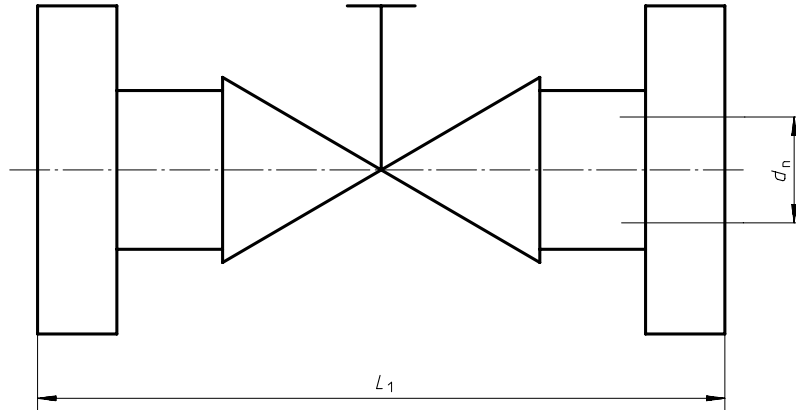


Figure 4 — Gate valve with flanged ends

iTeh STANDARD PREVIEW
Table 1 — Laying lengths of gate valves
(standards.iteh.ai)

Dimensions in millimetres

Nominal outside diameter of pipe d_n	Nominal size DN	Face-to-face length ¹⁾	
		short	long
50	40	165	240
63	50	178	250
75	65	190	270
90	80	203	280
110	100	229	300
140	125	254	325
160	150	267	350
225	200	292	400
280	250	300	450
315	300	356	500

1) Conforming to table 3 of ISO 5752:1982.