



SLOVENSKI STANDARD
SIST EN 14055:2011

01-oktober-2011

Izplakovalniki WC in pisoarjev

WC and urinal flushing cisterns

Spülkästen für WC-Becken und Urinale

Réservoirs de chasse d'eau pour WC et urinoirs

Ta slovenski standard je istoveten z: EN 14055:2010

[SIST EN 14055:2011
https://standards.iteh.ai/catalog/standards/sist/e7d8f8f2-8308-4a5e-b8d3-b05aa06086aa/sist-en-14055-2011](https://standards.iteh.ai/catalog/standards/sist/e7d8f8f2-8308-4a5e-b8d3-b05aa06086aa/sist-en-14055-2011)

ICS:

91.140.70 Sanitarne naprave Sanitary installations

SIST EN 14055:2011 **en,fr,de**

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 14055:2011

<https://standards.iteh.ai/catalog/standards/sist/e7d8f8f2-8308-4a5e-b8d3-b05aa06086aa/sist-en-14055-2011>

EUROPEAN STANDARD

EN 14055

NORME EUROPÉENNE

EUROPÄISCHE NORM

November 2010

ICS 91.140.70

English Version

WC and urinal flushing cisterns

Réservoirs de chasse d'eau pour WC et urinoirs

Spülkästen für WC-Becken und Urinale

This European Standard was approved by CEN on 16 October 2010.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

(standards.iteh.ai)

SIST EN 14055:2011

<https://standards.iteh.ai/catalog/standards/sist/e7d8f8f2-8308-4a5e-b8d3-b05aa06086aa/sist-en-14055-2011>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

Page

Foreword.....	4
1 Scope	5
2 Normative references	5
3 Terms and definitions	5
4 Classification.....	8
5 Requirements and test methods for class 1 products.....	8
5.1 Design	8
5.1.1 Flushing cistern equipment.....	8
5.1.2 Water supply connection	9
5.1.3 Supply piping	9
5.1.4 Removable parts	9
5.1.5 Connecting dimensions	9
5.1.6 Flush pipes	10
5.2 Hydraulic and mechanical characteristics.....	13
5.2.1 Flush volume.....	13
5.2.2 Water-saving devices.....	14
5.2.3 Flush rate and impact force.....	14
5.2.4 Overflow.....	15
5.2.5 Inlet valve opening characteristics for water saving flushing.....	16
5.2.6 Safety margin – Dimension “c”	16
5.2.7 Backflow prevention, air gap, safety margin – Dimension “a”	17
5.2.8 Outlet valve leaktightness	17
5.2.9 Outlet valve reliability.....	17
5.2.10 Operating force	17
5.2.11 Durability	17
5.3 Test methods.....	18
5.3.1 General.....	18
5.3.2 Flush volume.....	18
5.3.3 Flush rate	19
5.3.4 Determination of the overflow capacity.....	23
5.3.5 Inlet valve opening characteristics	24
5.3.6 Determination of dimension “c”	24
5.3.7 Determination of dimension “a”	24
5.3.8 Outlet valve leak tightness	24
5.3.9 Outlet valve reliability test	24
5.3.10 Operating force	25
5.3.11 Impact force.....	26
6 Functional requirements and test methods for class 2 products	30
6.1 Inlet valve.....	30
6.2 Backflow prevention.....	30
6.3 Marking of flushing cistern.....	30
6.4 Warning pipe and overflow provision.....	30
6.5 Flush volume.....	30
6.5.1 Full flush	30
6.5.2 Reduced flush	30
6.6 Flush rate	31
6.7 Physical endurance and leakage of flushing device.....	31
6.8 Chemical endurance of flushing device	31
6.9 Durability	31

6.10	Test methods	31
6.10.1	Inlet valve tests	31
6.10.2	Warning pipe and overflow provisions	32
6.10.3	Flush volume test	32
6.10.4	Flush rate test	33
6.10.5	Physical endurance and leakage test of flushing device	34
6.10.6	Chemical endurance test of flushing device	35
6.10.7	Requirements for compatibility testing of class 2 products	35
7	Requirements and test methods for class 3 products	36
7.1	Requirements and test methods	36
7.2	Adjustment	36
8	Acoustic characteristics	36
9	Dangerous substances	36
10	Marking and product designation	36
11	Evaluation of conformity	37
11.1	General	37
11.2	Type testing	37
11.2.1	Initial type testing	37
11.2.2	Further type testing	38
11.2.3	Sample, testing and compliance criteria	38
11.3	Factory production control	39
11.3.1	General	39
11.3.2	Testing equipment	39
11.3.3	Raw materials and components	39
11.3.4	Product testing and assessment	39
11.3.5	Non-conforming products	39
Annex ZA	(informative) Clauses of this European Standard addressing the provisions of the EU Construction Products Directive	40
ZA.1	Scope and relevant characteristic	40
ZA.2	Procedure for attestation of conformity of WC and urinal flushing cisterns	41
ZA.2.1	System of attestation of conformity	41
ZA.2.2	Declaration of conformity	42
ZA.3	CE marking and labelling	42
Bibliography	44

Foreword

This document (EN 14055:2010) has been prepared by Technical Committee CEN/TC 163 “Sanitary appliances”, the secretariat of which is held by UNI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by May 2011, and conflicting national standards shall be withdrawn at the latest by August 2012.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directive(s).

For relationship with EU Directive(s), see informative Annex ZA, which is an integral part of this document.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and the United Kingdom.

(standards.iteh.ai)

[SIST EN 14055:2011](https://standards.iteh.ai/catalog/standards/sist/e7d8f8f2-8308-4a5e-b8d3-b05aa06086aa/sist-en-14055-2011)

<https://standards.iteh.ai/catalog/standards/sist/e7d8f8f2-8308-4a5e-b8d3-b05aa06086aa/sist-en-14055-2011>

1 Scope

This European Standard specifies design, performance requirements and the test methods for WC and urinal flushing cisterns with flushing mechanism, inlet valve and overflow.

This document covers flushing cisterns designed to be connected to drinking water installations inside buildings.

This standard does not cover automatic valveless siphon flushing cisterns for flushing urinals.

NOTE Flushing cisterns for one-piece WCs and close-coupled suites are covered by EN 997.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 997:2003, *WC pans and WC suites with integral trap*

EN 1717, *Protection against pollution of potable water in water installations and general requirements of devices to prevent pollution by backflow*

EN 13407:2006, *Wall-hung urinals — Functional requirements and test methods*

EN 14124, *Inlet valves for flushing cisterns with internal overflow*

BS 1212-2:1990, *Float operated valves — Specification for diaphragm type float operated valves (copper alloy body) (excluding floats)*

BS 1212-3:1990, *Float operated valves — Specification for diaphragm type float operated valves (plastics bodied) for cold water services only (excluding floats)*

BS 1212-4:1991, *Float operated valves — Specification for compact type float operated valves for WC flushing cisterns (including floats)*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1

valve-type flushing cistern

cistern with integral valve outlet device, for storage and discharge of a defined volume of flushing water for removal of excrement from a WC pan

3.2


valveless-type flushing cistern

cistern with integral syphonic actuated outlet device, for storage and discharge of a defined volume of flushing water for removal of excrement from a WC pan


NOTE Both types of flushing cisterns are available, as detailed below:

EN 14055:2010 (E)


Wall-hung independent low-level



Built-in independent



Wall-hung independent mid-level



Wall-hung independent high-level



One-piece integral (with WC pan)



Close-coupled



iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 14055:2011](https://standards.iteh.ai/catalog/standards/sist/e7d8f8f2-8308-4a5e-b8d3-b05aa06086aa/sist-en-14055-2011)

<https://standards.iteh.ai/catalog/standards/sist/e7d8f8f2-8308-4a5e-b8d3-b05aa06086aa/sist-en-14055-2011>

3.3**close-coupled multiple use flushing cistern**

close-coupled flushing cistern for use with different WC pans

3.4**independent flushing cistern**

flushing cistern mounted separately from a WC pan or urinal

3.5**outlet valve**

mechanism for opening and closing the outlet orifice of the flushing cistern

3.6**operating mechanism**

mechanism to open, and if applicable, close the outlet valve

3.7**flush pipe**

connecting pipe between a flushing cistern's outlet and a WC's or urinal's inlet

3.8**overflow**

device enabling release of excess water from a flushing cistern when water reaches a pre-determined level

3.9**inlet valve**

valve that controls and shuts off the flow of water into a flushing cistern

3.10**overflow level**

water level corresponding to the upper edge of the overflow or to the lower edge of the overflow notch

3.11**maximum water level**

highest water level reached after flow stabilisation, in the event of continuous supply, as a result of malfunction of the inlet valve

3.12**critical water level**

highest water level in any part of the appliance, 2 s after the supply is cut off

3.13**residual water level**

water level after a full flush is completed

3.14**adjustable residual water level**

water level in a cistern, after (uninterrupted) flushing, when an outlet mechanism can be adjusted to the elevated residual water level

3.15**meniscus level**

level resulting from surface tension of water during overflowing

3.16**nominal water level**

water level when a flushing cistern is filled to the nominal flush volume

3.17**nominal flush volume**

volume of water indicated, when a flushing cistern is filled to the nominal water level

3.18**flush volume**

volume of water discharged from the flushing cistern during a flush cycle

3.19**safety margin**

c

distance between the nominal water level determined by the manufacturer and the overflow level

3.20**flush rate**

volume of water flowing out of a flushing cistern as a function of time

3.21**test height**

distance between the seat of the outlet valve and the horizontal axis of the flush pipe

3.22**impact force**

force of the flushing water at the outlet of the flush pipe

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 14055:2011

<https://standards.iteh.ai/catalog/standards/sist/e7d8f8f2-8308-4a5e-b8d3-b95aa06086aa/sist-en-14055-2011>

EN 14055:2010 (E)**3.23****flushing device**

device fitted to a cistern to provide controlled measured volume(s) of water to a WC pan or suite for flushing

3.24**water-saving device**

flushing device that permits a part of the total flush volume to be delivered, e.g. acting as double-action mechanisms (interruptible) or double-control mechanisms (dual control or dual flush)

3.25**warning level**

level of spill over of a vertically mounted warning pipe connection or the invert of a horizontally mounted warning pipe connection, or the level at which an equally effective (warning) device would operate

3.26**short-term leak test**

leak test consisting of a 15 min wait after flushing then positioning paper designed to change colour when wet, under the flushing device for 10 min

NOTE A leak is defined as being visible discharge of water amounting to more than three separate drops.

3.27**long-term leak test**

leak test consisting of a 2 h wait after flushing then positioning paper designed to change colour when wet, under the outlet for 15 min

NOTE A leak is defined as being visible discharge of water amounting to more than three separate drops.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

4 Classification

[SIST EN 14055:2011](https://standards.iteh.ai/catalog/standards/sist/e7d8f8f2-8308-4a5e-b8d3-b05aa06086aa/sist-en-14055-2011)

Flushing cisterns are classified as described below:
<https://standards.iteh.ai/catalog/standards/sist/e7d8f8f2-8308-4a5e-b8d3-b05aa06086aa/sist-en-14055-2011>

- **Class 1:** Flushing cisterns tested in accordance with the requirements of Clauses 5 and 8 using a nominal flush volume of either 4 l, 5 l, 6 l, 7 l or 9 l.
- **Class 2:** Flushing cisterns tested in accordance with the requirements of Clauses 6 and 8 using a maximum flushing volume of 6 l, or a dual-flush which combines a maximum flush of 6 l and a reduced flush no greater than two-thirds of the maximum flush.
- **Class 3:** Class 1 flushing cistern intended to be used in connection with urinals.

5 Requirements and test methods for class 1 products**5.1 Design****5.1.1 Flushing cistern equipment**

An equipped flushing cistern comprises:

- a shell, provided with a removable lid or an access flap allowing access to components;
- an inlet valve complying with EN 14124;
- a flushing device;

- an overflow device;
- an operating mechanism;
- a flush pipe, when the cistern is for use with an independent WC pan.

In special cases, a combined fitting providing the functions of filling, overflowing and evacuation is permissible. In this case, the fitting shall be designed to comply with the hygiene, physico-chemical, leaktightness, hydraulic, pressure resistance, acoustic and mechanical characteristics specified in EN 14124. The tests shall be performed on the flushing cistern as supplied.

5.1.2 Water supply connection

The inlet valve can be connected to the cistern through:

- the side;
- the back;
- the underside;
- the top.

5.1.3 Supply piping

All materials of the supply piping which could be in contact with drinking water shall not be a danger to health. They shall not change the taste, aroma or visual appearance of the drinking water.

5.1.4 Removable parts

It shall be possible to dismantle removable parts, without having to remove the flushing cistern.

5.1.5 Connecting dimensions

The connecting dimensions shall comply with Table 1.


Table 1 — Connecting dimensions (Figures 1 and 2)

Designation	Symbol	Dimensions mm	Remarks
Hole for inlet valve	—	19 ± 2^c	For inlet valves size 3/8"
		23 ± 2^c	For inlet valves size 1/2"
Hole for outlet valve	A	$63^{+2}_{-3}^c$	For ceramic flushing cisterns
		$61^{+2}_0^c$	For thin-walled flushing cisterns (e.g. plastic)
		$45^{+2}_{-3}^c$	For high level flushing cisterns
Inside diameter of outlet connection	B	$32,5^{+1}_0^c$	For flush pipes of design A
		$51^{+0,5}_0^c$	For flush pipes of design B
Outside diameter of outlet connection	C ^a	$49,5^{+0,4}_0^b$	For flush pipes of design C
Hole in the cover for operating device	—	$40^{+2}_{-1}^c$	Recommended dimension

^a Not applicable to flushing cisterns built into wall frames.


^b Where the exterior diameter of the flush pipe is conical or has several stepped diameters, the maximum diameter is to be verified and recorded.

^c Other dimensions are permissible if the performance of the cistern is assured.

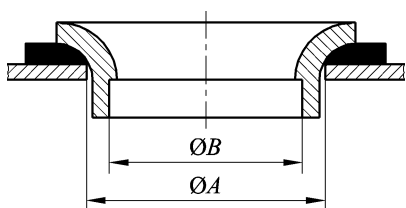

Key
See Table 1

Figure 1 — Outlet connection for flush pipes of designs A and B



Key
See Table 1

Figure 2 — Outlet connection for flush pipes of design C

5.1.6 Flush pipes

The dimensions of flush pipes designed to equip WC pans for independent supply shall comply with Table 2. The flush pipe shall be provided by the manufacturer of the flushing cistern.

Table 2 — Dimensions of flush pipes (Figures 3 to 6)

Designation	Symbol	Dimension mm	Remarks
Outside diameter at inlet	b	$32^{+0,5}_0$	For flush pipes of design A
		$50^{+0,5}_0$	For flush pipes of design B
Inside diameter	c	50^{+1}_0	For flush pipes of design C
Outside diameter at outlet to WC	e	$32^{+0,5}_0$	For flush pipes of design A
		$44^{+0,5}_0$	For flush pipes of design B
		$45^{+0,5}_0$	For flush pipes of design C
Inside diameter at outlet to WC	f	≥ 39	For flush pipes of designs B and C
Height of flush pipe	h	$\geq 1\ 500$	For flush pipes of design A
		≥ 165	For flush pipes of design B
		≥ 600	
		≥ 165	For flush pipes of design C
Length	k	≥ 210	For flush pipes of designs A and B
		≥ 180	For flush pipes of design C
Length of vertical inlet portion	m	≥ 100	For flush pipes of design A
Radius of bend	r	50 to 80	For flush pipes of design A
		≥ 15	For flush pipes of design B
		≥ 5	For flush pipes of design C

Apart from dimension e other dimensions are permissible, provided the performance requirements in 5.2 are satisfied.