



# Standard Specification for Crosslinked Polyethylene/Aluminum/Crosslinked Polyethylene Tubing OD Controlled SDR9<sup>1</sup>

This standard is issued under the fixed designation F 2262; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope

1.1 This specification covers establishes requirements for coextruded crosslinked polyethylene multi-layer pressure tubing with a continuously welded aluminum tube construction between inner and outer layers of plastic. The inner and outer crosslinked polyethylene layers are bonded to the aluminum by a melt adhesive. The tubing is outside diameter controlled and made in one standard dimension ratio, SDR9 and is intended to be used for hot and cold water conveyance in applications up to 180°F (82.2°C). Included in this specification is a system of nomenclature for crosslinked polyethylene-aluminum-crosslinked polyethylene (PEX-AL-PEX) tubes, and the requirements and test methods for materials, dimensions of component layers and the finished tubing, layer adhesion test, weld strength, short-term burst pressure, long-term sustained pressure and marking requirements. The tubing covered by this specification is intended for use in potable water distribution systems for residential and commercial applications, water service, hydronic radiant heating (HRH), radiant panel heating, baseboard, and snow melt systems.

1.2 This specification covers only plastic-metal-plastic multi-layer tubes incorporating a continuous welded aluminum tube. Tubing consisting of metallic layers not welded together is outside the scope of this specification.

1.3 *Units*—The values stated in inch-pound units are to be regarded as the standard. The values given in parentheses are mathematical conversions to SI units which are provided for information only and are not considered standard.

1.4 Specifications for connectors for use with pipe meeting the requirements of this specification are given in Annex A1.

1.5 The following precautionary caveat pertains only to the test method portion, Section 9, of this specification. *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory requirements prior to use.*

<sup>1</sup> This specification is under the jurisdiction of ASTM Committee F17 on Plastic Piping Systems and is the direct responsibility of Subcommittee F17.11 on Composites.

Current edition approved April 10, 2003. Published July 2003.

## 2. Referenced Documents

### 2.1 *ASTM Standards:*

- D 618 Practice for Conditioning Plastics and Electrical Insulating Materials for Testing<sup>2</sup>
- D 883 Terminology Relating to Plastics<sup>2</sup>
- D 1598 Test Method for Time-To-Failure of Plastic Pipe Under Constant Internal Pressure<sup>3</sup>
- D 1599 Test Method for Short-Time, Hydraulic Failure Pressure of Plastic Pipe, Tubing, and Fittings<sup>3</sup>
- D 1600 Terminology for Abbreviated Terms Relating to Plastics<sup>3</sup>
- D 2122 Test Method for Determining Dimensions of Thermoplastic Pipe and Fittings<sup>3</sup>
- D 2765 Test Methods for Determination of Gel Content and Swell Ratio of Crosslinked Ethylene Plastics<sup>4</sup>
- D 3350 Specification for Polyethylene Plastics Pipe and Fittings Materials<sup>4</sup>
- F 412 Terminology Relating to Plastic Piping Systems<sup>3</sup>

### 2.2 *NSF International Standards:*

- NSF/ANSI 14 for Plastic Piping Components and Related Materials<sup>5</sup>
- NSF/ANSI 61 for Drinking Water System Components-Health Effects<sup>5</sup>

### 2.3 *Federal Standard:*

- Fed. Std. No. 123 Marking for Shipments (Civil Agencies)<sup>6</sup>

### 2.4 *Military Standard:*

- MIL-STD-129 Marking for Shipment and Storage<sup>6</sup>

### 2.5 *Uniform Classification and Committee Standard:*

- Uniform Freight Classification<sup>7</sup>

### 2.6 *National Motor Freight Traffic Association Standard:*

- National Motor Freight Classification<sup>8</sup>

<sup>2</sup> *Annual Book of ASTM Standards*, Vol 08.01.

<sup>3</sup> *Annual Book of ASTM Standards*, Vol 08.04.

<sup>4</sup> *Annual Book of ASTM Standards*, Vol 08.02.

<sup>5</sup> Available from the NSF International, 789 Dixboro Rd., Ann Arbor, MI 48105.

<sup>6</sup> Available from Standardization Documents Order Desk, Bldg. 4 Section D, 700 Robbins Ave., Philadelphia, PA 19111-5094, Attn: NPODS.

<sup>7</sup> Available from the Uniform Classification Committee, Suite 1106, 222 South Riverside Plaza, Chicago, IL 60606.

<sup>8</sup> Available from the National Motor Freight Traffic Association, Inc., National Motor Freight Classification, American Tracking Associations, Inc., Traffic Dept., 1616 P St., NW, Washington, DC 20036.

**TABLE 1 Outside Diameters, Tolerances, and Aluminum Thickness for PEX-AL-PEX**

Nominal Tubing Size, in.	Average Outside Diameter, in. (mm)	Tolerance on Avg, in. (mm)	Maximum Out-of-Roundness, in. (mm)	Aluminum Thickness Minimum, in. (mm)
1/2	0.625 (15.88)	± 0.004 (0.10)	0.010 (0.25)	0.0095 (0.24)
3/4	0.875 (22.22)	± 0.004 (0.10)	0.010 (0.25)	0.0095 (0.24)
1	1.125 (28.58)	± 0.005 (0.12)	0.010 (0.25)	0.0115 (0.29)

**TABLE 2 Wall Thickness for PEX-AL-PEX**

Nominal Tubing Size, in.	Total Wall Thickness, min, in. (mm)	Tolerance on Total Wall, in. (mm)	Outer PEX Layer Thickness min, in. (mm)	Inner PEX Layer Thickness min, in. (mm)
1/2	0.070 (1.78)	+ 0.010 (0.25)	0.012 (0.30)	0.043 (1.09)
3/4	0.097 (2.47)	+ 0.010 (0.25)	0.013 (0.33)	0.069 (1.75)
1	0.125 (3.18)	+ 0.013 (0.33)	0.014 (0.36)	0.097 (2.46)

### 3. Terminology

3.1 Definitions are in accordance with Terminology F 412 and abbreviations are in accordance with Terminology D 1600, unless otherwise indicated.

#### 3.2 Definitions of Terms Specific to This Standard:

3.2.1 *tubing, PEX-AL-PEX, n*—multi-layer tubing produced by coextrusion or extrusion of layers of polyethylene/aluminum/ polyethylene bonded together with a melt adhesive and crosslinked by irradiation or chemical means in combination with applied heat and moisture, or any combination thereof.

3.2.2 *tubing hoop stress, n*— a value of hoop stress based on the assumption of a homogeneous wall cross-section.

3.2.2.1 *Discussion*—Thick walled plastic tubes produced from one material have hoop stresses that vary through the wall thickness, and are usually described by the Lamé Theory. The multi-layer nature of PEX-AL-PEX tubing, composed of materials with very different Young’s Modulus values, will, on pressurization, not have uniform stress distribution through the thickness of the wall of the tube. PEX-AL-PEX tubes have a hoop stress distribution that differs substantially from both thick and thin walled tubing cases.

3.2.3 *unaided eye, n*—observable without visual enhancement beyond correction for normal vision.

### 4. Classification

4.1 *General*—This specification covers one type of PEX-AL-PEX tubing with outside diameters corresponding to the outside diameter of the same nominal size as copper tubing (CTS).

4.2 *Tubing Outside Diameter*—The PEX-AL-PEX tubes specified in this standard are classified by the outside diameter in one standard dimension ratio, SDR9.

### 5. Materials

5.1 *General*—PEX-AL-PEX tubing is comprised of one metallic layer, two layers of polymeric adhesive and two-layers of crosslinked polyethylene. For tubing made to this specification, the constituent materials shall meet the respective requirements of 5.2-5.5.

5.2 *Aluminum*—The aluminum shall have a minimum thickness as specified in Table 1. The material shall have a minimum elongation and tensile strength of 20 % and 13 000 psi (90

MPa), respectively. The tests for these properties shall be conducted in accordance with ASTM E 8.

#### 5.3 Crosslinked Polyethylene:

5.3.1 Polyethylene plastics used to make the PEX layers of the PEX-AL-PEX tubing shall be virgin resin having a minimum density of 0.941 g/cm<sup>3</sup>. The outer layer of polyethylene shall be of color code B, C, or E in accordance with Specification D 3350. Color code B compounds shall have sufficient ultraviolet (UV) stabilization to protect the tubing from deleterious effects due to outdoor exposure during storage and shipping. The inner layer of polyethylene shall be of color code A, B, or C.

5.3.2 The polyethylene, in the final finished state in the tubing, shall be crosslinked as defined in Terminology D 883. The polyethylene layers may be crosslinked by peroxides, Azo compounds, or silane compounds in extrusion, or by electron beam irradiation after extrusion, or by other means such that the tubing meets the performance requirements of Section 6.

5.4 *Melt Adhesive*—The material shall have a density cell of 1, 2, or 3; a melt index cell of 1, 2, or 3; and a color code of A or B, in accordance with Specification D 3350.

5.5 *Rework Material*—The use of reclaimed, recycled, or re-work plastics is not permitted.

### 6. Requirements

6.1 *General*—The requirements and test methods in this specification cover PEX-AL-PEX tubing. Tests on the individual layers that comprise the final multi-layer tubing are outside the scope of this specification. The raw materials used, however, shall conform to the requirements of Section 5.

#### 6.2 Dimensions and Tolerances:

6.2.1 The dimensions of the tubing and layers shall be in accordance with Tables 1 and 2 when measured in accordance with 9.1.

6.2.1.1 *Out-of-Roundness*—Maximum out-of-roundness tolerances apply only to measurements made on pipe prior to coiling.

6.2.1.2 *Pipe Wall Thickness*—The minimum wall thickness at any point of measurement around the pipe circumference shall not be less than the value specified in Table 2.

6.2.1.3 *Outer and Inner PEX Layer Thickness*—The thickness of the PEX layers shall have a minimum value and tolerance as specified in Table 2, except for the polyethylene

material overlaying the weld, which shall allow half the minimum specified in Table 2.

6.3 *Adhesion*—There shall be no visible delamination or separation of the PEX and aluminum layers, either on the bore side or the outside (see Fig. 1), when examined with the unaided eye in accordance with 9.2.

6.4 *Burst Pressure*—Tubing shall meet or exceed the minimum burst pressure requirements shown in Table 3 when tested in accordance with 9.3.

6.5 *Sustained Pressure*—Tubing shall not fail, balloon, burst, or weep, as defined in Test Method D 1598 when tested for 10 h at the temperatures and pressures listed in Table 3 when tested in accordance with 9.4.

6.6 *Gel Content*—The inner and outer layers of crosslinked polyethylene, when tested in accordance with 9.5, shall be within the range from 65 to 89 % inclusive. Depending on the process used, the following minimum percentage crosslinking values shall be achieved: 70 % by peroxides, 65 % by Azo compounds, 65 % by electron beam, or 65 % by silane compounds.

6.7 *Apparent Ring Tensile Strength*—The pipe rings, when tested in accordance with 9.6, shall meet the minimum strength specifications defined in Table 4.

**7. Workmanship, Finish, and Appearance**

7.1 The tubing shall be free of visible cracks, blisters, holes, foreign inclusions and other known injurious defects. The

tubing shall be as uniform as practical in color, opacity, density and other physical properties.

**8. Sampling and Conditioning**

8.1 *Sampling*—Collect a sample of the PEX-AL-PEX tubing sufficient to determine conformance with this specification.

8.2 *Conditioning*:

8.2.1 For referee purposes, condition the specimens at 73.4 ± 3.6°F (23 ± 2°C) and 50 ± 5 % relative humidity for not less than 40 h prior to testing in accordance with Procedure A of Practice D 618, for those tests where conditioning is required. In cases of disagreement, the tolerances shall be ± 1.8°F (± 1°C) and ± 2 % relative humidity.

8.2.2 For routine quality control testing, condition the specimens at the temperature and humidity of the manufacturers testing facility for not less than 1 h or until the specimens are at the room temperature.

8.3 *Test Conditions*:


8.3.1 For referee purposes, conduct the tests in the standard laboratory atmosphere of 73.4 ± 3.6°F (23 ± 2°C) and 50 ± 5 % relative humidity, unless otherwise specified. In cases of disagreement, the tolerances shall be ± 1.8°F (± 1°C) and ± 2 % relative humidity.

8.3.2 For routine control testing, conduct tests at the room temperature and humidity of the manufacturers testing area.

**Outer PE Layer**

**Aluminum**

**Inner PE Layer**

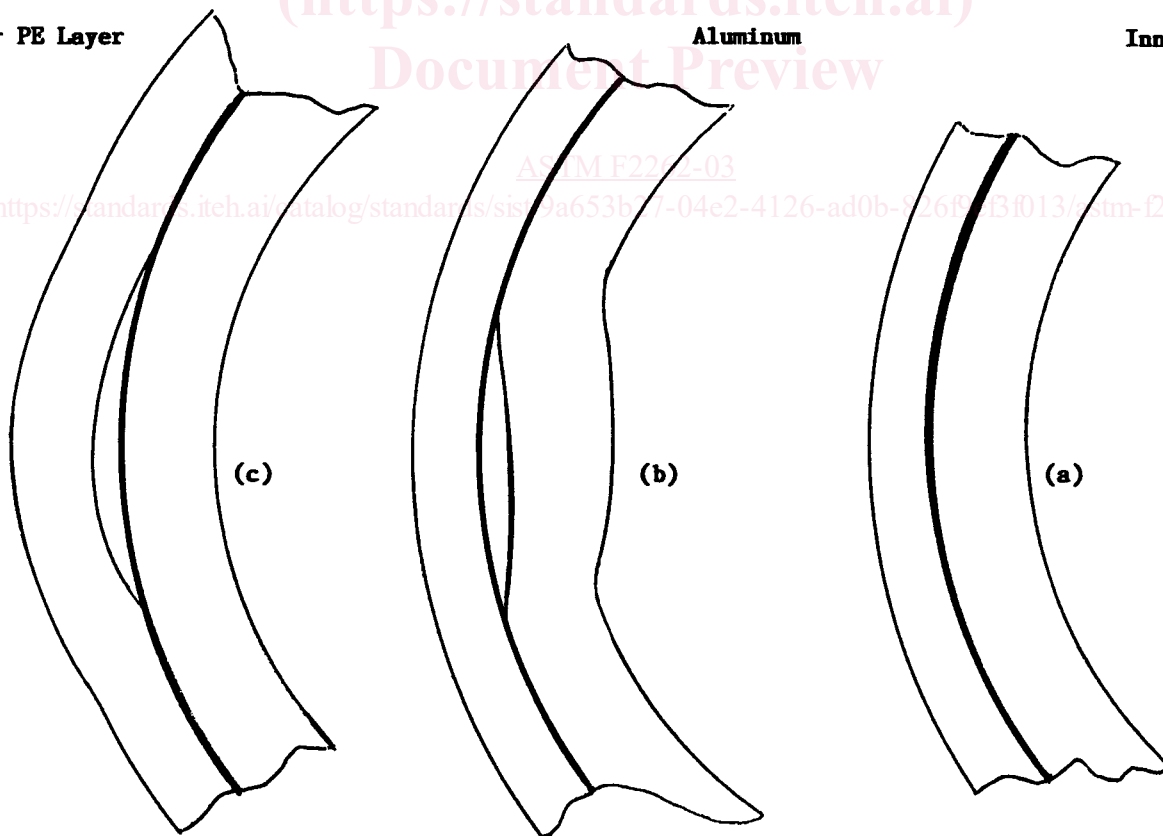

- (a) Good pipe showing no delamination.
- (b) Delamination between the inner layer and the aluminum
- (c) Delamination between the outer layer and the aluminum


**FIG. 1 Detection of Delamination**

**TABLE 3 Minimum Burst Pressure and Sustained Pressure Requirements**

Nominal Tubing Size, in.	Minimum Burst Pressure at 73°F (23°C), psi (kPa)	Minimum Burst Pressure at 180°F (82°C), psi (kPa)	Sustained Pressure Requirement at 180°F (82.2°C), psi (kPa)
1/2	880 (6000)	580 (4000)	395 (2720)
3/4	770 (5310)	465 (3200)	395 (2720)
1	685 (4720)	400 (2760)	395 (2720)

**TABLE 4 Minimum Ring Tensile Strengths**

Nominal Tubing Size, in.	Minimum Ring Tensile Strength, lb (N)
1/2	410 (1820)
3/4	410 (1820)
1	500 (2200)

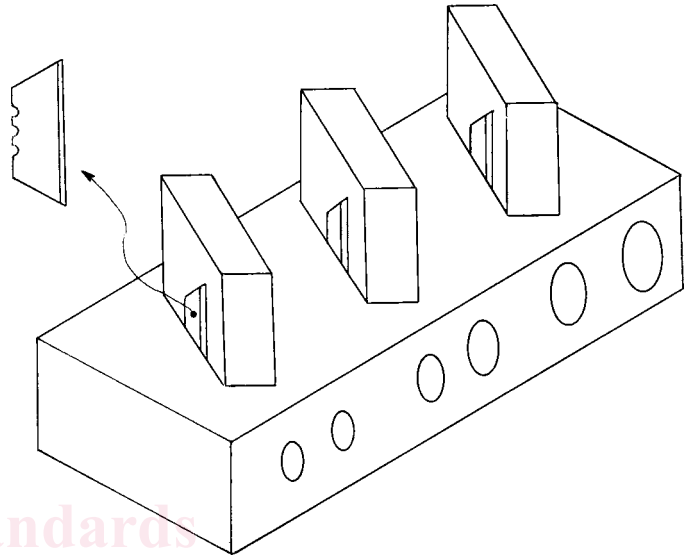

**FIG. 2 Spiral Cutter for the Delamination Test**

**9. Test Methods**

**9.1 Dimensions:**

9.1.1 Any length of tubing selected at random is suitable to determine dimensions.

9.1.2 *Outside Diameter*—Measure the outside diameter of tubing in accordance with Test Method D 2122.

9.1.3 *Total Wall Thickness*—Make measurements of the total wall thickness in accordance with Test Method D 2122. Measure the total wall thickness at each end of the sample to the nearest 0.001 in (0.02 mm).

9.1.4 *Inner and Outer Crosslinked Polyethylene Layer Thickness:*

9.1.4.1 *Sample Preparation*—Cut the tubing with a suitable sharp cutter ensuring that the tubing at the point of the cut and after cutting is no more than 10 % out-of-round.

9.1.4.2 *Thickness Determination*—Using a visual magnifying instrument with sufficient magnification to render a measuring resolution of 0.001 in. (0.02 mm) with a graduated reticle, measure the thickness of both inner and outer layers at six equally spaced points around the circumference.

**9.2 Adhesion Examination:**

9.2.1 *Cutting the Spiral*—Mount a Stanley 1991 or similarly sharp but rigid, razor-like blade within a protective housing and angle to cut a 45 ± 5° spiral in a pipe sample (see Fig. 2). Choose a PEX-AL-PEX tubing sample at random and insert into the housing and rotate to form the spiral cut. The cut goes through the complete wall on one side of the pipe only. Run the spiral along the pipe for a minimum distance along the pipe axis equal to five times the outside diameter.

9.2.2 *Examining for Delamination*—Firmly hold the tubing, cut as in 9.3.1, at the uncut end and create a ribbon of material by opening out the spiral-cut. Pliers can be used to grip the cut tubing. Visually examine the wall of the tubing side-on for evidence of delamination between the metal and plastic layers (see Fig. 1)

**9.3 Burst Pressure:**

9.3.1 *Samples*—Prepare five conditioned samples 12 ± 0.5 in (305 ± 13 mm) in length cut consecutively from a single length of tubing and seal the ends with appropriate connections or end caps as required. For testing in air, condition the samples at the test temperature for 4 h prior to pressurization.

When burst tests are to be conducted in a water bath, condition the samples in the water bath for 1 h prior to testing.

9.3.2 *Burst Pressure*—Determine the burst pressure for each sample in accordance with the procedure in Test Method D 1599. The test temperatures and minimum burst pressure values are given in Table 3.

**9.4 Sustained Pressure Test:**

9.4.1 *Samples*—Prepare six conditioned samples of each size to be tested. Each test sample shall have a minimum length between end closures of 10 times the nominal outside diameter but not less than 12 in. (305 mm). Seal the ends of samples with appropriate connections or end caps and fill the samples with water.

9.4.2 *Temperatures*—The test temperature shall be 180 ± 3.6°F (82 ± 2°C). The external test environment is water or air.

9.4.3 *Conditioning*—For testing in a water bath, condition the samples for a minimum of 2 h at the test temperature prior to pressurization. For testing in air, condition the samples at the test temperature for 4 h prior to pressurization. Maintain the test pressure ± 10 psi (± 70 kPa) for the duration of the test.

9.4.4 *Test Procedure*—After the appropriate conditioning period, raise the internal pressure to the test pressure of 395 ± 10 psi (2720 ± 69 kPa). Maintain this pressure for the duration of the test.

9.4.5 *Failure*—Any continuous loss of pressure of the test sample shall constitute failure of this test. Failure of one of the six samples is cause for retest of six additional samples. Failure of one of six of the retested samples constitutes failure of this test.

**9.5 Gel Content Determination:**