



SLOVENSKI STANDARD

SIST EN 12390-7:2009

01-julij-2009

BUXca Yý U

SIST EN 12390-7:2001

SIST EN 12390-7:2001/AC:2004

Preskušanje strjenega betona - 7. del: Gostota strjenega betona

Testing hardened concrete - Part 7: Density of hardened concrete

Prüfung von Festbeton - Teil 7: Dichte von Festbeton

Essai pour béton durci - Partie 7: Masse volumique du béton durci

[SIST EN 12390-7:2009](#)

Ta slovenski standard je istoveten z: EN 12390-7:2009

<http://standards.iteh.ai/catalog/standards/sist/5175142-5164860-986d-872f1622b95b/sist-en-12390-7-2009>

ICS:

91.100.30 Beton in betonski izdelki Concrete and concrete products

SIST EN 12390-7:2009

en,fr,de

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 12390-7:2009

<https://standards.iteh.ai/catalog/standards/sist/3517fd46-fdaf-4860-986d-872f1622b95b/sist-en-12390-7-2009>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 12390-7

February 2009

ICS 91.100.30

Supersedes EN 12390-7:2000

English Version

Testing hardened concrete - Part 7: Density of hardened concrete

Essai pour béton durci - Partie 7 : Masse volumique du béton durci

Prüfung von Festbeton - Teil 7: Dichte von Festbeton

This European Standard was approved by CEN on 27 December 2008.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

[SIST EN 12390-7:2009](https://standards.iteh.ai/catalog/standards/sist/3517fd46-fdaf-4860-986d-872f1622b95b/sist-en-12390-7-2009)

<https://standards.iteh.ai/catalog/standards/sist/3517fd46-fdaf-4860-986d-872f1622b95b/sist-en-12390-7-2009>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents		Page
Foreword.....		3
1	Scope	4
2	Normative references	4
3	Apparatus	4
4	Test specimens	4
5	Procedures	5
6	Test result.....	8
7	Test report	8
8	Precision.....	8
Bibliography.....		10

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 12390-7:2009](https://standards.iteh.ai/catalog/standards/sist/3517fd46-fdaf-4860-986d-872f1622b95b/sist-en-12390-7-2009)

<https://standards.iteh.ai/catalog/standards/sist/3517fd46-fdaf-4860-986d-872f1622b95b/sist-en-12390-7-2009>

Foreword

This document (EN 12390-7:2009) has been prepared by Technical Committee CEN/TC 104 “Concrete and related products”, the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by August 2009, and conflicting national standards shall be withdrawn at the latest by August 2009.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 12390-7:2000.

This standard is one of a series concerned with testing concrete.

The series EN 12390 includes the following parts:

EN 12390 Testing hardened concrete –

Part 1: Shape, dimensions and other requirements for specimens and moulds;

Part 2: Making and curing specimens (for strength tests);

Part 3: Compressive strength of test specimens;

Part 4: Compressive strength - Specification for testing machines;

Part 5: Flexural strength of test specimens;

Part 6: Tensile splitting strength of test specimens;

Part 7: Density of hardened concrete;

Part 8: Depth of penetration of water under pressure.

The following amendments have been made to the 2000-10 edition of this standard:

— editorial revision

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and the United Kingdom.

EN 12390-7:2009 (E)**1 Scope**

This European Standard specifies a method for determining the density of hardened concrete.

It is applicable to lightweight, normal-weight and heavy-weight concrete.

It differentiates between hardened concrete in the following states:

- 1) as-received;
- 2) water saturated;
- 3) oven-dried.

The mass and volume of the specimen of hardened concrete are determined and the density calculated.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 12390-1, *Testing hardened concrete – Part 1: Shape, dimensions and other requirements for test specimens and moulds*

ITCH STANDARD PREVIEW
(standards.itech.ai)

SIST EN 12390-7:2009

<https://standards.itech.ai/catalog/standards/sist/3517fd46-fdaf-4860-986d-872f1622b95b/sist-en-12390-7-2009>

3 Apparatus

3.1 Callipers and rules, capable of determining the dimensions of a specimen to within 0,5 %

3.2 Balance, equipped with a stirrup for weighing the specimen in both air and water to an accuracy of 0,1 % of the mass

3.3 Water tank, fitted with a device to maintain the water at a constant level and of sufficient size to allow the specimen on the stirrup to be fully immersed to a constant depth

NOTE If the reading of the balance is affected to within the accuracy required due to the displacement of water when immersing the specimen, then the tank should be fitted with a device to maintain the water at a constant level. The tank should be of sufficient size to allow the specimen to be fully immersed.

3.4 Ventilated oven, in which the temperature is capable of being controlled at $(105 \pm 5) ^\circ\text{C}$.

NOTE The apparatus required depends upon the method selected for determining the volume of the specimen.

4 Test specimens

The minimum volume of a specimen shall be 0,785 l. If the nominal maximum aggregate size of specimens cast in moulds exceeds 25 mm, the minimum volume shall be not less than $50D^3$, where D is the nominal maximum size of the coarse aggregate.

Normally, the entire specimen as received shall be used for the determination. If the shape or size of a specimen is such that it is not possible to use all of it, a smaller specimen may be broken or sawn from the original.

Capped specimens shall not be used.

5 Procedures

5.1 General

5.1.1 Determination of mass

This European Standard recognizes three conditions under which the mass of a specimen can be determined:

- a) as-received;
- b) water saturated;
- c) oven-dried.

5.1.2 Determination of volume

This European Standard recognizes three methods for determining the volume of the specimen:

- a) by water displacement (reference method);
- b) by calculation using actual measurements;
- c) for cubes, by calculation using checked, designated dimensions.

NOTE 1 The precision of the method depends on the method selected for measuring the volume of the specimen. Measurement of volume by the water-displacement method is the most precise, followed by calculation using measurement of actual dimensions and lastly calculation using checked, designated dimensions.

NOTE 2 The limitation to cubes in 5.1.2 c) of using designated dimensions in calculation of volume is due to the greater tolerance on length, according to EN 12390-1, of other specimen shapes.

5.2 Mass of as-received specimen

Weigh the as-received specimen m_r , to an accuracy of 0,01 % of the mass of the specimen. Record the value indicated in kg.

5.3 Mass of water saturated specimen

Immerse the specimen in water at $(20 \pm 2) ^\circ\text{C}$ until the mass changes by less than 0,2 % in 24 h, wiping the surplus water from the surface before each weighing. Record the value of the saturated mass m_s , in kg.

NOTE Specimens of concrete cured in water for at least 72 h prior to testing, may be assumed to be saturated to a constant mass.

5.4 Mass of oven-dried specimen

Dry the specimen in a ventilated oven at $(105 \pm 5) ^\circ\text{C}$ until the mass changes by less than 0,2 % in 24 h. Before each weighing, cool the specimen to near room temperature in a dry airtight vessel or desiccator. Record the value of the oven-dried mass m_o as indicated, in kg.

EN 12390-7:2009 (E)

5.5 Volume obtained by water displacement

5.5.1 General

Ensure that the specimen is in a saturated condition.

NOTE 1 This method is suitable for specimens of all shapes and is the only method suitable for specimens of irregular shape.

NOTE 2 This method is normally unsuitable for specimens of no-fines concrete, lightweight aggregate concrete with large pores, or specimens whose moisture content must not be altered. However, the application of a thin water impermeable layer can make this method practicable.

5.5.2 Mass in water

Determine the mass of the specimen in water according to the following procedure:

Raise the water tank until the stirrup, without a specimen, is immersed in the water tank and does not touch the bottom of the tank. Record the apparent mass of the stirrup m_{st} , in kg.

NOTE 1 The apparent mass of the stirrup may alternatively be allowed for using a zero setting facility on the balance (tareing).

Place the specimen in the stirrup and raise the water tank until the specimen is submerged and the water level on the stirrup is the same as it was without the specimen.

NOTE 2 Trapping of air bubbles on the sides of the specimen and on the stirrup should be avoided.

Record the apparent mass ($m_{st} + m_w$), in kg, of the immersed specimen and stirrup.

5.5.3 Mass in air

SIST EN 12390-7:2009
<https://standards.iteh.ai/catalog/standards/sist/3517fd46-fdaf-4860-986d-872f1622b95b/sist-en-12390-7-2009>

Determine the mass of the specimen in air according to the following procedure:

Remove the specimen from the stirrup and wipe the surplus water from the surfaces, using a damp cloth. Place the specimen on the balance and record the mass of the specimen in air m_a in kg.


5.5.4 Calculate the volume of the specimen

Calculate the volume of the specimen, using the formula:

$$V = \frac{m_a - [(m_{st} + m_w) - m_{st}]}{\rho_w} \quad (1)$$

where:

- V is the volume of the specimen, in m^3 ;
- m_a is the mass of the specimen in air, in kg;
- m_{st} is the apparent mass of the immersed stirrup, in kg;
- m_w is the apparent mass of the immersed specimen, in kg;
- ρ_w is the density of water, at 20°C , taken as 998 kg/m^3 .

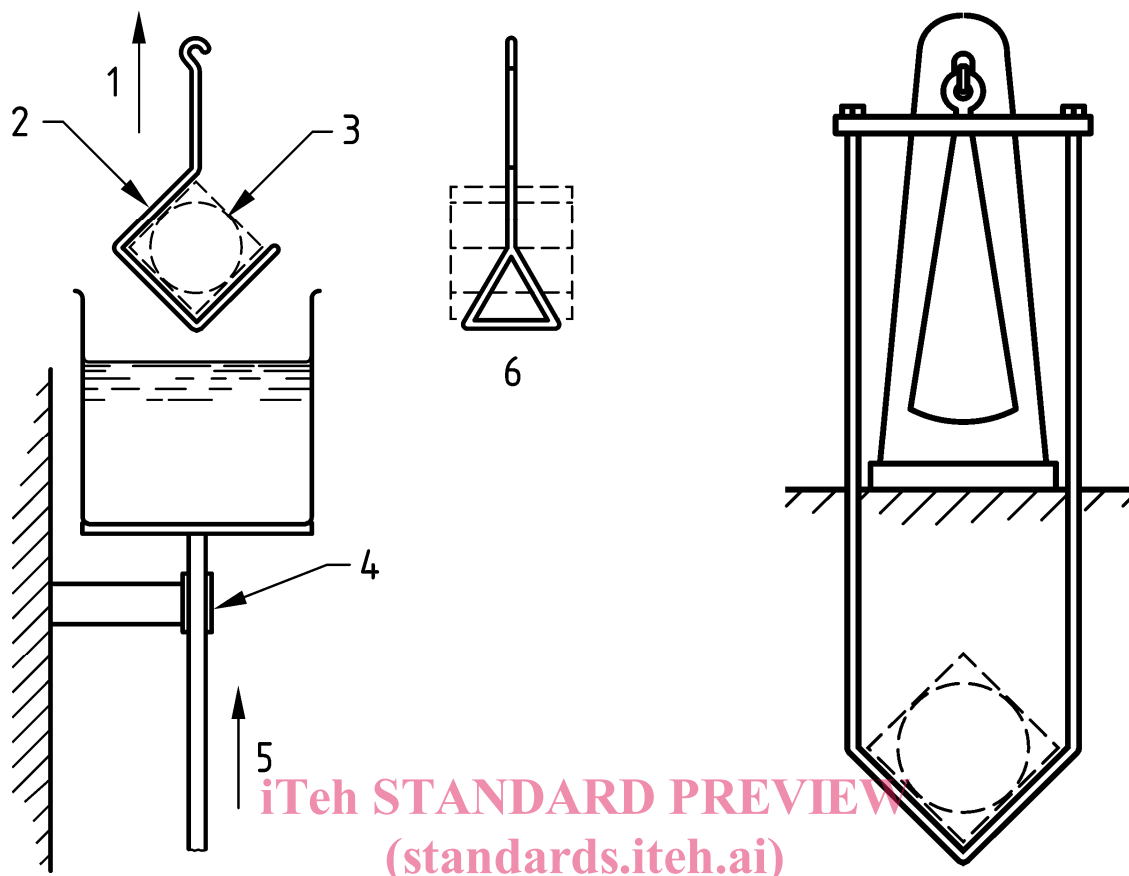

a) Stirrup suspended beneath balance mechanism b) Alternative form of stirrup suspended beneath balance mechanism

Key

- 1 Balance
- 2 Stirrup
- 3 Concrete specimen
- 4 Guide
- 5 Water tank is moved vertically
- 6 Side view of stirrup

Figure 1 — Typical stirrup arrangement for the determination of the volume of concrete specimens by water displacement

5.5.5 Volume obtained by measurement

Calculate the volume of the specimen from measurements made on the specimen in accordance with EN 12390-1, in m^3 , rounded to four significant figures.

5.5.6 Volume obtained by using designated dimensions (cubes only)

Confirm that the cube has been made in a calibrated mould, conforming to EN 12390-1.

Check the dimensions in accordance with EN 12390-1.

Calculate the volume of the cube in m^3 , expressed to 3 significant figures.