
Testing of concrete —
Part 2:
Properties of fresh concrete

Essais du béton —

Partie 2: Caractéristiques du béton frais

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 1920-2:2005

<https://standards.iteh.ai/catalog/standards/sist/a1cdbfeb-f238-4f37-9482-90dc41a37591/iso-1920-2-2005>



PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 1920-2:2005

<https://standards.iteh.ai/catalog/standards/sist/a1cdbfeb-f238-4f37-9482-90dc41a37591/iso-1920-2-2005>

© ISO 2005

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword.....	iv
Introduction	v
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Determination of consistence	2
4.1 General	2
4.2 Sampling	2
4.3 Slump test	2
4.4 Vebe test	5
4.5 Degree of compactability test	8
4.6 Flow-table test	11
4.7 Slump-flow test	15
5 Determination of fresh density	18
5.1 Principle	18
5.2 Apparatus	18
5.3 Sampling	19
5.4 Procedure	19
5.5 Test result	20
5.6 Test report	20
6 Determination of air content	21
6.1 General	21
6.2 Sampling	21
6.3 Filling the container and compacting the concrete	21
6.4 Pressure-gauge method	22
6.5 Water-column method	24
6.6 Calculations and expression of results	27
6.7 Test report	27
7 Test report	28
Annex A (informative) Precision — Data for the density measurements	29
Annex B (normative) Calibration of the container for the density test	30
Annex C (informative) Additional calculations for the density test	31
Annex D (informative) Precision — Water-column method	32
Annex E (normative) Calibration of apparatus — Pressure-gauge method	33
Annex F (normative) Calibration of apparatus — Water-column method	35
Annex G (normative) Aggregate corrector factor — Pressure-gauge method	38
Annex H (normative) Aggregate correction factor — Water-column method	40
Annex I (informative) Examples of test reports and worksheets	42
Bibliography	56

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 1920-2 was prepared by Technical Committee ISO/TC 71, *Concrete, reinforced concrete and pre-stressed concrete*, Subcommittee SC 1, *Test methods for concrete*.

This first edition of ISO 1920-2 cancels and replaces the first edition of ISO 4109:1980, ISO 4110:1979, ISO 4111:1979, ISO 4848:1980 and ISO 6276:1982, which have been technically revised.

ISO 1920 consists of the following parts, under the general title *Testing of concrete*:

- *Part 1: Sampling of fresh concrete*
- *Part 2: Properties of fresh concrete*
- *Part 3: Making and curing of test specimens*
- *Part 4: Strength of hardened concrete*
- *Part 5: Properties of hardened concrete other than strength*
- *Part 6: Sampling, preparing and testing of concrete cores*
- *Part 7: Non-destructive tests on hardened concrete*

Introduction

International Standards are widely adopted at the regional or national level and applied by manufacturers, trade organizations, purchasers, consumers, testing laboratories, authorities and other interested parties. Since these standards generally reflect the best experience of industry, researchers, consumers and regulators worldwide and cover common needs in a variety of countries, they constitute one of the important bases for the removal of technical barriers to trade. However, full adoption may not be practicable in all cases for reasons such as regional or national security, protection of human health or safety, or protection of the environment, or because of fundamental climatic, geographical or technological problems. As a consequence, the corresponding technical deviations to ISO standards are permitted where required by national or regional legislation or industry convention when adopting an International Standard.

Where such national deviations are required, it is important that they are clearly identified and the reasons for the deviations stated. Depending of on the method of adoption of the International Standard, the deviations will be noted in the national introduction, in the preface or foreword (for small numbers) or as a national annex (for large numbers). See ISO/IEC Guide 21-1 for more information.

ISO/TC 71 has identified those items in this part of ISO 1920-2 that may be the subject of national or regional deviations. The items are indicated in the text by the phrase "...except where the national annex to this part of ISO 1920 requires...".

iTeh STANDARD PREVIEW (standards.iteh.ai)

ISO 1920-2:2005

<https://standards.iteh.ai/catalog/standards/sist/a1cdbfeb-f238-4f37-9482-90dc41a37591/iso-1920-2-2005>

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 1920-2:2005

<https://standards.iteh.ai/catalog/standards/sist/a1cdbfeb-f238-4f37-9482-90dc41a37591/iso-1920-2-2005>

Testing of concrete —

Part 2: Properties of fresh concrete

Caution — When cement is mixed with water, alkali is released. When sampling, prevent skin contact with wet cement or concrete by wearing suitable protective clothing (gloves, footwear, safety glasses). If wet cement or concrete enters the eye, immediately wash it out thoroughly with clean water and seek medical treatment without delay. Wash wet concrete off the skin immediately.

Caution — The use of vibrating equipment, such as vibration tables, can cause damage to joints and loss of sensation due to nerve damage. Moulds, density containers, etc. should be clamped to the table and not held in position using one's hands while they are being vibrated.

1 Scope

This part of ISO 1920 specifies procedures for testing fresh concrete. It specifies the following test methods: determination of consistence (slump test, Vebe test, degree of compactability, flow-table test and for high-fluidity concrete, the slump-flow test), determination of fresh density and determination of air content by the pressure-gauge method and by the water-column method.

[ISO 1920-2:2005](https://standards.iteh.ai/catalog/standards/sist/a1cdbfeb-f238-4f37-9482-90dc41a37591/iso-1920-2-2005)

[https://standards.iteh.ai/catalog/standards/sist/a1cdbfeb-f238-4f37-9482-](https://standards.iteh.ai/catalog/standards/sist/a1cdbfeb-f238-4f37-9482-90dc41a37591/iso-1920-2-2005)

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 1101:1983, *Technical drawing — Geometric tolerances — Tolerancing of form, orientation, location and run-out — Generalities, definitions, symbols, indications on drawings*

ISO 1920-1, *Testing of concrete — Part 1: Sampling of fresh concrete*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1

fresh density

mass of a quantity of fully compacted fresh concrete divided by its volume

NOTE The fresh density is expressed in kilograms per cubic metre.

4 Determination of consistence

4.1 General

The consistence of the concrete is determined by one of the methods described below:

- slump test (see 4.3);
- Vebe test (see 4.4);
- degree of compactability (see 4.5);
- flow-table test. (see 4.6);
- slump-flow test for high-fluidity concrete (see 4.7).

These methods are not applicable to foamed concrete, no-fines concrete or where the maximum aggregate size exceeds 40 mm.

4.2 Sampling

Samples for the tests shall be obtained in accordance with ISO 1920-1. Each sample shall be remixed before carrying out the tests.

4.3 Slump test

iTeh STANDARD PREVIEW
(standards.iteh.ai)

4.3.1 Principle

The fresh concrete is compacted into a mould in the shape of a frustum of a cone. When the cone is withdrawn upwards, the distance the concrete has slumped provides a measure of the consistence of the concrete.

The slump test is applicable to a range of consistence of concrete that corresponds to slumps of between 10 mm and 210 mm. Outside this range, the measurement of slump may be unsuitable and other methods of determining the consistence should be considered.

If the slump continues to change over a period of 1 min after demoulding, this test is not suitable.

NOTE For high-fluidity concrete, the slump-flow test described in 4.7 is a more appropriate test.

4.3.2 Apparatus

Note the calibration requirements associated with each apparatus.

4.3.2.1 Mould, suitable of forming the test specimen, made of a metal not readily attacked by cement paste and not thinner than 1,5 mm.

The mould may be made either with or without a seam. The interior of the mould shall be smooth and free from projections such as protruding rivets and shall be free from dents. The mould shall be in the form of hollow frustum of a cone and shall have the following internal dimensions:

- diameter of base: 200 mm \pm 2 mm;
- diameter of top: 100 mm \pm 2 mm;
- height: 300 mm \pm 2 mm.

The base and the top shall be open and parallel to each other and at right angles to the axis of the cone. The mould shall be provided, on the upper portion, with two handles at two-thirds of the height, and at the bottom with fixing clamps or foot pieces to hold it steady. A mould that can be clamped to the base is acceptable, provided the clamping arrangement can be fully released without movement of the mould or interference with the slumping concrete.

The mould shall be visually checked prior to each use to assure that it is clean and is not damaged or dented. The cone shall be checked annually to ensure that its dimensions and conditions remain within tolerances.

4.3.2.2 Tamping rod, straight, made of steel, having a circular cross-section with a diameter of $16 \text{ mm} \pm 1 \text{ mm}$, $600 \text{ mm} \pm 5 \text{ mm}$ in length, and with rounded ends. The rod may be extended with a handle of plastic conduit, provided that the overall length does not exceed 1 000 mm.

The tamping rod shall be checked annually to ensure that its dimensions and conditions remain within tolerances.

4.3.2.3 Funnel (optional), made of a non-absorbent material not readily attacked by cement paste.

The funnel shall consist of two co-axial conical frustums having a common diameter of 100 mm, the ends being of greater diameter, one frustum to act as a filling funnel and the other as a collar to enable the funnel to be located on the outer surface of the mould.

The funnel shall be checked annually to ensure that its dimensions and conditions remain within tolerances.

4.3.2.4 Rule, graduated from 0 mm to 300 mm, at intervals not exceeding 5 mm, with the zero point being at the extreme end of the rule.

4.3.2.5 Base plate/surface, rigid, flat, non-absorbent and smooth plate or other surface on which to place the mould.

4.3.2.6 Shovel, with a square blade.

4.3.2.7 Re-mixing tray, of rigid construction and made from a non-absorbent material not readily attacked by cement paste.

It shall be of appropriate dimensions such that the concrete can be thoroughly remixed, using the square-bladed shovel.

4.3.2.8 Scoop, with a width of approximately 100 mm.

4.3.2.9 Timer or other similar **timing device**, to allow time measurement to 1 s.

The watch shall be properly calibrated at the time of test.

4.3.2.10 Moist cloth.

4.3.3 Procedure

Dampen the mould and the base plate. Wipe any excessive water from the surfaces, using an absorbent cloth. Place the mould on the horizontal base plate/surface. During filling, clamp or hold the mould firmly in place by standing on the two foot pieces.

Immediately after obtaining the sample in accordance with 4.2, fill the mould in three layers, each approximately one-third of the height of the mould when compacted. When adding the concrete, ensure that it is distributed symmetrically around the mould. Tamp each layer with 25 strokes of the tamping rod. Uniformly distribute the strokes over the cross-section of each layer. For the bottom layer, this will necessitate inclining the rod slightly and positioning approximately half the strokes spirally toward the centre. Tamp the second layer and the top layer each throughout its depth, so that the strokes just penetrate into the underlying layer. In filling and tamping the top layer, heap the concrete above the mould before tamping is started.

If the tamping operation of the top layer results in subsidence of the concrete below the top edge of the mould, add more concrete to keep an excess above the top of the mould at all times. Also ensure that the addition of concrete to the top layer does not provide extra compaction of the concrete. After the top layer has been tamped, scrape off the surface of the concrete level with the top of the mould by means of a sawing and rolling motion of the tamping rod.

Remove spilled concrete from the base plate/surface. Remove the mould in 5 ± 2 s by a steady upward lift with no lateral or torsional motion being imparted to the concrete. The lifting time may be shortened when required by the national annex.

The entire operation from the start of the filling to the removal of the mould shall be carried out without interruption and shall be completed within 180 s.

Immediately after removal of the mould, determine the slump, h , by measuring the difference between the height of the mould and that of the highest point of the slumped test sample (see Figure 1), except where the national annex to this part of ISO 1920 requires the measurement of the difference between the height of the mould and the centre point or the average height of the slumped concrete. Measure to the nearest 10 mm, except where the national annex to this part of ISO 1920 requires the measurement to the nearest 5 mm.

4.3.4 Test result

The test is valid only if it yields a true slump, this being a slump in which the concrete remains substantially intact and symmetrical as shown in Figure 2 a). If a specimen shears, as shown in Figure 2 b), take another sample and repeat the procedure.

Record the true slump, h , as shown in Figure 1 to the nearest 10 mm, or 5 mm when required by the national annex.

If two consecutive tests show a portion of the concrete shearing off from the mass of the test specimen, report the test as being invalid as the concrete lacks the necessary plasticity and cohesiveness for the slump test to be suitable.

iTech STANDARD PREVIEW
(standards.itech.ai)
<https://standards.itech.ai/catalog/standards/sist/a1cdbfeb-f238-4f37-9482-90dc41a37591/iso-1920-2-2005>


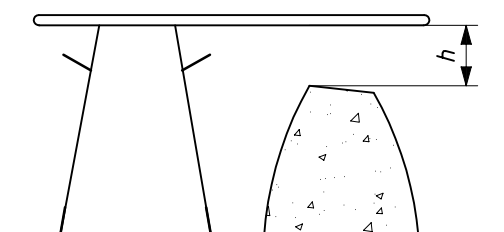


Figure 1 — Slump measurement

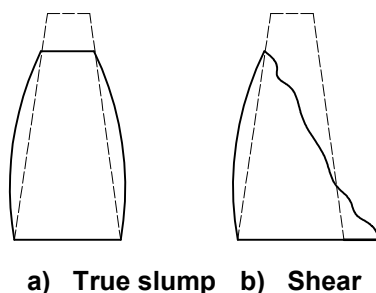

a) True slump b) Shear

Figure 2 — Forms of slump

4.3.5 Test report

In addition to the information required in Clause 7, the test report shall include the following:

- a) the slump, if there is a true slump, measured to nearest 10 mm (or 5 mm when required by the national annex), or;
- b) a notation that the test gave a sheared slump.

4.4 Vebe test

4.4.1 Principle

The fresh concrete is compacted into a slump mould. The mould is lifted clear of the concrete and a transparent disc is swung over the top of the concrete and carefully lowered until it comes in contact with the concrete. The slump of the concrete is recorded. The vibrating table is started and the time taken for the lower surface of the transparent disc to be fully in contact with concrete is measured.

If the Vebe time is less than 5 s or more than 30 s, the use of this test method to determine consistence may be unsuitable and other methods should be considered for this purpose.

4.4.2 Apparatus

Note the calibration requirements associated with each apparatus.

4.4.2.1 Consistometer (Vebe meter), consisting of the following items and as shown in Figure 3:

- a) **container** (Figure 3, item 1), cylindrical in shape, having an internal diameter of $240 \text{ mm} \pm 5 \text{ mm}$ and a height of $200 \text{ mm} \pm 2 \text{ mm}$, and made of a metal not readily attacked by cement paste. The thickness of the wall shall be 3 mm and that of the base, 7.5 mm.

The container shall be watertight and of sufficient rigidity to retain its shape under rough usage. It shall be fitted with handles and protected from corrosion. The container shall be provided with suitable foot pieces to enable it to be securely clamped to the top of the vibrating table (Figure 3, item 7) by means of wing nuts (Figure 3, item 8).

- b) **mould** (Figure 3, item 2), as described in 4.3.2.1, except that the fixing clamps or foot pieces are not required.

The mould shall be visually checked prior to each use to assure that it is clean and is not damaged or dented.

- c) **disc** (Figure 3, item 3), transparent, horizontal, attached to a rod (Figure 3, item 9) that slides vertically through a guide sleeve (Figure 3, item 5) mounted on a swivel arm (Figure 3, item 13) and which can be fixed in position by a screw (Figure 3, item 15).

The swivel arm also supports a funnel (Figure 3, item 4), the bottom of which coincides with the top of the conical mould when the latter is positioned concentrically in the container. The swivel arm is located by a holder (Figure 3, item 12) and can be fixed in position by a set-screw (Figure 3, item 6). When in the appropriate position, the axes of the rod and of the funnel shall be coincident with the axis of the container.


The transparent disc shall be $230 \text{ mm} \pm 2 \text{ mm}$ in diameter and $10 \text{ mm} \pm 2 \text{ mm}$ in thickness. A weight (Figure 3, item 14) placed directly above the disc shall be provided such that the moving assembly consisting of the rod, the disc and the weight has a mass of $2\,750 \text{ g} \pm 50 \text{ g}$. The rod shall be provided with a scale graduated to at least 5 mm intervals to record the slump of the concrete.

- d) **vibrating table** (Figure 3, item 7), 380 mm ± 3 mm in length and 260 mm ± 3 mm in width, supported on four rubber shock absorbers.

A vibrator unit (Figure 3, item 11), carried on a base (Figure 3, item 10) resting on three rubber feet, shall be securely fixed beneath it. The vibrator shall operate at a frequency of 55 Hz ± 5,5 Hz and the vertical amplitude of the vibration of the table with the empty container on top of it shall be approximately 0,5 ± 0,02 mm.

The vibrating table shall be checked annually to ensure that the frequency and vertical amplitude remain within tolerances.

All the elements of the vibration table shall be checked annually to ensure that their dimensions remain within tolerances.

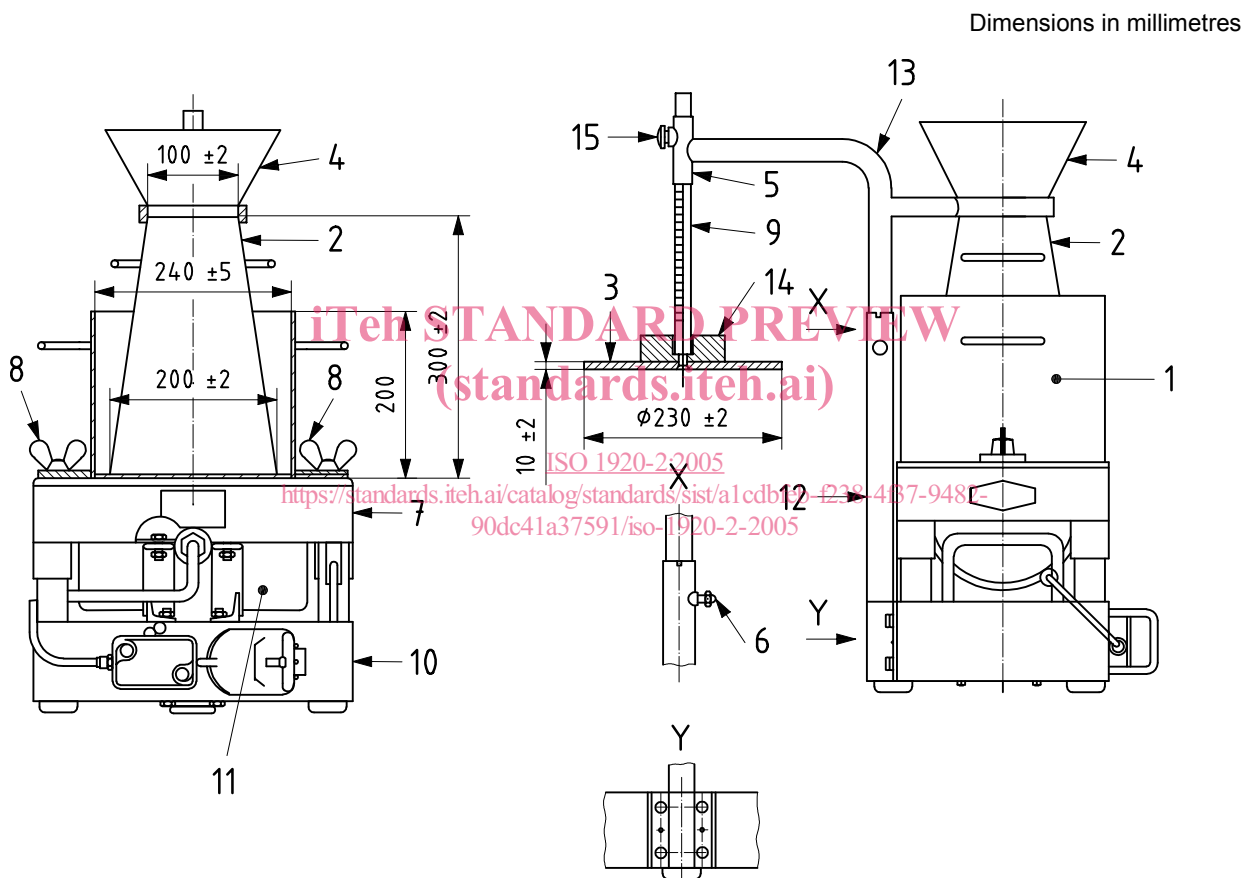

Key

- | | | |
|--------------------|----------------------|------------------|
| 1 container | 6 set-screw | 11 vibrator unit |
| 2 mould | 7 vibrating table | 12 holder |
| 3 transparent disc | 8 wing nuts | 13 swivel arm |
| 4 funnel | 9 rod | 14 weight |
| 5 guide sleeve | 10 base for vibrator | 15 screw |

Figure 3 — Consistometer (Vebe meter)

4.4.2.2 Tamping rod, straight, made of steel or other suitable metal, of circular cross-section, having a diameter of 16 mm ± 1 mm, 600 mm ± 5 mm in length, and with rounded ends.

4.4.2.3 Stopwatch or clock, capable of recording time to an accuracy of 0,5 s.

4.4.2.4 Remixing container, of rigid construction, made from a non-absorbent material not readily attacked by cement paste.

4.4.2.5 Scoop, with a width of approximately 100 mm.

4.4.2.6 Moist cloth.

4.4.3 Procedure

Place the Vebe meter (consistometer) on a rigid horizontal base free from extraneous vibration and shock. Make sure that the container (Figure 3, item 1) is firmly fixed to the vibrating table (Figure 3, item 7) by means of the wing nuts (Figure 3, item 8). Dampen the mould (Figure 3, item 2) and place it in the container. Swing the funnel (Figure 3, item 4) into position over the mould and lower the funnel on the mould. Tighten the screw (Figure 3, item 6) so that the mould cannot rise from the bottom of the container.

During the subsequent operations, ensure that the mould (Figure 3, item 2) does not rise or move until it is raised and do not allow any concrete to fall into the container (Figure 3, item 1).

From the sample of concrete obtained in accordance with 4.2, immediately fill the mould in three layers, each approximately one-third of the height of the mould when compacted. Tamp each layer with 25 strokes of the tamping rod. Uniformly distribute the strokes over the cross-section of each layer. For the bottom layer, this will necessitate inclining the rod slightly and positioning approximately half the strokes spirally toward the centre. Tamp the second layer and the top layer each throughout its depth, so that the strokes just penetrate into the underlying layer. In filling and tamping the top layer, heap the concrete above the mould before tamping is started.

(standards.iteh.ai)

If necessary, add further concrete to maintain an excess above the top of the mould throughout the tamping operation. After the top layer has been tamped, loosen the screw (Figure 3, item 6), raise and swing the funnel (Figure 3, item 4) through 90° and tighten the screw (Figure 3, item 6).

Scrape off the concrete level with the top of the mould with a sawing and rolling motion of the tamping rod. Remove the mould (Figure 3, item 2) from the concrete by raising it carefully in a vertical direction, using the handles. The operation of raising the mould shall be performed in 5 s to 10 s by a steady upward lift with no lateral or torsional motion being imparted to the concrete.

If the concrete shears [as shown in Figure 4 (b)], collapses [as shown in Figure 4 (c)], or slumps to the extent that it touches the wall of the container (Figure 3, item 1), this information shall be recorded.

If the concrete has not slumped into contact with the wall of the container (Figure 3, item 1) and a true slump, as shown in Figure 4 (a) has been obtained, the fact shall be recorded.

Swing the transparent disc (Figure 3, item 3) over the top of the concrete, tighten the screw (Figure 3, item 6), loosen the screw (Figure 3, item 15) and very carefully lower the disc until it just comes in contact with the concrete.

When the disc (Figure 3, item 3) just touches the highest point of the concrete without disturbing it, tighten the screw (Figure 3, item 15). When there is a true slump, the value of the slump shall be read from the scale (Figure 3, item 9) and the value recorded.


The screw (Figure 3, item 15) shall be loosened to allow the disc (Figure 3, item 3) to follow the concrete as it settles under the subsequent vibration. Simultaneously, start the vibration of the table and the timer. Observe through the transparent disc (Figure 3, item 3) how the concrete is being remoulded. As soon as the lower surface of the disc is fully in contact with cement grout, stop the timer and switch off the vibrating table. Record the time taken to the nearest second.

Complete the procedure within a period of 5 min from the start of filling.

The consistence of a concrete mix changes with time due to hydration of the cement and, possibly, loss of moisture. Tests on different samples should, therefore, be carried out at a constant time interval after mixing if strictly comparable results are to be obtained.

4.4.4 Test result

Record the time read from the stopwatch to the nearest second. This is the Vebe time expressing the consistence of the concrete under test.

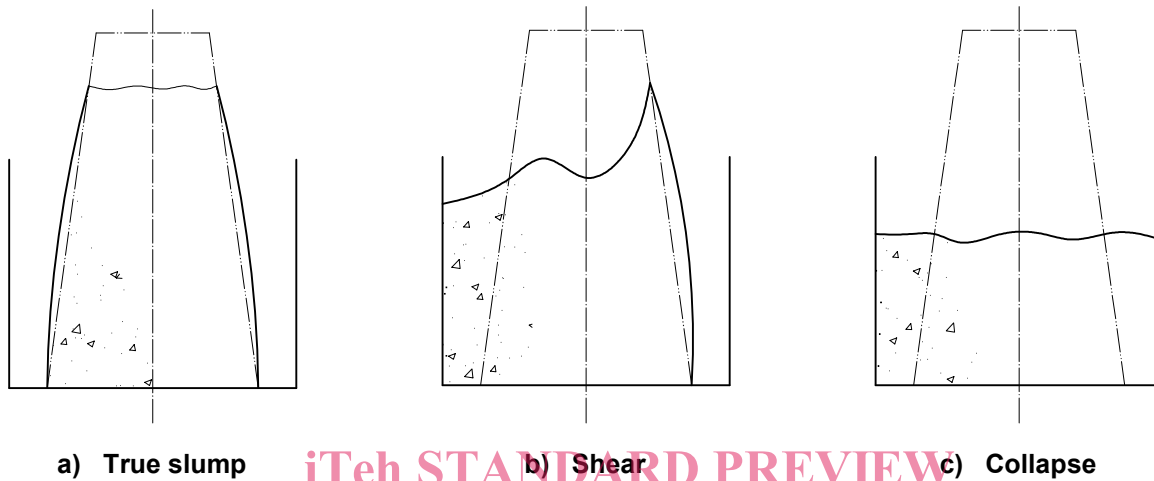

a) True slump

b) Shear

c) Collapse

iTeh STANDARD PREVIEW
(standards.iteh.ai)

Figure 4 — Forms of slump

ISO 1920-2:2005

4.4.5 Test report

<https://standards.iteh.ai/catalog/standards/sist/a1cdbfeb-f238-4f37-9482-90dc41a37591/iso-1920-2-2005>

In addition to the information required in Clause 7, the test report shall include the following:

- type of slump: true slump/collapse/shear;
- when there is a true slump, the measured slump, to nearest 10 mm;
- time from completion of mixing of the concrete until the time of removal of the mould;
- Vebe time, in seconds.

4.5 Degree of compactability test

4.5.1 Principle

The fresh concrete is carefully placed with a trowel in a container avoiding any compaction while filling. When the container is full, the top surface is scraped off level with the top of the container. The concrete is compacted and the distance from the surface of the compacted concrete to the upper edge of the container is used to determine the degree of compactability.

If the degree of compactability is less than 1,04 or more than 1,46, the concrete has a consistence for which the degree of compactability test is not suitable.

4.5.2 Apparatus

4.5.2.1 Container, with parallel sides and a general shape as shown in Figure 6, made of metal not readily attacked by cement paste and having the following internal dimensions:

- base: 200 mm \pm 2 mm \times 200 mm \pm 2 mm;
- height: 400 mm \pm 2 mm;
- The thickness of the base and walls shall be at least 1,5 mm.

The bottom of the container may be perforated to facilitate emptying. A suitable plastic plate to cover the bottom has then to be placed inside the container.

The dimensions and condition of the container shall be checked at the time of test to ensure that they are within the tolerances.

4.5.2.2 Trowel, with a flat blade (see Figure 5), or equivalent, e.g. square-bladed shovel.

Dimensions in millimetres

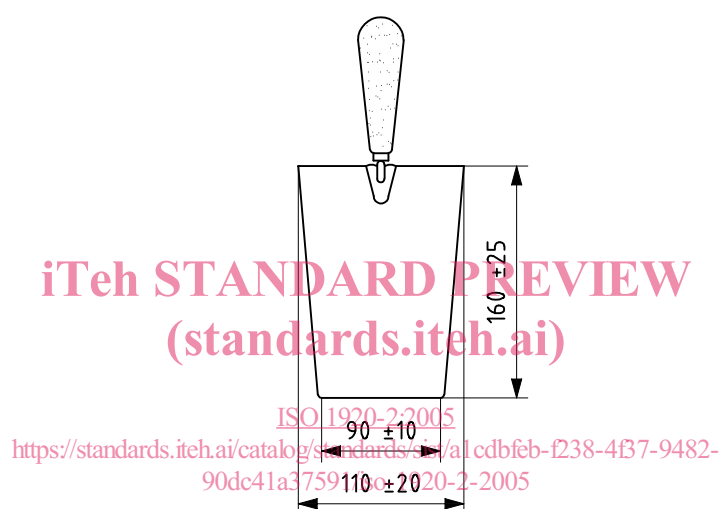


Figure 5 — Trowel

4.5.2.3 Means of compacting the concrete, consisting of one of the following:

- a) **internal vibrator**, with a minimum frequency of 120 Hz (7 200 cycles per minute). The diameter of the vibrating head shall not exceed one-quarter of the smallest dimension of the container.
- b) **vibrating table**, with a minimum frequency of 40 Hz (2 400 cycles per minute).

4.5.2.4 Remixing tray, of rigid construction, made from a non-absorbent material not readily attacked by cement paste.

4.5.2.5 Straight edged scraper, having a length of greater than 200 mm.

4.5.2.6 Rule, having a length of greater than 400 mm, having 1-mm subdivisions along its entire length with the zero point being at the extreme end of the rule.

4.5.2.7 Moist cloth.