

**Access, Terminals, Transmission and Multiplexing (ATTM);  
Broadband Deployment - Energy efficiency  
and broadband deployment;  
Part 5: Customer network infrastructures;  
Sub-part 2: Office premises (single-tenant)**

---

**iTeh STANDARD PREVIEW**  
(standards.iteh.ai)  
Full standard:  
<https://standards.iteh.ai/catalog/standards/sist/0ecb48f9-0ab1-497c-b6da-90626562981c/etsi-tr-105-174-5-2-v1.1.1-2009-10>



## Reference

DTR/ATTM-020005-4-1

## Keywords

access, cable, optical, site engineering

**ETSI**

650 Route des Lucioles  
F-06921 Sophia Antipolis Cedex - FRANCE

Tel.: +33 4 92 94 42 00 Fax: +33 4 93 65 47 16

Siret N° 348 623 562 00017 - NAF 742 C  
Association à but non lucratif enregistrée à la  
Sous-Préfecture de Grasse (06) N° 7803/88

**Important notice**

Individual copies of the present document can be downloaded from:

<http://www.etsi.org>

The present document may be made available in more than one electronic version or in print. In any case of existing or perceived difference in contents between such versions, the reference version is the Portable Document Format (PDF). In case of dispute, the reference shall be the printing on ETSI printers of the PDF version kept on a specific network drive within ETSI Secretariat.

Users of the present document should be aware that the document may be subject to revision or change of status. Information on the current status of this and other ETSI documents is available at

<http://portal.etsi.org/tb/status/status.asp>

If you find errors in the present document, please send your comment to one of the following services:

[http://portal.etsi.org/chaicor/ETSI\\_support.asp](http://portal.etsi.org/chaicor/ETSI_support.asp)

**Copyright Notification**

No part may be reproduced except as authorized by written permission.  
The copyright and the foregoing restriction extend to reproduction in all media.

© European Telecommunications Standards Institute 2009.  
All rights reserved.

**DECT™**, **PLUGTESTS™**, **UMTS™**, **TIPHON™**, the TIPHON logo and the ETSI logo are Trade Marks of ETSI registered for the benefit of its Members.

**3GPP™** is a Trade Mark of ETSI registered for the benefit of its Members and of the 3GPP Organizational Partners.

**LTE™** is a Trade Mark of ETSI currently being registered

for the benefit of its Members and of the 3GPP Organizational Partners.

**GSM®** and the GSM logo are Trade Marks registered and owned by the GSM Association.

# Contents

Intellectual Property Rights .....	4
Foreword.....	4
Introduction .....	4
1 Scope .....	5
2 References .....	5
2.1 Normative references .....	5
2.2 Informative references.....	5
3 Definitions and abbreviations.....	7
3.1 Definitions.....	7
3.2 Abbreviations .....	7
4 Customer networks in office premises (single-tenant).....	8
4.1 Overview of office network infrastructures.....	8
4.1.1 General.....	8
4.1.2 Network convergence .....	8
4.2 Infrastructure standardization activities.....	9
4.2.1 Generic cabling designs in accordance with EN 50173-2.....	9
4.2.1.1 Infrastructure design.....	9
4.2.1.2 Cabling media .....	10
4.2.2 Generic cabling for other services in office premises.....	10
4.2.3 Cabling installation in accordance with EN 50174 standards.....	11
4.3 Network access infrastructure .....	11
5 Energy efficiency .....	12
5.1 General .....	12
5.2 Energy efficiency of information technology infrastructures.....	12
5.3 The use of information technology to reduce total energy consumption.....	13
5.3.1 Infrastructure.....	13
5.3.2 Applications.....	13
5.3.3 Green issues.....	13
History .....	14

---

## Intellectual Property Rights

IPRs essential or potentially essential to the present document may have been declared to ETSI. The information pertaining to these essential IPRs, if any, is publicly available for **ETSI members and non-members**, and can be found in ETSI SR 000 314: *"Intellectual Property Rights (IPRs); Essential, or potentially Essential, IPRs notified to ETSI in respect of ETSI standards"*, which is available from the ETSI Secretariat. Latest updates are available on the ETSI Web server (<http://webapp.etsi.org/IPR/home.asp>).

Pursuant to the ETSI IPR Policy, no investigation, including IPR searches, has been carried out by ETSI. No guarantee can be given as to the existence of other IPRs not referenced in ETSI SR 000 314 (or the updates on the ETSI Web server) which are, or may be, or may become, essential to the present document.

---

## Foreword

This Technical Report (TR) has been produced by ETSI Technical Committee Access, Terminals, Transmission and Multiplexing (ATTM).

The present document is part 5-2 of a multi-part deliverable. Full details of the entire series can be found in part 1 [i.13].

---

## Introduction

The increasing interaction between the different elements of the Information Communication Technology (ICT) sector (hardware, middleware, software and services) supports the concept of convergence in which:

- multi-service packages can be delivered over a common infrastructure;
- a variety of infrastructures is able to deliver these packages;
- a single multi-service-package may be delivered over different infrastructures.

As a result of this convergence, the development of new services, applications and content has resulted in an increased demand for bandwidth, reliability, quality and performance, with a consequent increase in the demand for power which has implications for cost and, in some cases, availability. It is therefore important to maximize the energy efficiency of all the network elements necessary to deliver the required services.

New technologies and infrastructure strategies are expected to enable operators to decrease the energy consumption, for a given level of service, of their existing and future infrastructures thus decreasing their costs. This requires a common understanding among market participants that only standards can produce.

The present document is part 5-2 of a multi-part deliverable which has been produced by ETSI Technical Committee Access, Terminals, Transmission and Multiplexing (ATTM) in close collaboration with CENELEC via the Co-ordination Group on Installations and Cabling (CGIC). It offers a contribution to the required standardization process by establishing an initial basis for work on ICT networks and transmission engineering, with active collaboration from a number of other ETSI and CENELEC Technical Bodies. When complete, the documents will contain information that has been jointly evolved to present developments in installations and transmission implementation, and describing their progress towards energy efficiency in Next Generation Networks (NGN).

---

# 1 Scope

The present document details measures which may be taken to improve the energy efficiency within office premises (single-tenant) by virtue of broadband deployment. Clauses 2 and 3 contain references, definitions and abbreviations which relate to this part; similar information will be included in the corresponding clauses of the other parts, thus ensuring that each document can be used on a "stand-alone" basis.

Within the present document:

- clause 4 describes the nature of customer premises networks in homes (single tenant), defines the interfaces to those networks and identifies the standardization bodies working on the design and installation of those networks;
- clause 5 describes the strategies that may be employed within office premises (single tenant) to both increase the energy efficiency of installed information technology equipment and to use the facilities offered by information technology services to reduce overall energy consumption.

This will enable the proper implementation of services, applications and content on an energy efficient infrastructure, though it is not the goal of this multi-part deliverable to provide detailed standardized solutions for home broadband network architecture.

---

# 2 References

References are either specific (identified by date of publication and/or edition number or version number) or non-specific.

- For a specific reference, subsequent revisions do not apply.
- Non-specific reference may be made only to a complete document or a part thereof and only in the following cases:
  - if it is accepted that it will be possible to use all future changes of the referenced document for the purposes of the referring document;
  - for informative references.

Referenced documents which are not found to be publicly available in the expected location might be found at <http://docbox.etsi.org/Reference>.

NOTE: While any hyperlinks included in this clause were valid at the time of publication ETSI cannot guarantee their long term validity.

## 2.1 Normative references

The following referenced documents are indispensable for the application of the present document. For dated references, only the edition cited applies. For non-specific references, the latest edition of the referenced document (including any amendments) applies.

Not applicable.

## 2.2 Informative references

The following referenced documents are not essential to the use of the present document but they assist the user with regard to a particular subject area. For non-specific references, the latest version of the referenced document (including any amendments) applies.

- [i.1] European Commission: "DG-JRC Code of Conduct on Energy Consumption of Broadband Equipment".

- [i.2] CENELEC EN 50173-1: "Information technology - Generic cabling systems - Part 1: General requirements".
- [i.3] CENELEC EN 50173-2: "Information technology - Generic cabling systems -- Part 2: Office premises".
- [i.4] CENELEC EN 50174-1: "Information technology - Cabling installation - Part 1: Installation specification and quality assurance".
- [i.5] CENELEC EN 50174-2: "Information technology - Cabling installation - Part 2: Installation planning and practices inside buildings".
- [i.6] CENELEC EN 50174-3: "Information technology - Cabling installation - Part 3: Installation planning and practices outside buildings".
- [i.7] ETSI TS 102 973: "Access Terminals, Transmission and Multiplexing (ATTM); Network Termination (NT) in Next Generation Network architectures".
- [i.8] IEEE 802.3af: "IEEE Standard for Information Technology - Telecommunications and Information Exchange Between Systems - Local and Metropolitan Area Networks - Specific Requirements - Part 3: Carrier Sense Multiple Access with Collision Detection (CSMA/CD) Access Method and Physical Layer Specifications - Data Terminal Equipment (DTE) Power Via Media Dependent Interface (MDI)".
- [i.9] IEEE 802.3at: "Standard for Information Technology Telecommunications and Information Exchange Between Systems Local and Metropolitan Area Networks Specific Requirements Part 3: Carrier Sense Multiple Access with Collision Detection (CSMA/CD) Access Method and Physical Layer Specifications Amendment: Data Terminal Equipment (DTE) Power Via the Media Dependent Interface (MDI) Enhancements".
- [i.10] IEEE 802.3az: "IEEE Standard for Information Technology - Telecommunications and Information Exchange Between Systems - Local and Metropolitan Area Networks - Specific Requirements Part 3: Carrier Sense Multiple Access with Collision Detection (CSMA/CD) Access Method and Physical Layer Specifications - Amendment: Media Access Control Parameters, Physical Layers and Management Parameters for Energy-Efficient Ethernet".
- [i.11] ISO/IEC 11801: "Information technology- Generic cabling for customer premises".
- [i.12] Commission Regulation (EC) No 1275/2008 of 17 December 2008, implementing Directive 2005/32/EC of the European Parliament and of the Council with regard to "ecodesign requirements for standby and off mode electric power consumption of electrical and electronic household and office equipment".
- [i.13] ETSI TS 105 174-1: "Access, Terminals, Transmission and Multiplexing (ATTM); Broadband Deployment - Energy Efficiency and Key Performance Indicators; Part 1: Overview, common and generic aspects".
- [i.14] ETSI TS 105 174-5-4: "Access, Terminals, Transmission and Multiplexing (ATTM); Broadband Deployment - Energy Efficiency and Key Performance Indicators; Part 5: Customer network infrastructures; Sub-part 4: Data centres (customer)".
- [i.15] ETSI TR 105 174-4: "Access, Terminals, Transmission and Multiplexing (ATTM); Broadband Deployment - Energy Efficiency and Key Performance Indicators; Part 4: Access networks".

## 3 Definitions and abbreviations

### 3.1 Definitions

For the purposes of the present document, the following terms and definitions apply:

**application:** system, with its associated transmission method that is supported by telecommunications cabling (this corresponds to a Layer One application in the OSI 7-layer model)

**Broadcast Communication Technology (BCT) application:** system, with its associated transmission method using the HF band (3 MHz to 30 MHz), the VHF band (30 MHz to 300 MHz) and the UHF band (300 MHz to 3 000 MHz) dedicated to the transmission of sound radio, TV and two-way data services, as well as for in-home inter-networking

NOTE: See EN 50173-1 [i.2] modified.

**BCT service:** transmission of sound radio, TV and two-way data

NOTE: See EN 50173-1 [i.2] modified.

**Control, Command and Communications in Building (CCCB) application:** system, with its associated transmission method dedicated to providing appliance control and building control

NOTE: See EN 50173-1 [i.2] modified.

**CCCB services:** appliance control and building control

NOTE: See EN 50173-1 [i.2] modified.

**Information Communication Technology (ICT) applications:** system, with its associated transmission method for the communication of information

**ICT services:** creation, communication dissemination, storage and management of information

**network convergence:** ability of a network, by virtue of the applications it supports, to deliver multiple ICT, BCT and CCCB services

### 3.2 Abbreviations

For the purposes of the present document, the following abbreviations apply:

BCT	Broadcast Communication Technology
BD	Building Distributor
CATV	Cable Television
CCCB	Command Control and Communications in Buildings
CD	Campus Distributor
CGIC	ETSI CLC Co-ordination Group on Installations and Cabling
CP	Consolidation Point
DC	Direct Current
DSL	Digital Subscriber Line
DTE	Data Terminal Equipment
ENTI	External Network Termination Interface
FD	Floor Distributor
FTTB	Fibre To The Building
HBES	Home and Building Electronic Systems
HF	High Frequency
ICT	Information and Communication Technology
KPI	Key Performance Indicator
MDI	Media-Dependent Interface
NGN	Next Generation Network
OIE	Operator Independent Equipment
OSE	Operator Specific Equipment

PoE	Power over Ethernet
TO	Telecommunications Outlet
UHF	Ultra High Frequency
USB	Universal Serial Bus
VHF	Very High Frequency

---

## 4 Customer networks in office premises (single-tenant)

### 4.1 Overview of office network infrastructures

#### 4.1.1 General

Office premises typically accommodate personnel that require a variety of ICT services (and BCT services, to a lesser degree) in order to perform relevant commercial activities on behalf of their employers.

In order to provide these services to the desired locations, office premises feature a range of cabling infrastructures for the distribution of external network telecommunications services or internally generated information technology services. In the past separate cabling infrastructures were installed for each service but over the last twenty years there has been a move toward the use of generic cabling infrastructures capable of supporting a wide range of ICT services and the supporting applications. More recently, these cabling infrastructures have been augmented to provide wireless networks within the premises. These systems lie outside the scope of the present document.

Office premises typically also accommodate private data centres housing information technology equipment which both provide generate and process information within the customer network and also have interfaces to the access network. These data centres vary in size and complexity to reflect the operations of the office they support (see TS 105 174-5-4 [i.14]).

In addition to ICT services, office premises have requirements for building management systems including access control, surveillance and environmental control. In the past separate cabling infrastructures have been installed for each service. The trend towards network convergence had led to the installation of multiple "parallel" cabling infrastructures of equivalent performance differentiated only by their function.

As the size and population of offices increases, the energy consumption of information technology equipment as a proportion of the overall energy consumption of the office premises rises significantly. The opportunities for improvements in energy efficiency within the information technology infrastructure, and reduction in overall energy consumption are correspondingly greater for large office premises.

#### 4.1.2 Network convergence

Within the office premises, telecommunications services fall into three groups:

- ICT (also referred to as HBES Class 2): for example, telephone, local area network;
- BCT (also referred to as HBES Class 3): for example, broadcast television;
- CCCB (also referred to as HBES Class 1): for example, security alarms, surveillance and door access control, environmental controls.

Access networks providing ICT services are also supporting BCT and CCCB services using ICT applications. Access networks providing BCT services also support ICT services using embedded ICT applications.

Within customer premises, the range of networks has, in the past, reflected the diversity of the services with ICT services being delivered over a variety of cabling infrastructures ranging from those suitable only for basic telephony through to those used for specified computer-computer or computer-peripheral connections. The concept of generic cabling (see clause 4.2.1), which provides specified levels of transmission performance in support of a wide range of ICT applications, was founded in office premises and has become a de-facto infrastructure solution for the delivery of ICT services.



While some connections to external BCT services are delivered over application-specific coaxial cabling systems, the wide range of transmission distances encountered in office premises support the delivery of such services using ICT applications which are supported by generic cabling.

CCCB services continue to be delivered over a variety of cabling infrastructures ranging from application-specific solutions, often including those combining power with control systems, through to those used for generic cabling (see clause 4.2.1). The use of ICT applications to deliver CCCB services is further enhanced by the development of ICT networking standards that support delivery of Power over Ethernet (PoE). These can typically provide approximately 13W via IEEE 802.3af [i.8] and approximately 25 W via IEEE 802.3at [i.9] when using ICT applications such as 10/100/1000BASE-T.

By these means, ICT applications, such as 10/100/1000BASE-T, are able to support ICT, BCT and CCCB services within the office premises installed with a generic cabling infrastructure in accordance with EN 50173-2 [i.3] developed by CENELEC TC215.

## 4.2 Infrastructure standardization activities

### 4.2.1 Generic cabling designs in accordance with EN 50173-2

NOTE: EN 50173-2 [i.3], published in 2007, has a similar scope, and is intended to be technically equivalent, to ISO/IEC 11801 [i.11] produced by ISO/IEC JTC1 SC25. EN 50173-2 [i.3] is a development of earlier standards EN 50173 (1995) and EN 50173-1 [i.2].

#### 4.2.1.1 Infrastructure design

EN 50173-2 [i.3] specifies a single layer infrastructure as shown in figure 1 (*modified from EN 50173-2 [i.3]*) which supports campus premises containing multiple buildings.

On multi-building campus premises each building is fed from a Campus Distributor (CD).

Within each building the infrastructure is fed from a Building Distributor (BD). Floors or equivalent areas are fed from Floor Distributors (FD) connected to the BD. Information technology equipment may be housed at any distributor as required by the networked application. The final distribution to the "work areas" is from the FD to the Telecommunications Outlets (TO). A Consolidation Point may be installed between a TO and an FD to provide a point of administration but does not house active information technology equipment.

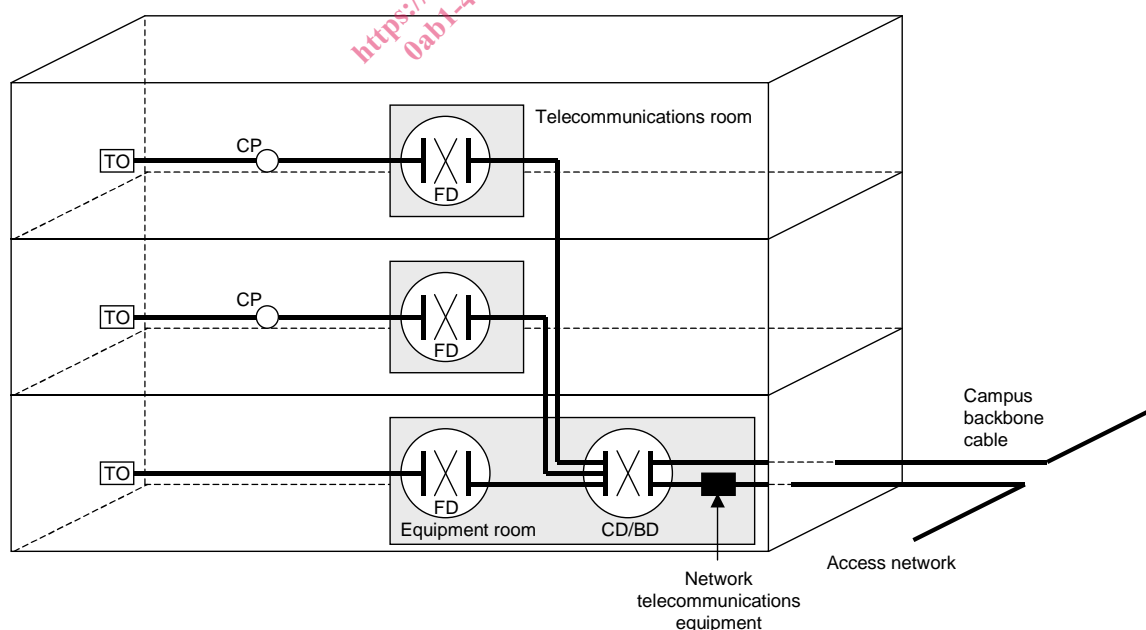


Figure 1: Building cabling infrastructure of EN 50173-2 [i.3]