

SLOVENSKI STANDARD

SIST EN 1822-3:2010

01-januar-2010

Nadomešča:
SIST EN 1822-3:2000

Visoko učinkoviti zračni filtri (EPA, HEPA in ULPA) - 3. del: Preskušanje ravnih filterjskih medijev

High efficiency air filters (EPA, HEPA and ULPA) - Part 3: Testing flat sheet filter media

Schwebstofffilter (EPA, HEPA und ULPA) - Teil 3: Prüfung des planen Filtermediums

Filtres à air à haute efficacité (EPA, HEPA et ULPA) - Partie 3: Essais de médias filtrants plans

[SIST EN 1822-3:2010](https://standards.iteh.ai/catalog/standards/sist/d8f8f9cc-f8db-42fd-b06a-9f20c/sist-en-1822-3-2010)

<https://standards.iteh.ai/catalog/standards/sist/d8f8f9cc-f8db-42fd-b06a-9f20c/sist-en-1822-3-2010>

Ta slovenski standard je istoveten z: EN 1822-3:2009

ICS:

23.120

Zračni niki. Vetrniki. Klimatske naprave

Ventilators. Fans. Air-conditioners

SIST EN 1822-3:2010

en

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1822-3:2010

<https://standards.iteh.ai/catalog/standards/sist/d8f8f9cc-f8db-42fd-b06a-3d48dce9f20c/sist-en-1822-3-2010>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 1822-3

November 2009

ICS 13.040.40

Supersedes EN 1822-3:1998

English Version

**High efficiency air filters (EPA, HEPA and ULPA) - Part 3:
Testing flat sheet filter media**

Filtres à air à haute efficacité (EPA, HEPA et ULPA) -
Partie 3: Essais de medias filtrants plans

Schwebstofffilter (EPA, HEPA und ULPA) - Teil 3: Prüfung
des planen Filtermediums

This European Standard was approved by CEN on 17 October 2009.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

SIST EN 1822-3:2010

<https://standards.iteh.ai/catalog/standards/sist/d8f8f9cc-f8db-42fd-b06a-3d48dce9f20c/sist-en-1822-3-2010>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

Page

Foreword.....	3
Introduction	4
1 Scope	5
2 Normative references	5
3 Terms and definitions	5
4 Symbols and abbreviations	5
5 Description of the test method.....	7
6 Sampling of sheet filter media.....	7
7 Test apparatus	7
7.1 General.....	7
7.2 Test arrangements for testing with monodisperse test aerosol.....	7
7.3 Test arrangements for testing with a polydisperse test aerosol	10
7.4 Test filter mounting assembly	12
7.4.1 General.....	12
7.4.2 Measurement of differential pressure	13
7.4.3 Sampling	13
7.5 Determination of the filter medium face velocity	14
8 Requirements for the test air	14
9 Testing procedure.....	14
9.1 Preparatory checks	14
9.2 Procedure	15
9.2.1 General.....	15
9.2.2 Measurement of the pressure drop.....	15
9.2.3 Testing with a monodisperse test aerosol	15
9.2.4 Testing with a polydisperse test aerosol	15
9.3 Reference test method	15
10 Evaluation	16
11 Test report	16
12 Maintenance and inspection of the test apparatus	17
Annex A (informative) Example of an application with evaluation	18
A.1 Testing the sheet filter medium.....	18
A.1.1 General.....	18
A.1.2 Measurement of the differential pressure	18
A.1.3 Particle counting.....	18
A.2 Calculation of the arithmetic means	19
A.2.1 General.....	19
A.2.2 Mean differential pressure	19
A.2.3 Mean efficiency $\bar{E}$	19
A.2.4 Mean efficiencies $\bar{E}_{95\%}$ as lower limit values for the 95 % confidence interval.....	20
A.3 Representation of the efficiency curve	21
Bibliography	23

Foreword

This document (EN 1822-3:2009) has been prepared by Technical Committee CEN/TC 195 "Air filters for general air cleaning", the secretariat of which is held by UNI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by May 2010, and conflicting national standards shall be withdrawn at the latest by May 2010.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 1822-3:1998.

It is dealing with the performance testing of efficient particulate air filters (EPA), high efficiency particulate air filters (HEPA) and ultra low penetration air filters (ULPA).

The series of standards EN 1822, *High efficiency air filters (EPA, HEPA and ULPA)* consists of the following parts:

- *Part 1: Classification, performance testing, marking*
- *Part 2: Aerosol production, measuring equipment, particle counting statistics*
- *Part 3: Testing flat sheet filter media*
- *Part 4: Determining leakage of filter elements (scan method)*
- *Part 5: Determining the efficiency of filter elements*

As decided by CEN/TC 195, this European Standard is based on particle counting methods which actually cover most needs of different applications. The difference between this European Standard and previous national standards lies in the technique used for the determination of the integral efficiency. Instead of mass relationships, this new technique is based on particle counting at the most penetrating particle size (MPPS; range: 0,12 µm to 0,25 µm). It also allows ultra low penetration air filters to be tested, which is not possible with the previous test methods because of their inadequate sensitivity.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and the United Kingdom.

Introduction

As decided by CEN/TC 195, this European Standard is based on particle counting methods which actually cover most needs of different applications. The difference between this European Standard and previous national standards lies in the technique used for the determination of the integral efficiency. Instead of mass relationships, this technique is based on particle counting at the most penetrating particle size (MPPS), which is for micro-glass filter mediums usually in the range of 0,12 µm to 0,25 µm.

For Membrane filter media, separate rules apply, see Annex A of EN 1822-5:2009. This method also allows to test ultra low penetration air filters, which was not possible with the previous test methods because of their inadequate sensitivity.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 1822-3:2010](https://standards.iteh.ai/catalog/standards/sist/d8f8f9cc-f8db-42fd-b06a-3d48dce9f20c/sist-en-1822-3-2010)

<https://standards.iteh.ai/catalog/standards/sist/d8f8f9cc-f8db-42fd-b06a-3d48dce9f20c/sist-en-1822-3-2010>

1 Scope

This European Standard applies to high efficiency particulate air filters and ultra low penetration air filters (EPA, HEPA and ULPA) used in the field of ventilation and air conditioning and for technical processes, e.g. for applications in clean room technology or pharmaceutical industry.

It establishes a procedure for the determination of the efficiency on the basis of a particle counting method using a liquid test aerosol, and allows a standardized classification of these filters in terms of their efficiency.

This European Standard applies to testing sheet filter media used in high efficiency air filters. The procedure includes methods, test assemblies and conditions for carrying out the test, and the basis for calculating results.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 1822-1:2009, *High efficiency air filters (EPA, HEPA and ULPA) — Part 1: Classification, performance testing, marking*

EN 1822-2:2009, *High efficiency air filters (EPA, HEPA and ULPA) — Part 2: Aerosol production, measuring equipment, particle counting statistics*

EN 14799:2007, *Air filters for general air cleaning — Terminology*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 14799:2007 apply.

4 Symbols and abbreviations

Table 1 contains the quantities (terms and symbols) used in this standard to represent measurement variables and calculated values. The values inserted in the equation given for these calculations should be in the units specified.

Table 1 — Quantities

Term	Symbol	Unit	Equation for the calculation
Measured variables			
Exposed area	A	cm ²	
Test volume flow rate	$\dot{V}$	cm ³ /s	
Pressure drop	Δp	Pa	
Mean particle diameter	$\tilde{d}_p$	µm	
Particle number	N	-	
Sampling volume flow rate	$\dot{V}_S$	cm ³ /s	
Sampling duration	t	s	
Calculated quantities			
Filter medium face velocity	u	cm/s	$u = \frac{\dot{V}}{A}$
Mean differential pressure	$\overline{\Delta p}$	Pa	$\overline{\Delta p} = \frac{1}{n} \sum_{i=1}^n \Delta p_i$
Particle number concentration	c_N	cm ⁻³	$c_N = \frac{N}{\dot{V}_S \cdot t}$
Penetration for particles in size range i	P_i		$P_i = \frac{c_{N,d,i}}{c_{N,u,i}}$ ^b
Mean penetration	$\overline{P}$	^a	$\overline{P} = \frac{1}{n} \sum_{i=1}^n P_i$
Mean efficiency	$\overline{E}$	^a	$\overline{E} = 1 - \overline{P}$
Number of particles for the upper or lower limit of the 95 % level of confidence	$N_{95\%}$	-	See Clause 7 of EN 1822-2:2009
Penetration as upper limit value for the 95 % level of confidence	$P_{95\%, i}$	^a	$P_{95\%, i} = \frac{c_{N,d,95\%,i}}{c_{N,u,95\%,i}}$ ^b
Mean penetration as upper limit value for the 95 % level of confidence	$\overline{P}_{95\%}$	^a	$\overline{P}_{95\%} = \frac{1}{n} \sum_{i=1}^n P_{95\%,i}$
Mean efficiency as lower limit value for the 95 % level of confidence	$\overline{E}_{95\%}$	^a	$\overline{E}_{95\%} = 1 - \overline{P}_{95\%}$
^a These quantities are usually given as a percentage.			
^b The index "u" refers to up-stream particle counts, and the index "d" refers to down-stream particle counts.			

5 Description of the test method

When testing the sheet filter medium the fractional efficiency is determined using a particle counting method. The testing can use a monodisperse or a polydisperse test aerosol. The methods differ in terms of both the production of the aerosol and the particle counter used. Furthermore the measurement of the pressure drop is made at the prescribed filter medium velocity.

Specimens of the sheet filter medium are fixed in a test filter assembly and subjected to the test air flow corresponding to the prescribed filter medium velocity. The test aerosol from the aerosol generator shall be conditioned (e.g. vapourisation of a solvent) then neutralised, mixed homogeneously with filtered test air and led to the test filter assembly.

In order to determine the efficiency, partial flows of the test aerosol are sampled upstream and downstream of the filter medium. Using a particle counting instrument the number concentration of the particles contained is determined for various particle sizes. The results of these measurements are used to draw a graph of efficiency against particle size for the filter medium, and to determine the particle size for which the efficiency is a minimum. This particle size is known as the Most Penetrating Particle Size (MPPS).

When measuring the particles on the upstream side of the filter medium it may be necessary to use a dilution system in order to reduce the concentration of particles down to the measuring range of the particle counter used.

Additional equipment is required to measure the absolute pressure, temperature and relative humidity of the test aerosol and to measure and control the test volume flow rate.

6 Sampling of sheet filter media

The testing of the sheet filter medium shall be carried out on at least five samples.

The samples shall be handled with care; the area to be tested shall be free from all folds, kinks, holes or other irregularities.

All samples shall be clearly and permanently marked with the following details:

- a) The designation of the filter medium;
- b) The upstream side of the filter medium.

7 Test apparatus

7.1 General

The test apparatus to be used and the arrangement of the components and measuring equipment are shown in Figure 1 of EN 1822-1:2009.

The basic details for the aerosol generation and the aerosol neutralisation, together with the details of suitable types of apparatus are contained in EN 1822-2.

7.2 Test arrangements for testing with monodisperse test aerosol

When testing sheet filter media with a monodisperse test aerosol the particle number concentration is determined using a total count method with a condensation nucleus counter. The arrangement of the test apparatus is shown in Figure 1.

The monodisperse test aerosol is created in a number of steps. Firstly a polydisperse primary aerosol is produced using a jet nebuliser with, for example, a DEHS/Iso-propanol solution. The particles are reduced to a

EN 1822-3:2009 (E)

convenient size for the following process by evaporation of the solvent. The aerosol is then neutralised and passed to a differential mobility analyser. The quasi-monodisperse test aerosol available at the output of the differential mobility analyser is once again neutralised, and then mixed homogeneously with filtered test air in order to achieve at the test volume flow rate required for the filter medium velocity.

The mean particle diameter of the number distribution is varied by adjusting the voltage between the electrodes of the differential mobility analyzer¹⁾

In order to achieve a sufficiently high particle number concentration over the entire test range from 0,04 µm to 0,8 µm it may prove necessary to use several jet nebulizers with differing concentrations of the aerosol substances in the solvent. Numerical concentrations which are too high can be adjusted by diluting the test aerosol before the test filter mounting assembly. The number concentration in the test aerosol shall be selected so that no dilution is necessary for the measurements made downstream from the filter.

A pump positioned downstream draws the test aerosol through the test filter mounting assembly. This ensures that the differential mobility analyser can always operate under nearly the same conditions, independent of the pressure drop across the tested filter medium. In contrast, where the testing system operates with an overpressure this ensures that leaks in the system do not falsify the test measurements.


Particles are counted upstream and downstream from the filter using either two condensation nucleus counters in parallel, or using only one such counter to measure the upstream and downstream concentrations alternately. If the level of the upstream number concentration exceeds the measuring range of the counter then a dilution system shall be included between the sampling point and the counter.

iTeh STANDARD PREVIEW **(standards.iteh.ai)**

SIST EN 1822-3:2010

<https://standards.iteh.ai/catalog/standards/sist/d8f8f9cc-f8db-42fd-b06a-3d48dce9f20c/sist-en-1822-3-2010>

1) Actually, the adjustment gives the mode of number distribution. This can be taken as equal to the median value with sufficient accuracy.

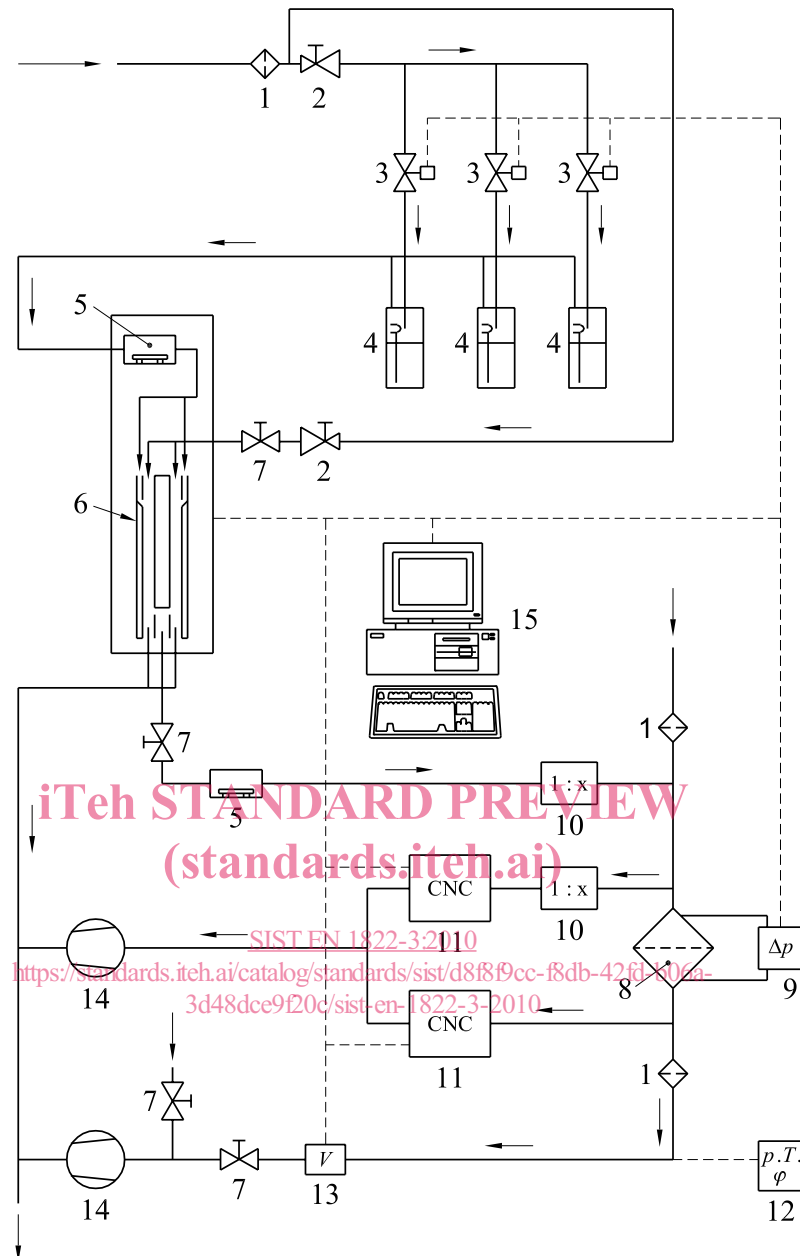

Key

- 1 Filter
- 2 Pressure valve
- 3 Solenoid valve
- 4 Jet nebuliser
- 5 Neutraliser
- 6 Differential mobility analyser
- 7 Needle valve
- 8 Test filter mounting assembly
- 9 Differential pressure gauge
- 10 Dilution system
- 11 Condensation nucleus counter
- 12 Measuring equipment for absolute pressure, temperature and relative humidity
- 13 Volume flow rate meter
- 14 Vacuum pump
- 15 Computer for control and data storage

Figure 1 — Setup for testing with monodisperse test aerosols