



Standard Specification for “Fiberglass” (Glass-Fiber-Reinforced Thermosetting-Resin) Pressure Pipe¹

This standard is issued under the fixed designation D 3517; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the Department of Defense.

1. Scope*

1.1 This specification covers machine-made fiberglass pipe, 8 in. (200 mm) through 144 in. (3700 mm), intended for use in water conveyance systems which operate at internal gage pressures of 250 psi (1.72 MPa) or less. Both glass-fiber-reinforced thermosetting-resin pipe (RTRP) and glass-fiber-reinforced polymer mortar pipe (RPMP) are fiberglass pipes. The standard is suited primarily for pipes to be installed in buried applications, although it may be used to the extent applicable for other installations such as, but not limited to, jacking, tunnel lining and sliplining rehabilitation of existing pipelines.

NOTE 1—For the purposes of this standard, polymer does not include natural polymers.

1.2 The values stated in inch-pound units are to be regarded as the standard. The values given in parentheses are provided for information purposes only.

NOTE 2—There is no similar or equivalent ISO standard.

1.3 The following safety hazards caveat pertains only to the test methods portion, Section 8, of this specification: *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 ASTM Standards:

- C 33 Specification for Concrete Aggregates²
- D 638 Test Method for Tensile Properties of Plastics³
- D 695 Test Method for Compressive Properties of Rigid Plastics³
- D 790 Test Methods for Flexural Properties of Unreinforced

and Reinforced Plastics and Electrical Insulating Materials³

- D 883 Terminology Relating to Plastics³
- D 1600 Terminology for Abbreviated Terms Relating to Plastics³
- D 2290 Test Method for Apparent Tensile Strength of Ring or Tubular Plastics and Reinforced Plastics by Split Disk Method⁴
- D 2412 Test Method for Determination of External Loading Characteristics of Plastic Pipe by Parallel-Plate Loading⁴
- D 2584 Test Method for Ignition Loss of Cured Reinforced Resins⁵
- D 2992 Practice for Obtaining Hydrostatic or Pressure Design Basis for “Fiberglass” (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe and Fittings⁴
- D 3567 Practice for Determining Dimensions of “Fiberglass” (Glass-Fiber-Reinforced Thermosetting Resin) Pipe and Fittings⁴
- D 3892 Practice for Packaging/Packing of Plastics⁶
- D 4161 Specification for “Fiberglass” (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe Joints Using Flexible Elastomeric Seals⁴
- F 412 Terminology Relating to Plastic Piping Systems⁴
- F 477 Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe⁴
- 2.2 ISO Standard:
 - ISO 1172 Textile Glass Reinforced Plastics—Determination of Loss on Ignition⁷
- 2.3 NSF Standard:
 - Standard No. 14 for Plastic Piping Components and Related Materials⁸

3. Terminology

3.1 Definitions:

¹ This specification is under the jurisdiction of ASTM Committee D20 on Plastics and is the direct responsibility of Subcommittee D20.23 on Reinforced Plastic Piping Systems and Chemical Equipment.

Current edition approved May 10, 2003. Published November 2003. Originally approved in 1976. Last previous edition approved 2001 as D 3517 – 01.

² *Annual Book of ASTM Standards*, Vol 04.02.

³ *Annual Book of ASTM Standards*, Vol 08.01.

⁴ *Annual Book of ASTM Standards*, Vol 08.04.

⁵ *Annual Book of ASTM Standards*, Vol 08.02.

⁶ *Annual Book of ASTM Standards*, Vol 08.03.

⁷ Available from American National Standards Institute, 11 West 42nd Street, 13th Floor, New York, NY 10036.

⁸ Available from the National Sanitation Foundation, P.O. Box 1468, Ann Arbor, MI 48106.

*A Summary of Changes section appears at the end of this standard.

3.1.1 *General*—Definitions are in accordance with Terminology D 833 and Terminology F 412 and abbreviations are in accordance with Terminology D 1600, unless otherwise indicated.

3.2 *Definitions of Terms Specific to This Standard:*

3.2.1 *fiberglass pipe*—a tubular product containing glass-fiber reinforcements embedded in or surrounded by cured thermosetting resin. The composite structure may contain aggregate, granular, or platelet fillers, thixotropic agents, pigments, or dyes. Thermoplastic or thermosetting liners or coatings may be included.

3.2.2 *flexible joint*—a joint that is capable of axial displacement or angular rotation, or both.

3.2.3 *liner*—a resin layer, with or without filler, or reinforcement, or both, forming the interior surface of the pipe.

3.2.4 *qualification test*—one or more tests used to prove the design of a product. Not a routine quality control test.

3.2.5 *reinforced polymer mortar pipe (RPMP)*—a fiberglass pipe with aggregate.

3.2.6 *reinforced thermosetting resin pipe (RTRP)*—a fiberglass pipe without aggregate.

3.2.7 *rigid joint*—a joint that is not capable of axial displacement or angular rotation.

3.2.8 *surface layer*—a resin layer, with or without filler, or reinforcements, or both, applied to the exterior surface of the pipe structural wall.

4. Classification

4.1 *General*—This specification covers fiberglass pressure pipe defined by raw materials in the structural wall (type) and liner, surface layer material (grade), operating pressure (class), and pipe stiffness. Table 1 lists the types, liners, grades, classes, and stiffnesses that are covered.

NOTE 3—All possible combinations of types, liners, grades, classes, and stiffnesses may not be commercially available. Additional types, liners, grades, and stiffnesses may be added as they become commercially

available. The purchaser should determine for himself or consult with the manufacturer for the proper class, type, liner, grade and stiffness of pipe to be used under the installation and operating conditions that will exist for the project in which the pipe is to be used.

4.2 *Designation Requirements*—The pipe materials designation code shall consist of the standard designation, ASTM D 3517, followed by type, liner, and grade in Arabic numerals, class by the letter C and two or three Arabic numerals, and pipe stiffness by a capital letter. Table 1 presents a summary of the designation requirements. Thus, a complete material code shall consist of ASTM D 3517. . . three numerals, C . . . and two or three numerals, and a capital letter.

NOTE 4—Examples of the designation are as follows: (1) ASTM D 3517-1-1-3-C50-A for glass-fiber reinforced aggregate and polyester resin mortar pipe with a reinforced thermoset liner and an unreinforced polyester resin and sand surface layer, for operation at 50 psi (345 kPa), and having a minimum pipe stiffness of 9 psi (62 kPa), (2) ASTM D 3517-4-2-6-C200-C for glass-fiber reinforced epoxy resin pipe with a non-reinforced thermoset liner, no surface layer, for operation at 200 psi (1380 kPa), and having a minimum pipe stiffness of 36 psi (248 kPa).

NOTE 5—Although the “Form and Style for ASTM Standards” manual requires that the type classification be roman numerals, it is recognized that companies have stencil cutting equipment for this style of type, and it is therefore acceptable to mark the product type in arabic numbers.

5. Materials and Manufacture

5.1 *General*—The resins, reinforcements, colorants, fillers, and other materials, when combined as a composite structure, shall produce a pipe that shall meet the performance requirements of this specification.

5.2 *Wall Composition*—The basic structural wall composition shall consist of thermosetting resin, glass fiber reinforcement, and, if used, an aggregate filler.

5.2.1 *Resin*—A thermosetting polyester or epoxy resin, with or without filler.

5.2.2 *Reinforcement*—A commercial grade of E-type glass fibers with a finish compatible with the resin used.

TABLE 1 General Designation Requirements for Fiberglass Pressure Pipe

Designation Order	Property	Cell Limits (Note 1)									
		1		2		3		4		5	
1	Type	glass-fiber-reinforced thermosetting polyester (Note 2) resin mortar (RPMP polyester (Note 2))		glass-fiber-reinforced thermosetting polyester (Note 2) resin (RTRP polyester (Note 2))		glass-fiber-reinforced thermosetting epoxy resin mortar (RPMP epoxy)		glass-fiber-reinforced thermosetting epoxy resin (RTRP epoxy)			
2	Liner	1 reinforced thermoset liner		2 non-reinforced thermoset liner		3 thermoplastic liner		4 no liner			
3	Grade	1 polyester (Note 2) resin surface layer—reinforced		2 polyester (Note 2) resin surface layer—non-reinforced		3 polyester (Note 2) resin and sand surface layer nonreinforced		4 epoxy resin surface layer—reinforced		5 epoxy resin surface layer—non-reinforced	
4	Class (Note 3)	C50	C75	C100	C125	C150	C175	C200	C225	C250	
5	Pipe Stiffness psi (kPa)	A 9 (62)		B 18 (124)		C 36 (248)		D 72 (496)			

NOTE 1—The cell-type format provides the means of identification and specification of piping materials. This cell-type format, however, is subject to misapplication since unobtainable property combinations can be selected if the user is not familiar with non-commercially available products. The manufacturer should be consulted.

NOTE 2—For the purposes of this standard, polyester includes vinyl ester resins.

NOTE 3—Based on operating pressure in psig (numerals).

5.2.3 *Aggregate*—A siliceous sand conforming to the requirements of Specification C 33, except that the requirements for gradation shall not apply.

NOTE 6—Fiberglass pipe intended for use in the transport of potable water should be evaluated and certified as safe for this purpose by a testing agency acceptable to the local health authority. The evaluation should be in accordance with requirements for chemical extraction, taste, and odor that are no less restrictive than those included in National Sanitation Foundation (NSF) Standard 61. The seal or mark of the laboratory making the evaluation should be included on the fiberglass pipe.

5.3 *Liner and Surface Layers*—Liner or surface layer, or both, when incorporated into or onto the pipe, shall meet the structural requirements of this specification.

5.4 *Joints*—The pipe shall have a joining system that shall provide for fluid tightness for the intended service condition. A particular type of joint may be restrained or unrestrained and flexible or rigid depending on the specific configuration and design conditions.

5.4.1 *Unrestrained*—Pipe joints capable of withstanding internal pressure but not longitudinal tensile loads.

5.4.1.1 *Coupling or Bell-and-Spigot Gasket Joints*, with a groove either on the spigot or in the bell to retain an elastomeric gasket that shall be the sole element of the joint to provide watertightness. For typical joint details see Fig. 1.

5.4.1.2 *Mechanical Coupling Joint*, with elastomeric seals.

5.4.1.3 *Butt Joint*, with laminated overlay.

5.4.1.4 *Flanged Joint*, both integral and loose ring.

5.4.2 *Restrained*—Pipe joints capable of withstanding internal pressure and longitudinal tensile loads..

5.4.2.1 Joints similar to those in 5.4.1.1 with supplemental restraining elements.

5.4.2.2 *Butt Joint*, with laminated overlay.

5.4.2.3 *Bell-and-Spigot*, with laminated overlay.

5.4.2.4 *Bell-and-Spigot*, adhesive-bonded joint: Three types of adhesive-bonded joints are permitted by this standard as follows:

5.4.2.4.1 *Tapered bell-and-spigot*, an adhesive joint that is manufactured with a tapered socket for use in conjunction with a tapered spigot and a suitable adhesive.

5.4.2.4.2 *Straight bell-and-spigot*, an adhesive joint that is manufactured with an untapered socket for use in conjunction with an untapered spigot and a suitable adhesive.

5.4.2.4.3 *Tapered bell and straight spigot*, an adhesive joint that is manufactured with a tapered socket for use with an untapered spigot and a suitable adhesive.

5.4.2.5 *Flanged Joint*, both integral and loose ring

5.4.2.6 *Mechanical Coupling*, an elastomeric sealed coupling with a supplemental restraining elements.

5.4.2.7 *Threaded Joints*.

NOTE 7—Other types of joints may be added as they become commercially available.

NOTE 8—Restrained joints typically increase service loads on the pipe to greater than those experienced with unrestrained joints. The purchaser is cautioned to take into consideration all conditions that may be

encountered in the anticipated service and to consult the manufacturer regarding the suitability of a particular type and class of pipe for service with restrained joint systems.

5.5 *Gaskets*—Elastomeric gaskets when used with this pipe shall conform to the requirements of Specification F 477.

6. Requirements

6.1 Workmanship:

6.1.1 Each pipe shall be free from all defects including indentations, delaminations, bubbles, pinholes, cracks, pits, blisters, foreign inclusions, and resin-starved areas that due to their nature, degree, or extent, detrimentally affect the strength and serviceability of the pipe. The pipe shall be as uniform as commercially practicable in color, opacity, density, and other physical properties.

6.1.2 The inside surface of each pipe shall be free of bulges, dents, ridges, and other defects that result in a variation of inside diameter of more than 1/8 in. (3.2 mm) from that obtained on adjacent unaffected portions of the surface. No glass fiber reinforcement shall penetrate the interior surface of the pipe wall.

6.1.3 Joint sealing surfaces shall be free of dents, gouges, and other surface irregularities that will affect the integrity of the joints.

6.2 Dimensions:

6.2.1 *Pipe Diameters*—Pipe shall be supplied in the nominal diameters shown in Table 2 or Table 3. The pipe diameter tolerances shall be as shown in Table 2 or Table 3, when measured in accordance with 8.1.1.

6.2.2 *Lengths*—Pipe shall be supplied in nominal lengths of 10, 20, 30, 40, and 60 ft. (3.05, 6.10, 9.15, 12.19, and 18.29 m). The actual laying length shall be the nominal length ±2 in. (±51 mm), when measured in accordance with 8.1.2. At least 90 % of the total footage of any one size and class, excluding special order lengths, shall be furnished in the nominal lengths specified by the purchaser. Random lengths, if furnished, shall not vary from the nominal lengths by more than 5 ft (1.53 m) or 25 %, whichever is less.

6.2.3 *Wall Thickness*—The average wall thickness of the pipe shall not be less than the nominal wall thickness published in the manufacturer’s literature current at the time of purchase, and the minimum wall thickness at any point shall not be less than 87.5 % of the nominal wall thickness when measured in accordance with 8.1.3.

6.2.4 *Squareness of Pipe Ends*—All points around each end of a pipe unit shall fall within ±1/4 in. (±6.4 mm) or ±0.5 % of the nominal diameter of the pipe, whichever is greater, to a plane perpendicular to the longitudinal axis of the pipe, when measured in accordance with 8.1.4.

6.3 *Soundness*—Unless otherwise agreed upon between purchaser and supplier, test each length of pipe up to 54 in. (1370 mm) diameter hydrostatically without leakage or cracking, at the internal hydrostatic proof pressures specified for the applicable class in Table 4, when tested in accordance with 8.2.



FIG. 1 Typical Joints

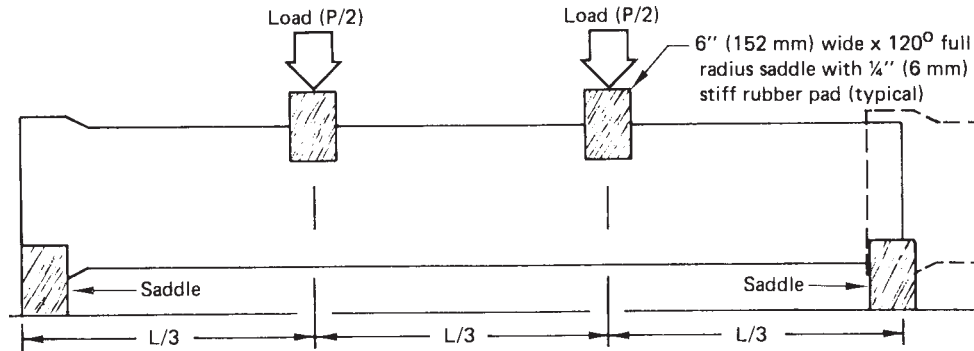


FIG. 2 Beam Strength—Test Setup

TABLE 2 Nominal Inside Diameters (ID) and Tolerances Inside Diameter Control Pipe

Inch-Pound Units		SI Units			
Nominal Diameter ^A , in.	Tolerance, in.	Nominal Metric Diameter ^B , mm	ID Range ^B , mm		Tolerance ^B on Declared ID, mm
			Minimum	Maximum	
8	±0.25	200	196	204	±1.5
10	±0.25	250	246	255	±1.5
12	±0.25	300	296	306	±1.8
14	±0.25	400	396	408	±2.4
15	±0.25	500	496	510	±3.0
16	±0.25	600	595	612	±3.6
18	±0.25	700	695	714	±4.2
20	±0.25	800	795	816	±4.2
21	±0.25	900	895	918	±4.2
24	±0.25	1000	995	1020	±5.0
27	±0.27	1200	1195	1220	±5.0
30	±0.30	1400	1395	1420	±5.0
33	±0.33	1600	1595	1620	±5.0
36	±0.36	1800	1795	1820	±5.0
39	±0.39	2000	1995	2020	±5.0
42	±0.42	(2200)	2195	2220	±6.0
45	±0.45	2400	2395	2420	±6.0
48	±0.48	(2600)	2595	2620	±6.0
51	±0.51	2800	2795	2820	±6.0
54	±0.54	(3000)	2995	3020	±6.0
60	±0.60	3200	3195	3220	±7.0
66	±0.66	(3400)	3395	3420	±7.0
72	±0.72	3600	3595	3620	±7.0
78	±0.78	(3800)	3795	3820	±7.0
84	±0.84	4000	3995	4020	±7.0
90	±0.90
96	±0.96
102	±1.00
108	±1.00
114	±1.00
120	±1.00
132	±1.00
144	±1.00

^AInside diameters other than those shown shall be permitted by agreement between purchaser and supplier.
^BValues are taken from International Standards Organization documents. Parentheses indicate non-preferred diameters.

For sizes over 54 in., the frequency of hydrostatic leak tests shall be as agreed upon by purchaser and supplier.

6.4 Hydrostatic Design Basis:

6.4.1 Long-Term Hydrostatic Pressure—The pressure classes shall be based on long-term hydrostatic pressure data obtained in accordance with 8.3 and categorized in accordance with Table 5. Pressure classes are based on extrapolated strengths at 50 years. For pipe subjected to longitudinal loads or circumferential bending, the effect of these conditions on the hydrostatic design pressure, classification of the pipe must be considered.

6.4.2 Control Requirements—Test pipe specimens periodically in accordance with Practice D 2992.

NOTE 9—Hydrostatic design basis (HDB-extrapolated value at 50 years) determined in accordance with Procedure A of Practice D 2992, may be substituted for the Procedure B evaluation required by 8.3. It is generally accepted that the Procedure A HDB value times 3 is equivalent to the Procedure B HDB value.

6.5 Stiffness—Each length of pipe shall have sufficient strength to exhibit the minimum pipe stiffness ($F/\Delta y$) specified in Table 6, when tested in accordance with 8.4. At deflection level A per Table 7, there shall be no visible damage in the test

TABLE 3 Nominal Outside Diameters (OD) and Tolerances

Nominal Pipe Size, in.	Steel Pipe Equivalent (IPS) OD's, in.	Tolerance, in.	Cast Iron Pipe Equivalent OD's, in.	Tolerance, in.
8	8.625	+0.086	9.05	±0.06
10	10.750	-0.040	11.10	
12	12.750	+0.108	13.20	
14	14.000	-0.048	15.30	
16	16.000	+0.128	17.40	
18	...	-0.056	19.50	+0.05
20	...	+0.160	21.60	
24	...	-0.070	25.80	
30	32.00	-0.08
36	38.30	
42	44.50	
48	50.80	
54	57.56	
60	61.61	

Metric Pipe Size, mm	Ductile Iron Pipe Equivalent, mm	Tolerance, mm	International OD, mm	Tolerance, mm
200	222	-3.0
250	274	-3.1
300	326	-3.3	310	-1.0
350	378	-3.4	361	-1.2
400	429	-3.5	412	-1.4
450	463	-1.6
500	532	-3.8	514	-1.8
600	635	-4.0	616	-2.0
700	738	-4.3	718	-2.2
800	842	-4.5	820	-2.4
900	945	-4.8	924	-2.6
1000	1048	-5.0	1026	-2.6
1100	1152	-5.3
1200	1255	-5.5	1229	-2.6
1400	1462	-6.0	1434	-2.8
1600	1668	-7.4	1638	-2.8
1800	1875	-8.2	1842	-3.0
2000	2082	-9.0	2046	-3.0
2200	2250	-3.2
2400	2453	-3.4
2600	2658	-3.6
2800	2861	-3.8
3000	3066	-4.0

TABLE 4 Hydrostatic-Pressure Test

Class	Hydrostatic Proof Pressure, gage, psi (kPa)
C50	100 (689)
C75	150 (1034)
C100	200 (1379)
C125	250 (1723)
C150	300 (2068)
C175	350 (2412)
C200	400 (2757)
C225	450 (3102)
C250	500 (3445)

TABLE 5 Long-Term Hydrostatic Pressure Categories

Class	Minimum Calculated Values of Long-Term Hydrostatic Pressure gage, psi (kPa)
C50	90 (621)
C75	135 (931)
C100	180 (1241)
C125	225 (1551)
C150	270 (1862)
C175	315 (2172)
C200	360 (2482)
C225	405 (2792)
C250	450 (3103)

specimen evidenced by surface cracks. At deflection level B per Table 7, there shall be no indication of structural damage as evidenced by interlaminar separation, separation of the liner or surface layer (if incorporated) from the structural wall, tensile failure of the glass fiber reinforcement, and fracture or buckling of the pipe wall.

NOTE 10—This is a visual observation (made with the unaided eye) for quality control purposes only and should not be considered a simulated service test. Table 7 values are based on an in-use long-term deflection

limit of 5 % and provide an appropriate uniform safety margin for all pipe stiffnesses. Since the pipe stiffness values ($F/\Delta y$) shown in Table 6 vary, the percent deflection of the pipe under a given set of installation conditions will not be constant for all pipes. To avoid possible misapplication, take care to analyze all conditions which might affect performance of the installed pipe.

6.5.1 For other pipe stiffness levels, appropriate values for Level A and Level B deflections (Table 7) may be computed as follows:

TABLE 6 Minimum Stiffness at 5 % Deflection

Nominal Diameter, in.	Pipe Stiffness, psi (kPa)			
	Designation			
	A	B	C	D
8	36 (248)	72 (496)
10	...	18 (124)	36 (248)	72 (496)
12 and greater	9 (62)	18 (124)	36 (248)	72 (496)

TABLE 7 Ring Deflection Without Damage or Structural Failure

	Nominal Pipe Stiffness, psi			
	9	18	36	72
Level A	18 %	15 %	12 %	9 %
Level B	30 %	25 %	20 %	15 %

$$\text{Level A at new PS} = \left(\frac{72}{\text{new PS}} \right)^{0.33} (9) \quad (1)$$

$$\text{Level B at new PS} = \text{new Level A} \div 0.6$$

6.5.2 Since products may have use limits of other than 5 % long-term deflection, Level A and Level B deflections (Table 7) may be proportionally adjusted to maintain equivalent in-use safety margins. For example, a 4 % long-term limiting deflection would result in a 20 % reduction of Level A and Level B deflections, while a 6 % limiting deflection would result in a 20 % increase in Level A and Level B deflection values. However, minimum values for Level A and Level B deflections shall be equivalent to strains of 0.6 and 1.0 % respectively (as computed by Eq X1.4 in Appendix X1 of Specification D 3262).

6.6 *Hoop-Tensile Strength*—All pipe manufactured under this specification shall meet or exceed the hoop-tensile strength shown for each size and class in Table 8, when tested in accordance with 8.5.

6.6.1 *Alternative Requirements*—When agreed upon between the purchaser and the supplier, the minimum hoop-tensile strength shall be as determined in accordance with 8.5.1.

6.7 *Joint Tightness*—All joints shall meet the laboratory performance requirements, of Specification D 4161. Unrestrained joints shall be tested with a fixed end closure condition and restrained joints shall be tested with a free end closure condition. Rigid joints shall be exempt from angular deflection requirements of D 4161. Rigid joints typically include butt joints with laminated overlay, bell-and-spigot joints with laminated overlay, flanged, bell-and-spigot adhesive bonded and threaded.

6.8 *Longitudinal Strength:*

6.8.1 *Beam Strength*—For pipe sizes up to 27 in. the pipe shall withstand, without failure, the beam loads specified in Table 9, when tested in accordance with 8.6.1. For pipe sizes larger than 27 in., and alternatively for smaller sizes, adequate beam strength is demonstrated by tension and compression tests conducted in accordance with 8.6.2 and 8.6.3, respec-

tively, for pipe wall specimens oriented in the longitudinal direction, using the minimum tensile and compressive strength specified in Table 9.

6.8.2 *Longitudinal Tensile Strength*—All pipe manufactured under this specification shall have a minimum axial tensile elongation at failure of 0.25% and meet or exceed the longitudinal tensile strength shown for each size and class in Table 10, when tested in accordance with 8.6.2.

NOTE 11—The values listed in Table 10 are the minimum criteria for products made to this standard. The values may not be indicative of the axial strength of some products, or of the axial strength required by some installation conditions and joint configurations.

6.8.3 Conformance to the requirements of 6.8.1 shall satisfy the requirements of 6.8.2 for those pipe sizes and classes where the minimum longitudinal tensile strength values of Table 9 are equal to the values of Table 10. Conformance to the requirements of 6.8.2 shall satisfy the longitudinal tensile strength requirements of 6.8.1.

7. Sampling

7.1 *Lot*—Unless otherwise agreed upon between the purchaser and the supplier, one lot shall consist of 100 lengths of each type, grade, and size of pipe produced.

7.2 *Production Tests*—Select one pipe at random from each lot and take one specimen from the pipe barrel to determine conformance of the material to the workmanship, dimensional, and stiffness, and strength requirements of 6.1, 6.2, 6.5, and 6.6, respectively. Unless otherwise agreed upon between purchaser and supplier, all pipes (up to 54-in. (1370-mm) diameter) shall meet the soundness requirements of 6.3.

7.3 *Qualification Tests*—Sampling for qualification tests (see section 3.2.4) is not required unless otherwise agreed upon between the purchaser and the supplier. Qualification tests, for which a certification and test report shall be furnished when requested by the purchaser include the following:

7.3.1 *Long-Term Hydrostatic Pressure Test.*

7.3.2 *Joint-Tightness Test (See 6.7).*

7.3.3 *Longitudinal-Strength Test, including:*

7.3.3.1 *Beam strength and*

7.3.3.2 *Longitudinal tensile strength.*

7.4 *Control Tests*—The following test is considered a control requirement and shall be performed as agreed upon between the purchaser and the supplier:

7.4.1 *Soundness Test*—60-in. (1520-mm) diameter pipe and larger.

7.4.2 Perform the sampling and testing for the control requirements for hydrostatic design basis at least once every two years.

7.5 For individual orders conduct only those additional tests and numbers of tests specifically agreed upon between the purchaser and the supplier.

8. Test Methods

8.1 *Dimensions:*

8.1.1 *Diameters:*

8.1.1.1 *Inside Diameter*—Take inside diameter measurements at a point approximately 6 in. (152 mm) from the end of the pipe section using a steel tape or an inside micrometer with