

SLOVENSKI STANDARD
SIST EN 14908-2:2014**01-julij-2014****Nadomešča:**
SIST EN 14908-2:2006

Odprta izmenjava podatkov v avtomatizaciji stavb in izvršnih elementov ter pri upravljanju stavb - Protokol regulacijske mreže - 2. del: Komunikacija zavitega para

Open Data Communication in Building Automation, Controls and Building Management - Control Network Protocol - Part 2: Twisted Pair Communication

iTeh STANDARD PREVIEW

Firmenneutrale Datenkommunikation für die Gebäudeautomation und Gebäudemanagement - Gebäudedatennetzprotokoll - Teil 2: Kommunikation über paarig verdrillte Leitungen

[SIST EN 14908-2:2014](https://standards.itih.ai/catalog/standards/sist/91f73422-4b31-43ad-93fd-11e1c1034/sist-en-14908-2-2014)[https://standards.itih.ai/catalog/standards/sist/91f73422-4b31-43ad-93fd-](https://standards.itih.ai/catalog/standards/sist/91f73422-4b31-43ad-93fd-11e1c1034/sist-en-14908-2-2014)

Réseau ouvert de communication de données pour l'automatisation, la régulation et la gestion technique du bâtiment - Protocole de contrôle du réseau - Partie 2 : Communication par paire torsadée

Ta slovenski standard je istoveten z: EN 14908-2:2014**ICS:**

35.240.99	Uporabniške rešitve IT na drugih področjih	IT applications in other fields
97.120	Avtomatske krmilne naprave za dom	Automatic controls for household use

SIST EN 14908-2:2014**en,fr,de**

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 14908-2:2014](#)

<https://standards.iteh.ai/catalog/standards/sist/91f73422-4b31-43ad-93fd-ed1ff4f4c024/sist-en-14908-2-2014>

EUROPEAN STANDARD

EN 14908-2

NORME EUROPÉENNE

EUROPÄISCHE NORM

April 2014

ICS 35.240.99; 91.140.01; 97.120

Supersedes EN 14908-2:2005

English Version

Open Data Communication in Building Automation, Controls and Building Management - Control Network Protocol - Part 2: Twisted Pair Communication

Réseau ouvert de communication de données pour l'automatisation, la régulation et la gestion technique du bâtiment - Protocole de contrôle du réseau - Partie 2 : Communication par paire torsadée

Offene Datenkommunikation für die Gebäudeautomation und Gebäudemanagement - Gebäude-Netzwerk-Protokoll - Teil 2: Kommunikation über verdrehte Zweidrahtleitungen

This European Standard was approved by CEN on 12 April 2013.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

Foreword.....	3
Introduction	4
1 Scope	5
2 Normative references	5
3 Network overview	5
4 System specifications	5
4.1 General aspects	5
4.2 Cable	5
4.3 Topology.....	5
4.3.1 Free or bus topology	5
4.3.2 Repeater.....	6
4.4 Cable termination.....	6
4.4.1 Free-topology segment.....	6
4.4.2 Bus topology segment.....	6
4.5 Segment configuration.....	6
4.6 Power specifications	7
5 Link power	7
5.1 General.....	7
5.2 Source.....	7
5.3 Power supply requirements.....	8
5.4 Passive coupler circuit.....	10
6 Node specifications	12
6.1 Link power	12
6.2 Hot plugging.....	12
6.3 Transmitter/receiver interface to the MAC sub-layer	12
6.3.1 Physical layer protocol data unit	12
6.3.2 Frame format	12
6.3.3 Transmit waveform.....	13
6.4 Impedance	15
7 Communication parameters	16
Annex A (informative) Environmental specifications	18
Bibliography.....	19

iTech STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 14908-2:2014

<https://standards.iteh.ai/catalog/standards/sist/91f73422-4b31-43ad-93fd->

<ed1ff4f4c024/sist-en-14908-2-2014>

Foreword

This document (EN 14908-2:2014) has been prepared by Technical Committee CEN/TC 247 "Building Automation, Controls and Building Management", the secretariat of which is held by SNV.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by October 2014 and conflicting national standards shall be withdrawn at the latest by October 2014.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 14908-2:2005.

This European Standard is part of a series of standards for open data transmission in building automation, control and in building management systems. The content of this European Standard covers the data communications used for management, automation/control and field functions.

EN 14908-2 is part of a series of European Standards under the general title *Control Network Protocol (CNP)*, which comprises the following parts:

Part 1: *Protocol stack*;

Part 2: *Twisted pair communication*;

Part 3: *Power line channel specification*;

Part 4: *IP-Communication*;

Part 5: *Implementation*;

Part 6: *Application elements*.

According to the CEN-CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 14908-2:2014](https://standards.iteh.ai/catalog/standards/sist/91f73422-4b31-43ad-93fd-ed1ff44c024/sist-en-14908-2-2014)

<https://standards.iteh.ai/catalog/standards/sist/91f73422-4b31-43ad-93fd-ed1ff44c024/sist-en-14908-2-2014>

EN 14908-2:2014 (E)**Introduction**

This European Standard has been prepared to provide mechanisms through which various vendors of building automation, control, and building management systems may exchange information in a standardised way. It defines communication capabilities.

This European Standard will be used by all involved in design, manufacture, engineering, installation and commissioning activities.

**iTeh STANDARD PREVIEW
(standards.iteh.ai)**

SIST EN 14908-2:2014

<https://standards.iteh.ai/catalog/standards/sist/91f73422-4b31-43ad-93fd-ed1ff4f4c024/sist-en-14908-2-2014>

1 Scope

This European Standard specifies the control network protocol (CNP) free-topology twisted-pair channel for networked control systems in commercial Building Automation, Controls and Building Management and is used in conjunction with EN 14908-1:2014. The channel supports communication at 78,125 kbit/s between multiple nodes, each of which consists of a transceiver, a protocol processor, an application processor, a power supply, and application electronics.

This European Standard covers the complete physical layer (OSI Layer 1), including the interface to the Media Access Control (MAC) sub-layer and the interface to the medium. Parameters that are controlled by other layers but control the operation of the physical layer are also specified.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 14908-1:2014, *Open Data Communication in Building Automation, Controls and Building Management - Control Network Protocol - Part 1: Protocol Stack*

EN 50173-1, *Information technology — Generic cabling systems — Part 1: General requirements*

3 Network overview

The CNP free-topology twisted-pair channel supports up to 128 nodes on a single network segment with an optional link power source that supplies DC power to the nodes on the network. The channel is specified to support free-topology wiring, and will accommodate bus, star, loop, or any combination of these topologies. The total network length and number of nodes may be extended by use of CNP channel physical layer repeaters, or CNP compliant routers. The channel data rate is 78,125 kbit/s. Nodes can be either locally powered or link powered. A link-powered node derives its power from the network. The power is delivered on the same two conductors that carry data. Nodes are polarity-insensitive with respect to data as well as DC power. A locally powered node derives its power from a local source. The data is transmitted using Differential Manchester encoding, which is polarity-insensitive.

4 System specifications

4.1 General aspects

This sub-clause specifies the cable type used, terminations required with bus or free topology, maximum node counts and distances for link and locally powered schemes, and the maximum steady state power that can be drawn from the link power supply.

4.2 Cable

The cable shall conform to EN 50173-1.

4.3 Topology

4.3.1 Free or bus topology

The network may use either a singly-terminated free topology or a doubly-terminated bus topology.

EN 14908-2:2014 (E)

4.3.2 Repeater

Two network segments may be interconnected with a channel physical layer repeater. No more than one physical layer repeater shall be in a path between any two nodes on a network. Physical layer repeaters shall not be interconnected in such a way as to create a loop.

Each port of a physical layer repeater shall meet the specifications stated in 6.2, 6.3.3, and 6.4. The delay through the repeater shall not exceed 36 μ s.


4.4 Cable termination

4.4.1 Free-topology segment

A free-topology segment shall have a single termination. If the segment is locally powered, an RC network as shown in Figure 1 shall be used, with $R1 = 52,3 \Omega \pm 1 \%$, 1/8 W. The termination may be located anywhere on the segment. If the segment is link-powered, the termination shall be provided by the link power source. See Figure 5. The link power source and termination may be located anywhere on the segment.

4.4.2 Bus topology segment

A bus topology segment shall have two terminations, one at each end of the bus. If the segment is locally powered, an RC network as shown in Figure 1 shall be used, with $R1 = 105 \Omega \pm 1 \%$, 1/8 W at each end. If the segment is link-powered, the link power source shall provide one termination. See Figure 5. The other termination shall be an RC network as shown in Figure 1, with $R1 = 105 \Omega \pm 1 \%$, 1/8 W.

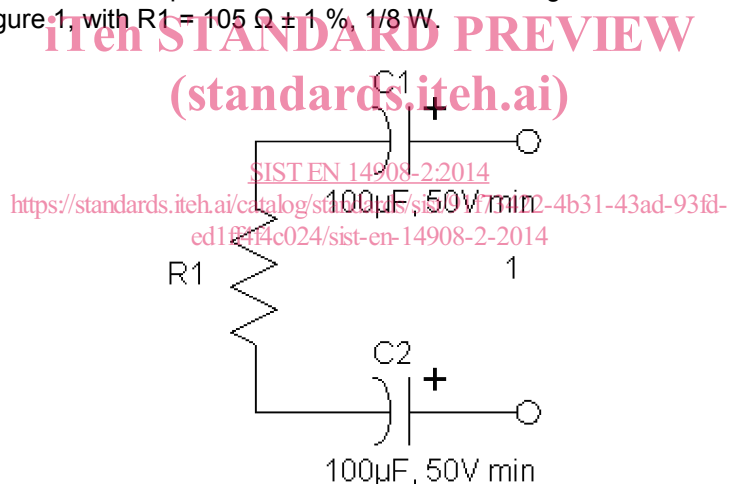

Key

1 network connection

Figure 1 — Termination

4.5 Segment configuration

A free-topology twisted-pair channel shall support up to 128 link-powered or 64 locally-powered nodes at a maximum bit error rate of 1 in 100 000. Both types of nodes shall be supported on a given segment, provided the following constraint is met:

$$(1 \times \text{number of link powered nodes}) + (2 \times \text{number of locally powered nodes}) \leq 128$$

Table 1 shows the maximum bus length for a bus-topology segment.

Table 2 shows the maximum node-to-node distance and maximum wire length for a free-topology segment. The distance from each node to each of the other nodes and to the link power source shall not exceed the maximum node-to-node distance. If multiple paths exist, e.g., a loop topology, then the longest path shall be used for the calculations. The maximum wire length is the total amount of wire connected to a network segment.

Table 1 — Bus-topology distance specifications

Maximum Bus Length	Maximum Stub Length	Units
600	3	m

Table 2 — Free topology distance specifications

Maximum Distance	Node-to-node	Maximum Total Wire length	Units
250		450	m

4.6 Power specifications

The sum of the steady-state power drawn by all nodes on a segment shall not exceed 36,5 watts. For each branch, the sum of the products of each node's distance multiplied by that node's power shall not exceed a constant:

$$P_1 \times d_1 + P_2 \times d_2 + P_3 \times d_3 + \dots \leq C \times \alpha \quad (1)$$

where

- C is a constant, dependent on wire type, taking into account manufacturing tolerance and all other variations except wire temperature;
- $C = 1,9 \times 10^3$ Wm;
- P_i = Node power, i.e., the maximum steady-state power drawn by node 'i' from the network, in watts;
- d_i = Node distance, i.e., the distance of node 'i' from the link power source, in meters;
- $\alpha = 1/(1 + 0,00393 * (\text{temp} - 25 \text{ }^\circ\text{C}))$, accounting for average wire temperature.

5 Link power


5.1 General

A link-powered node derives its power from the network. The power is delivered on the same two conductors that carry data.

5.2 Source

The link power source shall consist of a passive coupler together with a power supply having special attributes. The requirements for the power supply for proper system operation include its start-up behaviour, tolerance to direct shorts across its output, and output voltage regulation. A schematic for the coupler is also included. The combination coupler/power supply block diagram is shown in Figure 2. Any deviations from the power supply requirements and coupler schematic (Figure 5) are allowed provided that the link power source design is electrically equivalent.

EN 14908-2:2014 (E)

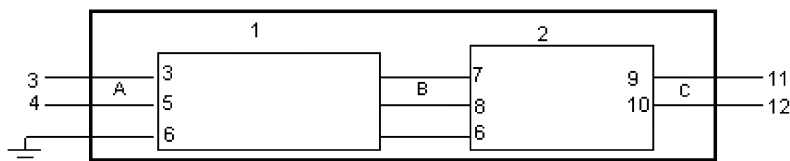**Key**

1	power supply	7	vin +
2	coupler	8	vin -
3	line	9	net +
4	input	10	net -
5	neutral	11	network
6	earth	12	output

Figure 2 — Link Power Source

The differential DC output voltage of the link power source shall be 41,0 VDC – 42,4 VDC over full operating conditions. Under normal (non-fault) conditions, the link power source shall "centre" the output voltage with respect to earth ground, resulting in +21 V and –21 V outputs at "Net+" and "Net-" respectively. The link power source shall recover after a continuous direct short across the output and shall properly restart the link powered network.

An earth reference terminal is required if the coupler is not grounded via the power supply.

5.3 Power supply requirements

Unless otherwise specified, the power supply specifications in Table 3 shall be met over all combinations of the following conditions:

- specified coupling circuit connected;
- line input voltage over full range per specification;
- network output load = 0 to 1,5 DC amperes.

Table 3 — Power supply requirements

Description	Conditions	Specification
Line input voltage & indicator	<ul style="list-style-type: none"> Measured at "A" (see Figure 2) 	Line voltage as required by application environment. Input Power Applied indicator required - LED or equivalent.
Output voltage	<ul style="list-style-type: none"> Measured at "B" (see Figure 2) 	42,4 VDC maximum 42,08 VDC minimum
Output voltage regulation response	<ul style="list-style-type: none"> Measured at "B" 50 % step change in load 	Output voltage shall recover to within 1 % of its final value in less than 1ms of step change in load.
Output reference	<ul style="list-style-type: none"> Measured at "B" Coupling circuit disconnected 	Floating with respect to earth.
Output ripple voltage (Differential)	<ul style="list-style-type: none"> Measured at "B" 	Reference to Figure 2.
Spike noise (Differential)	<ul style="list-style-type: none"> Measured at "B" 50 MHz bandwidth 	400 mV peak-to-peak maximum.
Output common-mode noise	<ul style="list-style-type: none"> Measured at "B" with respect to earth 	100 mV peak-to-peak maximum.
Continuous output current capability	<ul style="list-style-type: none"> Measured at "B" 	0 - 1,5 ADC
Output start-up interval behaviour	<ul style="list-style-type: none"> Start-up or recovery from output short circuit or over-current fault Measured at "B" 	Reference to Figure 4.
Short circuit output protection	<ul style="list-style-type: none"> Continuous short circuit at output for any duration 	Shall recover after fault is cleared according to "Output start-up interval behaviour" specification.
Single fault tolerance	<ul style="list-style-type: none"> Any single component failure as open or short Measured at "B" 	"Vin+" - "Vin-" ≤ 42,4V. "Vin+" to earth ≤ 42,4V. "Vin-" to earth ≤ 42,4V.