

SLOVENSKI STANDARD
SIST EN 15434:2006+A1:2010
01-julij-2010

Steklo v gradbeništvu - Produktni standard za strukturna in/ali UV-odporna tesnila (za uporabo v strukturnih zasteklitvah in/ali v izolacijskih steklih z nezavarovanim robnim tesnjenjem)

Glass in building - Product standard for structural and/or ultra-violet resistant sealant (for use with structural sealant glazing and/or insulating glass units with exposed seals)

Glas im Bauwesen - Produktnorm für lastübertragende und/oder UV-beständige Dichtstoffe (für geklebte Verglasungen und/oder Isolierverglasungen mit exponierten Dichtungen)

Verre dans la construction - Norme de produits pour produit de collage et de scellement structurel et/ou résistants aux rayonnements ultraviolets (utilisé pour les vitrages extérieurs collés et/ou pour les vitrages isolants à bords exposés)

Ta slovenski standard je istoveten z: EN 15434:2006+A1:2010

ICS:

81.040.20 Steklo v gradbeništvu Glass in building

SIST EN 15434:2006+A1:2010 en,fr,de

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 15434:2006+A1:2010](https://standards.iteh.ai/catalog/standards/sist/bb44a9c3-5f08-419d-8f8f-1306c6ba76f1/sist-en-15434-2006a1-2010)

<https://standards.iteh.ai/catalog/standards/sist/bb44a9c3-5f08-419d-8f8f-1306c6ba76f1/sist-en-15434-2006a1-2010>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 15434:2006+A1

March 2010

ICS 81.040.20

Supersedes EN 15434:2006

English Version

Glass in building - Product standard for structural and/or ultra-violet resistant sealant (for use with structural sealant glazing and/or insulating glass units with exposed seals)

Verre dans la construction - Norme de produits pour produit de collage et de scellement structurel et/ou résistants aux rayonnements ultraviolets (utilisé pour les vitrages extérieurs collés et/ou pour les vitrages isolants à bords exposés)

Glas im Bauwesen - Produktnorm für lastübertragende und/oder UV-beständige Dichtstoffe (für geklebte Verglasungen und/oder Isolierverglasungen mit exponierten Dichtungen)

This European Standard was approved by CEN on 3 April 2006 and includes Amendment 1 approved by CEN on 25 January 2010.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

Page

Foreword.....	4
1 Scope.....	5
2 Normative references	5
3 Terms and definitions.....	6
4 Sealant.....	7
4.1 General.....	7
4.2 The compulsory part of the product description.....	7
5 Requirements	8
5.1 General.....	8
5.1.1 Identification - performances.....	8
5.1.2 Application.....	8
5.2 Identification tests	9
5.2.1 General.....	9
5.2.2 Thermogravimetric analysis	9
5.2.3 Specific gravity.....	9
5.2.4 Shore A hardness	9
5.2.5 Change in volume or shrinkage	10
5.2.6 Infrared spectrometer analysis.....	10
5.3 Intrinsic properties.....	10
5.3.1 General.....	10
5.3.2 Standard substrates and test pieces	10
5.3.3 Tensile.....	11
5.3.4 Shear at 23 °C	12
5.3.5 Elastic recovery.....	12
5.3.6 Tear strength	13
5.3.7 Mechanical cyclic load	14
5.3.8 Displacement under permanent shear load (creep test).....	15
5.3.9 Elastic modulus of the sealant	18
5.4 Environmental influences	18
5.4.1 General.....	18
5.4.2 Determination of cohesion/adhesion properties after exposure to artificial light through glass and to water	18
5.4.3 Salt spray	20
5.4.4 SO ₂ atmosphere.....	20
5.4.5 Façade cleaning products.....	21
5.4.6 High temperature	21
5.5 Water vapour transmission and gas transmission	21

5.6	Reaction to fire	21
5.7	Dangerous substances.....	22
5.8	Outer seal of insulating glass unit category differentiation	22
6	Sealing and bonding.....	22
7	Compatibility with adjacent material.....	22
8	Evaluation of conformity	27
8.1	General or scope.....	27
8.2	Requirements	27
8.2.1	Product description	27
8.2.2	Conformity with the definition of sealant	27
8.2.3	Determination of the characteristic's performances.....	27
8.2.4	Durability.....	28
8.2.5	Dangerous substances.....	29
8.3	Evaluation of conformity	29
8.3.1	General.....	29
8.3.2	Initial type testing of the product (see Clause 5).....	29
8.3.3	General.....	29
8.4	Factory production control and inspection of samples in accordance with a prescribed test plan (8.3.1.1, 1 a) and 1 b).....	31
8.4.1	General.....	31
8.4.2	Initial inspection of factory and of factory production control (8.3.1.1 1 b)	31
8.4.3	Continuous surveillance and assessment of the factory production control (see 8.3.1.1 1 c).....	32
9	Marking and/or labelling.....	33
9.1	General.....	33
9.2	Labelling	33
9.3	Product marking.....	33
9.4	Product characteristics	33
9.5	“Characteristics/performance identification paper”	33
	Annex A (normative) Evaluation of mechanical tests results	35
	Annex B (normative) Shear at 23 °C: Test method.....	42
	Annex C (normative) Factory production control.....	44
	Annex D (normative) Outer seal of insulating glass category differentiation	49
	Annex E (normative) Formation of bubbles	54
	Annex F (informative) Sealing, structural bonding and UV resistance: schematic illustrations.....	56
	Annex G (normative) Initial testing of bonding of sealant to non-glass substrates	59
	Annex V (informative) Provisions for voluntary involvement of third party(ies)	61
	Bibliography	62

EN 15434:2006+A1:2010 (E)**Foreword**

This document (EN 15434:2006+A1:2010) has been prepared by Technical Committee CEN/TC 129 “Glass in building”, the secretariat of which is held by NBN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by September 2010, and conflicting national standards shall be withdrawn at the latest by September 2010.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document includes Amendment 1, approved by CEN on 2010-01-25.

This document supersedes EN 15434:2006.

The start and finish of text introduced or altered by amendment is indicated in the text by tags \square_{A1} \square_{A1} .

This European Standard is one of a series of interrelated standard parts dealing with:

- glass products for structural sealant glazing systems;
- installation of glass products in a structural manner on building façades;
- UV-resistant and structural sealant for use in structural sealant glazing

The interrelated parts are:

- EN 13022-1: Glass in building — Structural sealant glazing — Part 1: Glass products for structural sealant glazing systems for supported and unsupported monolithic and multiple glazing
- EN 13022-2: Glass in building — Structural sealant glazing — Assembly rules
- EN 15434: Glass in building — Product standard for structural and/or ultra-violet resistant sealant (for use with structural sealant glazing and/or insulating glass units with exposed seals)

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

1 Scope

A1 This European Standard covers the requirements for and testing of sealants for use in one or more of the following applications:

- a) Manufacturing of insulating glass units where ultra-violet resistance and/or mechanical resistance (structural use) of the insulating glass edge seal is required.
- b) Manufacturing of factory made structural sealant glazing elements when referred to by the relevant European Standards and/or European Technical Approval Guidelines.
- c) Assembling of glass products into or onto supports, where also ultra-violet resistance and/or mechanical resistance (structural use) of the seal is required, under controlled environmental conditions as described in Clause 5 of EN 13022-2: 2006.

NOTE 1 The required level of resistance to ultra-violet exposure will be dependent upon the degree of exposure to ultra-violet radiation.

NOTE 2 Only silicone based sealants are permitted for the applications a, b and c above.

d) Manufacturing of insulating glass units where the outer seal of the insulating glass has no structural function and exposure to ultra-violet radiation is reduced for example either by:

- i) Use of glass components that decrease the ultra-violet radiation transmission, e.g. laminated glass with ultra-violet absorbing interlayer(s), screen enamelled printing, etc., or
- ii) Use of durable applied opaque surface coverings, e.g. metal components, etc.

NOTE 3 Dependent upon the amount of ultra-violet radiation exposure both organic and silicone based sealants are permitted.

This European Standard covers the evaluation of conformity and the factory production control with respect to the production of sealants in conformity with this standard.

This European Standard describes the role of sealants that are in conformity with this European Standard, with respect to sealing and bonding.

This European Standard does not apply to sealants for the manufacture of insulating glass units where the seal is fully protected, i.e. by a frame, from ultra-violet radiation.

NOTE 4 Sealants for this application should comply with EN 1279-4.

This European Standard contains other aspects of importance for trade. **A1**

2 Normative references

The following referenced documents are indispensable for the application of this European Standard. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 572-1, *Glass in building — Basic soda lime silicate glass products — Part 1: Definitions and general physical and mechanical properties*

EN 572-2, *Glass in building — Basic soda lime silicate glass products — Part 2: Float glass*

EN 1279-4:2002, *Glass in building — Insulating glass units — Part 4: Methods of test for the physical attributes of edge seals*

EN 15434:2006+A1:2010 (E)

EN 13022-1:2006, *Glass in building — Structural sealant glazing — Part 1: Glass products for structural sealant glazing systems for supported and unsupported monolithic and multiple glazing*

EN 13022-2:2006, *Glass in building — Structural sealant glazing — Part 2: Assembly rules*

EN 13501-1, *Fire classification of construction products and building elements — Part 1: Classification using data from reaction to fire tests*

EN ISO 527-3, *Plastics — Determination of tensile properties — Part 3: Test conditions for films and sheets (ISO 527-3:1995)*

EN ISO 868, *Plastics and ebonite — Determination of indentation hardness by means of a durometer (Shore hardness) (ISO 868:2003)*

EN ISO 1183-1:2004, *Plastics — Methods for determining the density of non-cellular plastics — Part 1: Immersion method, liquid pycnometer method and titration method (ISO 1183-1:2004)*

EN ISO 3231, *Paints and varnishes — Determination of resistance to humid atmospheres containing sulfur dioxide (ISO 3231:1993)*

EN ISO 4892-2, ^[A1] *Plastics — Methods of exposure to laboratory light sources — Part 2: Xenon-arc lamps (ISO 4892-2:2006) ^[A1]*

EN ISO 7389, *Building construction — Jointing products — Determination of elastic recovery of sealants (ISO 7389:2002)*

EN ISO 8339, *Building construction — Sealants — Determination of tensile properties (Extension to break) (ISO 8339:2005)*

^[A1] EN ISO 9227, *Corrosion tests in artificial atmospheres — Salt spray tests (ISO 9227:2006) ^[A1]*

EN ISO 10563, *Building construction — Sealants — Determination of change in mass and volume (ISO 10563:2005)*

EN ISO 11358:1997, *Plastics — Thermogravimetry (TG) of polymers — General principles (ISO 11358:1997)*

ISO 16269-6, *Statistical interpretation of data — Part 6: Determination of statistical tolerance intervals*

3 Terms and definitions

For the purposes of this European Standard, the terms and definitions given in EN 13022-1:2006, EN 13022-2:2006, EN 1279-4:2002 and the following apply.

3.1

initial cure

stage in the curing where sealant has appropriate cohesive strength to resist to different levels of action

3.2

creep factor

shear design stress under dynamic load

3.3**initial type testing**

determination of the performance of a product (characteristic, durability), on the basis of either actual tests or other procedures (such as conventional, standardised, tabulated or general accepted values, standardised or recognised calculation methods, test reports when made available), in accordance with this European Standard that demonstrates compliance with this European Standard

3.4**test report**

document that covers the results of tests undertaken on a representative sample of the product from production or on a prototype design of the product

3.5**product description**

document that details the relevant parameters for defining a product that complies with the standard. It includes specific reference(s) to characteristics that are modified by the production process and by raw materials

3.6**significant change**

variation in performance beyond the permitted tolerance for the characteristic

3.7**type of rupture**

number of tests prescribe "Rupture \geq 90 % cohesive", i.e. the rupture of the samples need to be located at least 90 % within the sealant and a maximum 10 % at the interface between the sealant and the glass

IT-EN STANDARD PREVIEW
(standards.iteh.ai)

4 Sealant

[SIST EN 15434:2006+A1:2010](https://standards.iteh.ai/catalog/standards/sist/bb44a9c3-5f08-419d-8f8f-1306c6ba76f1/sist-en-15434-2006a1-2010)

4.1 General

<https://standards.iteh.ai/catalog/standards/sist/bb44a9c3-5f08-419d-8f8f-1306c6ba76f1/sist-en-15434-2006a1-2010>

For conformity purposes, the sealant manufacturer shall describe the product in a product description, which will be part of the factory production control documentation, or of the quality insurance system, whichever is applied.

Disclosure of the product description is entirely at the discretion of the sealant manufacturer or his agent.

The product description shall contain at least a normative part, and may contain an informative part when the manufacturer foresees further development of the product.

The product description shall be prepared under the responsibility of the sealant manufacturer or his agent.

4.2 The compulsory part of the product description

The compulsory part of the description consists of three sub parts:

2) component description:

name and/or type of the sealant, together if it concerns a mono or a multiple component sealant

and in the case of a multiple component sealant, the mixing ratio and the tolerances of the mixing ratio within which the performances of the characteristics and properties does not change significantly;

EN 15434:2006+A1:2010 (E)

- 3) initial cure information:
- relevant data (or figure or values) depending on the temperature and the relative humidity, the chemistry of the curing system, number of components, mixing ratio and tolerances, section of the sealant to be applied, the nature of the adhesion surfaces ...;
- 4) cured sealant description:
- list of identification test results in accordance with 5.2 in order to ensure no significant change in the characteristics, properties and durability of the sealant.

The definition of product families shall be consistent with the normative part of the product description.

The substitution of raw materials or change in the process shall maintain the conformity with the product description. The substituting material can be added to the product family and also the product description when compliance has been demonstrated.

5 Requirements

5.1 General

5.1.1 Identification - performances

Sealants shall be identified by the tests referred to in 5.2.

The performances of the characteristics claimed in Table 1 shall be determined. The assessments to which Table 1 refers include the durability of the sealant.

5.1.2 Application

The sealant shall be applied in conformity with the manufacturer's recommendations and of the requirements of Clause 5 of EN 13022-2:2006.

Table 1 — The performances of the characteristics to determine if relevant

Nr	Performance of characteristic:	Refer to:
1	Mechanical resistance and stability	None
2	Safety in case of fire:	
	2.1 Reaction to fire	5.6
3	Hygiene, health and the environment::	
	3.1 Release of dangerous substances	5.7
4	Safety in use:	
	4.1 Resistance against wind, snow, permanent load and/or imposed loads of the glass unit	5.3 and 5.4
5	Protection against noise (when intended for use in insulating glass seal):	5.3, 5.4, 5.5 and 5.8
6	Energy economy and heat retention (when intended for use in insulating glass seal):	5.3, 5.4, 5.5 and 5.8

5.2 Identification tests

5.2.1 General

All tests of 5.2 except 5.2.5 "Change in volume" are carried out on cured products. When no curing time has explicitly been stated by the sealant manufacturer, a curing time of at least 28 days at $(23 \pm 2) ^\circ\text{C}$ and $(50 \pm 5) \%$ relative humidity shall be maintained.

The identification test performances are independent of the production equipment used, provided that a factory production control in accordance with Annex C is in use.

5.2.2 Thermogravimetric analysis

The test shall be carried out in accordance with EN ISO 11358:1997, Temperature scanning method, Procedure A, non-oxidative condition, temperature slope $10 ^\circ\text{C}/\text{min}$.

After conditioning / curing: $(23 \pm 2) ^\circ\text{C}$, $(50 \pm 5) \%$ RH, 28 days.

Number of test pieces: 1.

Evaluation:

- curve and the first derivate of the curve;
- percentage of cumulative losses up to $900 ^\circ\text{C}$;
- zones of maximum loss through volatilisation;
- exo- or endothermic conversion zones.

5.2.3 Specific gravity

[SIST EN 15434:2006+A1:2010](https://standards.iteh.ai/catalog/standards/sist/bb44a9c3-5f08-419d-8f8f-1306c6ba76f1/sist-en-15434-2006a1-2010)

<https://standards.iteh.ai/catalog/standards/sist/bb44a9c3-5f08-419d-8f8f-1306c6ba76f1/sist-en-15434-2006a1-2010>

The determination of the specific mass shall be in accordance with EN ISO 1183-1:2004, Method A.

Test samples to take from:

- cured product;
- non cured product (mono component sealant);
- components (multiple component sealant).

Number of test pieces per test sample: 3

Evaluation: each value, after complete curing shall be within the minimum and maximum value declared by the sealant manufacturer.

5.2.4 Shore A hardness

The measurement of the shore A hardness shall be carried out in accordance with EN ISO 868.

Test time: 3 s, every sample 5 times.

The measurement shall be carried out on three test pieces after full curing of the sealant.

Number of test specimen: 3.

EN 15434:2006+A1:2010 (E)

Evaluation: each value after complete curing shall be within the minimum and maximum value declared by the sealant manufacturer.

5.2.5 Change in volume or shrinkage

The aim of this test is to evaluate the degree of change of volume or shrinkage of the structural sealants to limit the initial stresses in the SSG joints.

The test shall be carried out in accordance with EN ISO 10563.

Number of test pieces: 3.

Evaluation: the average change in volume shall not exceed 10 %.

5.2.6 Infrared spectrometer analysis

The infrared spectrum is measured by transmission or by reflection in the range from 2,4 μm to 50 μm , preferably by use of a KRS 5 crystal.

Test specimen: a tongue shaped amount of cured sealant which shall be conditioned for at least 48 h at $(23 \pm 2) ^\circ\text{C}$, subsequently subjected to pyrolysis.

Evaluation: the measured spectrum highlighting the relevant characteristic wavelengths of absorption.

5.3 Intrinsic properties

STANDARD PREVIEW
(standards.iteh.ai)

5.3.1 General

For determining these properties, the tests are to be carried out on test pieces according to 5.3.2.

The rigidity modulus and strength $R_{t,5}$ are defined in Annex A.

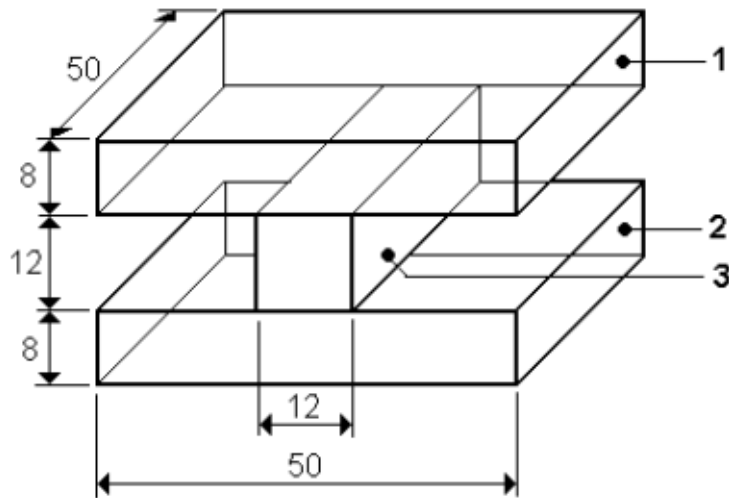
The intrinsic properties are independent of the production equipment used, provided that a factory production control in accordance with Annex C is in use.

5.3.2 Standard substrates and test pieces

Flat float glass, in accordance with EN 572 Parts 1 and 2, is to be used as a standard glass substrate.

Unless otherwise indicated in the various clauses, test pieces are to be used with the dimensions given in Figure 1. Substrate dimension may be different from those given in Figure 1. The dimensions of the sealant joint, however, shall always be 12 mm x 12 mm x 50 mm.

Dimensions in millimetres

**Key**

- 1 float glass
- 2 float glass
- 3 sealant

iTeh STANDARD PREVIEW

Figure 1 – Standard test piece
(standards.iteh.ai)

Unless otherwise specified in this European Standard the test pieces shall be conditioned for 28 days at $(23 \pm 2) ^\circ\text{C}$ and $(50 \pm 5) \% \text{ R.H.}$ For in conformity with the specification of the sealant's manufacturer.

<https://standards.iteh.ai/catalog/standards/sist/bb44a9c3-5f08-419d-8f8f-1306c6ba76f1/sist-en-15434-2006a1-2010>

The stresses are given in MPa by the ratio of the breaking force in N and the initial cross section area in mm^2 .

5.3.3 Tensile

Tests are carried out in conformity with EN ISO 8339, Conditioning A.

After conditioning for 24 ± 4 hours, pulling of the test pieces at the following temperatures:

- for the class T1: $-20 ^\circ\text{C}$, $+23 ^\circ\text{C}$, $+80 ^\circ\text{C}$;
- for the class T2: $-40 ^\circ\text{C}$, $+23 ^\circ\text{C}$, $+80 ^\circ\text{C}$ (for Nordic countries).

Number of test specimen: 10 for each temperature.

Evaluation:

a) general:

visual examination: rupture shall be at least of 90 % cohesive;

b) sealant for structural purposes.

EN 15434:2006+A1:2010 (E)

Criteria as defined in Table 2:

Table 2 — Criteria for sealant for structural purposes

	Criteria
Class T1:	
80 °C	$\Delta_{x \text{ mean}} \geq 75 \%$
23 °C	$R_{u5} \geq 0,5 \text{ MPa}$
-20 °C	$\Delta_{x \text{ mean}} \geq 75 \%$
Class T2:	
80 °C	$\Delta_{x \text{ mean}} \geq 75 \%$
23 °C	$R_{u5} \geq 0,5 \text{ MPa}$
-40 °C	$\Delta_{x \text{ mean}} \geq 75 \%$

With $\Delta_{x \text{ mean}} = X_{\text{mean } 0^\circ\text{C}} / X_{\text{mean } 23^\circ\text{C}}$

X_{mean} is defined in A.1.

From the stress-at-elongation graph recorded, the following shall be noted:

- type of failure - whether cohesive or adhesive;
 - stress at elongations of 5 %, 10 %, 15 %, 20 % and 25 %;
 - stress and elongation at rupture, only for test specimens conditioned at + 23 °C.
- c) sealant for use for non structural insulating glass unit seals:
- strength and elongation criteria according to EN 1279-4.

5.3.4 Shear at 23 °C

Tests are carried out in conformity with Annex B.

Direction of force: longitudinal.

Number of test specimen: 10.

Pulling of the test pieces at the following temperatures: -20 °C, +23 °C, +80 °C.

Evaluation: Shear displacement.

Criteria identical to 5.3.3.

Rupture shall be at least of 90 % cohesive.

5.3.5 Elastic recovery

The purpose of the test is to evaluate the elastic recovery behaviour and consequently the relaxation behaviour after long term loading.

The test shall be carried out in accordance with EN ISO 7389, Conditioning A with a load to give 25 % elongation (= 125 % of original length).

Record:

- initial stress and elongation;
- final stress and elongation;
- elongation after unloading the test pieces.

Number of test specimen: 3.

Evaluation:

- sealant for structural purposes: the average of the elastic recovery shall be at least 95 %.

5.3.6 Tear strength

The aim of this test is to establish the mode of propagation of a cut in the structural sealant.

Five test pieces are prepared as specified in 5.3.2.

After curing, the test pieces are cut at the ends of the sealant as shown on Figure 2.

The samples are tested to destruction in accordance with 5.3.3 and EN ISO 8339 at the temperature: $23\text{ °C} \pm 2\text{ °C}$.

Number of test pieces: 5.

Evaluation: The average tear breaking strength value shall be:

- when insert in the structural seal (e.g. mechanical self-weight support, safety devices, other elements as relevant):

at least 0,75 times the average value as measured by 5.3.2 at 23 °C : $\Delta X_{\text{mean}} > 0,75$;

- without insert in the structural seal:

at least 0,50 times the average value as measured by 5.3.2 at 23 °C : $\Delta X_{\text{mean}} \geq 0,50$.

Rupture shall be at least of 90 % cohesive.

Where $\Delta X_{\text{mean}} = X_{\text{mean tear}} / X_{\text{mean } 23\text{ °C}}$