
**Hygrothermal performance of
buildings — Calculation and presentation
of climatic data —**

**Part 6:
Accumulated temperature differences
(degree days)**

iTeh STANDARD PREVIEW

(standards.iteh.ai)
*Performance hygrothermique des bâtiments — Calcul et présentation
des données climatiques —*

Partie 6: Différences accumulées de la température (en degrés par jour)

<https://standards.iteh.ai/catalog/standards/sist/b26979d1-c06e-4c11-ae7b-9e511550dc8f/iso-15927-6-2007>



PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 15927-6:2007

<https://standards.iteh.ai/catalog/standards/sist/b26979d1-c06e-4c11-ae7b-9e511550dc8f/iso-15927-6-2007>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2007

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword	iv
Introduction	v
1 Scope	1
2 Normative references	1
3 Terms, definitions, symbols and units	1
4 Direct calculation of accumulated temperature differences	3
5 Estimation of totals	6
6 Reference altitude	7
7 Accuracy and presentation of data	8
Annex A (informative) Estimation of monthly accumulated temperature differences from climatological statistics	10
Bibliography	13

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[ISO 15927-6:2007](https://standards.iteh.ai/catalog/standards/sist/b26979d1-c06e-4c11-ae7b-9e511550dc8f/iso-15927-6-2007)

<https://standards.iteh.ai/catalog/standards/sist/b26979d1-c06e-4c11-ae7b-9e511550dc8f/iso-15927-6-2007>

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 15927-6 was prepared by the European Committee for Standardization (CEN) Technical Committee CEN/TC 89, *Thermal performance of buildings and building components*, in collaboration with Technical Committee ISO/TC 163, *Thermal performance and energy use in the built environment*, Subcommittee SC 2, *Calculation methods*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

ISO 15927 consists of the following parts, under the general title *Hygrothermal performance of buildings — Calculation and presentation of climatic data*: [ISO 15927-6:2007](https://standards.iteh.ai/catalog/standards/sist/b26979d1-c06e-4c11-ae7b-9e511550dc8f/iso-15927-6-2007)

- *Part 1: Monthly means of single meteorological elements*
- *Part 2: Hourly data for design cooling load*
- *Part 3: Calculation of a driving rain index for vertical surfaces from hourly wind and rain data*
- *Part 4: Hourly data for assessing the annual energy use for heating and cooling*
- *Part 5: Data for design heat load for space heating*
- *Part 6: Accumulated temperature differences (degree days)*

Introduction

Accumulated temperature differences are a relatively simple form of climatic data, useful as an index of climate severity as it affects energy use for space heating.

Calculation or estimation of accumulated temperature differences in this part of ISO 15927 is based on the concept of a base temperature. The base temperature reflects the point at which buildings begin to need heating to maintain the required internal temperatures. This is the external temperature below which the heating plant is assumed to come into operation. For some purposes, such as development of energy policy, the need is for a single base temperature that can be taken to represent an average value for the whole built stock and overall climate. For other purposes, it is better to determine a base temperature appropriate to an individual building and time of year.

This part of ISO 15927 meets these needs by including both exact and approximate methods of determining accumulated temperature differences to both standard and variable base temperatures. Some methods include the possibility of a threshold temperature (e.g. a daily mean air temperature lower than the base temperature, above which accumulated temperature differences are not counted). This approach is found in certain national methods of computation. It is, however, not covered in this part of ISO 15927 because it is considered to be less flexible than the methods given, in which accumulated temperature differences are assessed for a base temperature appropriate to the thermal performance of the building (taking account of other climatic conditions such as solar irradiation).

Accumulated temperature differences computed and presented in accordance with this part of ISO 15927 are suitable for various purposes including the following:

- a) providing an index of climatic severity as it affects energy use for space heating (the comparison use);
- b) monitoring the amount of energy used by a heating plant, and thus its efficiency (the energy management use);
- c) comparing the actual energy consumption for heating in a specific period with the consumption in a standardized period in order to determine the measured rating (the energy modelling use);
- d) predicting the economic consequences of different levels of energy efficiency (e.g. through thermal insulation) for the building stock as a whole or for different classes of building (the energy policy use).

Energy management [list item b)] requires new accumulated temperature difference data at regular intervals, such as meteorological station data or data representative of a climatic region, calculated to standard base temperatures, published for each month of the heating season as soon as these can be computed from verified meteorological observations.

Comparison, energy modelling and energy policy [list items a), c) and d)] require meteorological station data, data representative of a climatic region or mapped data, collected over many years (possibly giving extremes as well as mean values), to typify the severity of the climate of a locality, area or region. For list item b), accumulated temperature differences are best suited to modelling the energy performance of relatively small buildings with simple heating systems and controls, using “steady-state” thermal analysis. Modelling the performance of larger or more complex buildings can require more extensive climatological data sets, such as full or short “test reference years” which are outside the scope of this part of ISO 15927.

In principle the equations in this part of ISO 15927 can be reversed to deal with accumulated temperature differences for assessing energy use in cooling or air-conditioning buildings (“cooling degree-hours” or “cooling degree-days”). However, as the air conditioning demand depends as much on solar gain and external humidity as temperature, the results are not a reliable index of energy demand.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 15927-6:2007

<https://standards.iteh.ai/catalog/standards/sist/b26979d1-c06e-4c11-ae7b-9e511550dc8f/iso-15927-6-2007>

Hygrothermal performance of buildings — Calculation and presentation of climatic data —

Part 6: Accumulated temperature differences (degree days)

1 Scope

This part of ISO 15927 specifies the definition, method of computation and method of presentation of data on accumulated temperature differences, used for assessing the energy used for space heating in buildings. These are normally expressed in degree-hours or degree-days, and such data are often referred to simply as “heating degree-hours” or “heating degree-days”.

This part of ISO 15927 includes approximate methods for calculating accumulated temperature differences based on hourly or daily mean temperatures and for estimating monthly values to any base temperature, for use when data computed directly from meteorological air temperature records are not available.

In some countries, a threshold temperature different from the base temperature is used. This part of ISO 15927 does not cover this.

[ISO 15927-6:2007](https://standards.iteh.ai/catalog/standards/sist/b26979d1-c06e-4c11-ae7b-9e511550dc8f/iso-15927-6-2007)

[https://standards.iteh.ai/catalog/standards/sist/b26979d1-c06e-4c11-ae7b-](https://standards.iteh.ai/catalog/standards/sist/b26979d1-c06e-4c11-ae7b-9e511550dc8f/iso-15927-6-2007)

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 6243, *Climatic data for building design — Proposed system of symbols*

WMO *Guide to Meteorological Instruments and Methods of Observation*, No. 8., 6th Edition, 1996¹⁾

3 Terms, definitions, symbols and units

3.1 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1.1

hourly temperature difference

difference between a specified base temperature and the external air temperature during a given hour when the difference is positive, otherwise zero

1) World Meteorological Organization: <http://www.wmo.ch/pages/catalogue/New%20HTML/frame/engfil/8.html>

3.1.2

daily temperature difference

difference between a specified base temperature and the mean external air temperature during a given day when the difference is positive, otherwise zero

3.1.3

accumulated hourly temperature difference

sum of all hourly temperature differences over a given period, e.g. day, month, season, year

3.1.4

accumulated daily temperature difference

sum of all daily temperature differences over a given period, e.g. day, month, season, year

3.1.5

base temperature

any conventional temperature, for instance the internal design temperature less decrements due to internal and solar gains

3.1.6

daily maximum and daily minimum temperatures

maximum and minimum external dry-bulb temperatures during a day, which may be taken either as the highest and lowest of the 24 hourly mean temperatures, recorded from 01:00 to 24:00, or as the recorded extremes on a maximum/minimum thermometer

3.1.7

hourly mean temperature

average of instantaneous external air temperatures during an hour or, in the absence of continuous measurements, the air temperature measured at a particular moment (e.g. on the hour)

3.1.8

daily mean temperature

average of the hourly mean temperatures over a day or, if that is not available, the arithmetic mean of the daily maximum and minimum temperatures

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 15927-6:2007

<https://standards.iteh.ai/catalog/standards/sist/b26979d1-c06e-4c11-ae7b-9e511550dc8f/iso-15927-6-2007>

NOTE See 4.6.

3.1.9

monthly mean temperature

long-term average of daily mean temperatures for a particular month (e.g. over a period of at least 10 years)

3.1.10

standard deviation of hourly mean temperature

standard deviation of hourly mean temperatures about the monthly mean temperature, based on long-term data

3.1.11

standard deviation of daily mean temperature

standard deviation of daily mean temperatures about the monthly mean temperature, based on long-term data

3.1.12

reference altitude

altitude above mean sea level to which accumulated hourly or daily temperature difference data refer

3.1.13

lapse rate of temperature

rate at which monthly mean temperature falls with increasing altitude

3.2 Symbols and units

Symbol	Quantity	Unit
$\theta_{\Sigma h}$	accumulated hourly temperature difference	K·h
$\theta_{\Sigma h(d)}$	accumulated hourly temperature difference expressed in degree-days	K·d
$\theta_{\Sigma d}$	accumulated daily temperature difference	K·d
L	lapse of temperature with altitude	K/m
N_M	number of days in a month	—
S_d	standard deviation of daily mean temperature about the monthly mean	K
S_h	standard deviation of hourly mean temperature about the monthly mean	K
z	altitude above reference level	m
$\Delta\theta_h$	hourly temperature difference	K
$\Delta\theta_d$	daily temperature difference	K
N_d	number of days in any period	—
N_h	number of hours in any period	—
θ_b	base temperature	°C
θ_{dx}	daily maximum temperature	°C
θ_{dn}	daily minimum temperature	°C
θ_{dm}	daily mean temperature	°C
θ_{hm}	hourly mean temperature	°C
θ_{Mm}	monthly mean temperature	°C

4 Direct calculation of accumulated temperature differences

4.1 General

The methods of calculation in 4.4 and 4.5 shall be used when accumulated temperature difference values can be derived directly from hourly or daily temperature data for a specified base temperature. They apply when the values are calculated to standard base temperatures and may be used in some cases for non-standard base temperatures.

Accumulated hourly temperature differences shall be calculated according to 4.4 when hourly data are available. When hourly data are not available, the approximate method given in 4.5, based on the maximum and minimum temperatures each day, may be used.

Accumulated daily temperature differences shall be calculated according to 4.6.

4.2 Sources of data

The temperatures used to calculate accumulated temperature difference values shall have been measured by the methods specified in *WMO Guide No.8*.

4.3 Standard base temperatures

The recommended standard base temperature is 12 °C.

Data may also be provided at other integer base temperatures.

NOTE Multiples of 2 °C, e.g. 10 °C, 12 °C, 14 °C, 16 °C, 18 °C, 20 °C are preferred.

4.4 Calculation of hourly temperature differences and accumulated hourly temperature differences

4.4.1 Calculation of hourly temperature differences

Hourly temperature differences, θ_{hm} , are calculated for each hour in the accumulation period using Equation (1) when $\theta_{hm} < \theta_b$ or Equation (2) when $\theta_{hm} \geq \theta_b$:

$$\Delta\theta_h(\theta_b) = (\theta_b - \theta_{hm}) \tag{1}$$

$$\Delta\theta_h(\theta_b) = 0 \tag{2}$$

4.4.2 Calculation of accumulated hourly temperature differences

The accumulated hourly temperature difference, $\theta_{\Sigma h}$, for a period of n hours is computed as the sum of the $\Delta\theta_h$ values for individual hours within the period under consideration as given in Equation (3):

$$\theta_{\Sigma h}(\theta_b) = \sum_{h=1}^n \Delta\theta_h(\theta_b) \tag{3}$$

The accumulated hourly temperature difference, $\theta_{\Sigma h(d)}(\theta_b)$, may be expressed in degree-days as given in Equation (4):

$$\theta_{\Sigma h(d)}(\theta_b) = \theta_{\Sigma h}(\theta_b) / 24 \tag{4}$$

NOTE Monthly, seasonal and annual values are commonly computed.

4.5 Estimation of accumulated hourly temperature differences from daily maximum and minimum temperatures

4.5.1 Calculation of daily temperature differences

The daily temperature differences, $\Delta\theta_d(\theta_b)$, for each day in the accumulation period are calculated as follows:

- a) when θ_{dx} is less than θ_b , as given in Equation (5) and shown in Figure 1:

$$\Delta\theta_d(\theta_b) = \theta_b - [0,5 (\theta_{dx} + \theta_{dn})] \tag{5}$$

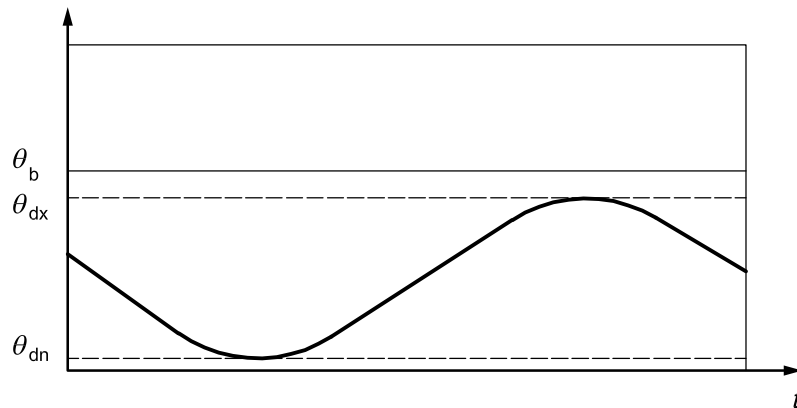


Figure 1 — $\theta_{dx} < \theta_b$

b) when θ_{dx} is greater than θ_b , but $(\theta_{dx} - \theta_b) < (\theta_b - \theta_{dn})$, as given in Equation (6) and shown in Figure 2:

$$\Delta\theta_d(\theta_b) = [0,5 (\theta_b - \theta_{dn}) - 0,25 (\theta_{dx} - \theta_b)] \tag{6}$$

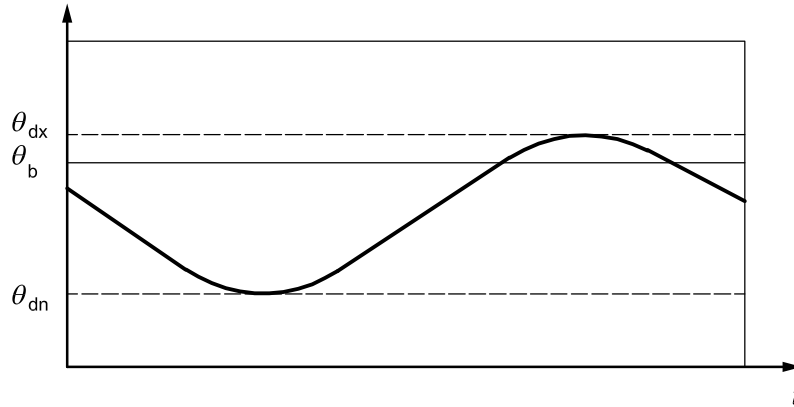


Figure 2 — $(\theta_{dx} - \theta_b) < (\theta_b - \theta_{dn})$

c) when θ_{dn} is less than θ_b , but $(\theta_{dx} - \theta_b) > (\theta_b - \theta_{dn})$, as given in Equation (7) and shown in Figure 3:

$$\Delta\theta_d(\theta_b) = [0,25 (\theta_b - \theta_{dn})] \tag{7}$$

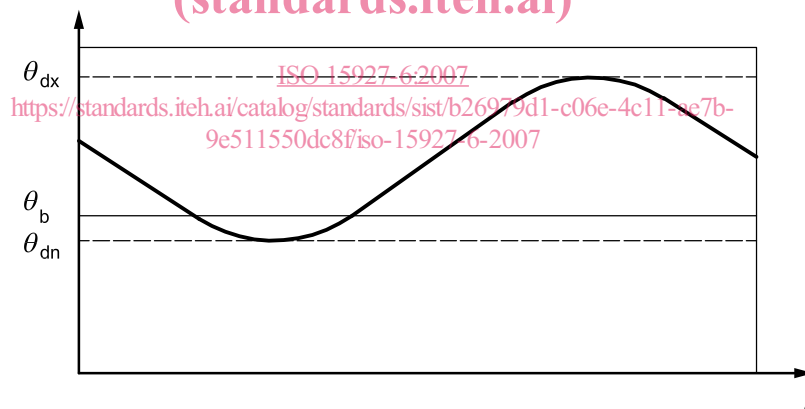


Figure 3 — $(\theta_{dx} - \theta_b) > (\theta_b - \theta_{dn})$

d) when θ_{dn} is equal to or greater than θ_b , as given in Equation (8):

$$\Delta\theta_d(\theta_b) = 0 \tag{8}$$

4.5.2 Calculation of estimated degree-days

The estimated accumulated degree-days, $\theta_{\Sigma h(d)}$, for a period of n days is computed as the sum of $\Delta\theta_d$ values for individual days within the period under consideration as given in Equation (9):

$$\theta_{\Sigma h(d)}(\theta_b) = \sum_{d=1}^n \Delta\theta_d(\theta_b) \tag{9}$$

NOTE Monthly, seasonal and annual totals are commonly computed.