

SLOVENSKI STANDARD
kSIST-TS FprCEN ISO/TS 21083-2:2019
01-februar-2019

Preskusna metoda za merjenje učinkovitosti sredstev za filtriranje zraka, ki vsebuje kroglaste nanomateriale - 2. del: Velikost delcev od 3 nm do 30 nm (ISO/PRF TS 21083-2:2018)

Test method to measure the efficiency of air filtration media against spherical nanomaterials - Part 2: Particle size range from 3 nm to 30 nm (ISO/PRF TS 21083-2:2018)

iteh STANDARD PREVIEW
(standards.iteh.ai)

Méthode d'essai pour mesurer l'efficacité des médias de filtration d'air par rapport aux nanomatériaux sphériques - Partie 2: Spectre granulométrique de 3 nm à 30 nm (ISO/PRF TS 21083-2:2018)

Ta slovenski standard je istoveten z: FprCEN ISO/TS 21083-2

ICS:

91.140.30	Prezračevalni in klimatski sistemi	Ventilation and air-conditioning systems
-----------	------------------------------------	--

kSIST-TS FprCEN ISO/TS 21083-2:2019 en,fr,de

TECHNICAL
SPECIFICATION

ISO/TS
21083-2.2

First edition
ISO release-date

**Test method to measure the efficiency
of air filtration media against
spherical nanomaterials —**

**Part 2:
Size range from 3 nm to 30 nm**

*Méthode d'essai pour mesurer l'efficacité des médias de filtration
d'air par rapport aux nanomatériaux sphériques —
Partie 2: Spectre granulométrique de 3 nm à 30 nm*

[SIST-TS CEN ISO/TS 21083-2:2019](https://standards.iteh.ai/catalog/standards/sist/e2c975f8-feb2-4638-9da7-25e14b5100be/sist-ts-cen-iso-ts-21083-2-2019)

<https://standards.iteh.ai/catalog/standards/sist/e2c975f8-feb2-4638-9da7-25e14b5100be/sist-ts-cen-iso-ts-21083-2-2019>

PROOF / ÉPREUVE



Reference number
ISO/TS 21083-2.2:2018(E)

© ISO 2018

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST-TS CEN ISO/TS 21083-2:2019

<https://standards.iteh.ai/catalog/standards/sist/e2c975f8-feb2-4638-9da7-25e14b5100be/sist-ts-cen-iso-ts-21083-2-2019>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2018

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

Page

Foreword	v
Introduction	vi
1 Scope	1
2 Normative references	1
3 Terms, definitions, symbols and abbreviated terms	1
3.1 Terms and definitions.....	1
3.2 Symbols and abbreviated terms.....	2
3.2.1 Symbols.....	2
3.2.2 Abbreviated terms.....	3
4 Principle	3
5 Test materials	4
5.1 General.....	4
5.2 Solid phase aerosol — Silver test aerosol as an example.....	4
5.3 Solid phase aerosol generation method.....	4
6 Test setup	5
6.1 General.....	5
6.2 Specifications of setup.....	7
6.2.1 Aerosol generation system.....	7
6.2.2 Tubing.....	7
6.2.3 DEMC.....	7
6.2.4 Equilibrium charge distribution and neutralization of aerosol particles.....	9
6.2.5 Neutralization of aerosol particles.....	10
6.2.6 Make-up air line.....	12
6.2.7 Test filter mounting assembly.....	12
6.2.8 CPC.....	13
6.2.9 Final filter.....	16
6.3 Detailed setup for test using silver nanoparticles.....	16
6.4 Determination of the filter medium velocity.....	17
7 Qualification of the test rig and apparatus	17
7.1 CPC tests.....	17
7.1.1 CPC — Air flow rate stability test.....	17
7.1.2 CPC — Zero test.....	18
7.1.3 CPC — Overload test.....	18
7.1.4 Counting accuracy calibration.....	19
7.2 DEMC tests.....	21
7.3 Qualification of aerosol neutralization.....	21
7.3.1 General.....	21
7.3.2 Qualification of neutralization by checking the multiple charge fraction on the particles passing through the neutralizer.....	21
7.3.3 Qualification of the aerosol neutralizer using corona discharge balanced output.....	22
7.3.4 Qualification of neutralization according to ISO/TS 19713-1.....	22
7.4 System leak checks.....	23
7.4.1 Air leakage tests.....	23
7.4.2 Visual detection by cold smoke.....	23
7.4.3 Pressurization of the test system.....	23
7.4.4 Use of high efficiency filter media.....	23
7.5 Uniformity of the test aerosol concentration.....	23
8 Test procedure	23
8.1 Determination of the correlation ratio.....	23
8.2 Protocol of filtration efficiency measurement.....	25

ISO/TS 21083-2.2:2018(E)

8.2.1	Preparatory checks	25
8.2.2	Equipment preparation	25
8.2.3	Aerosol generator	25
8.2.4	Aerosol generator — Neutralizer	26
8.2.5	Filter medium neutralization	27
8.2.6	Filter medium neutralization according to ISO 29461-1	27
8.2.7	Air flow measurement	29
8.2.8	Measurement of the pressure drop	30
8.2.9	Zero count test	30
8.2.10	Air leakage test	30
8.2.11	Loading effect test	30
8.2.12	Reported values	30
8.2.13	Measurement of filtration efficiency — Silver nanoparticles	30
8.3	Test evaluation	32
8.4	Measurement protocol for one sample — Summary	32
8.4.1	Using one CPC to measure the upstream and downstream particle concentrations	32
8.4.2	Using two CPCs to measure the upstream and downstream particle concentrations	33
9	Maintenance items	34
10	Measurement uncertainties	35
11	Reporting results	35
11.1	General	35
11.2	Required reporting elements	36
11.2.1	General	36
11.2.2	Report summary	36
11.2.3	Report details	37
Annex A (informative)	Instruments specifications	42
Annex B (informative)	Statistical analysis for precision of an experiment (according to ISO 5725-2)	45
Annex C (informative)	Safety use of IPA	50
Annex D (informative)	Safe handling of radioactive devices	51
	Bibliography	52

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see www.iso.org/iso/foreword.html.

This document was prepared by the European Committee for Standardization (CEN) Technical Committee CEN/TC 195, *Air filters for general cleaning*, in collaboration with ISO Technical Committee TC 142, *Cleaning equipment for air and other gases*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

A list of all parts in the ISO 21083 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

ISO/TS 21083-2.2:2018(E)

Introduction

Nano-objects are discrete piece of material with one, two or three external dimensions in the nanoscale (see ISO/TS 80004-2) and are building blocks of nanomaterials. Nanoparticles, referring to particles with at least one dimension below 100 nm, generally have a higher mobility than larger particles. Because of their higher mobility and larger specific surface area, available for surface chemical reactions, they can pose a more serious health risk than larger particles. Thus, particulate air pollution with large concentrations of nanoparticles can result in an increased adverse effect on human health and an increased mortality (see Reference [15]).

With the increased focus on nanomaterials and nanoparticles, the filtration of airborne nanoparticles is also subject to growing attention. Aerosol filtration can be used in diverse applications, such as air pollution control, emission reduction, respiratory protection for human and processing of hazardous materials. The filter efficiency can be determined by measuring the testing particle concentrations upstream and downstream of the filter. The particle concentration may be based on mass, surface area or number. Among these, the number concentration is the most sensitive parameter for nanoparticles measurement. State-of-the-art instruments enable accurate measurement of the particle number concentration in air and therefore precise fractional filtration efficiency. Understanding filtration efficiency for nanoparticles is crucial in schemes to remove nanoparticles, and thus, in a wider context, improve the general quality of the environment, including the working environment.

Filtration testing for nanoparticles, especially those down to single-digit nanometres, is a challenging task which necessitates generation of a large amount of extremely small particles, and accurate sizing and quantification of such particles. The thermal rebound remains a question for particles down to 1 nm to 2 nm (see Reference [11]). The accuracy of particle size classification is complicated by very strong diffusion of particles below 10 nm (see References [7] and [8]). The state-of-the-art commercial condensation particle counters for general purposes can detect particles down to 1 nm to 2 nm.

A large number of standards for testing air filters exist such as the ISO 29463 and ISO 16890 series. The test particle range in the ISO 29463 series is between 0,04 µm and 0,8 µm, and the focus is on measurement of the minimum efficiency at the most penetrating particle size (MPPS). The test particle range in the ISO 16890 series is between 0,3 µm and 10 µm. The ISO 21083 series aims to standardize the methods of determining the efficiencies of filter media, of all classes, used in most common air filtration products and it focuses on filtration efficiency of airborne nanoparticles, especially for particle size down to single-digit nanometres.

Advances in aerosol instruments and studies on nanoparticle filtration in the recent years provide a solid base for development of a test method to determine effectiveness of filtration media against airborne nanoparticles down to 3 nm range.

Test method to measure the efficiency of air filtration media against spherical nanomaterials —

Part 2: Size range from 3 nm to 30 nm

1 Scope

This document specifies the testing instruments and procedure for determining the filtration efficiencies of flat sheet filter media against airborne nanoparticles in the range of 3 nm to 30 nm. The testing methods in this document are limited to spherical or nearly-spherical particles to avoid uncertainties due to the particle shape.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 5167 (all parts), *Measurement of fluid flow by means of pressure differential devices inserted in circular cross-section conduits running full*

ISO 5725-1, *Accuracy (trueness and precision) of measurement methods and results — Part 1: General principles and definitions*

ISO 5725-2, *Accuracy (trueness and precision) of measurement methods and results — Part 2: Basic method for the determination of repeatability and reproducibility of a standard measurement method*

ISO 15900, *Determination of particle size distribution — Differential electrical mobility analysis for aerosol particles*

ISO 27891, *Aerosol particle number concentration — Calibration of condensation particle counters*

ISO 29464, *Cleaning of air and other gases — Terminology*

3 Terms, definitions, symbols and abbreviated terms

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 5167-1, ISO 5725-1, ISO 5725-2, ISO 15900, ISO 27891, and ISO 29464 apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <http://www.electropedia.org/>

ISO/TS 21083-2.2:2018(E)

3.2 Symbols and abbreviated terms

3.2.1 Symbols

Symbol	Definition
A	Source strength of the radioactive source
A_0	Original source strength of the radioactive source
A_f	Effective filtration surface area
C_{up}	Particle concentration upstream of the filter medium
$C_{up,i}$	Concentration of particles with the i_{th} monodisperse size upstream of the filter medium
C_{down}	Particle concentration downstream of the filter medium
$C_{down,i}$	Concentration of particles with the i_{th} monodisperse size downstream of the filter medium
C_{ni}	Concentration of particles after the second DEMC for the particles with i charge(s)
d_d	Diameter of the initial droplet including the solvent
d_p	Diameter of the testing particle after complete evaporation of the solvent
E	Filtration efficiency of the test filter medium
E_i	Filtration efficiency of the test filter medium against the particles with the i_{th} monodisperse size
e	Charge of an electron
φ_v	Volume fraction of DEHS in the solution
$t_{0,5}$	Half-life of the radioactive source
N_{up}	Total count of particles upstream of the filter medium in a certain user-defined time interval
$N_{up,i}$	Counts of particles with the i_{th} monodisperse size upstream of the filter medium in a certain user-defined time interval
N_{down}	Total count of particles downstream of the filter medium in a certain user-defined time interval
$N_{down,i}$	Counts of particles with the i_{th} monodisperse size downstream of the filter medium in a certain user-defined time interval
N_{ni}	Total count of particles after the second DEMC for the particles with i charge(s)
n_p	Number of elementary charges
P	Fractional penetration of the test filter medium
P_i	Fractional penetration of particles with the i_{th} monodisperse size for the test filter medium
P_m	Penetration with the filter medium, before applying the correlation ratio
$P_{m,i}$	Measured penetration against particles with the i_{th} monodisperse size when the filter medium is installed in the filter medium holder, before applying the correlation ratio
q	Flow rate through the filter medium
q_e	Air flow rate through the electrometer
R	Correlation ratio
R_i	Correlation ratio for the i_{th} monodisperse particle size, obtained as the penetration without the filter media
R_{es}	Resistance of resistor
t	Time
v_f	Filter medium velocity
V	Voltage
x	Volume of the sampled air
α	Angle for the transition section in the filter medium holder
Δp	Pressure drop across the filter medium
E_0	Initial particulate efficiency of media sample
ΔE_c	Difference in particulate efficiency between E_0 and conditioned efficiency of the media sample
λ	Radioactive decay constant equal to $0,693/t_{0,5}$

3.2.2 Abbreviated terms

AC	Alternating current
CAS	Chemical abstracts service
CL	Concentration limit
CMD	Count median diameter
CPC	Condensation particle counter
DEHS	Di(2-ethylhexyl) sebacate
DEMC	Differential electrical mobility classifier
DMAS	Differential mobility analysing system
HEPA	High efficiency particulate air
Kr	Krypton
IPA	Isopropyl alcohol
MPPS	Most penetrating particle size
Po	Polonium
PSL	Polystyrene latex
RH	Relative humidity
SRM	Standard reference material

4 Principle

The filtration efficiency of the filter medium is determined by measuring the particle number concentrations upstream and downstream of the filter medium. The fractional penetration, P , represents the fraction of aerosol particles which can go through the filter medium, as shown in [Formula \(1\)](#):

$$P = C_{\text{down}} / C_{\text{up}} \quad (1)$$

where C_{down} and C_{up} are the particle concentrations downstream and upstream of the filter medium, respectively. Another way is to measure the particle counts upstream and downstream of the filter medium for a certain same user-defined time interval and sampling volume rate. Then, the penetration is the ratio between the downstream count, N_{down} , and upstream count, N_{up} , as shown in [Formula \(2\)](#):

$$P = N_{\text{down}} / N_{\text{up}} \quad (2)$$

The filter medium efficiency, E , is the fraction of aerosols particles removed by the filter medium, as shown in [Formula \(3\)](#):

$$E = 1 - P \quad (3)$$

The filter medium efficiency is dependent on the challenge particle size. If the test is performed with a number of monodisperse particles with different sizes, the expression for the penetration of particles with the i_{th} monodisperse size, P_i , can be written as shown in [Formula \(4\)](#):

$$P_i = C_{\text{down},i} / C_{\text{up},i} \quad (4)$$

where $C_{\text{up},i}$ and $C_{\text{down},i}$ are the concentration of particles with the i_{th} monodisperse size upstream and downstream of the filter medium, respectively. If the test is performed with a number of monodisperse

ISO/TS 21083-2.2:2018(E)

particles with different sizes, the expression for the penetration of particles with the i_{th} monodisperse size, P_i can be written as shown in [Formula \(5\)](#):

$$P_i = N_{\text{down},i} / N_{\text{up},i} \quad (5)$$

where $N_{\text{up},i}$ and $N_{\text{down},i}$ are the counts of particles with the i_{th} monodisperse size upstream and downstream of the filter medium in the same user-defined time interval and sampling volume rate, respectively. Correspondingly, the filtration efficiency, E_i , of the test filter medium against the particles with the i_{th} monodisperse size is as shown in [Formula \(6\)](#):

$$E_i = 1 - P_i \quad (6)$$

The test particles in the range from 3 nm to 30 nm are generated by an evaporation-condensation method. One realization of this method is the generation of silver (Ag) particles from an electrical tube furnace.

The test particle from the generator is neutralized. The particles are mixed homogeneously with filtered test air if necessary to achieve desired concentration and flow rate, before they are used to challenge the test filter medium.

A specimen of the sheet filter medium is fixed in a test filter assembly and is subject to the test air flow corresponding to the prescribed filter medium velocity. Partial flow, which is the flow that the CPC operates with, of the test aerosol is sampled upstream and downstream of the filter medium, and the fractional penetration is determined from the upstream and downstream number concentrations or total numbers in user-defined time intervals. Furthermore, the measurement of the pressure drop across the filter medium is made at the prescribed filter medium velocity.

Additional equipment is required to measure the absolute pressure, temperature and RH of the test air. It is also needed to measure and control the air volume flow rate.

[SIST-TS CEN ISO/TS 21083-2:2019](https://standards.iteh.ai/catalog/standards/sist/e2c975f8-feb2-4638-9da7-25e14b5100be/sist-ts-cen-iso-ts-21083-2-2019)

5 Test materials**5.1 General**

Any aerosol used to test the filtration performance according to this test method shall only be introduced to the test section as long as needed to test the filtration performance properties of the test filter medium without changing the filtration performance properties of the subject test filter medium due to loading, charge neutralization or other physical or chemical reaction.

5.2 Solid phase aerosol — Silver test aerosol as an example

Pure silver powder source – Ag (99,999 %)

Pure silver powder properties:

Density 10,49 · 10³ kg/m³

Melting point 1 234 K

Boiling point 2 434 K

Solubility insoluble in water

5.3 Solid phase aerosol generation method

Silver nanoparticles or nanoparticles of other materials can be used as long as the qualification procedure is performed and the requirements are fulfilled.

Silver nanoparticles can be generated by the evaporation-condensation method (see Reference [17]). An electric furnace is used to generate silver nanoparticles from a pure silver powder source (99,999 %), and clean compressed air or other gases, such as nitrogen, is used as a carrier gas with flow rate of 16,7 m³/s to 50·10⁻⁶ m³/s (1 l/min to 3,0 l/min). The silver powder source located in the centre of a heating tube is vaporized and condensed into silver nanoparticles with a relatively wide size distribution when the air flow exits the tube furnace. For very small particles a rapid temperature decrease may be applied at the exit of the tube furnace so as to produce particles in the desired size range. As an example, some technical specifications regarding tube furnaces are presented in [Annex A, Tables A.1 to A.4](#).

Any other generator capable of producing particles in sufficient concentrations in the particle size range of 3 nm to 30 nm so that the particle concentration upstream of the test filter medium is at least 1 000 per cm³ under any of the test mode, such as monodisperse or polydisperse test described in [Clause 6](#), can be used.

6 Test setup


6.1 General

The test setup is shown in [Figure 1](#) for monodisperse challenge particles and in [Figure 2](#) for polydisperse challenge particles. When the challenge particles are monodisperse, the setup consists of three sections: the one that produces the aerosol particles (which contains the aerosol generator), the particle classification section (which contains the DEMC) and the particle measuring section (which contains the CPC). When the challenge particles are polydisperse, the particle classification shall be performed after sampling the aerosol from the upstream or downstream section.

The measurement with monodisperse particles is the reference test while the measurement with polydisperse particles shall be qualified carefully and verified by comparison with monodisperse test for validating the measurement procedure.

Tests using monodisperse and polydisperse aerosols should yield equivalent results if they are carried out correctly. Japuntich et al.[9] performed both polydisperse and monodisperse measurements down to 20 nm to 30 nm range and showed reasonable agreement. Buha et al.[20] compared polydisperse test results with models down to similar size range and showed good agreement. With the particles in even smaller size range, the size distribution measurement downstream of the filter is increasingly difficult.

ISO/TS 21083-2.2:2018(E)

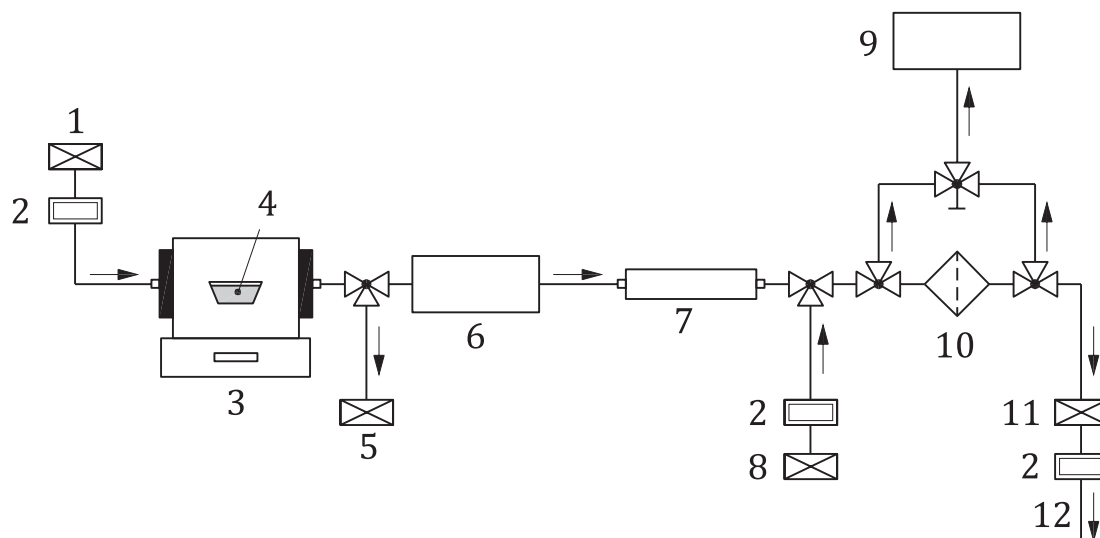


Key

- | | | | |
|---|-------------------------------|----|---------------------------------|
| 1 | air or N2 through HEPA filter | 7 | neutralizer |
| 2 | flow controller | 8 | make up air with HEPA filter |
| 3 | furnace | 9 | CPC |
| 4 | silver | 10 | filter medium holder |
| 5 | excess flow with HEPA filter | 11 | HEPA filter on the exhaust line |
| 6 | DEMC | 12 | vacuum |

Figure 1 — Test setup for monodisperse challenge particles

[SIST-TS CEN ISO/TS 21083-2:2019](https://standards.iteh.ai/catalog/standards/sist/e2c975f8-feb2-4638-9da7-25e14b5100be/sist-ts-cen-iso-ts-21083-2-2019)

<https://standards.iteh.ai/catalog/standards/sist/e2c975f8-feb2-4638-9da7-25e14b5100be/sist-ts-cen-iso-ts-21083-2-2019>

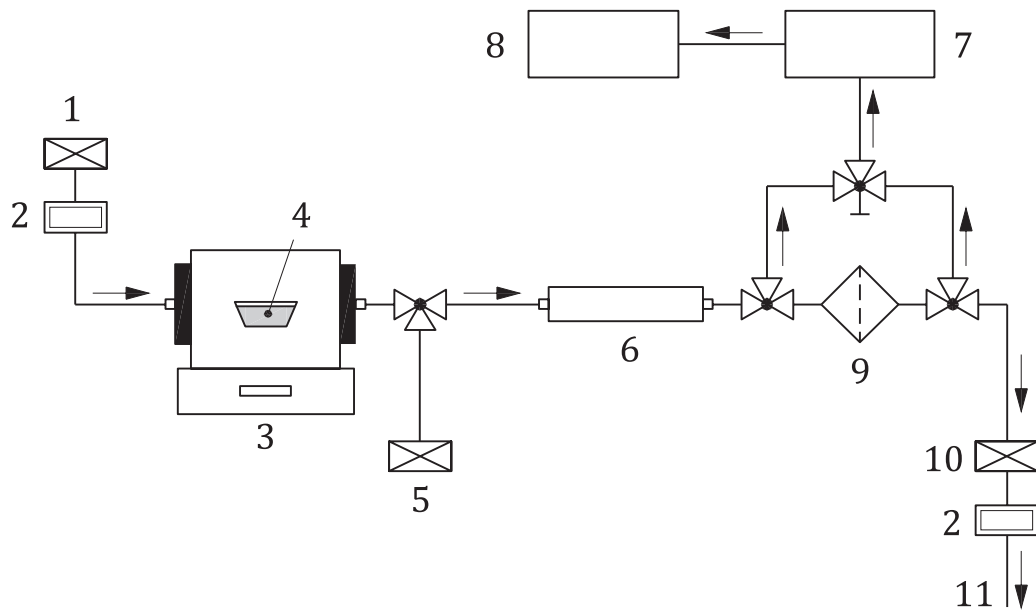**Key**

1	air or N ₂	7	DEMC
2	flow controller	8	CPC
3	furnace	9	filter medium holder
4	silver	10	HEPA filter on the exhaust line
5	flow compensation through HEPA filter	11	vacuum
6	neutralizer		

Figure 2 — Test setup for polydisperse challenge particles

<https://standards.iteh.ai/catalog/standards/sist/e2c975f8-feb2-4638-9da7-25e14b5100be/sist-ts-cen-iso-ts-21083-2-2019>

6.2 Specifications of setup**6.2.1 Aerosol generation system**

The aerosol generation system is described in [5.3](#).

6.2.2 Tubing

Tubes shall be made of electrically conductive material (stainless steel, carbon-embedded silicon tubing, etc.) in order to minimize particle losses due to electrostatic deposition. Furthermore, the tubing length shall be minimized so as to minimize particle losses due to diffusion. The upstream and downstream sample lines shall be nominally identical in geometry and material.

6.2.3 DEMC**6.2.3.1 Principles and specifications**

The DMAS consists primarily of a bipolar charger to neutralize the charges on particles, a controller to control flows and high-voltage, a DEMC (see [Figure 3](#)) which separates particles based on their electrical mobilities, a particle detector, interconnecting plumbing, a computer and suitable software.

The DEMC shall be able to classify particles in the size range of 3 nm to 30 nm and fulfil the qualification procedure described in [7.2](#). In case of the unipolar charger-based instrument, the manufacturer shall