



# SLOVENSKI STANDARD

## SIST EN 1487:2014

01-oktober-2014

Nadomešča:  
SIST EN 1487:2000

---

### Ventili v stavbah - Varnostni bloki - Preskusi in zahteve

Building valves - Hydraulic safety groups - Tests and requirements

Gebäudearmaturen - Hydraulische Sicherheitsgruppen - Prüfungen und Anforderungen

Robinetterie de bâtiment - Groupes de sécurité hydraulique - Essais et exigences

iTeh STANDARD PREVIEW  
(standards.iteh.ai)

Ta slovenski standard je istoveten z: ~~SIST EN 1487:2014~~ EN 1487:2014

<https://standards.iteh.ai/catalog/standards/sist/7688e837-342c-4fbb-9d00-6b163e3b3a51/sist-en-1487-2014>

---

#### **ICS:**

23.060.01	Ventili na splošno	Valves in general
91.140.60	Sistemi za oskrbo z vodo	Water supply systems

**SIST EN 1487:2014**

**en,fr,de**

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

SIST EN 1487:2014

<https://standards.iteh.ai/catalog/standards/sist/7688e837-342c-4fbb-9d00-6b163e3b3a51/sist-en-1487-2014>

EUROPEAN STANDARD  
NORME EUROPÉENNE  
EUROPÄISCHE NORM

**EN 1487**

July 2014

ICS 91.140.60

Supersedes EN 1487:2000

English Version

## Building valves - Hydraulic safety groups - Tests and requirements

Robinetterie de bâtiment - Groupes de sécurité hydraulique  
- Essais et exigences

Gebäudearmaturen - Hydraulische Sicherheitsgruppen -  
Prüfungen und Anforderungen

This European Standard was approved by CEN on 22 May 2014.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

SIST EN 1487:2014

<https://standards.iteh.ai/catalog/standards/sist/7688e837-342c-4fbb-9d00-6b163e3b3a51/sist-en-1487-2014>



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

**CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels**

## Contents

	Page
Foreword.....	4
Introduction .....	6
<b>1 Scope .....</b>	<b>7</b>
<b>2 Normative references .....</b>	<b>7</b>
<b>3 Terms and definitions .....</b>	<b>8</b>
<b>4 Materials and surface finishes .....</b>	<b>11</b>
4.1 General.....	11
4.2 Materials .....	11
4.3 Detection of residual stress.....	11
4.3.1 Test.....	11
4.3.2 Test method (Procedure) .....	11
4.3.3 Requirements .....	12
4.4 Outside visible surfaces .....	12
4.4.1 Surfaces without coatings .....	12
4.4.2 Surfaces with coatings.....	13
4.5 Corrosion resistance.....	13
4.5.1 Test method.....	13
4.5.2 Requirements .....	13
4.6 Coating adherence.....	13
4.6.1 Test method.....	13
4.6.2 Requirements .....	14
4.7 Compatibility with the products used for disinfection of the networks.....	14
4.7.1 General.....	14
4.7.2 Test method.....	14
4.7.3 Requirements .....	14
<b>5 Design and dimensional requirements .....</b>	<b>14</b>
5.1 General guidance.....	14
5.2 Dimensional characteristics .....	15
5.2.1 End connections .....	15
5.3 Test port.....	17
5.4 Pressure tapping.....	17
5.5 Hydraulic safety valve outlet connection to air break to drain .....	18
5.6 Hydraulic safety valve discharge connection to drain device .....	18
5.7 Exclusions .....	18
5.8 Replacing of the safety valve .....	18
5.9 Check valve .....	18
<b>6 Apparatus .....</b>	<b>18</b>
6.1 General.....	18
6.2 Tolerances of parameters and accuracy of measure instruments .....	18
6.2.1 Tolerances on set parameters.....	18
6.2.2 Accuracy of measuring instruments .....	19
6.2.3 Test media .....	19
<b>7 Hydraulic tests and requirements .....</b>	<b>19</b>
7.1 Flow rate test.....	19
7.1.1 Procedure .....	19
7.1.2 Requirement .....	19
7.2 Tightness test.....	19

7.2.1	General .....	19
7.2.2	Tightness test for the isolating valve at a pressure of 1,6 MPa (16 bar) .....	19
7.2.3	Hydraulic safety group tightness test .....	20
8	Mechanical tests and requirements .....	20
8.1	Mechanical strength .....	20
8.1.1	Pressure test of the body of the hydraulic safety group.....	20
8.1.2	Bending test of the body and pull out test of the drainage of the hydraulic safety group .....	20
8.1.3	Torsional strength of the hydraulic safety group's body.....	22
8.1.4	Tensile strength of the captive rotating nuts .....	23
8.2	Mechanical strength of the easing gear of the pressure safety valve .....	23
8.2.1	Procedure .....	23
8.2.2	Requirement.....	23
9	Tests and requirements of the components of the hydraulic safety group .....	24
9.1	Isolating valve .....	24
9.1.1	General .....	24
9.1.2	Test of manual operation .....	24
9.1.3	Endurance test.....	24
9.1.4	Test for manual operation .....	24
9.2	Check valve .....	25
9.2.1	Verification of the leaktightness between the group's body and the check valve at low pressure.....	25
9.2.2	Verification of the leaktightness between the group's body and the check valve under high pressure .....	25
9.3	Pressure safety valve .....	25
9.3.1	Pressures .....	25
9.3.2	Cold water pressure tests .....	26
9.3.3	Steam test.....	27
9.4	Endurance test.....	28
9.4.1	Procedure .....	28
9.4.2	Requirement.....	28
9.5	Easing gear (manual control device).....	29
9.5.1	Operation of the easing gear .....	29
9.5.2	Easing gear endurance test.....	29
9.6	Manual drainage device .....	29
9.6.1	General .....	29
9.6.2	Flow rate test .....	29
9.7	Air break to drain .....	29
10	Resistance to thermal shocks.....	30
10.1	Test method .....	30
10.2	Requirement.....	30
11	Acoustic tests and requirements.....	30
12	Classification .....	31
13	Designation .....	31
14	Marking .....	32
15	Technical documents and presentation at delivery.....	32
Annex A	(informative) Test sequences .....	34

**EN 1487:2014 (E)****Foreword**

This document (EN 1487:2014) has been prepared by Technical Committee CEN/TC 164 "Water Supply", the secretariat of which is held by AFNOR.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by January 2015, and conflicting national standards shall be withdrawn at the latest by January 2015.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 1487:2000.

The main changes compared to EN 1487:2000 are as follows:

- a) the Scope has been modified to nominal sizes DN 15 to DN 25;
- b) Normative references were updated;
- c) Terms and definitions were changed;
- d) subclause 4.1 (general wording for materials) was modified;
- e) subclauses 4.3 (Detection of residual stress), 4.4 (Outside visible surfaces), 4.5 (Corrosion resistance), 4.6 (Coating adherence) and 4.7 (Compatibility with the products used for disinfection of the networks) were added;
- f) subclauses 5.2 (Dimensional characteristics), 5.3 (Test port) and 5.4 (Pressure tapping) were modified;
- g) subclause 5.7 (Other threads) was deleted;
- h) subclauses 5.8 (Replacing of the safety valve) and 5.9 (Check valve) were added;
- i) Clause 6 (Apparatus) was added, thus renumbering of the following clauses was necessary;
- j) Clause 7 (Hydraulic tests and requirements) was modified;
- k) Clause 8 (Acoustic tests and requirements) was moved to Clause 11 and modified editorially;
- l) Clause 9 (Tests and requirements of the components of the hydraulic safety group) was modified;
- m) Clause 10 (Resistance to thermal shocks) was added;
- n) Clause 12 (Classification) was modified;
- o) Clause 13 (Designation) was modified editorially;
- p) Clause 15 (Technical documents, presentation at delivery) was added;
- q) informative Annex A was replaced by informative Annex A (Test sequences).

According to the CEN-CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

## iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST EN 1487:2014](https://standards.iteh.ai/catalog/standards/sist/7688e837-342c-4fbb-9d00-6b163e3b3a51/sist-en-1487-2014)

<https://standards.iteh.ai/catalog/standards/sist/7688e837-342c-4fbb-9d00-6b163e3b3a51/sist-en-1487-2014>

## Introduction

In respect of potential adverse effect on the quality of water intended for human consumption, caused by the product covered by this standard:

- a) This standard provides no information as to whether the product may be used without restriction in any of the Member States of the EU or EFTA.
- b) It should be noted that, whilst awaiting the adoption of verifiable European criteria, existing national regulations concerning the use and or the characteristics of this product remain in force.

## iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST EN 1487:2014](https://standards.iteh.ai/catalog/standards/sist/7688e837-342c-4fbb-9d00-6b163e3b3a51/sist-en-1487-2014)

<https://standards.iteh.ai/catalog/standards/sist/7688e837-342c-4fbb-9d00-6b163e3b3a51/sist-en-1487-2014>



## 1 Scope

This European Standard specifies dimensions, materials and performance requirements (including methods of test) for hydraulic safety groups, of nominal sizes from DN 15 to DN 25, having working pressures<sup>1)</sup> from 0,1 MPa (1 bar) to 0,7 MPa (7 bar). Hydraulic safety groups are intended for fitting to the potable water supply of storage water heaters, having a maximum storage temperature of 95°C.

Hydraulic safety groups limit the pressure in hot water heaters, prevent the backflow of water into the main circuit and prevent the discharged water to get into contact with the water in the water heater.

Hydraulic safety groups do not control the temperature. They ensure the hydraulic safety of water heaters if the mechanical resistance of the water heater remains at least equal to the rating pressure.

NOTE The use of the device specified in this European Standard does not override the need to use controls (e.g. thermostats and cut-outs) which act directly on the power sources of water heaters.

## 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 248:2002, *Sanitary tapware - General specification for electrodeposited coatings of Ni-Cr*

EN 806-1, *Specifications for installations inside buildings conveying water for human consumption - Part 1: General*

EN 806-2, *Specification for installations inside buildings conveying water for human consumption - Part 2: Design*

EN 806-3, *Specifications for installations inside buildings conveying water for human consumption - Part 3: Pipe sizing - Simplified method*

EN 806-4, *Specifications for installations inside buildings conveying water for human consumption - Part 4: Installation*

EN 806-5, *Specifications for installations inside buildings conveying water for human consumption - Part 5: Operation and maintenance*

EN 1488, *Building valves - Expansion groups - Tests and requirements*

EN 1567, *Building valves - Water pressure reducing valves and combination water pressure reducing valves - Requirements and tests*

EN 1717:2000, *Protection against pollution of potable water in water installations and general requirements of devices to prevent pollution by backflow*

EN 10226-1, *Pipe threads where pressure tight joints are made on the threads - Part 1: Taper external threads and parallel internal threads - Dimensions, tolerances and designation*

EN 13959, *Anti-pollution check valves - DN 6 to DN 250 inclusive family E, type A, B, C and D*

---

<sup>1)</sup> All pressures are gauge unless otherwise stated.

**EN 1487:2014 (E)**

EN ISO 228-1, *Pipe threads where pressure-tight joints are not made on the threads - Part 1: Dimensions, tolerances and designation (ISO 228-1)*

EN ISO 3822-1, *Acoustics - Laboratory tests on noise emission from appliances and equipment used in water supply installations - Part 1: Method of measurement (ISO 3822-1)*

EN ISO 3822-3, *Acoustics - Laboratory tests on noise emission from appliances and equipment used in water supply installations - Part 3: Mounting and operating conditions for in-line valves and appliances (ISO 3822-3)*

EN ISO 4628-3, *Paints and varnishes - Evaluation of degradation of coatings - Designation of quantity and size of defects, and of intensity of uniform changes in appearance - Part 3: Assessment of degree of rusting (ISO 4628-3)*

EN ISO 6509, *Corrosion of metals and alloys - Determination of dezincification resistance of brass (ISO 6509)*

ISO 6957, *Copper alloys — Ammonia test for stress corrosion resistance*

**3 Terms and definitions**

For the purposes of this document, the following terms and definitions apply.

**3.1****hydraulic safety group**

safety device that limits the pressure in hot water heaters, prevents the backflow of water into the main circuit, prevents the discharged water from coming into contact with the water in the water heater, allows the function of the backflow prevention to be controlled and isolates and drains the water heater for maintenance services

Note 1 to entry: A hydraulic safety group is comprised of at least the following items in a single unit, in an upstream to downstream order, as shown in Table 1.

<https://standards.iteh.ai/catalog/standards/sist/7688e837-342c-4fbb-9d00-6b163e3b3a51/sist-en-1487-2014>

**Table 1 — Components of hydraulic safety groups**

	DN 15	DN 20	DN 25
isolating valve	1	1	1
test port for monitoring the check valve	1	1	1
check valve	1	1	1
isolating valve	1 <sup>a</sup>	1 <sup>a</sup>	1 <sup>a</sup>
additional outlet connection	1 <sup>a</sup>	1 <sup>a</sup>	1 <sup>a</sup>
pressure safety valve	1	1	1
drain device or drain function	1	1	1
air break to drain	1	1	1
pressure tapping	1 <sup>a</sup>	1 <sup>a</sup>	1 <sup>a</sup>
<sup>a</sup> Optional.			

**3.2****isolating valve**

valve that allows the water heater to be isolated from the potable water supply

Note 1 to entry: If a second valve is fitted, it is placed between the check valve and safety valve.

**3.3****check valve**

valve that allows water to flow into a water heater, and automatically prevents water returning to the water supply

**3.4****additional outlet connection**

outlet connection that allows cold potable water to be supplied to an additional device

Note 1 to entry: For example, inline hot water supply tempering valves etc.

**3.5****pressure safety valve**

valve that limits the pressure of the water in the water heater to a predetermined value by discharging water to the drain and in case of temperature control failure, discharging the energy stored as water or steam

**3.6****drain device or drain function**

device that allows the water heater to be drained without removing the hydraulic safety group and the outlet connection which is also used to discharge water or steam from the pressure safety valve

**3.7****air break to drain**

air break that prevents discharged water from returning to the hydraulic safety group and thus to the water heater

**iTeh STANDARD PREVIEW**  
(standards.iteh.ai)

**3.8****pressure tapping**

tapping that allows pressure measuring equipment to be connected

[SIST EN 1487:2014](https://standards.iteh.ai/catalog/standards/sist/7688e837-342c-4fbb-9d00-6b163e3b3a51/sist-en-1487-2014)

**3.9****nominal set pressure ( $P_{nr}$ )**

pressure of the pressure safety valve which is set on production

<https://standards.iteh.ai/catalog/standards/sist/7688e837-342c-4fbb-9d00-6b163e3b3a51/sist-en-1487-2014>

Note 1 to entry: The "nominal set pressure" ( $P_{nr}$ ) is often called "set pressure".

**3.10****water tightness pressure ( $P_e$ )**

pressure up to which the pressure safety valve is closed

Note 1 to entry: See Figure 1.

**3.11****initial opening pressure ( $P_{dc}$ )****3.11.1**

$P_{dc, water}$

pressure at which the pressure safety valve opens for the first time, as indicated by the first droplet of water at the outlet of the safety group, after a period of storage

Note 1 to entry: See Figure 1.

**3.11.2**

$P_{dc, steam}$

pressure at which the pressure safety valve opens for the first time, as indicated by the first appearance of steam at the outlet of the safety group, after a period of storage

Note 1 to entry: See Figure 1.

## EN 1487:2014 (E)

### 3.12 opening pressure ( $P_o$ )

#### 3.12.1

$P_{o, \text{water}}$

pressure at which the pressure safety valve opens as indicated by the appearance of water at the discharge connection of the hydraulic safety group

Note 1 to entry: See Figure 1.

#### 3.12.2

$P_{o, \text{steam}}$

pressure at which the pressure safety valve opens as indicated by the appearance of steam at the discharge connection of the hydraulic safety group

### 3.13

#### rating pressure ( $P_{dn}$ )

pressure at which the discharged flow is above the limit given in Table 9 and Table 10


Note 1 to entry: See Figure 1.

### 3.14

#### closing pressure ( $P_f$ )

pressure at which the pressure safety valve closes after having reached the rating pressure

Note 1 to entry: See Figure 1.

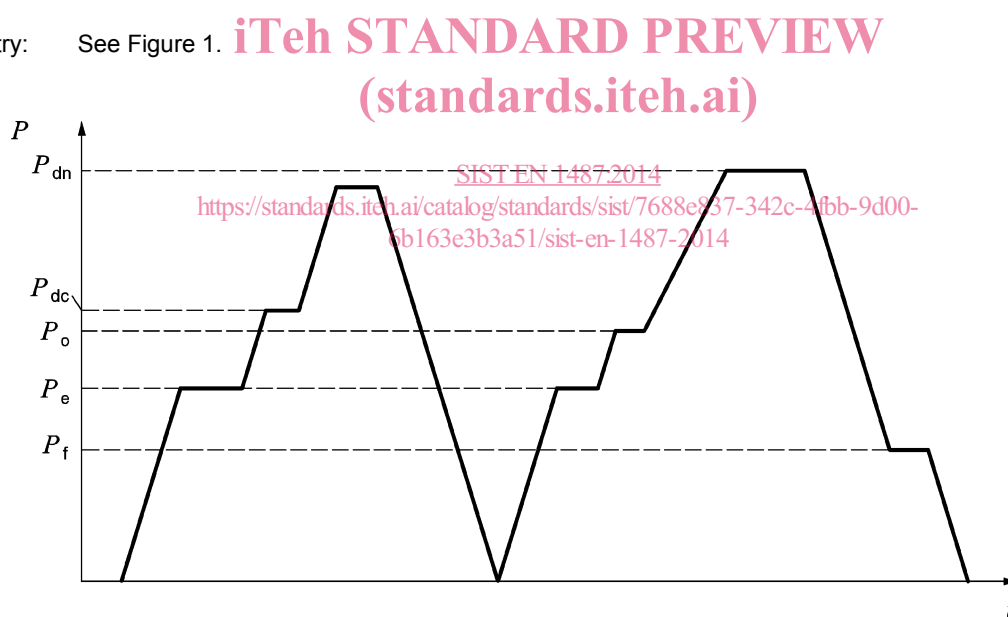

#### Key

$P$  pressure

$t$  time

Figure 1 — Pressures