

SLOVENSKI STANDARD

SIST IEC 60364-4-44:2009

01-april-2009

BUXca Yý U

SIST IEC 60364-4-44:2006

9`Y_h] bY]býHJ UWY`n[fUXV`!(("XY.`NUý]Hb]i _fYd]!`NUý]HJdfYX
dfYbUdYfcgla]!`NUý]HJdfYX`bUdYfcgHb]a]]b`YY_hfca U[bYfb]a]`a cHb`Ua]

Low-voltage electrical installations - Part 4-44: Protection for safety - Protection against voltage disturbances and electromagnetic disturbances

iTeh STANDARD PREVIEW

(standards.iteh.ai)

Installations électriques à basse tension - Partie 4-44: Protection pour assurer la sécurité - Protection contre les perturbations de tension et les perturbations électromagnétiques

<https://standards.iteh.ai/catalog/standards/sist/30e554b0-6c7c-49f2-ae06-3e8b36f3601d/sist-iec-60364-4-44-2009>

Ta slovenski standard je istoveten z: **IEC 60364-4-44**

ICS:

29.120.50	Xæ[çæ ^/æ /æi` * æ { ^åq \[ç} æA æz ãæ	Fuses and other overcurrent protection devices
91.140.50	Sistemi za oskrbo z elektriko	Electricity supply systems

SIST IEC 60364-4-44:2009

en,fr

iTeh STANDARD PREVIEW **(standards.iteh.ai)**

SIST IEC 60364-4-44:2009

<https://standards.iteh.ai/catalog/standards/sist/30e554b0-6c7c-49f2-ac06-3e8b36f3601d/sist-iec-60364-4-44-2009>



IEC 60364-4-44

Edition 2.0 2007-08

INTERNATIONAL STANDARD

NORME INTERNATIONALE

**Low-voltage electrical installations –
Part 4-44: Protection for safety – Protection against voltage disturbances and
electromagnetic disturbances**

**Installations électriques à basse tension –
Partie 4-44: Protection pour assurer la sécurité – Protection contre les
perturbations de tension et les perturbations électromagnétiques**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

PRICE CODE
CODE PRIX

XA

ICS 91.140.50

ISBN 2-8318-9261-9

CONTENTS

FOREWORD.....	5
INTRODUCTION.....	7
440.1 Scope.....	8
440.2 Normative references.....	8
441 (Vacant).....	9
442 Protection of low-voltage installations against temporary overvoltages due to earth faults in the high-voltage system and due to faults in the low-voltage system	9
442.1 Scope and object.....	9
442.1.1 General.....	9
442.1.2 Symbols.....	10
442.2 Overvoltages in LV-systems during a high-voltage earth fault	11
442.2.1 Magnitude and duration of power frequency fault-voltage	12
442.2.2 Magnitude and duration of power frequency stress-voltages.....	13
442.2.3 Requirements for calculation of limits	14
442.3 Power frequency stress voltage in case of loss of the neutral conductor in a TN and TT system	14
442.4 Power frequency stress voltage in the event of an earth fault in an IT system with distributed neutral.....	14
442.5 Power frequency stress voltage in the event of short-circuit between a line conductor and the neutral conductor.....	14
443 Protection against overvoltages of atmospheric origin or due to switching.....	14
443.1 General	14
443.2 Classification of impulse withstand voltages (overvoltage categories)	15
443.2.1 Purpose of classification of impulse withstand voltages (overvoltage categories)	15
443.2.2 Relationship between impulse withstand voltages of equipment and overvoltage categories	15
443.3 Arrangements for overvoltage control.....	16
443.3.1 Inherent overvoltage control	16
443.3.2 Protective overvoltage control.....	16
443.4 Required impulse withstand voltage of equipment.....	18
444 Measures against electromagnetic influences.....	18
444.1 General	18
444.2 (void).....	19
444.3 Definitions	19
444.4 Mitigation of Electromagnetic Interference (EMI)	20
444.4.1 Sources of EMI.....	20
444.4.2 Measures to reduce EMI.....	21
444.4.3 TN-system	22
444.4.4 TT system	26
444.4.5 IT system	27
444.4.6 Multiple-source supply.....	28
444.4.7 Transfer of supply	31
444.4.8 Services entering a building.....	33
444.4.9 Separate buildings.....	34
444.4.10 Inside buildings	34
444.4.11 Protective devices	36

444.4.12	Signal cables.....	36
444.5	Earthing and equipotential bonding.....	36
444.5.1	Interconnection of earth electrodes.....	36
444.5.2	Interconnection of incoming networks and earthing arrangements.....	37
444.5.3	Different structures for the network of equipotential conductors and earthing conductors.....	37
444.5.4	Equipotential bonding networks in buildings with several floors	39
444.5.5	Functional earthing conductor.....	40
444.5.6	Commercial or industrial buildings containing significant amounts of information technology equipment.....	41
444.5.7	Earthing arrangements and equipotential bonding of information technology installations for functional purposes	41
444.6	Segregation of circuits	42
444.6.1	General.....	42
444.6.2	Design guidelines.....	42
444.6.3	Installation guidelines	43
444.7	Cable management systems	44
444.7.1	General.....	44
444.7.2	Design guidelines.....	44
444.7.3	Installation guidelines	45
445	Protection against undervoltage	47
445.1	General requirements	47
<p style="text-align: center;">STANDARD PREVIEW (standards.iteh.ai)</p>		
Annex A (informative)	Explanatory notes concerning 442.1 and 442.2.....	48
Annex B (informative)	Guidance for overvoltage control by SPDs applied to overhead lines.....	50
Annex C (normative)	Determination of the conventional length, d	52
Bibliography		54
<p>Figure 44.A1 – Representative schematic sketch for possible connections to earth in substation and LV-Installation and occurring overvoltages in case of faults</p>		
<p>Figure 44.A2 – Tolerable fault-voltage due to an earth-fault in the HV system</p>		
<p>Figure 44.R1 – By-pass conductor for screen reinforcement to provide a common equipotential bonding system</p>		
<p>Figure 44.R2 – Example of a substitute or by-pass equipotential bonding conductor in a TT-system.....</p>		
<p>Figure 44.R3A – Avoidance of neutral conductor currents in a bonded structure by using the TN-S system from the origin of the public supply up to and including the final circuit within a building</p>		
<p>Figure 44.R3B – Avoidance of neutral conductor currents in a bonded structure by using a TN-S system downstream of a consumer's private supply transformer</p>		
<p>Figure 44.R4 – TN-C-S system within an existing building installation</p>		
<p>Figure 44.R5 – TT system within a building installation</p>		
<p>Figure 44.R6 – IT system within a building installation</p>		
<p>Figure 44.R7A – TN multiple-source power supply with a non-suitable multiple connection between PEN and earth</p>		
<p>Figure 44.R7B – TN multiple source power supplies to an installation with connection to earth of the star points at one and the same point</p>		

Figure 44.R8 – TT multiple-source power supplies to an installation with connection to earth of the star points at one and the same point	30
Figure 44.R9A – Three-phase alternative power supply with a 4-pole switch	31
Figure 44.R9B – Neutral current flow in a three-phase alternative power supply with an unsuitable 3-pole switch	32
Figure 44.R9C – Single-phase alternative power supply with 2-pole switch.....	33
Figure 44.R10 – Armoured cables and metal pipes entering the buildings (examples)	34
Figure 44.R11 – Illustration of measures in an existing building	35
Figure 44.R12 – Interconnected earth electrodes.....	36
Figure 44.R13 – Examples of protective conductors in star network	37
Figure 44.R14 – Example of multiple meshed bonding star network	38
Figure 44.R15 – Example of a common meshed bonding star network	39
Figure 44.R16 – Example of equipotential bonding networks in structures without lightning protection systems	40
Figure 44.R17A – Separation between power and information technology cables for cable route lengths ≤ 35 m	43
Figure 44.R17B – Separation between power and information technology cables for cable route lengths > 35 m	43
Figure 44.R18 – Separation of cables in wiring systems.....	44
Figure 44.R19 – Cable arrangements in metal cable-trays.....	45
Figure 44.R20 – Continuity of metallic system components.....	46
Figure 44.R21 – Location of cables inside metallic construction elements	46
Figure 44.R22 – Connection of metallic sections.....	47
Figure 44.Q – Examples of how to apply d_1 , d_2 and d_3 for the determination of d	53
Table 44.A1 – Power frequency stress voltages and power frequency fault voltage in the low voltage system	12
Table 44.A2 – Permissible power frequency stress-voltage.....	13
Table 44.B – Required rated impulse withstand voltage of equipment	18
Table B.1 – Different possibilities for IT systems.....	51

INTERNATIONAL ELECTROTECHNICAL COMMISSION

LOW-VOLTAGE ELECTRICAL INSTALLATIONS –

**Part 4-44: Protection for safety –
Protection against voltage disturbances and
electromagnetic disturbances**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 60364-4-44 has been prepared by IEC technical committee 64: Electrical installations and protection against electric shock.

This second edition of IEC 60364-4-44 cancels and replaces the first edition published in 2001, amendment 1 (2003) and amendment 2 (2006).

The document 64/1600/FDIS, circulated to the National Committees as Amendment 3, led to the publication of the new edition.

The text of this standard is based on the first edition, its Amendment 1, Amendment 2 and the following documents:

FDIS	Report on voting
64/1600/FDIS	64/1609/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all the parts in the IEC 60364 series, under the general title *Low-voltage electrical installations*, can be found on the IEC website.

Future standards in this series will carry the new general title as cited above. Titles of existing standards in this series will be updated at the time of the next edition.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

ITeH STANDARD PREVIEW
(standards.iteh.ai)

[SIST IEC 60364-4-44:2009](https://standards.iteh.ai/catalog/standards/sist/30e554b0-6c7c-49f2-ac06-3e8b36f3601d/sist-iec-60364-4-44-2009)
<https://standards.iteh.ai/catalog/standards/sist/30e554b0-6c7c-49f2-ac06-3e8b36f3601d/sist-iec-60364-4-44-2009>

INTRODUCTION

Part 4-44 of IEC 60364 covers the protection of electrical installations and measures against voltage disturbances and electromagnetic disturbances.

The requirements are arranged into four clauses as follows:

- | | |
|------------|---|
| Clause 442 | Protection of low-voltage installations against temporary overvoltages due to earth faults in the high-voltage system and due to faults in the low-voltage system |
| Clause 443 | Protection against overvoltages of atmospheric origin or due to switching |
| Clause 444 | Measures against electromagnetic influences |
| Clause 445 | Protection against undervoltage |

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST IEC 60364-4-44:2009](https://standards.iteh.ai/catalog/standards/sist/30e554b0-6c7c-49f2-ac06-3e8b36f3601d/sist-iec-60364-4-44-2009)

<https://standards.iteh.ai/catalog/standards/sist/30e554b0-6c7c-49f2-ac06-3e8b36f3601d/sist-iec-60364-4-44-2009>

LOW-VOLTAGE ELECTRICAL INSTALLATIONS –

Part 4-44: Protection for safety – Protection against voltage disturbances and electromagnetic disturbances

440.1 Scope

The rules of this Part of IEC 60364 are intended to provide requirements for the safety of electrical installations in the event of voltage disturbances and electromagnetic disturbances generated for different specified reasons.

The rules of this part are not intended to apply to systems for distribution of energy to the public, or power generation and transmission for such systems (see the scope of IEC 60364-1) although such disturbances may be conducted into or between electrical installations via these supply systems.

440.2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60038:1983, *IEC standard voltages*

IEC 60050-604:1987, *International Electrotechnical Vocabulary – Chapter 604: Generation, transmission and distribution of electricity – Operation*

IEC 60364-1, *Low-voltage electrical installations – Part 1: Fundamental principles, assessment of general characteristics, definitions*

IEC 60364-4-41:2005, *Electrical installations of buildings – Part 4-41: Protection for safety – Protection against electric shock*

IEC 60364-5-54:2002, *Electrical installations of buildings – Part 5-54: Selection and erection of electrical equipment – Earthing arrangements and protective bonding conductors*¹

IEC 60479-1:2005, *Effects of current on human beings and livestock – Part 1: General aspects*

IEC 60664-1:2007, *Insulation co-ordination for equipment within low-voltage systems – Part 1: Principles, requirements and tests*

IEC 60950-1, *Information technology equipment – Safety – Part 1: General requirements*

IEC 61000-2-5:1995, *Electromagnetic compatibility (EMC) – Part 2: Environment – Section 5: Classification of electromagnetic environments – Basic EMC publication*

IEC 61000-6-1, *Electromagnetic compatibility (EMC) – Part 6-1: Generic standards – Immunity for residential, commercial and light-industrial environments*

IEC 61000-6-2, *Electromagnetic compatibility (EMC) – Part 6-2: Generic standards – Immunity for industrial environments*

¹ A third edition is currently in preparation.

IEC 61000-6-3, *Electromagnetic compatibility (EMC) – Part 6-3: Generic standards – Emission standard for residential, commercial and light-industrial environments*

IEC 61000-6-4, *Electromagnetic compatibility (EMC) – Part 6-4: Generic standards – Emission standard for industrial environments*

IEC 61558-2-1, *Safety of power transformers, power supplies, reactors and similar products – Part 2-1: Particular requirements for tests for separating transformers and power supplies incorporating separating transformers for general applications*

IEC 61558-2-4, *Safety of power transformers, power supply units and similar – Part 2-4: Particular requirements for isolating transformers for general use*

IEC 61558-2-6, *Safety of power transformers, power supply units and similar – Part 2-6: Particular requirements for safety isolating transformers for general use*

IEC 61558-2-15, *Safety of power transformers, power supply units and similar – Part 2-15: Particular requirements for isolating transformers for the supply of medical locations*

IEC 61643 (all parts), *Low-voltage surge protective devices*

IEC 61936-1, *Power installations exceeding 1 kV a.c. – Part 1: Common rules*

IEC 62305-1, *Protection against lightning – Part 1: General principles*

IEC 62305-3, *Protection against lightning – Part 3: Physical damage to structures and life hazard*

IEC 62305-4, *Protection against lightning – Part 4: Electrical and electronic systems within structures*

[SIST IEC 60364-4-44:2009](https://standards.iteh.ai/catalog/standards/sist/30e554b0-6c7c-49f2-ac06-3e8b36f3601d/sist-iec-60364-4-44-2009)

<https://standards.iteh.ai/catalog/standards/sist/30e554b0-6c7c-49f2-ac06-3e8b36f3601d/sist-iec-60364-4-44-2009>

441 (Vacant)

442 Protection of low-voltage installations against temporary overvoltages due to earth faults in the high-voltage system and due to faults in the low-voltage system

442.1 Field of application

The rules of this clause provide requirements for the safety of low-voltage installation in the event of

- a fault between the high-voltage system and earth in the transformer substation that supplies the low-voltage installation,
- a loss of the supply neutral in the low-voltage system,
- a short-circuit between a line conductor and neutral,
- an accidental earthing of a line conductor of a low-voltage IT-system.

The requirements for the earthing arrangement at the transformer substation are given in IEC 61936-1.

442.1.1 General requirements

As Clause 442 covers faults between a high-voltage line and the earth in the HV/LV substation, it gives rules for the designer and installer of the substation. It is necessary to have the following information concerning the high-voltage system:

- quality of the system earthing;

- maximum level of earth fault current;
- resistance of the earthing arrangement.

The following subclauses consider four situations as proposed in 442.1, which generally cause the most severe temporary overvoltages such as defined in IEC 60050-604:

- fault between the high-voltage system(s) and earth (see 442.2);
- loss of the neutral in a low-voltage system (see 442.3);
- accidental earthing of a low-voltage IT system (see 442.4);
- short-circuit in the low-voltage installation (see 442.5).

442.1.2 Symbols

In Clause 442 the following symbols are used (see Figure 44.A1):

I_E	part of the earth fault current in the high-voltage system that flows through the earthing arrangement of the transformer substation.
R_E	resistance of the earthing arrangement of the transformer substation.
R_A	resistance of the earthing arrangement of the exposed-conductive-parts of the equipment of the low-voltage installation.
R_B	resistance of the earthing arrangement of the low-voltage system neutral, for low-voltage systems in which the earthing arrangements of the transformer substation and of the low-voltage system neutral are electrically independent.
U_0	in TN- and TT-systems: nominal a.c. r.m.s. line voltage to earth in IT-systems: nominal a.c. voltage between line conductor and neutral conductor or mid point conductor, as appropriate
U_f	power-frequency fault voltage that appears in the low-voltage system between exposed-conductive-parts and earth for the duration of the fault.
U_1	power-frequency stress voltage between the line conductor and the exposed-conductive-parts of the low-voltage equipment of the transformer substation during the fault.
U_2	power-frequency stress voltage between the line conductor and the exposed-conductive-parts of the low-voltage equipment of the low-voltage installation during the fault.

NOTE 1 The power-frequency stress voltage (U_1 and U_2) is the voltage that appears across the insulation of low-voltage equipment and across surge protective devices connected to the low-voltage system.

The following additional symbols are used in respect of IT-systems in which the exposed-conductive-parts of the equipment of the low-voltage installation are connected to an earthing arrangement that is electrically independent of the earthing arrangement of the transformer substation.

I_h	fault current that flows through the earthing arrangement of the exposed-conductive-parts of the equipment of the low-voltage installation during a period when there is a high-voltage fault and a first fault in the low-voltage installation (see Table 44.A1).
I_d	fault current, in accordance with 411.6.2, that flows through the earthing arrangement of the exposed-conductive-parts of the low-voltage installation during the first fault in a low-voltage system (see Table 44.A1).

Z impedance (e.g. IMD internal impedance, artificial neutral impedance) between the low-voltage system and an earthing arrangement.

NOTE 2 An earthing arrangement may be considered electrically independent of another earthing arrangement if a rise of potential with respect to earth in one earthing arrangement does not cause an unacceptable rise of potential with respect to earth in the other earthing arrangement. See IEC 61936-1.

442.2 Overvoltages in LV-systems during a high-voltage earth fault

In case of a fault to earth on the HV-side of the substation, the following types of overvoltage may affect the LV-installation:

- power frequency fault-voltage (U_f);
- power frequency stress-voltages (U_1 and U_2).

Table 44.A1 provides the relevant methods of calculation for the different types of overvoltages.

NOTE 1 Table 44.A1 deals with IT systems with a neutral point only. For IT systems with no neutral point, the formulae should be adjusted accordingly.

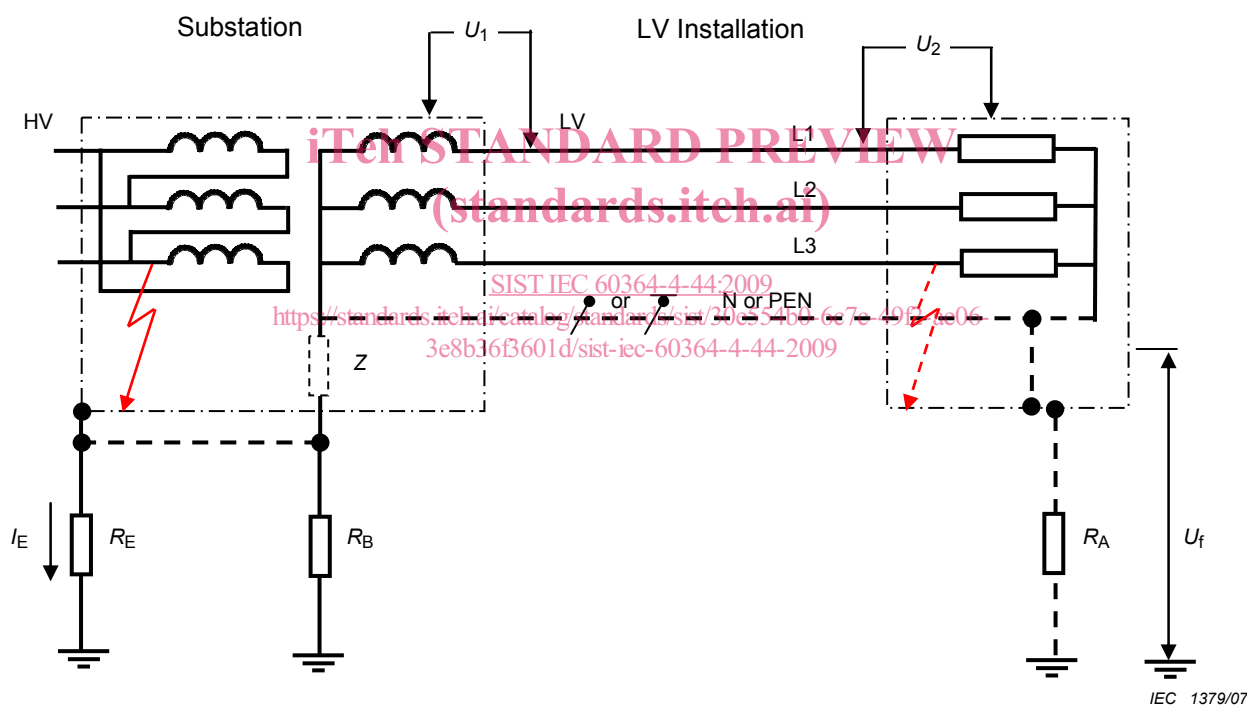


Figure 44.A1 – Representative schematic sketch for possible connections to earth in substation and LV-installation and occurring overvoltages in case of faults

Where high- and low-voltage earthing systems exist in proximity to each other, two practices are presently used:

- interconnection of all high-voltage (R_E) and low-voltage (R_B) earthing systems;
- separation of high-voltage (R_E) from low-voltage (R_B) earthing systems.

The general method used is interconnection. The high- and low-voltage earthing systems shall be interconnected if the low-voltage system is totally confined within the area covered by the high-voltage earthing system (see IEC 61936-1).


NOTE 2 Details of the different types of system earthing (TN, TT, IT) are shown in IEC 60364-1.

Table 44.A1 – Power-frequency stress voltages and power-frequency fault voltage in low-voltage system

Types of system earthing	Types of earth connections	U_1	U_2	U_f
TT	R_E and R_B connected	$U_o^*)$	$R_E \times I_E + U_o$	$0^*)$
	R_E and R_B separated	$R_E \times I_E + U_o$	$U_o^*)$	$0^*)$
TN	R_E and R_B connected	$U_o^*)$	$U_o^*)$	$R_E \times I_E^{**})$
	R_E and R_B separated	$R_E \times I_E + U_o$	$U_o^*)$	$0^*)$
IT	R_E and Z connected R_E and R_A separated	$U_o^*)$	$R_E \times I_E + U_o$	$0^*)$
		$U_o \times \sqrt{3}$	$R_E \times I_E + U_o \times \sqrt{3}$	$R_A \times I_h$
	R_E and Z connected R_E and R_A interconnected	$U_o^*)$	$U_o^*)$	$R_E \times I_E$
		$U_o \times \sqrt{3}$	$U_o \times \sqrt{3}$	$R_E \times I_E$
	R_E and Z separated R_E and R_A separated	$R_E \times I_E + U_o$	$U_o^*)$	$0^*)$
		$R_E \times I_E + U_o \times \sqrt{3}$	$U_o \times \sqrt{3}$	$R_A \times I_d$

*) No consideration needs to be given.

**) See 442.2.1 second paragraph

 With existing earth fault in the installation.

NOTE 3 The requirements for U_1 and U_2 are derived from design criteria for insulation of low-voltage equipment with regard to temporary power-frequency overvoltage (see also Table 44.A2).

NOTE 4 In a system whose neutral is connected to the earthing arrangement of the transformer substation, such temporary power-frequency overvoltage is also to be expected across insulation which is not in an earthed enclosure when the equipment is outside a building.

NOTE 5 In TT- and TN-systems the statement “connected” and “separated” refers to the electrical connection between R_E and R_B . For IT-systems it refers to the electrical connection between R_E and Z and the connection between R_F and R_A .

442.2.1 Magnitude and duration of power-frequency fault voltage

The magnitude and the duration of the fault voltage U_f (as calculated in Table 44.A1) which appears in the LV installation between exposed-conductive-parts and earth, shall not exceed the values given for U_f by the curve of Figure 44.A2 for the duration of the fault.

Normally, the PEN conductor of the low-voltage system is connected to earth at more than one point. In this case, the total resistance is reduced. For these multiple grounded PEN conductors, U_f can be calculated as:

$$U_f = 0,5 R_F \times I_F$$

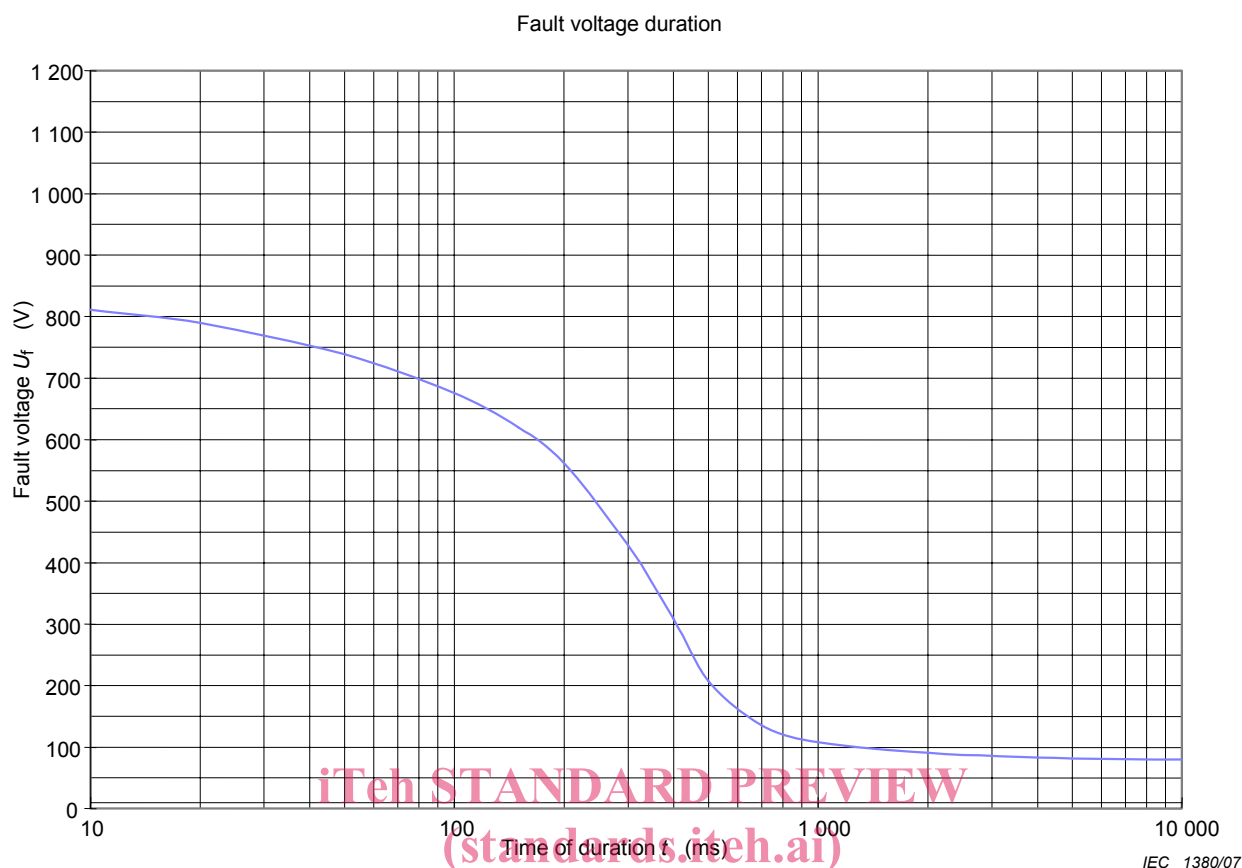


Figure 44.A2 – Tolerable fault voltage due to an earth-fault in the HV system

NOTE The curve shown in Figure 44.A2 is taken from IEC 61936-1. On the basis of probabilistic and statistical evidence this curve represents a low level of risk for the simple worst case where the low voltage system neutral conductor is earthed only at the transformer substation earthing arrangements. Guidance is provided in IEC 61936-1 concerning other situations.

442.2.2 Magnitude and duration of power-frequency stress voltages

The magnitude and the duration of the power-frequency stress voltage (U_1 and U_2) as calculated in Table 44.A1 of the low-voltage equipment in the low-voltage installation due to an earth fault in the high-voltage system shall not exceed the requirements given in Table 44.A2.

Table 44.A2 – Permissible power-frequency stress voltage

Duration of the earth fault in the high-voltage system t	Permissible power-frequency stress voltage on equipment in low-voltage installations U
>5 s	$U_o + 250 \text{ V}$
≤5 s	$U_o + 1\,200 \text{ V}$
In systems without a neutral conductor, U_o shall be the line-to-line voltage.	
NOTE 1 The first line of the table relates to high-voltage systems having long disconnection times, for example, isolated neutral and resonant earthed high-voltage systems. The second line relates to high-voltage systems having short disconnection times, for example low-impedance earthed high-voltage systems. Both lines together are relevant design criteria for insulation of low-voltage equipment with regard to temporary power frequency overvoltage, see IEC 60664-1.	
NOTE 2 In a system whose neutral is connected to the earthing arrangement of the transformer substation, such temporary power-frequency overvoltage is also to be expected across insulation which is not in an earthed enclosure when the equipment is outside a building.	