



ETSI Standard

**Access, Terminals, Transmission and Multiplexing (ATM);
Energy management;
Global KPIs;
Operational infrastructures;
Part 2: Specific requirements;
Sub-part 1: Data centres**

439d-b894-2b60ad1-1276/etsses205200-2-1-v1.1.1-2013-05
<https://standards.etsi.org/205200-2-1-v1.1.1-2013-05>

Reference
DES/ATTM-02019
Keywords
performance, power

ETSI

650 Route des Lucioles
F-06921 Sophia Antipolis Cedex - FRANCE

Tel.: +33 4 92 94 42 00 Fax: +33 4 93 65 47 16

Siret N° 348 623 562 00017 - NAF 742 C
Association à but non lucratif enregistrée à la
Sous-Préfecture de Grasse (06) N° 7803/88

iTeh STANDARD (Standards.iteh.org)
Full standard:
<http://standards.iteh.org/catalog/standards/sist/192e-051>
Full standard:
<http://standards.iteh.org/catalog/standards/sist/192e-051>

Important notice

Individual copies of the present document can be downloaded from:
<http://www.etsi.org>

The present document may be made available in more than one electronic version or in print. In any case of existing or perceived difference in contents between such versions, the reference version is the Portable Document Format (PDF). In case of dispute, the reference shall be the printing on ETSI printers of the PDF version kept on a specific network drive within ETSI Secretariat.

Users of the present document should be aware that the document may be subject to revision or change of status.

Information on the current status of this and other ETSI documents is available at

<http://portal.etsi.org/tb/status/status.asp>

If you find errors in the present document, please send your comment to one of the following services:

http://portal.etsi.org/chaircor/ETSI_support.asp

Copyright Notification

No part may be reproduced except as authorized by written permission.
The copyright and the foregoing restriction extend to reproduction in all media.

© European Telecommunications Standards Institute 2013.
All rights reserved.

DECT™, PLUGTESTS™, UMTS™ and the ETSI logo are Trade Marks of ETSI registered for the benefit of its Members.
3GPP™ and LTE™ are Trade Marks of ETSI registered for the benefit of its Members and
of the 3GPP Organizational Partners.

GSM® and the GSM logo are Trade Marks registered and owned by the GSM Association.

Contents

Intellectual Property Rights	5
Foreword.....	5
Introduction	6
1 Scope	7
2 References	7
2.1 Normative references	7
2.2 Informative references.....	7
3 Definitions, symbols and abbreviations	8
3.1 Definitions	8
3.2 Symbols.....	9
3.3 Abbreviations	9
4 System definition and boundaries	10
5 Mapping to the objectives of ES 205 200-1	12
5.1 Energy consumption.....	12
5.2 Task efficiency	12
5.3 Energy re-use.....	12
5.4 Renewable energy	13
6 Global operational KPIs	13
6.1 Scale	13
6.2 Evolution	13
6.3 Formulae.....	14
6.3.1 KPI _{EM}	14
6.3.1.1 Formula	14
6.3.1.2 Definitions of terms.....	14
6.3.1.3 Measurement procedures	14
6.3.1.4 Criteria	15
6.3.2 KPI _{EC}	15
6.3.2.1 Formula	15
6.3.2.2 Definitions of terms.....	16
6.3.2.3 Measurement points	16
6.3.2.3.1 General	16
6.3.2.3.2 Dedicated energy sources	17
6.3.2.3.3 Shared supply systems.....	17
6.3.2.4 Measurement procedures	17
6.3.2.5 Criteria	17
6.3.3 KPI _{TE}	17
6.3.3.1 Formula	17
6.3.3.2 Definitions of terms.....	18
6.3.3.3 Measurement points	18
6.3.3.4 Measurement procedures	18
6.3.3.5 Criteria	18
6.3.4 KPI _{REUSE}	19
6.3.4.1 Formula	19
6.3.4.2 Definitions of terms.....	19
6.3.4.3 Measurement points	19
6.3.4.4 Measurement procedures	20
6.3.4.5 Criteria	20
6.3.5 KPI _{REN}	20
6.3.5.1 Formula	20
6.3.5.2 Definitions of terms.....	20
6.3.5.3 Measurement points	20
6.3.5.4 Measurement procedures	20

6.3.5.5	Criteria	20
6.4	Weighting factors	21
6.4.1	Energy re-use	21
6.4.1.1	W _{REUSE}	21
6.4.1.2	W _L	21
6.4.2	Renewable energy (W _{REN})	21

Annex A (informative): Concepts: Energy management, sustainability and Key Performance Indicators.....22

A.1	Energy management and sustainability concepts	22
A.2	The status of Key Performance Indicators (KPIs).....	23
A.2.1	Technical KPIs	23
A.2.2	Objective KPIs	23
A.2.3	Global KPIs.....	24
A.2.4	Summary	24
	History	25

iTeh STANDARD PREVIEW
(Standards.iteh.ai)
Full standard:
<https://standards.iteh.ai/catalog/standard/sist/dd9f792e-f0b1-439d-b894-2b6f0ad7976/etsi-es-205-200-2-1-v1.1-2013-05>

Intellectual Property Rights

IPRs essential or potentially essential to the present document may have been declared to ETSI. The information pertaining to these essential IPRs, if any, is publicly available for **ETSI members and non-members**, and can be found in ETSI SR 000 314: *"Intellectual Property Rights (IPRs); Essential, or potentially Essential, IPRs notified to ETSI in respect of ETSI standards"*, which is available from the ETSI Secretariat. Latest updates are available on the ETSI Web server (<http://ipr.etsi.org>).

Pursuant to the ETSI IPR Policy, no investigation, including IPR searches, has been carried out by ETSI. No guarantee can be given as to the existence of other IPRs not referenced in ETSI SR 000 314 (or the updates on the ETSI Web server) which are, or may be, or may become, essential to the present document.

Foreword

This ETSI Standard (ES) has been produced by ETSI Technical Committee Access, Terminals, Transmission and Multiplexing (ATTM).

The present document is part 2, sub-part 1 of a multi-part deliverable covering operational energy management and sustainability of broadband deployment as identified below:

Part 1: "General requirements";

Parts 2: "Specific requirements";

Sub-part 1: "Data centres";

Sub-part 3: "Mobile access networks"

NOTE 1: Additional documents are in development by ETSI Technical Committee Access, Terminals, Transmission and Multiplexing (ATTM) which include:

ES 205 200-1-1: "Access, Terminals, Transmission and Multiplexing; Guidance; Energy management; Global KPIs: Guidance";

ES 205 200-2-2: "Access, Terminals, Transmission and Multiplexing; Energy management; Global KPIs: Operational infrastructures: Fixed (excluding cable) access networks";

ES 205 200-3: "Access, Terminals, Transmission and Multiplexing; Energy management; Global KPIs: Monitoring of sustainability".

NOTE 2: A further document is under consideration ETSI Technical Committee CABLE to address "cable access networks (ES 205 200-2-4)".

Introduction

Energy costs continue to rise, a trend that will continue in the future, while broadband penetration is introducing new active equipment to the network architecture. In this context, and to reflect other environmental aspects of sustainability, it is vital that the main telecommunication actors implement effective general engineering of fixed and mobile broadband networks and sites provisioning, managing or using those networks (i.e. operator sites, operator data centres and customer data centres) in order to respond to critical issues of energy consumption while proposing essential solutions to true broadband deployment.

These issues are of particular importance in data centres - both of operators **and** customers. To guide this process, it is essential that metrics are defined, termed Global Key Performance Indicators (KPI_{EM}) that enable energy usage to be managed more efficiently.

The ES 205 200 series of standards comprises:

- ES 205 200-1: a generic requirements document addressing Global KPIs for operational infrastructures.

NOTE: Global KPIs do not address design/operation of components or subsystems of broadband deployment networks.

- A sub-series ES 205 200-2 that defines the Global KPIs, and drives energy management targets, for specific operational networks and sites and which describes how the Global KPIs are to be applied (which may be used to support future regulatory objectives):

- ES 205 200-2-1: Data centres;
- ES 205 200-2-3: Mobile access networks.

These documents do not define KPI limits or targets (which is outside the scope of the ES 205 200 series of standards).

These documents will accelerate:

- availability of operational infrastructure architectures and network implementations that use energy more efficiently;
- the definition and attainment of sustainability objectives for operational broadband networks.

Within the present document:

- clause 4 explains the definition of a data centre in terms of the systems it comprises and the boundaries that apply and shows that the present document is equally applicable to operator data centres, operator sites and customers data centres;
- clause 5 describes how the Objective KPIs of the present document meet the requirements of ES 205 200-1 [2];
- clause 6 describes the specific requirements of the Global KPI and the supporting Objective KPIs for data centres;
- annex A discusses the roles of different types of Key Performance Indicators i.e. Technical, Objective and Global in relation to the overall energy management concepts of the present document.

1 Scope

The present document specifies Global Key Performance Indicators (KPI_{EE}) in relation to energy management for operator data centres (ODC), operator sites (OS) and customer data centres (CDC) and addresses the following objectives:

- energy consumption;
- task efficiency;
- energy re-use;
- renewable energy.

The definition of the Globals KPIs (clause 6) are in accordance with requirements of ES 205 200-1 [2] (as described in clause 5) in relation to:

- infrastructure scalability;
- infrastructure evolution;
- formulae and definitions of terms;
- measurement points and procedures.

The present document also provides information on system definition and boundaries (clause 4).

2 References

References are either specific (identified by date of publication and/or edition number or version number) or non-specific. For specific references, only the cited version applies. For non-specific references, the latest version of the reference document (including any amendments) applies.

Referenced documents which are not found to be publicly available in the expected location might be found at <http://docbox.etsi.org/Reference>.

NOTE: While any hyperlinks included in this clause were valid at the time of publication, ETSI cannot guarantee their long term validity.

2.1 Normative references

The following referenced documents are necessary for the application of the present document.

- [1] CENELEC EN 50600-2-2: "Information technology - Data centre facilities and infrastructures - Part 2-2: Power distribution".
- [2] ETSI ES 205 200-1: "Access, Terminals, Transmission and Multiplexing (ATTM); Energy management; Global KPIs; Operational infrastructures; Part 1: General requirements".

2.2 Informative references

The following referenced documents are not necessary for the application of the present document but they assist the user with regard to a particular subject area.

- [i.1] CENELEC EN 50600-1: "Information technology - Data centre facilities and infrastructures - Part 1: General requirements".
- [i.2] EC Mandate M/462: "Standardisation mandate addressed to CEN, CENELEC and ETSI in the field of Information and Communication Technologies".

- [i.3] ETSI TR 105 174-2-2: "Access, Terminals, Transmission and Multiplexing (ATM); Broadband Deployment - Energy Efficiency and Key Performance Indicators; Part 2: Network sites; Sub-part 2: Data centres".
- [i.4] European Commission DG JRC Code of Conduct for Data Centre Energy Efficiency.
- [i.5] Recommendation ITU-T L.1300: "Series L: Construction, installation and protection of cables and other elements of outside plant: Best practices for green data centers".
- [i.6] European Commission DG JRC Code of Conduct on Energy Consumption of Broadband Equipment.
- [i.7] ISO Guide 82: "Guide for addressing sustainability in standards".
- [i.8] ETSI TR 105 174-1: "Access, Terminals, Transmission and Multiplexing (ATM); Broadband Deployment - Energy Efficiency and Key Performance Indicators; Part 1: Overview, common and generic aspects".

3 Definitions, symbols and abbreviations

3.1 Definitions

For the purposes of the present document, the following terms and definitions apply:

core infrastructure (core network): functional elements (that is equipment and infrastructure) that enable communication between operator sites and/or operator data centres

NOTE: See TR 105 174-1 [i.8].

customer data centre: data centre that is not directly connected to the core network

data centre: structure, or group of structures, dedicated to the centralized accommodation, interconnection and operation of information technology and network telecommunications equipment providing data storage, processing and transport services together with all the facilities and infrastructures for power distribution and environmental control together with the necessary levels of resilience and security required to provide the desired service availability

energy consumption: total consumption of electrical energy by an operational infrastructure

energy management: combination of reduced energy consumption and increased task efficiency, re-use of energy and use of renewable energy

energy re-use: transfer or conversion of energy (typically in the form of heat) produced by the operational infrastructure to do other work

fixed access network: functional elements that enable wired (including optical fibre) communications to customer equipment

Information Technology Equipment (ITE): equipment providing data storage, processing and transport services for subsequent distribution by network telecommunications equipment

ITE and/or NTE load: total requirement for power by a set of information technology equipment (ITE) and/or network telecommunications equipment (NTE)

mobile access network: functional elements that enable wireless communications to customer equipment

Network Telecommunications Equipment (NTE): equipment dedicated to providing direct connection to core and/or access networks

Objective KPI: KPI assessing one of the objectives of operational energy performance which is subsequently used to define a Global KPI for energy management (KPI_{EM})

operational infrastructure: combination of information technology equipment (ITE) and/or network telecommunications equipment (NTE) together with the power supply and environmental control systems necessary to ensure provision of service

operator data centre: data centre embedded within the core network

operator site: premises accommodating network telecommunications equipment providing direct connection to the core and access networks and which may also accommodate information technology equipment

primary distribution equipment: equipment which is required to manage, control and convert incoming power supplies (primary, secondary and, where appropriate, additional) in a form suitable for distribution by secondary distribution equipment

NOTE: See EN 50600-2-2 [1].

renewable energy: energy produced from dedicated generation systems using resources that are naturally replenished

secondary distribution equipment: equipment which is required to manage, control and distribute the power provided by the primary distribution equipment to the short-break and unprotected sockets within the data centre and to the tertiary distribution equipment

NOTE 1: See EN 50600-2-2 [1].

NOTE 2: The power supply may be single-phase AC, three-phase AC or DC. If there is a change from 3-phase to 1-phase supply, this is generally achieved at the secondary distribution equipment that is served directly from the primary distribution equipment.

task efficiency: measure of the work done (as a result of design and/or operational procedures) for a given amount of energy consumed

3.2 Symbols

For the purposes of the present document, the following symbols apply:

Δt	the maximum time variation between measurement points of the different Objective Key Performance Indicators within a given Global Key Performance Indicator
KPI_{EC}	Objective Key Performance Indicator of energy consumption
KPI_{EM}	Global Key Performance Indicator of energy management
KPI_{REN}	Objective Key Performance Indicator of renewable energy usage
KPI_{REUSE}	Objective Key Performance Indicator of energy re-use
KPI_{TE}	Objective Key Performance Indicator of task efficiency
T_{KPI}	period of time over which Objective KPIs are assessed
T_{REPEAT}	the minimum time between which the Objective KPIs can be assessed to determine relevant trend information
W_{EC}	weighting factor applied to KPI_{EC}
W_L	weighting factor within KPI_{REUSE}
W_{REN}	weighting factor applied to KPI_{REN}
W_{REUSE}	weighting factor applied to KPI_{REUSE}
W_{TE}	weighting factor applied to KPI_{TE}

3.3 Abbreviations


For the purposes of the present document, the following abbreviations apply:

CDC	Customer Data Centre
ESO	European Standardisation Organization
ITE	Information Technology Equipment
KPI	Key Performance Indicator
NTE	Network Telecommunications Equipment
ODC	Operator Data Centre

OS	Operator Site
PDU	Power Distribution Unit
UPS	Uninterruptible Power Supply

4 System definition and boundaries

Figure 1 shows the schematic of the operational infrastructures of broadband deployment as contained with the ESO response to the EC Mandate M/462 [i.2].

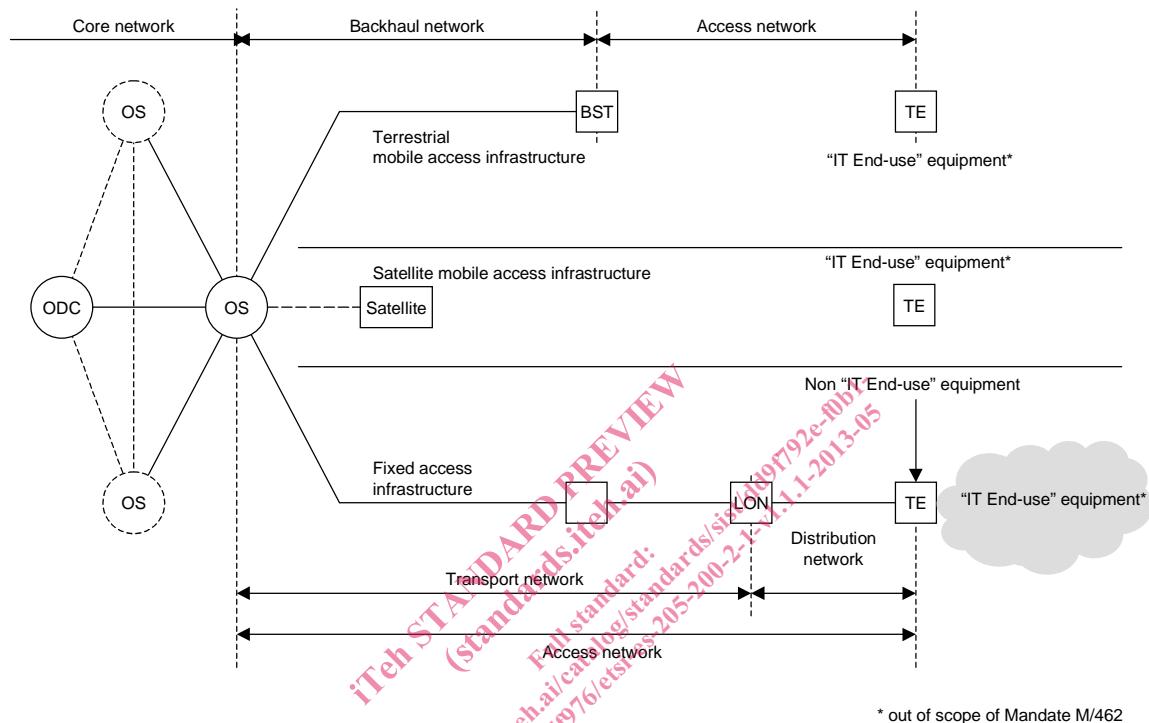

NOTE: Not all the terms and abbreviations of Figure 1 are included in clause 3 of the present document.

Figure 1: Schematic of core network together with fixed and mobile access infrastructures

With reference to Figure 1:

- an operator data centre (ODC) accommodates a mixture of information technology equipment (ITE) and network telecommunication equipment (NTE);
- an operator site (OS) will also accommodate a mixture of ITE and NTE - where the NTE may provide connections to connections to core, fixed access, terrestrial mobile access and satellite mobile access network infrastructures.

It is unlikely that either the ODC or OS of Figure 1 would allow separate assessment of energy consumption of the ITE and the various NTE for the disparate network infrastructures. As a result, the boundaries applied to ODC and OS in relation to the objective of Global KPIs for operational infrastructures have to be modified from that of Figure 1 to that shown in Figure 2.

Similarly, the principal difference between the ODC and the OS would be the relative proportion of ITE and NTE as is shown in Figure 3. Furthermore a customers data centre (CDC) would also contain NTE - although generally providing a connection to the access networks. For this reason, the present document considers its Global KPIs for operators data centres to also be applicable to OSs and CDCs.