
**Glass in buildings — Insulating glass —
Part 2:
Chemical fogging tests**

Verre dans la construction — Verre isolant —

Partie 2: Essais d'embuage chimique

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[ISO 20492-2:2008](https://standards.iteh.ai/catalog/standards/sist/201113b8-ffaf-4cbd-a069-23daa6f2aa15/iso-20492-2-2008)

<https://standards.iteh.ai/catalog/standards/sist/201113b8-ffaf-4cbd-a069-23daa6f2aa15/iso-20492-2-2008>



PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 20492-2:2008

<https://standards.iteh.ai/catalog/standards/sist/201113b8-ffaf-4cbd-a069-23daa6f2aa15/iso-20492-2-2008>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2008

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword	iv
Introduction	v
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Requirements	2
5 Test methods	2
6 Test report	8
Bibliography	13

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[ISO 20492-2:2008](https://standards.iteh.ai/catalog/standards/sist/201113b8-ffaf-4cbd-a069-23daa6f2aa15/iso-20492-2-2008)

<https://standards.iteh.ai/catalog/standards/sist/201113b8-ffaf-4cbd-a069-23daa6f2aa15/iso-20492-2-2008>

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 20492-2 was prepared by Technical Committee ISO/TC 160, *Glass in building*, Subcommittee SC 1, *Product considerations*.

ISO 20492 consists of the following parts, under the general title *Glass in buildings — Insulating glass*:

- *Part 1: Durability of edge seals by climate tests*
- *Part 2: Chemical fogging tests*
- *Part 3: Gas concentration and gas leakage*
- *Part 4: Test methods for the physical attributes of edge seals*

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 20492-2:2008

[https://standards.iteh.ai/catalog/standards/sist/201113b8-ffaf-4cbd-a069-](https://standards.iteh.ai/catalog/standards/sist/201113b8-ffaf-4cbd-a069-23daa6f2aa15/iso-20492-2-2008)

[23daa6f2aa15/iso-20492-2-2008](https://standards.iteh.ai/catalog/standards/sist/201113b8-ffaf-4cbd-a069-23daa6f2aa15/iso-20492-2-2008)

Introduction

This part of ISO 20492 consists of a series of procedures for testing the performance of pre-assembled, permanently sealed insulating glass units or insulating glass units with capillary tubes that have been intentionally left open. This part of ISO 20492 is intended to help ensure that

- energy savings are made, as the U -value and solar factor (solar heat gain coefficient) do not change significantly;
- health is preserved, because sound-reduction and vision do not change significantly;
- safety is provided because mechanical resistance does not change significantly.

This part of ISO 20492 also covers additional characteristics that are important to the trade, and marking of the product (i.e. CE marking or other regulatory groups) is also included.

There are distinct markets to be considered for insulating glass. As within each market there are technical differences with respect to rebate sizes, vision lines and methods of application, two approaches are included in this part of ISO 20492. Approach 1 addresses requirements for markets such as North America. Approach 2 addresses requirements for markets such as Europe. Each approach includes separate test methods and specifications pertaining to minimum requirements for the durability of edge seals by climate tests.

(standards.iteh.ai)

This part of ISO 20492 does not cover the physical requirements of sealed glass insulating units such as appearance, thermo-physical properties, heat and light transmission and glass displacement.

The main intended uses of the insulating glass units are installations in buildings and constructions such as in windows, doors, curtain walling, skylights, roofs and partitions where protection against direct ultraviolet radiation exists at the edges.

NOTE In cases where there is no protection against direct ultraviolet radiation at the edges, such as structural-sealant glazing systems, it is still necessary to review factors such as sealant longevity when exposed to long-term ultraviolet light and the structural properties of the sealant for these applications. For more information on the requirements for structural sealant glazing applications, reference can be made to ASTM C1369^[1], ASTM C1249^[2] and ASTM C1265^[3].

The test methods in this part of ISO 20492 are intended to provide a means for testing the performance of the sealing system and construction of sealed insulating glass units.

Sealed, insulating glass units tested in accordance with these methods are not intended for long-term immersion in water.

The options for testing apply only to sealed, insulating glass units that are constructed with glass.

The methods of this part of ISO 20492 might not be applicable in certain cases, such as insulating glass units containing spandrel glass or absorptive coatings, as these products can experience field temperatures that exceed the temperature limitations of the sealant.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 20492-2:2008

<https://standards.iteh.ai/catalog/standards/sist/201113b8-ffaf-4cbd-a069-23daa6f2aa15/iso-20492-2-2008>

Glass in buildings — Insulating glass —

Part 2: Chemical fogging tests

1 Scope

This part of ISO 20492 establishes two methods for testing the resistance to fogging of pre-assembled, permanently sealed insulating glass units or insulating glass units with capillary tubes intentionally left open. The two methods are designated as Approach 1 for markets such as North America, and Approach 2 for markets such as Europe.

This part of ISO 20492 is not applicable to sealed, insulating glass units containing a spandrel glass coating due to testing limitations.

This part of ISO 20492 does not apply to insulating glass (IG) units whose function is decorative only.

iTeh STANDARD PREVIEW

2 Normative references (standards.iteh.ai)

The following reference documents are indispensable for the application of this document. For dated references, only the cited edition applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 20492-1, *Glass in buildings — Insulating glass — Part 1: Durability of edge seals by climate tests*

EN 572-1, *Glass in building — Basic soda lime silicate glass products — Definitions and general physical and mechanical properties*

EN 572-2, *Glass in building — Basic soda lime silicate glass products — Float glass*

EN 1279-1, *Glass in building — Insulating glass units — Part 1: Generalities, dimensional tolerances and rules for the system description*

ASTM C1036, *Standard Specification for Flat Glass*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 20492-1 and the following apply.

3.1

fog

visible deposits present after testing on the inside surface(s) of an insulating glass unit

3.2

sealed, insulating glass unit

pre-assembled unit, comprised of panes of glass that are sealed at the edges and separated by dehydrated space(s), intended for vision areas of buildings

NOTE The unit is normally used for windows, window walls, picture windows, sliding doors, patio doors, or other types of fenestration.

4 Requirements

4.1 Approach 1

No fog shall be visible after the test has ended in accordance with 5.1.4.

4.2 Approach 2

No permanent visual condensation shall be permitted in accordance with 5.2.4.

5 Test methods

5.1 Approach 1

5.1.1 Principle

Test specimens are placed in a chamber that is controlled at (50 ± 3) °C. A lamp is positioned in the bottom of the chamber to supply heat and UV radiation. A chilled plate, controlled to a constant temperature of (21 ± 2) °C, is positioned on the centre of each specimen. After 7 days of exposure, the test specimens are examined at arm's length for fog.

5.1.2 Test specimens

Each test specimen shall measure (355 ± 6) mm by (505 ± 6) mm, and shall be composed of two or three panes of clear, tinted or coated annealed, heat-strengthened, tempered or laminated glass.

The double-glazed test specimen shall be fabricated with at least one pane of clear, uncoated glass. The triple-glazed test specimen shall be fabricated with at least one outer pane of clear, uncoated glass. The other outer pane shall be fabricated with a glass that allows easy viewing of fog.

For double-glazed test specimens, the glass and airspace thicknesses shall be 4 mm glass with 12 mm airspace or 5 mm glass with 6 mm airspace.

For triple-glazed test specimens, 4 mm glass with 6 mm airspaces shall be used.

Tolerance of glass thickness shall be in accordance with ASTM C1036.

Airspace tolerance(s) shall be $\pm 0,8$ mm.

A minimum of two specimens of double-glazed or four specimens of triple-glazed test specimens shall be submitted for testing.

NOTE 1 However, it is recommended to submit extra specimens in case of breakage.

Triple-glazed test specimens where the intermediate airspace divider is a plastic film shall be acceptable for testing.

NOTE 2 The overall unit thickness of a test specimen has some limits. Testing laboratories are usually able to accommodate 30 mm overall thickness. If testing thicker units, it is necessary to contact the testing laboratory prior to manufacturing to ascertain their capabilities for testing thicker units.

Each specimen shall be permanently and legibly marked with the designation of the manufacturer, the date of fabrication (month or quarter and year) and orientation intended in the field (for test specimens that have been constructed with coated glass).

During all stages of exposure and storage, the test specimens shall be held in a vertical position with equal support to all panes and no compression loading.


The selection of test specimens for testing shall be made at random, except when specimens have been damaged in transit. Damaged test specimens shall not be tested.

Test specimens representing sealed, insulating glass units that are gas-filled shall be fabricated using the same hole-sealing and gas-filling techniques as those used during manufacturing. For example, if a gas-filling plug is used in manufacturing, then it should be used in the test specimens. It is not necessary that the specimens be filled with gas provided that the gas is classified as inert.

Test specimens representing products that are normally filled with an inert gas in production may be submitted air filled for this testing as long as they have been manufactured with the same techniques as used in production.

Test specimens representing sealed, insulating glass units that include tubes intended to be left open shall be fabricated with one tube. This tube shall be left open during testing. Test specimens representing sealed, insulating glass units that include tubes intended to be closed off after shipping shall be fabricated with one tube. The exterior end of this tube shall be closed prior to testing.

For test specimens representing sealed, insulating glass units that include internal components in the air space, the grid formed by these components shall divide the test specimen into nine equal areas (3×3) (see Figure 1).

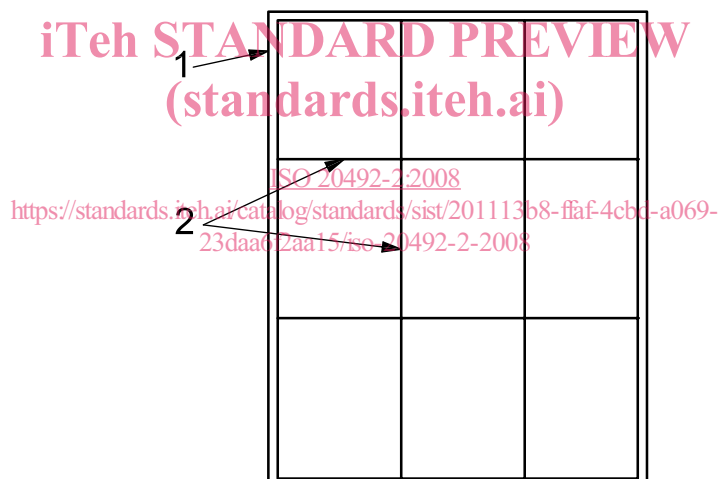

Key

- 1 insulating glass spacer/edge seal
- 2 internal grids

Figure 1 — Test specimen with internal grids

The test specimens should be sealed a minimum of 4 weeks from the date of manufacture to allow for stabilization before testing.

Before testing, the glass surfaces shall be checked to ensure that they are clean.

5.1.3 Apparatus

5.1.3.1 Volatile fog test apparatus

The dimensions and components of the volatile fog test apparatus shall be in accordance with Figure 2. The construction of the apparatus shall be capable of maintaining $(50 \pm 3) ^\circ\text{C}$. In order to maintain this temperature, a fan shall be mounted in the box. The fan shall run continuously.

The apparatus shall be constructed from sturdy, solid materials that minimize the escape of ultraviolet light into the surrounding area.

Plywood that is at least 12 mm thick has been found to be suitable for this purpose. If plywood is used to construct the apparatus, the entire interior of the apparatus should be lined with aluminium foil or other reflective material.

NOTE Stainless steel construction is also acceptable.

The interior of the apparatus shall have a reflective surface.

The test specimen supports shall be located in accordance with Figure 2.

The cooling plates shall be constructed of a conductive material such as copper or brass. The cooling plates shall be nominally $150 \text{ mm} \pm 5 \text{ mm}$ in diameter, and shall be placed directly in complete contact with the glass surface for the duration of the test.

Alternatively, a rectangular cooling plate shall have an area of $0,0177 \pm 0,0006 \text{ m}^2$.

The cooling water temperature shall be determined as the water immediately exits the apparatus from each cooling plate as shown in Figure 2. The cooling water temperature at these locations shall be $21 ^\circ\text{C} \pm 2 ^\circ\text{C}$.


The apparatus shall have radiation-shielded thermocouples to continuously monitor the temperature of the apparatus, located in accordance with Figure 2.

5.1.3.2 Ultraviolet light source

WARNING — Light from the ultraviolet sources used in this test method are harmful to the human body, especially to the eyes. Appropriate protective measures should be observed.

The source shall consist of one ultraviolet lamp. The output of the UV source shall be measured from a distance of $355 \text{ mm} \pm 5 \text{ mm}$ with a long-wave ultraviolet meter and shall not be less than $400 \mu\text{W}/\text{cm}^2$.

Dimensions in millimetres

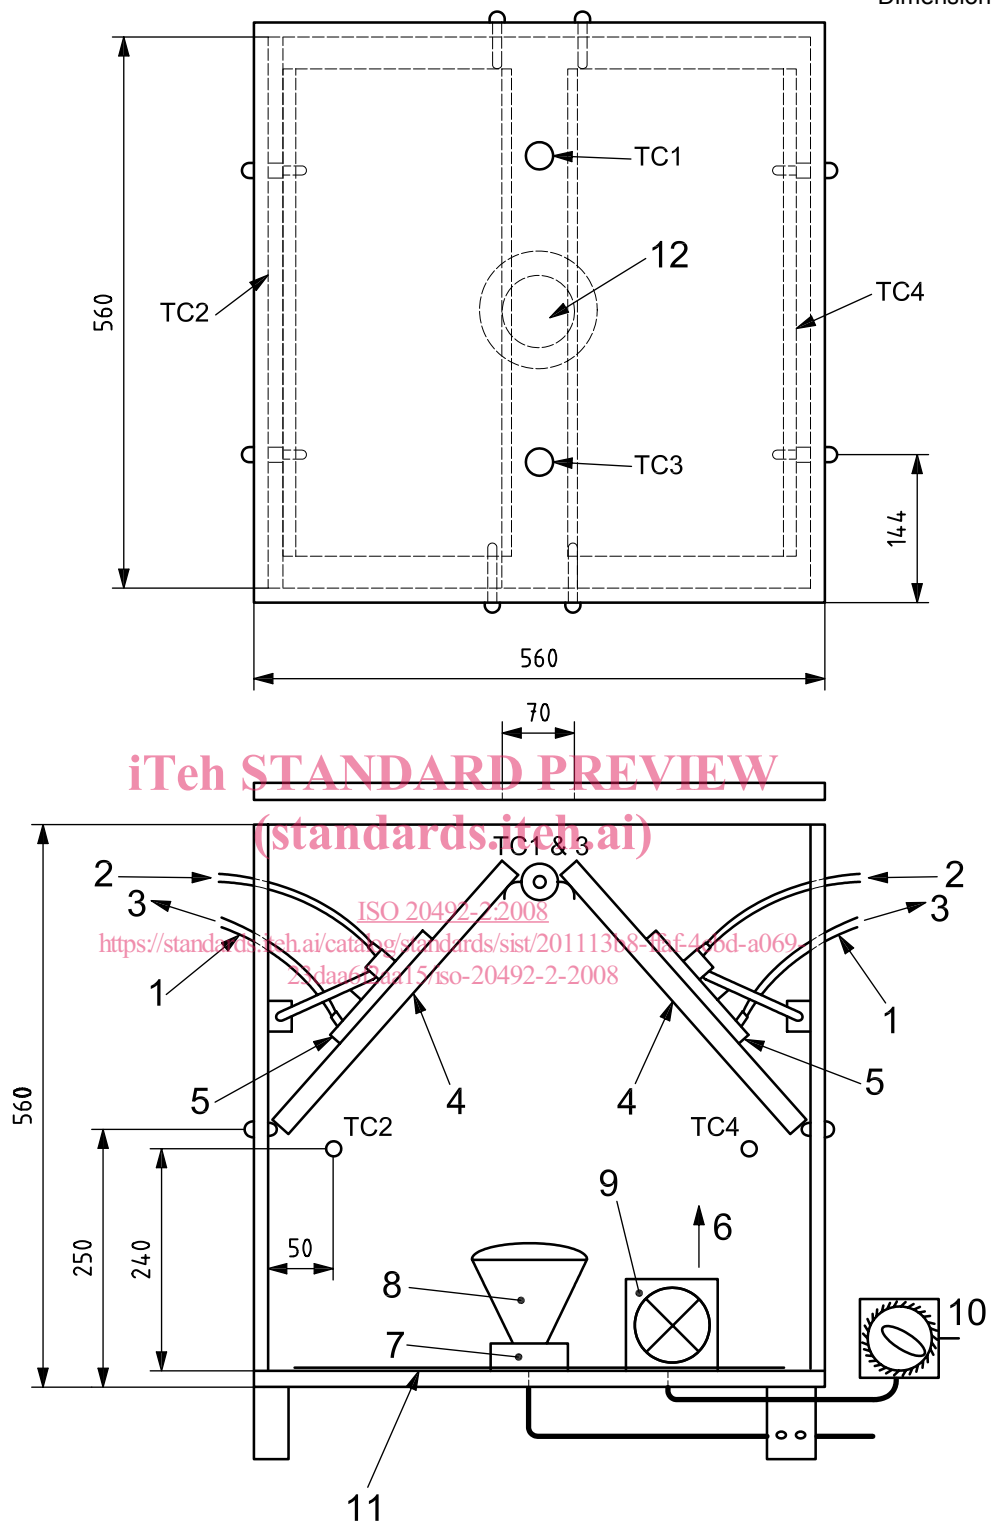

Key

- | | | | | | |
|------|----------------|---|-------------------------------|----|---|
| TC 1 | thermocouple 1 | 1 | cooling water measuring point | 7 | power socket |
| TC 2 | thermocouple 2 | 2 | water inlet | 8 | UV lamp |
| TC 3 | thermocouple 3 | 3 | water outlet | 9 | fan |
| TC 4 | thermocouple 4 | 4 | test specimens | 10 | auto transformer to fan |
| | | 5 | cooling plate | 11 | plywood box lined with aluminium foil or other reflective surface |
| | | 6 | air flow | 12 | vent hole |

Figure 2 — Volatile fogging exposure box