



SLOVENSKI STANDARD
oSIST prEN 1381:2014
01-julij-2014

Lesene konstrukcije - Metode preskušanja - Nosilni spoji s sponkami

Timber structures - Test methods - Load bearing stapled joints

Holzbauwerke - Prüfverfahren - Tragende Klammerverbindungen

Structures en bois - Méthodes d'essai - Assemblages agrafés porteurs

Ta slovenski standard je istoveten z: prEN 1381 rev

<https://standards.iteh.ai/catalog/standards/sist/ce0f0ff0-dc45-4148-a965-3a61729e91ee/sist-en-1381-2016>

ICS:

91.080.20 Lesene konstrukcije Timber structures

oSIST prEN 1381:2014

en,fr,de

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

DRAFT
prEN 1381 rev

April 2014

ICS 91.080.20

Will supersede EN 1381:1999

English Version

Timber structures - Test methods - Load bearing stapled joints

Structures en bois - Méthodes d'essai - Assemblages
agrafés porteurs

Holzbauwerke - Prüfverfahren - Tragende
Klammerverbindungen

This draft European Standard is submitted to CEN members for enquiry. It has been drawn up by the Technical Committee CEN/TC 124.

If this draft becomes a European Standard, CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

This draft European Standard was established by CEN in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

Recipients of this draft are invited to submit, with their comments, notification of any relevant patent rights of which they are aware and to provide supporting documentation.

Warning : This document is not a European Standard. It is distributed for review and comments. It is subject to change without notice and shall not be referred to as a European Standard.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

	Page
Foreword.....	3
1 Scope	4
2 Normative references	4
3 Terms and definitions	4
4 Symbols and abbreviations	5
5 Materials	6
5.1 Timber	6
5.2 Wood-based materials	6
5.3 Staples	6
6 Test methods.....	6
6.1 General.....	6
6.2 Conditioning.....	6
6.3 Fabrication of the test pieces	7
6.4 Preparation of the test pieces	7
6.4.1 Load parallel to grain	7
6.4.2 Load perpendicular to grain	7
6.5 Test procedure	7
6.6 Test Result.....	9
6.7 Test Report	9
Bibliography	10

SIST EN 1381:2016

<https://standards.iteh.ai/catalog/standards/sist/ce0f0ff0-dc45-4148-a965-3a61729e91ee/sist-en-1381-2016>

Foreword

This document (prEN 1381:2014) has been prepared by Technical Committee CEN/TC 124 “Timber Structures”, the secretariat of which is held by AFNOR.

This document is currently submitted to the CEN Enquiry.

This document will supersede EN 1381:1999.

Compared to EN 1381:1999, the following changes have been made

- replacement of EN 28970 by EN ISO 8970;
- improvement to figures.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1381:2016

<https://standards.iteh.ai/catalog/standards/sist/ce0f0ff0-dc45-4148-a965-3a61729e91ee/sist-en-1381-2016>

1 Scope

This standard specifies test methods for determining the strength and deformation characteristics of stapled joints in load-bearing timber structures.

The methods assess joints with members of timber (solid timber and glued laminated timber) or wood-based products in the combination proposed for use in service and using all types of staples up to 3 mm diameter for circular cross-section staples or 4 mm x 2 mm for rectangular or oval cross-section staples.

The methods determine load-slip characteristics and maximum load of joints with laterally loaded staples where various angles between the applied force and the timber grain direction or the main direction of the wood-based products, respectively, are possible.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 322, *Wood-based panels - Determination of moisture content*

EN 323, *Wood-based panels - Determination of density*

EN 26891:1991, *Timber structures - Joints made with mechanical fasteners - General principles for the determination of strength and deformation characteristics*

EN ISO 8970: 2010, *Timber structures - Testing of joints made with mechanical fasteners - Requirements for wood density* (ISO 8970)

EN 14592+A1:2012, *Timber Structures – Dowel-type-fasteners – Requirements*

ISO 3130, *Wood - Determination of moisture content for physical and mechanical tests*

ISO 3131, *Wood - Determination of density for physical and mechanical tests.*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1

staple

double-bent, u-shaped piece of round, square, rectangular or oval wire with pointed

3.2

staple crown

connection between the two staple legs.

3.3

staple leg diameter or side length

diameter of a round staple leg, the side length of a rectangular leg, or the diameter of an oval cross section as defined in EN 14592.

3.4

staple length

length of each staple leg, including point.

3.5

staple width

width across the staple legs, see Figure 1.

3.6

deformation of the joint

mean value of the measurements of the relative displacements of the two side members with respect to the central member.

4 Symbols and abbreviations

a staple crown width, see figure 1, in millimetres

b width of member cross-section, in millimetres

d nominal value of the diameter of a round staple leg, the side length of a rectangular leg, or the diameter of an oval cross section as defined in EN 14592, see Figure 1, in millimetres.

F load, in newtons

t member thickness, in millimetres

l staple length including the point, see figure 1, in millimetres

α_{cm} angle between the direction of a staple crown and the grain direction or the main direction of the wood-based products, respectively, see Figure 2, in degrees

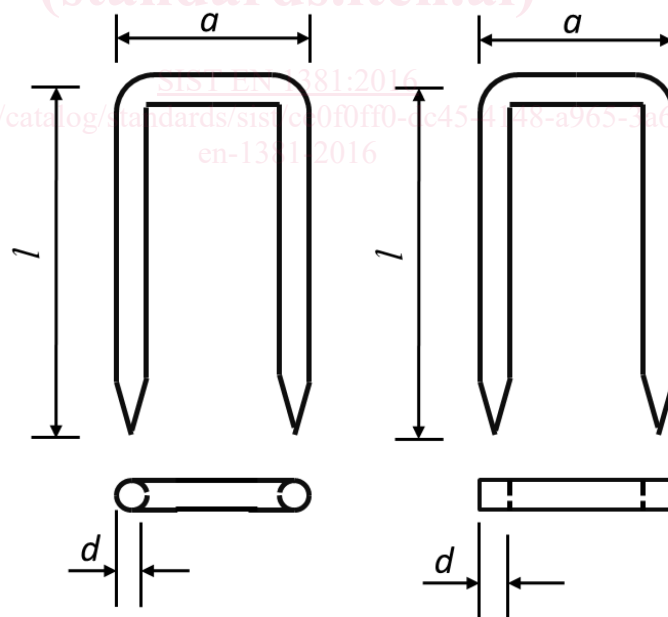


Figure 1 – Staple dimensions

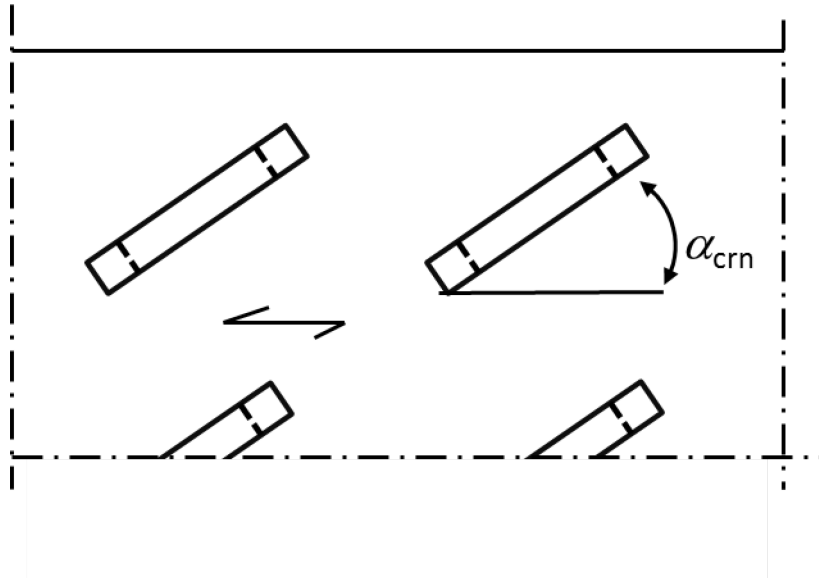


Figure 2 — Angle between the staple direction and the grain direction or the main direction of a wood-based product.

5 Materials

5.1 Timber

The timber (solid timber or glued laminated timber) shall be selected in accordance with the method given in EN ISO 8970. For each test piece, the density of the individual members to be joined shall not differ more than 10%. For a group of similar test pieces, separate planks shall be used for each test piece.

NOTE The members should be free from major defects which could lead to premature failure in the area away from the fasteners.

5.2 Wood-based materials

The specification of these products shall be established. The products used for the individual members of the test pieces shall be representative of the class or range of product to which they belong and the relevant properties shall be declared.

One unique grade shall be used to make the test pieces. For each test piece, the individual members in the joint shall be selected from separate pieces of material.

5.3 Staples

The technical specification of the staple wire and the staples shall be established if unknown.

6 Test methods

6.1 General

The moisture content and density of the timber or wood-based products members at test shall be determined as specified in ISO 3130, ISO 3131, EN 322 or EN 323 as appropriate.

6.2 Conditioning

In case of staples with smooth legs the test pieces shall be manufactured with the timber or wood-based products at an equilibrium moisture content corresponding to $(20 \pm 2) ^\circ\text{C}$ and $(85 \pm 5) \%$ relative humidity. The

material is conditioned when it attains constant mass. Constant mass is considered to be attained when, the results of two successive weightings, carried out at an interval of 6 h, do not differ by more than 0,1 % of the mass of the material.

After manufacture the test pieces shall be stored for at least one week at $(20 \pm 2) ^\circ\text{C}$ and $(65 \pm 5) \%$ relative humidity.

For other staples the test pieces shall be manufactured with the timber or wood-based products at an equilibrium moisture content corresponding to $(20 \pm 2) ^\circ\text{C}$ and $(65 \pm 5) \%$ relative humidity.

After manufacture the test pieces shall be stored at $(20 \pm 2) ^\circ\text{C}$ and $(65 \pm 5) \%$ relative humidity.

For certain investigations other moisture conditioning may be appropriate, and shall be reported.

NOTE For some deciduous wood species a much longer storing period may be necessary or the test pieces should be made with appropriate gaps between the members.

6.3 Fabrication of the test pieces

If there are no special requirements, timber elements shall be planed. Test pieces shall be fabricated with the staple leg perpendicular to the member surface. The insertion of the staples shall follow normal practice, which shall be reported.

NOTE The depth of staple crown indentation will have an influence on the test results, particular for joints loaded in double shear. The staples shall be inserted as prescribed in practice. It is not allowed that the staple crown protrudes above the surface.

6.4 Preparation of the test pieces

6.4.1 Load parallel to grain

For joints consisting solely of timber or wood-based products (or combinations thereof) the test pieces shall be made as three-member joints with four staples from each side, loaded in single shear, see Figure 3.

Test shall be made with test pieces with $\alpha_{\text{crn}} = 30^\circ$. If wood-based products are included in the test piece the test shall be carried out at either $\alpha_{\text{crn}} = 30^\circ$ or $\alpha_{\text{crn}} = 60^\circ$, whichever gives the smallest load carrying capacity.

NOTE The 50mm minimum end length shown in Figure 3 may not be appropriate to thin timber or wood-based products subjected to compression loads.

6.4.2 Load perpendicular to grain


For joints consisting solely of timber or wood-based products (or combinations thereof) the test pieces shall be made as three-member joints with four staples from each side, loaded in single shear, see Figures 4 and 5.

Test shall be made with test pieces with $\alpha_{\text{crn}} = 30^\circ$. If wood-based products are included in the test piece the test shall be carried out at either $\alpha_{\text{crn}} = 30^\circ$ or $\alpha_{\text{crn}} = 60^\circ$, whichever gives the smallest load carrying capacity.

6.5 Test procedure

The tests shall be carried out in accordance with clause 7 and 8 of EN 26891:1991 with the following additions:


- a) if compressive test pieces are used, instability of the members shall be prevented and
- b) the separation of the side members in combination with pulling out the staple shall not be significantly hindered by the loading equipment.

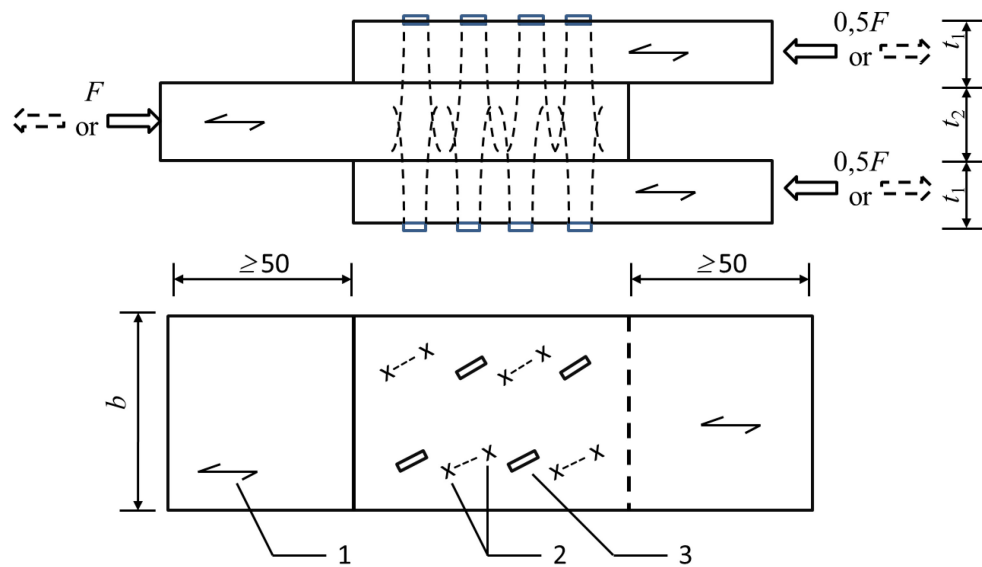**Key:**

- 1) Grain direction.
- 2) Staple point.
- 3) Staple crown.

Dimensions in millimetres

Figure 3 — Three-member joint, single shear, loaded in tension or compression. (This figure shows a joint in which $\alpha_{cm} = 30^\circ$.)

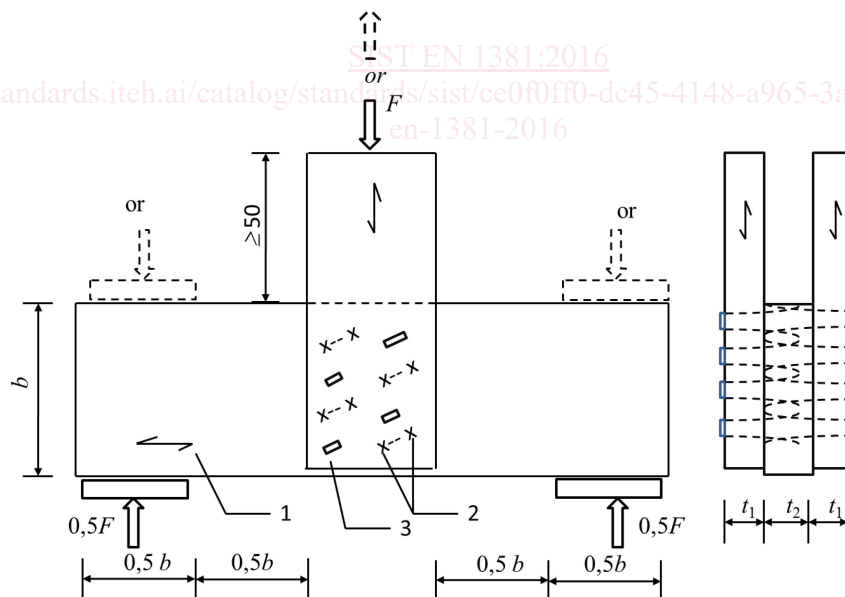**Key:**

- 1) Grain direction.
- 2) Staple point.
- 3) Staple crown.

Dimensions in millimetres

Figure 4 — Single shear test piece loaded in tension or compression - centre member loaded perpendicular to the grain. (This figure shows a joints in which $\alpha_{cm} = 30^\circ$.)