
Testing of concrete —

Part 5:

**Properties of hardened concrete other
than strength**

Essais du béton —

Partie 5: Caractéristiques du béton durci autres que la résistance
(standards.iteh.ai)

ISO 1920-5:2004

<https://standards.iteh.ai/catalog/standards/sist/1e70be4a-665d-4d60-b776-2fe5da09bb81/iso-1920-5-2004>



PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 1920-5:2004

<https://standards.iteh.ai/catalog/standards/sist/1e70be4a-665d-4d60-b776-2fe5da09bb81/iso-1920-5-2004>

© ISO 2004

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword.....	iv
1 Scope	1
2 Normative references	1
3 Definitions	1
4 Determination of density of hardened concrete	1
4.1 General	1
4.2 Apparatus	1
4.3 Test specimens	2
4.4 Procedures	2
4.5 Test result	4
4.6 Test Report	5
5 Determination of the depth of penetration of water under pressure	6
5.1 Principle	6
5.2 Apparatus	6
5.3 Test specimen	8
5.4 Procedure	8
5.5 Test result	9
5.6 Test report	9
6 Test report	9
Annex A (informative) Precision for the method of determination of the density	10
Annex B (informative) Example of test reports	11

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 1920-5 was prepared by Technical Committee ISO/TC 71, *Concrete, reinforced concrete and pre-stressed concrete*, Subcommittee SC 1, *Test methods for concrete*.

This first edition of ISO 1920-5 cancels and replaces ISO 6275:1982 which has been technically revised.

ISO 1920 consists of the following parts, under the general title *Testing of concrete*:

- *Part 1: Sampling of fresh concrete* [ISO 1920-5:2004](https://standards.iteh.ai/catalog/standards/sist/1e70be4a-665d-4d60-b776-2fe5da09bb81/iso-1920-5-2004)
- *Part 2: Properties of fresh concrete*
- *Part 3: Making and curing test specimens*
- *Part 5: Properties of hardened concrete other than strength*
- *Part 6: Sampling, preparing and testing concrete cores*
- *Part 7: Non-destructive tests of hardened concrete*

Part 4, *Strength of hardened concrete*, is in preparation.

Testing of concrete —

Part 5: Properties of hardened concrete other than strength

1 Scope

This part of ISO 1920 specifies procedures for testing properties of hardened concrete other than strength.

2 Normative references

The following referenced document is essential for the application of this document. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 1920-3, *Testing Concrete — Part 3: Making and curing test specimens*

iTeh STANDARD PREVIEW
(standards.iteh.ai)

3 Definitions

For the purpose of this document, the following definition applies.

3.1 density

ratio of the mass of a given quantity of hardened concrete to its volume

NOTE The density is expressed in kilograms per cubic metre.

4 Determination of density of hardened concrete

4.1 General

This test method is applicable to lightweight, normal-weight and heavy-weight concrete.

It differentiates between hardened concrete in the following states:

- as-received;
- saturated;
- oven-dried.

The mass and the volume of the specimen of hardened concrete are determined and the density calculated.

4.2 Apparatus

4.2.1 Callipers and rules, capable of determining the dimensions of a specimen to within $\pm 0,5$ %.

4.2.2 Balance. equipped with a stirrup for weighing the specimen in both air and water to an accuracy of 0,1 % of the mass (see Figure 1).

4.2.3 Water tank, fitted with a device to maintain the water at a constant level and of sufficient size to allow the specimen on the stirrup to be fully immersed to constant depth (see Figure 1).

4.2.4 Ventilated oven, for which the temperature can be maintained at $105\text{ °C} \pm 5\text{ °C}$.

4.3 Test specimens

The minimum volume of a specimen shall be 1 l. If the nominal maximum aggregate size exceeds 25 mm, the minimum volume of the specimen, in cubic millimetres, shall be not less than $50D^3$, where D is the nominal maximum size of the coarse aggregate.

Normally, the entire specimen as received should be used for the determination of the density.

If the shape or size of a specimen is such that it is not possible to use all of it, a smaller specimen, conforming to the requirements given above, may be sawn from the original.

4.4 Procedures

4.4.1 General

4.4.1.1 Calibration of the apparatus

The apparatus used shall be in calibration at time of use. The balance, the device for weighing specimens in water and the oven should be calibrated at least once per year.

4.4.1.2 Determination of mass

This part of ISO 1920 permits three conditions under which the mass of a specimen can be determined:

- a) as-received;
- b) water-saturated;
- c) oven-dried.

4.4.1.3 Determination of volume

This part of ISO 1920 permits three methods for determining the volume of the specimen:

- a) by water displacement (reference method);
- b) by calculation, using actual measurements;
- c) for cubes, by calculation, using checked designated dimensions.

4.4.2 Mass of as-received specimen

Weigh the as-received specimen, to an accuracy of 0,1 % of the mass of the specimen.

Record the value, expressed in kilograms, as m_r .

4.4.3 Mass of water-saturated specimen

Immerse the specimen in water at $20\text{ °C} \pm 2\text{ °C}$ until the mass changes by less than 0,2 % in 24 h. Before each weighing, wipe the surplus water from the surface using a moist cloth.

Specimens of normal-weight concrete cured in water continuously for at least 72 h prior to testing may be assumed to satisfy this requirement.

Record the value, expressed in kilograms, of saturated mass as m_s .

4.4.4 Mass of oven-dried specimen

Dry the specimen in a ventilated oven at $105\text{ °C} \pm 5\text{ °C}$ until the mass changes by less than 0,2 % in 24 h.

Before each weighing, cool the specimen to near room temperature in a dry airtight vessel or desiccator.

Record the value, expressed in kilograms, of the oven-dried mass as m_o .

4.4.5 Volume obtained by water displacement

4.4.5.1 General

This method is suitable for specimens of all shapes and is the only method suitable for specimens of irregular shape.

The specimen shall be in a saturated condition.

This method is not suitable for specimens of no-fines concrete, concrete made with lightweight aggregate that floats in water, concrete with large pores, or specimens the moisture content of which is not to be altered. However, if an impermeable layer is applied to the specimen, this method may be used.

4.4.5.2 Mass in water

Allow the hydrostatic device of the balance to reach equilibrium. Ensure that the empty stirrup hanging from the balance is completely immersed in the water tank and that the stirrup is not touching the bottom of the tank.

Record the depth of the immersion of the stirrup and the apparent mass, in kilograms, of the stirrup as m_{st} .

Place the specimen in the stirrup and fully immerse in water to the same depth as the empty stirrup.

Take care to avoid trapping air bubbles on the sides of the sample and on the stirrup.

Weigh the completely immersed specimen and stirrup. Record $(m_{st} + m_w)$, the apparent mass, in kilograms.

4.4.5.3 Mass in air

Remove the specimen from the stirrup, and wipe the surplus water from the surfaces using a damp cloth. Weigh the specimen on the balance.

Record the mass, in kilograms, of the specimen in air as m_a .

4.4.5.4 Calculation of volume

Calculate the volume of the specimen using Equation (1):

$$V = \frac{m_a - [(m_{st} + m_w) - m_{st}]}{\rho_w} \quad (1)$$

where

V is the volume, in cubic metres, of the specimen;

m_a is the mass, in kilograms, of the specimen in air;

m_{st} is the apparent mass, in kilograms, of the immersed stirrup,;

m_w is the apparent mass, in kilograms, of the immersed specimen;

ρ_w is the density of water, in kilograms per cubic metre, at 20 °C, taken as 998 kg/m³.

4.4.6 Volume, using actual measurements

Only undamaged, prismatic, or cylindrical specimens shall be used for the calculation of volume.

Where there is no documentation to show that a specimen has been cast in a calibrated mould, each dimension shall be measured in accordance with ISO 1920-3.

The average of the actual measurements taken and recorded for each dimension shall be used to calculate the volume, V , in cubic metres, of the specimen, rounded to four significant figures.

4.4.7 Volume, using checked designated dimensions

Only undamaged, prismatic, or cylindrical specimens shall be used for the calculation of volume.

Where specimens have documentation to show that they have been made in calibrated moulds (see ISO 1920-3), it shall be necessary only to check that each dimension is within $\pm 0,5$ % of the designated size.

The volume, V , of the specimen shall be calculated from the designated dimensions, and expressed in cubic metres, rounded to four significant figures.

4.5 Test result

Calculate the density using the value determined for the mass of specimen and its volume, using Equation (2):

$$D = \frac{m}{V} \quad (2)$$

where


D is the density, in kilograms per cubic metre, related to the condition of the specimen and the method of determining the volume;

m is the mass, in kilograms, of the specimen in its condition at the time of test;

V is the volume, in cubic metres, determined by the particular method.

Report the condition of the specimen at the time of test (see 4.4.1.2) and the method used for determining the volume of the specimen (see 4.4.1.3).

Express the result of the density determination to the nearest 10 kg/m³.

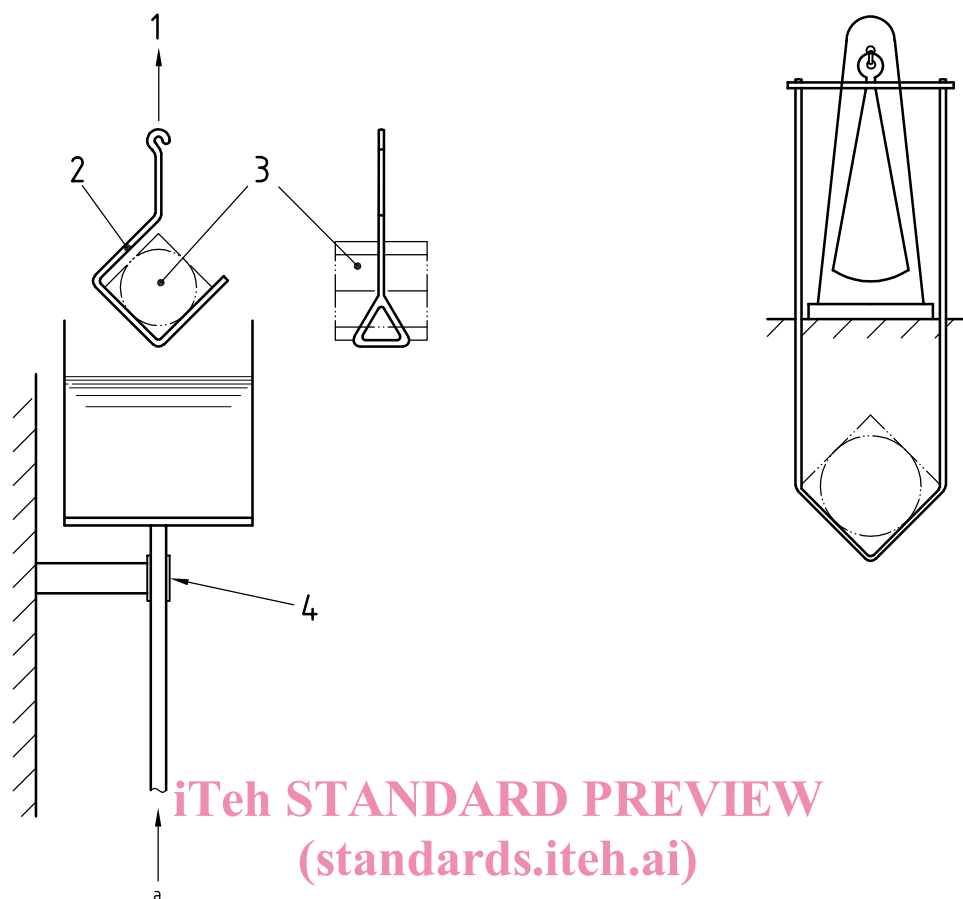

ISO 1920-5:2004
<https://standards.iteh.ai/catalog/standards/sist/1e70be4a-665d-4d60-b776-2fe5da09bb81/iso-1920-5-2004>

Key

- 1 balance
- 2 stirrup
- 3 concrete specimen
- 4 guide
- a Water tank is moved vertically.

Figure 1 — Typical stirrup arrangement for the determination of the volume of concrete specimens by water displacement — Stirrup suspended beneath the balance mechanism a) and alternate form of stirrup suspended above the balance mechanism b)

4.6 Test Report

In addition to the requirements in Clause 6, the test report shall include the following:

- description of the specimen (e.g. 100 mm cube, 150 mm diameter core);
- condition of specimen at time of test (as-received/saturated/oven-dried);
- time/date of determination of mass and volume;
- mass of specimen;
- method of determination of volume (checked designated size/measured size/water displacement);
- volume of specimen;