
Izvedba jeklenih in aluminijastih konstrukcij - 4. del: Tehnične zahteve za hladno oblikovane konstrukcijske jeklene elemente in hladno oblikovane konstrukcijske elemente za strešne, stropne, talne in stenske konstrukcije

Execution of steel structures and aluminium structures - Part 4: Technical requirements for cold-formed structural steel elements and cold-formed structures for roof, ceiling, floor and wall applications

Ausführung von Stahltragwerken und Aluminiumtragwerken - Teil 4: Technische Anforderungen an tragende, kaltgeformte Bauelemente aus Stahl und tragende, kaltgeformte Bauteile für Dach-, Decken-, Boden- und Wandanwendungen

[SIST EN 1090-4:2018](https://standards.iteh.ai/catalog/standards/sist/2fcce3ca-8a95-477b-b2f3-552222222222/sist-en-1090-4:2018)

Exécution des structures en acier et des structures en aluminium - Partie 4 : Exigences techniques pour éléments et structures en acier formés à froid pour applications en toiture, plafond, paroi verticale et plancher

Ta slovenski standard je istoveten z: EN 1090-4:2018

ICS:

91.080.13	Jeklene konstrukcije	Steel structures
91.080.17	Aluminijaste konstrukcije	Aluminium structures

SIST EN 1090-4:2018

en,fr,de

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1090-4:2018

<https://standards.iteh.ai/catalog/standards/sist/2fccc3ca-8a95-477b-b2b-f534ec72bcde/sist-en-1090-4-2018>

EUROPEAN STANDARD

EN 1090-4

NORME EUROPÉENNE

EUROPÄISCHE NORM

July 2018

ICS 91.010.30; 91.080.13; 91.080.17

English Version

Execution of steel structures and aluminium structures - Part 4: Technical requirements for cold-formed structural steel elements and cold-formed structures for roof, ceiling, floor and wall applications

Exécution des structures en acier et des structures en aluminium - Partie 4 : Exigences techniques pour éléments et structures en acier formés à froid pour applications en toiture, plafond, paroi verticale et plancher

Ausführung von Stahltragwerken und Aluminiumtragwerken - Teil 4: Technische Anforderungen an tragende, kaltgeformte Bauelemente aus Stahl und tragende, kaltgeformte Bauteile für Dach-, Decken-, Boden- und Wandanwendungen

This European Standard was approved by CEN on 6 February 2017.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents

Page

European foreword.....	7
1 Scope	8
2 Normative references	10
3 Terms, definitions, symbols and abbreviations	13
3.1 Terms and definitions	13
3.2 Symbols and abbreviations	14
4 Specifications and documentation	16
4.1 Execution Specification	16
4.1.1 General	16
4.1.2 Execution classes	16
4.1.3 Layout drawings	16
4.1.4 Geometrical tolerances	17
4.2 Installer's Documentation	18
4.2.1 General	18
4.2.2 Quality documentation	18
4.2.3 Safety of the erection works	18
4.3 Detailed traceability documentation	18
4.4 Execution documentation	18
5 Constituent products	18
5.1 General	18
5.2 Identification, inspection documents and traceability	19
5.3 Materials	19
5.4 Thickness tolerances	21
5.5 Minimum nominal sheet thicknesses	21
5.5.1 Profiled sheets	21
5.5.2 Structural members	22
5.6 Geometrical tolerances	22
5.7 Mechanical fasteners	22
5.7.1 General	22
5.7.2 Type of fasteners and materials	23
5.8 Accessories	24
5.9 Surface protection	24
5.10 External fire performance for roofing elements	24
5.11 Reaction to fire	24
5.12 Resistance to fire	24
5.13 Release of dangerous substances	24
5.14 Lightning protection	24
6 Manufacturing	24
6.1 General	24
6.2 Identification	25
6.3 Cold forming	25
6.4 Cutting	25
6.4.1 General	25
6.4.2 Shearing and nibbling	25
6.4.3 Thermal cutting	25

6.5	Punching	25
6.5.1	General	25
6.5.2	Execution	26
7	Welding	27
7.1	Welding of customized cold rolled hollow sections	27
7.1.1	General	27
7.1.2	Qualification of welding procedures and welding personnel	27
7.1.3	Geometrical tolerances	28
7.1.4	Inspection and testing of welded custom cold rolled sections	28
7.2	Spot welding	28
7.3	Welding at the construction site	29
8	Mechanical fastening	29
8.1	General	29
8.2	Use of self-tapping and self-drilling screws	29
8.3	Use of blind rivets	30
8.4	Use of cartridge fired pins	30
8.5	Attachment of cold formed structural members and sheeting to the supporting member	31
8.5.1	Types of connections and attachments	31
8.5.2	Attachment of profiled sheets to the supporting member transverse to the direction of span	31
8.5.3	Attachment of profiled sheets to the supporting member parallel to the direction of sheeting's span	33
8.5.4	Supporting member made of metal	33
8.5.5	Supporting member made of timber or other wood-based materials	33
8.5.6	Supporting member made of concrete or masonry	33
8.6	Connecting profiled sheets	33
8.7	Edge distances and spacing of fasteners for sheeting	34
8.7.1	General	34
8.7.2	Edge spacings of webs of trapezoidal sheeting and liner tray profiles	34
9	Erection	34
9.1	General	34
9.2	Site conditions	35
9.3	Training/instruction of installation personnel	35
9.4	Inspection of preceding works	35
9.5	Layout drawing	35
9.6	Tools required	36
9.7	Safety on site	36
9.8	Inspection of packaging and contents	36
9.9	Storage	36
9.10	Damaged structural members and sheeting and connecting devices	37
9.11	Unloading, lifting gear/slings/straps	37
9.12	Laying	37
9.13	Direction of lay	38
9.14	Maintaining the cover width during installation	38
9.15	Condition after installation (swarf from drilling, fouling of surface, protective film wrap)	38
9.16	Inspection after installation	38
9.17	Diaphragms	38
9.18	Protection against lightning	39
10	Surface protection	39

10.1	Corrosion protection.....	39
10.2	Cleaning and maintenance.....	40
10.2.1	Organic coated products.....	40
10.2.2	Metallic coated products	40
10.2.3	Stainless steel	40
11	Geometrical tolerances.....	40
11.1	General.....	40
11.2	Tolerance types.....	41
11.3	Essential tolerances	41
11.3.1	General.....	41
11.3.2	Manufacturing tolerances	41
11.3.3	Erection tolerances.....	41
11.4	Functional tolerances	42
12	Inspection, testing and correction	42
12.1	General.....	42
12.2	Structural members, profiled sheets and fasteners	42
12.2.1	General.....	42
12.2.2	Non-conforming products.....	42
12.3	Manufacturing: geometrical dimensions of manufactured structural members and sheeting.....	42
12.3.1	General.....	42
12.3.2	Profiled sheets.....	42
12.3.3	Members.....	43
12.4	Inspection of the installed structure.....	44
12.5	Inspection of fastening.....	44
12.5.1	Self-tapping and self-drilling screws.....	44
12.5.2	Blind rivets	44
12.5.3	Cartridge fired pins.....	44
12.5.4	Bolted Connections.....	44
	Annex A (normative) Basic requirements for profiled sheeting.....	45
A.1	General.....	45
A.2	Supporting members	45
A.2.1	Materials.....	45
A.2.2	Shear forces/fixed points	45
A.3	Edges of laying area.....	45
A.3.1	Longitudinal decking edge trims.....	45
A.3.2	Weakening of the cross section.....	46
A.3.3	Reinforcements and double layers	46
A.3.4	Avoidance of ice damming	47
A.4	Building physics requirements	48
A.4.1	General.....	48
A.4.2	Water permeability	48
A.4.3	Thermal insulation	48
A.4.4	Avoidance of condensation / moisture protection	48
A.4.4.1	General.....	48

A.4.4.2 Measures against convection	49
A.4.5 Airborne sound insulation (R_w).....	49
A.4.6 Sound absorption (α_w).....	49
A.4.7 Protection against lightning	49
A.5 Roof drainage.....	50
Annex B (normative) Additional design requirements for profiled sheeting	52
B.1 General	52
B.2 Serviceability.....	52
B.3 Widths of supports	52
B.4 Supports made of concrete or masonry	53
B.5 Eccentric attachments.....	54
B.6 Stiffening of liner trays	55
B.7 Walkability.....	56
B.7.1 Walkability during installation	56
B.7.2 Walkability and access after installation.....	56
B.7.3 Test “Walkability”	56
B.8 Moment-resisting connection	58
B.9 Rotational restraint	60
B.10 Cantilevers	60
B.11 Openings in laying area	62
Annex C (informative) Documentation	65
Annex D (normative) Geometrical tolerances.....	66
D.1 General	66
D.2 Essential and functional manufacturing tolerances — Cold-formed profiled sheets.....	66
D.3 Essential and functional manufacturing tolerances — cold formed members including custom cold rolled hollow sections	70
D.3.1 Press braked or folded members.....	70
D.3.2 Roll formed members	72
Annex E (normative) Corrosion protection by metallic coating with or without organic coatings	73
E.1 Corrosion protection	73
E.2 Suitability of corrosion protection	76
E.2.1 Selection.....	76
E.2.2 Examination of suitability (initial inspection).....	82
E.2.2.1 General	82
E.2.2.2 Coating mass / coating thickness.....	82
E.2.2.3 Condensed-water test	83

EN 1090-4:2018 (E)

E.2.2.4 Salt spray test	83
E.2.2.5 Adhesive strength of coil coating after cupping.....	83
E.2.2.6 Testing of workability and formability, crack testing after bending	83
E.2.3 Monitoring.....	84
E.2.3.1 General.....	84
E.2.3.2 Type testing.....	84
E.2.3.3 Factory production control (FPC)	84
E.2.4 Galvanic corrosion.....	85
Annex F (normative) Additional information	88
F.1 List of required additional information.....	88
F.2 List of additional information if not otherwise specified.....	88
Bibliography.....	90

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1090-4:2018

<https://standards.iteh.ai/catalog/standards/sist/2fccc3ca-8a95-477b-b2b-f534ec72bcdc/sist-en-1090-4-2018>

European foreword

This document (EN 1090-4:2018) has been prepared by Technical Committee CEN/TC 135 “Execution of steel structures and aluminium structures”, the secretariat of which is held by SN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by January 2019, and conflicting national standards shall be withdrawn at the latest by January 2019.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document is part of the EN 1090 series, which comprises the following parts:

- EN 1090-1, *Execution of steel structures and aluminium structures - Part 1: Assessment and verification of constancy of performance for structural components*
- EN 1090-2, *Execution of steel structures and aluminium structures - Part 2: Technical requirements for steel structures*
- EN 1090-3, *Execution of steel structures and aluminium structures - Part 3: Technical requirements for aluminium structures*
- EN 1090-4, *Execution of steel structures and aluminium structures - Part 4: Technical requirements for cold-formed structural steel elements and cold-formed structures for roof, ceiling, floor and wall applications*
- EN 1090-5, *Execution of steel structures and aluminium structures - Part 5: Technical requirements for cold-formed structural aluminium elements and cold-formed structures for roof, ceiling, floor and wall applications*

According to the CEN-CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

EN 1090-4:2018 (E)**1 Scope**

This European Standard specifies requirements for the execution, i.e. the manufacture and the installation, of cold-formed structural steel members and sheeting and cold-formed structures for roof, ceiling, floor, wall and cladding applications.

This European Standard applies to structures designed according to the EN 1993 series.

This European Standard applies to structural members and sheeting to be designed according to EN 1993-1-3.

This European Standard may be used for structures designed according to other design rules provided that conditions for execution comply with them and any necessary additional requirements are specified.

This European Standard also specifies requirements for the execution i.e. the manufacture and the installation of structures made from cold formed profiled sheeting for roof, ceiling, floor and wall applications under predominately static loading or seismic loading conditions and their documentation.

This European Standard covers sheeting of structural classes I and II according to EN 1993-1-3 used in structures.

This European Standard covers structural members of all structural classes according to EN 1993-1-3.

Structural sheeting are understood here to be:

- profiled sheet, such as trapezoidal, sinusoidal or liner trays (Figure 1), or

Structural members are understood here to be:

- members (linear profiled cross sections) that are produced by cold forming (Figure 2).

This European Standard also covers:

- not welded built-up sections (Figure 2b and 2c);
- cold-formed hollow sections including the welding of the longitudinal seam, not covered by EN 10219-1;
- perforated, punctured and micro profiled sheeting and members;

NOTE 1 Welded built-up sections, are not covered, the execution provisions are given in EN 1090-2.

This European Standard also covers spacer constructions between the outer and inner or upper and lower skins for roofs, walls and ceilings made from cold-formed profiled sheeting and the connections and attachments of the afore mentioned elements as long as all are involved in load transfer.

This European Standard covers steel profiled sheeting for composite floors, e.g. during installation and in stage of pouring concrete.

Composite structural members where the interaction between dissimilar materials are an integral part of the structural behaviour such as sandwich panels and composite floors are not covered by this standard.

This European Standard does not cover the necessary analyses and detailing and execution rules for thermal insulation, moisture protection, noise control and fire protection.

This European Standard does not cover regulations of roof cladding and wall cladding, produced by traditional plumber methods or tinsmith methods.

Annex B of this standard concerns provisions which are not yet included in EN 1993-1-3. The guidelines in this annex may be wholly or partially superseded by future guidelines added to EN 1993.

This European Standard does not cover detailed requirements for water tightness or air permeability resistance and thermal aspects of sheeting.

NOTE 2 The structures covered in this standard can be for example

- single- or multi-skin roofs, whereby the load-bearing structure (lower skin) or the actual roof covering (upper skin) or both consist of cold-formed structural members and sheeting;
- single- or multi-skin walls whereby the load-bearing structure (inner skin), the actual cladding (outer skin) or both consist of cold-formed structural members and sheeting, or
- trusses from cold formed members.

NOTE 3 Structures can consist of an assembly of structural members and sheeting made of steel according to EN 1090-4 and of aluminium according to EN 1090-5.

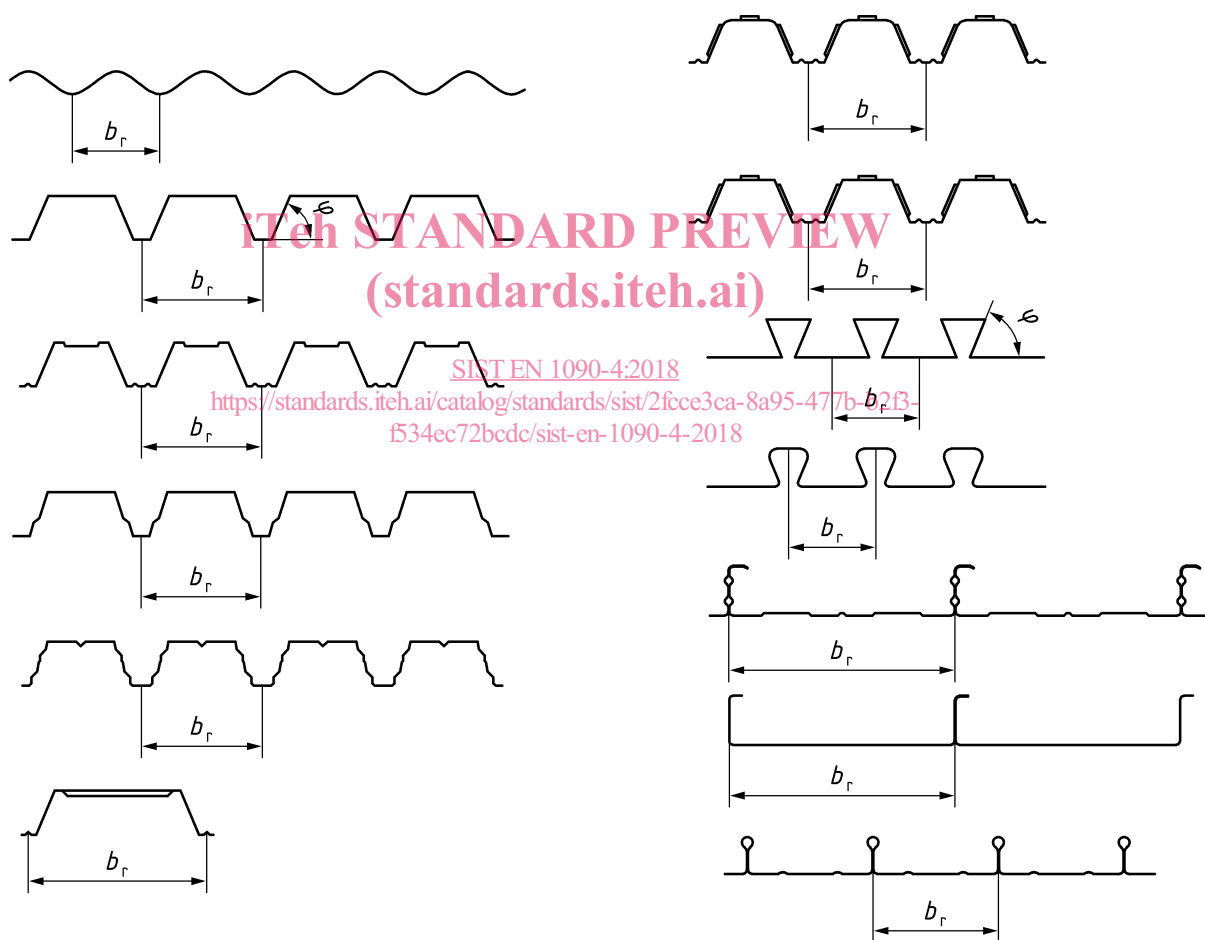


Figure 1 — Examples of profiled sheets

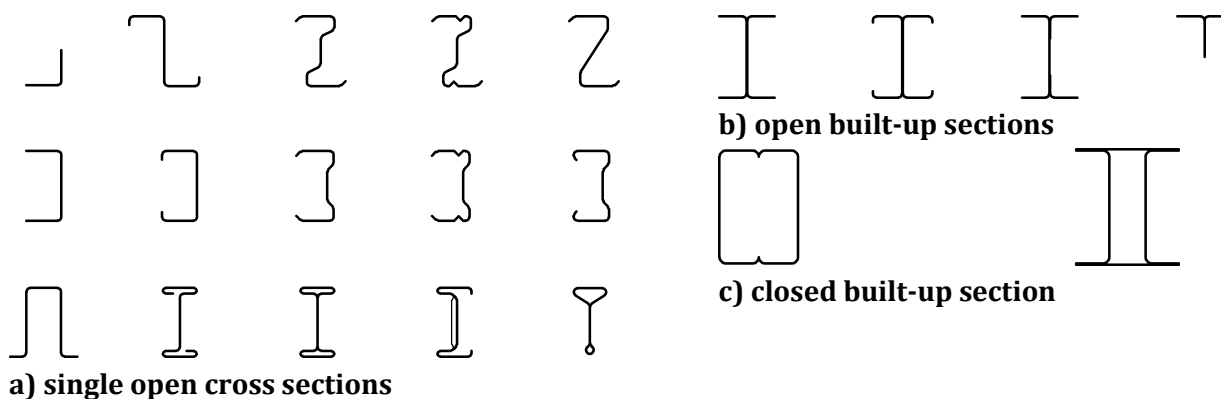


Figure 2 — Examples of linear profile cross sections

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 508-1, *Roofing and cladding products from metal sheet — Specification for self-supporting of steel, aluminium or stainless steel sheet — Part 1: Steel*

EN 508-3, *Roofing products from metal sheet — Specification for self-supporting products of steel, aluminium or stainless steel sheet — Part 3: Stainless steel*

EN 1090-1, *Execution of steel structures and aluminium structures — Part 1: Requirements for conformity assessment of structural elements*

EN 1090-2:2008+A1:2011, *Execution of steel structures and aluminium structures — Part 2: Technical requirements for steel structures*

EN 1991 (all parts), *Eurocode 1: Actions on structures — Part 1-1: General actions — Densities, self-weight, imposed loads for buildings*

EN 1993-1-1:2005, *Eurocode 3: Design of steel structures — Part 1-1: General rules and rules for buildings*

EN 1993-1-3:2006, *Eurocode 3 — Design of steel structures — Part 1-3: General rules — Supplementary rules for cold-formed members and sheeting*

EN 1993-1-4:2006, *Eurocode 3 — Design of steel structures — Part 1-4: General rules — Supplementary rules for stainless steels*

EN 1995-1-1, *Eurocode 5: Design of timber structures — Part 1-1: General — Common rules and rules for buildings*

EN 10143, *Continuously hot-dip coated steel sheet and strip — Tolerances on dimensions and shape*

EN 10152, *Electrolytically zinc coated cold rolled steel flat products for cold forming — Technical delivery conditions*

- EN 10162:2003, *Cold rolled steel sections — Technical delivery conditions — Dimensional and cross-sectional tolerances*
- EN 10169:2010+A1:2012, *Continuously organic coated (coil coated) steel flat products — Technical delivery conditions*
- EN 10204, *Metallic products — Types of inspection documents*
- EN 10346, *Continuously hot-dip coated steel flat products for cold forming — Technical delivery conditions*
- EN 13523-1, *Coil coated metals — Test methods — Part 1: Film thickness*
- EN 13523-6, *Coil coated metals — Test methods — Part 6: Adhesion after indentation (cupping test)*
- EN 13523-7:2014, *Coil coated metals — Test methods — Part 7: Resistance to cracking on bending (T-bend test)*
- EN 13523-8, *Coil coated metals — Test methods — Part 8: Resistance to salt spray (fog)*
- EN 13523-10, *Coil coated metals — Test methods — Part 10: Resistance to fluorescent UV radiation and water condensation*
- EN 13523-19, *Coil coated metals — Test methods — Part 19: Panel design and method of atmospheric exposure testing*
- EN 13523-21, *Coil coated metals — Test methods — Part 21: Evaluation of outdoor exposed panels*
- EN 13523-26, *Coil coated metals — Test methods — Part 26: Resistance to condensation of water*
- EN 62305-3, *Protection against lightning — Part 3: Physical damage to structures and life hazard (IEC 62305-3)*
- EN 62561-1, *Lightning Protection System Components (LPSC) — Part 1: Requirements for connection components (IEC 62561-1)*
- EN ISO 717-1, *Acoustics — Rating of sound insulation in buildings and of building elements — Part 1: Airborne sound insulation (ISO 717-1)*
- EN ISO 1461, *Hot dip galvanized coatings on fabricated iron and steel articles — Specifications and test methods (ISO 1461)*
- EN ISO 2081, *Metallic and other inorganic coatings — Electroplated coatings of zinc with supplementary treatments on iron or steel (ISO 2081)*
- EN ISO 2409, *Paints and varnishes — Cross-cut test (ISO 2409)*
- EN ISO 2808, *Paints and varnishes — Determination of film thickness (ISO 2808)*
- EN ISO 2810, *Paints and varnishes — Natural weathering of coatings — Exposure and assessment (ISO 2810)*
- EN ISO 3452-1, *Non-destructive testing — Penetrant testing — Part 1: General principles (ISO 3452-1)*

EN 1090-4:2018 (E)

- EN ISO 3834 (all parts), *Quality requirements for fusion welding of metallic materials (ISO 3834)*
- EN ISO 4042, *Fasteners — Electroplated coatings (ISO 4042)*
- EN ISO 4136, *Destructive tests on welds in metallic materials — Transverse tensile test (ISO 4136)*
- EN ISO 5173, *Destructive tests on welds in metallic materials — Bend tests (ISO 5173)*
- EN ISO 6270-1, *Paints and varnishes — Determination of resistance to humidity — Part 1: Continuous condensation (ISO 6270-1)*
- EN ISO 6507 (all parts), *Metallic materials — Vickers hardness test — Part 1: Test method (ISO 6507)*
- EN ISO 8492, *Metallic materials — Tube — Flattening test (ISO 8492)*
- EN ISO 8493, *Metallic materials — Tube — Drift-expanding test (ISO 8493)*
- EN ISO 9227, *Corrosion tests in artificial atmospheres — Salt spray tests (ISO 9227)*
- EN ISO 9712, *Non-destructive testing — Qualification and certification of NDT personnel (ISO 9712)*
- EN ISO 11654, *Acoustics — Sound absorbers for use in buildings — Rating of sound absorption (ISO 11654)*
- EN ISO 12944-2, *Paints and varnishes — Corrosion protection of steel structures by protective paint systems — Part 2: Classification of environments (ISO 12944-2)*
- EN ISO 12944-4, *Paints and varnishes — Corrosion protection of steel structures by protective paint systems — Part 4: Types of surface and surface preparation (ISO 12944-4)*
- EN ISO 12944-6, *Paints and varnishes — Corrosion protection of steel structures by protective paint systems — Part 6: Laboratory performance test methods (ISO 12944-6)*
- EN ISO 12944-7, *Paints and varnishes — Corrosion protection of steel structures by protective paint systems — Part 7: Execution and supervision of paint work (ISO 12944-7)*
- EN ISO 14554 (all parts), *Quality requirements for welding — Resistance welding of metallic (ISO 14554)*
- EN ISO 14713 (all parts), *Zinc coatings — Guidelines and recommendations for the protection against corrosion of iron and steel in structures (ISO 14713)*
- EN ISO 14731, *Welding coordination — Tasks and responsibilities (ISO 14731)*
- EN ISO 14732, *Welding personnel — Qualification testing of welding operators and weld setters for mechanized and automatic welding of metallic materials (ISO 14732)*
- EN ISO 15607, *Specification and qualification of welding procedures for metallic materials — General rules (ISO 15607)*
- EN ISO 17639, *Destructive tests on welds in metallic materials — Macroscopic and microscopic examination of welds (ISO 17639)*
- EN ISO 17872:2007, *Paints and varnishes — Guidelines for the introduction of scribe marks through coatings on metallic panels for corrosion testing (ISO 17872:2007)*

3 Terms, definitions, symbols and abbreviations

3.1 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1.1

component I

component (usually the profile sheet) that is facing the head of the fastener (the swage head in the case of blind rivets)

3.1.2

component II

second component of a connection (usually the supporting member)

3.1.3

decking

load bearing sheet to support

EXAMPLE E.g. insulation and outer skin.

3.1.4

decking edge trim

fold added to the free end of an outstand plane element to restrain that element for local buckling and to ensure the geometry under access loads

3.1.5

edge trim

load-bearing flashings around a perimeter of a composite steel deck to retain the wet concrete during casting

3.1.6

fastening

fastener and the process of fastening and the final connected components

3.1.7

flashing

non-load bearing element, for example accessories and coverings in the areas of the skirting, eaves, gable end, ridge and corners

3.1.8

layout drawings

drawings which are showing the position of structural members and execution details

3.1.9

liner tray

profiled sheet with large lipped edge stiffener, suitable for interlocking with adjacent liner trays to form a plane of ribbed sheeting that is capable of supporting a parallel plane of profiled sheeting

3.1.10

penetration

opening in the decking made on-site