



SLOVENSKI STANDARD
oSIST prEN 1090-5:2015
01-januar-2015

Izvedba jeklenih in aluminijastih konstrukcij - 5. del: Tehnične zahteve za tankostenske, hladno oblikovane aluminijaste elemente in konstrukcijske elemente kot del strešnih, stropnih, talnih in stenskih konstrukcij

Execution of steel structures and aluminium structures - Part 5: Technical requirements for thin-gauge, cold-formed aluminium elements and structures for roof, ceiling, floor and wall applications

Ausführung von Stahltragwerken und Aluminiumtragwerken - Teil 5: Technische Anforderungen an tragende, dünnwandige, kaltgeformte Bauelemente und Bauteile für Dach-, Decken-, Boden- und Wandanwendungen aus Aluminium

Exécution des structures en acier et des structures en aluminium - Partie 5 : Exigences techniques pour éléments minces en aluminium formés à froid et structure de toiture, plafond, applications pour mur et plancher

Ta slovenski standard je istoveten z: prEN 1090-5

ICS:

91.080.10 Kovinske konstrukcije Metal structures

oSIST prEN 1090-5:2015 **en,fr,de**

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

DRAFT
prEN 1090-5

October 2014

ICS 91.080.10

English Version

**Execution of steel structures and aluminium structures - Part 5:
Technical requirements for thin-gauge, cold-formed aluminium
elements and structures for roof, ceiling, floor and wall
applications**

Exécution des structures en acier et des structures en
aluminium - Partie 5 : Exigences techniques pour éléments
minces en aluminium formés à froid et structure de toiture,
plafond, applications pour mur et plancher

Ausführung von Stahltragwerken und Aluminiumtragwerken
- Teil 5: Technische Anforderungen an tragende,
dünnwandige, kaltgeformte Bauelemente und Bauteile für
Dach-, Decken-, Boden- und Wandanwendungen aus
Aluminium

This draft European Standard is submitted to CEN members for enquiry. It has been drawn up by the Technical Committee CEN/TC 135.

If this draft becomes a European Standard, CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

This draft European Standard was established by CEN in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

Recipients of this draft are invited to submit, with their comments, notification of any relevant patent rights of which they are aware and to provide supporting documentation.

Warning : This document is not a European Standard. It is distributed for review and comments. It is subject to change without notice and shall not be referred to as a European Standard.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

	Page
Foreword.....	5
1 Scope	6
2 Normative references	8
3 Terms, definitions, symbols and abbreviations	8
3.1 Terms and definitions	8
3.2 Symbols and abbreviations	10
4 Specifications and documentation	11
4.1 Execution Specification	11
4.1.1 General	11
4.1.2 Execution classes	12
4.1.3 Layout drawings	12
4.1.4 Geometrical tolerances	13
4.2 Constructor's Documentation	13
4.2.1 General	13
4.2.2 Quality documentation	13
4.2.3 Safety of the erection works	14
4.3 Detailed traceability documentation	14
4.4 Execution documentation	14
5 Constituent products	14
5.1 General	14
5.2 Identification, inspection documents and traceability	14
5.3 Materials	15
5.4 Thickness tolerances	16
5.5 Minimum nominal sheet thicknesses	16
5.5.1 Profiled sheets	16
5.5.2 Linear thin-gauge structural elements	16
5.6 Dimensional tolerances	16
5.7 Mechanical fasteners	16
5.7.1 Materials	16
5.7.2 Verification of suitability	17
5.8 Accessories	17
5.9 Surface protection	17
5.10 External fire performance for roofing elements	17
5.11 Reaction to fire	17
5.12 Resistance to fire	17
5.13 Release of dangerous substances	17
5.14 Lightning protection	18
6 Manufacturing	18
7 Welding at the construction site	18
8 Fastening	18
8.1 General	18
8.2 Use of self-tapping and self-drilling screws	19
8.3 Use of blind rivets	20
8.4 Attachment of thin-gauge cold formed structural elements to the supporting member	20
8.4.1 Types of connections and attachments	20

8.4.2	Attachment of profiled sheets to the supporting member transverse to the direction of span	20
8.4.3	Attachment of profiled sheets to the supporting member parallel to the direction of span	21
8.4.4	Supporting member made of metal	21
8.4.5	Supporting member made of timber or wood-based materials	22
8.4.6	Supporting member made of concrete or masonry	22
8.5	Connecting profiled sheets	22
8.6	Edge and field spacings of fasteners for thin-gauge structural elements	23
8.6.1	General	23
8.6.2	Edge spacings of webs of trapezoidal sheeting and liner tray profiles	23
9	Installation	25
9.1	General	25
9.2	Training/instruction of installation personnel	25
9.3	Inspection of preceding works	25
9.4	Layout drawing	25
9.5	Tools required	25
9.6	Safety on site	25
9.7	Inspection of packaging and contents	26
9.8	Storage	26
9.9	Damaged structural elements	26
9.10	Unloading, lifting gear/slings/straps	26
9.11	Laying	26
9.12	Direction of lay	26
9.13	Maintaining the cover width/adherence to tolerances	27
9.14	Condition after installation (swarf from drilling, fouling of surface, protective film wrap)	27
9.15	Inspection after installation	27
9.16	Diaphragms and moment-resisting connections in the envelope	27
9.17	Protection against lightning	28
10	Surface protection	28
10.1	Corrosion protection	28
10.2	Cleaning and maintenance	28
11	Geometrical tolerances	29
11.1	General	29
11.2	Tolerance types	29
11.3	Essential tolerances	29
11.3.1	General	29
11.3.2	Manufacturing tolerances	30
11.3.3	Erection tolerances	30
11.4	Functional tolerances	30
11.4.1	General	30
11.4.2	Tabulated values	30
12	Inspection, testing and correction	30
12.1	General	30
12.2	Structural elements	30
12.2.1	General	30
12.2.2	Non-conforming products	31
12.3	Manufacturing: geometrical dimensions of manufactured structural elements	31
12.4	Welding at the construction site	32
12.5	Inspection of fastening	32
12.5.1	Self-tapping and self-drilling screws	32
12.5.2	Blind rivets	32
Annex A	(normative) Basic requirements for profiled sheeting	33
A.1	Supporting members	33
A.1.1	General	33
A.1.2	Materials	33
A.1.3	Dimensions, widths of supports	33
A.1.4	Supporting members made of metal (steel/aluminium)	33

prEN 1090-5:2014 (E)

A.1.5	Supporting members made of timber.....	33
A.1.6	Supports made of concrete or masonry	34
A.1.7	Shear forces/fixed points	35
A.2	Edges of laying area.....	35
A.2.1	Longitudinal edge stiffeners.....	35
A.2.2	Cantilevers.....	36
A.2.3	Weakening of the cross section.....	37
A.2.4	Penetrations	38
A.2.5	Avoidance of ice damming	40
A.3	Building physics requirements	40
A.3.1	Water permeability.....	40
A.3.2	Thermal insulation.....	41
A.3.3	Avoidance of condensation.....	41
A.3.4	Airborne sound insulation (R_w)	41
A.3.5	Sound absorption (α_w).....	41
A.3.6	Protection against lightning	42
A.4	Roof drainage.....	42
Annex B	(normative) Special requirements for profiled sheeting	44
B.1	General.....	44
B.2	Serviceability.....	44
B.3	Stiffening of liner trays.....	44
B.4	Walkability	45
B.4.1	Walkability during installation.....	45
B.4.2	Walkability and access after installation.....	45
B.4.3	Test “Walkability”	45
B.5	Rotational restraint.....	46
B.6	Stressed skin design (diaphragms)	47
Annex C	(informative) Documentation	48
Annex D	(normative) Geometrical tolerances.....	49
D.1	Essential and functional manufacturing tolerances — Cold formed profiled sheets	50
D.2	Essential and functional manufacturing tolerances — Linear thin-gauge structural elements	52
Annex E	(normative) Corrosion protection.....	54
E.1	Galvanic corrosion	54
Annex F	(normative) List of required additional information.....	55
Bibliography	56

Foreword

This document (prEN 1090-5:2014) has been prepared by Technical Committee CEN/TC 135 “Execution of steel structures and aluminium structures”, the secretariat of which is held by SN.

This document is currently submitted to the CEN Enquiry.

iTeh Standards
(<https://standards.itih.ai>)
Document Preview

[SIST EN 1090-5:2017](https://standards.itih.ai/catalog/standards/sist/e6354b09-9625-4b4a-8be6-46f5af5ebb11/sist-en-1090-5-2017)

<https://standards.itih.ai/catalog/standards/sist/e6354b09-9625-4b4a-8be6-46f5af5ebb11/sist-en-1090-5-2017>

prEN 1090-5:2014 (E)

1 Scope

This European Standard defines the requirements for the manufacture of thin-gauge cold-formed elements, the execution of structures made from such elements (e.g. roofs, coverings, walls, floors, ceilings) under predominately static loading conditions and their documentation. It does cover products of construction class I and II according to EN 1999-1-4 used in structures.

Thin-gauge structural elements are understood here to mean profiled sheeting, such as trapezoidal, sinusoidal, liner trays or cassette profiles (Figure 1) or linear profile cross sections, (Figure 2), that are produced by cold forming and have thicknesses not greater than 4 mm. Closed build-up sections of thicknesses not greater than 3 mm, as defined in EN 1999-1-1 and -4 are also covered by this part. Perforated and micro profiled sheeting are also covered by this part.

For closed build-up sections (Figure 2b) of thicknesses greater than 3 mm the execution provisions of EN 1090-3 apply.

Welded sections are excluded from this part and are covered by EN 1090-3.


This European Standard also covers spacer constructions between the outer and inner or upper and lower skins as well as supporting members for roofs, walls and ceilings made from cold-formed profiled sheeting and the connections and attachments of the afore mentioned elements as long as they are involved in load transfer.

This European Standard combined with EN 1090-4 covers combined steel and aluminium structural elements, e.g. liner trays made of steel, stiffened by profiles made of aluminium.

Other composite structural elements where the interaction between dissimilar materials are an integral part of the structural behaviour such as sandwich panels and composite floors are not covered by this standard.

NOTE 1 The structures covered in this standard can be for example


- single- or multi-skin roofs, whereby the load-bearing structure (lower skin) as well as the actual roof covering (upper skin) or both consist of thin-gauge structural elements,
- single- or multi-skin walls whereby the load-bearing structure (inner skin) as well as the actual cladding (outer skin) or both consist of thin-gauge structural elements, or
- suspended ceilings for interior fitting or coverage of tunnels.

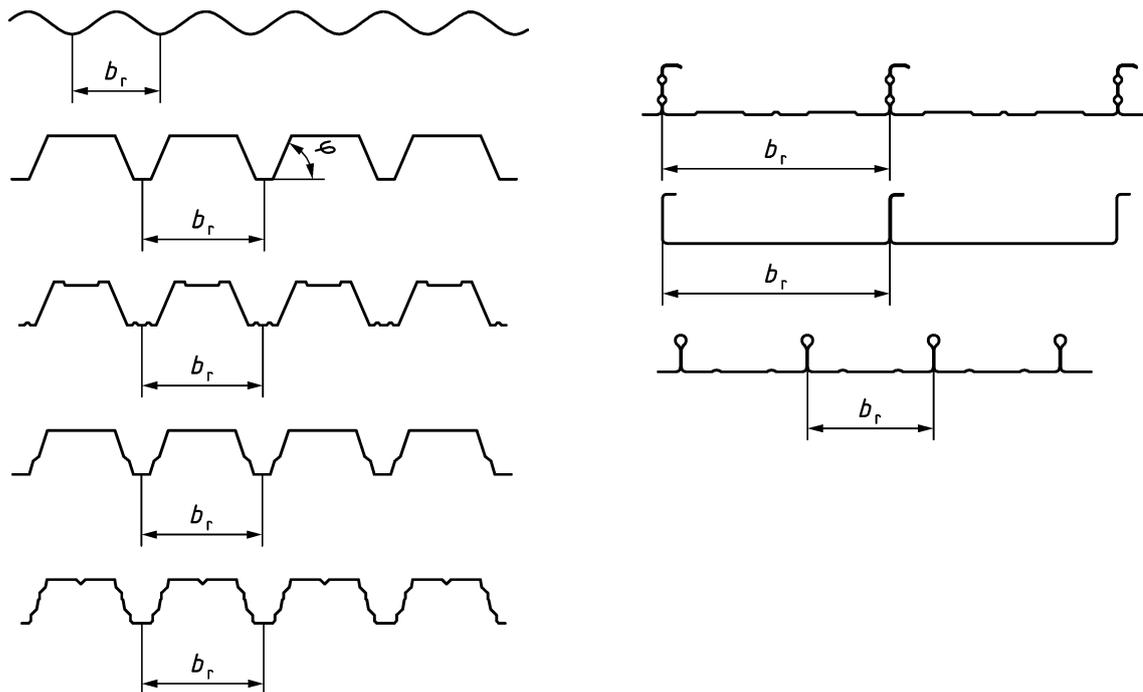

Key

- 1: b_R
- 2: φ

Figure 1 — Examples of profile shapes

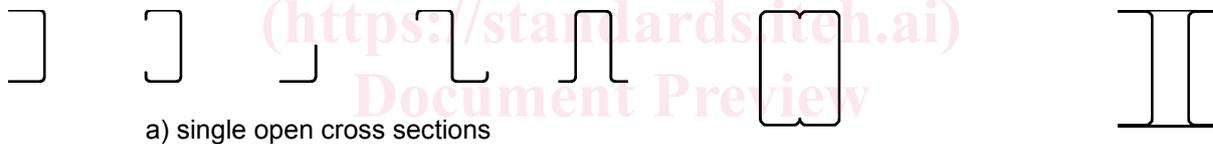

a) single open cross sections

b) closed build-up sections

SIST EN 1090-5:2017

<https://standards.itech.ai/catalog/standards/sist/e6354b09-9625-4b4a-8be6-46f5af5ebb11/sist-en-1090-5-2017>

Figure 2 — Examples of linear profile cross sections

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 1090-1, *Execution of steel structures and aluminium structures — Part 1: Requirements for conformity assessment of structural elements*

EN 1090-3, *Execution of steel structures and aluminium structures — Part 3: Technical requirements for aluminium structures*

EN 1995-1-1, *Eurocode 5: Design of timber structures — Part 1-1: General — Common rules and rules for buildings*

EN 1999-1-1, *Eurocode 9: Design of aluminium structures — Part 1-1: General structural rules*

EN 1999-1-4, *Eurocode 9: Design of aluminium structures — Part 1-4: Cold-formed structural sheeting*

EN 10204, *Metallic products — Types of inspection documents*

EN 12056-1, *Gravity drainage systems inside buildings — Part 1: General and performance requirements*

EN 12056-3, *Gravity drainage systems inside buildings — Part 3: Roof drainage, layout and calculation*

EN ISO 12944-1, *Paints and varnishes — Corrosion protection of steel structures by protective paint systems — Part 1: General introduction (ISO 12944-1)*

EN 14782, *Self-supporting metal sheet for roofing, external cladding and internal lining — Product specification and requirements*

EN 62305-3, *Protection against lightning — Part 3: Physical damage to structures and life hazard*

3 Terms, definitions, symbols and abbreviations

For the purposes of this document the following terms and definitions apply:

3.1 Terms and definitions

3.1.1

ancillaries

additional components e.g. as part of a purlin and rail system required to make the system function

3.1.2

cassette profile

cassette profiles are press-braked or folded structural elements with or without stiffeners used as substructures for walls and roofs with a bigger variety in cross sections as liner trays

3.1.3

cleat

connection bracket used to connect purlins and rails to the main steel frame. Also a cleat can be connector for attaching cold formed section to each other — example as in forming window or door openings

3.1.4**continuity sleeve**

sleeve that connects two structural elements together and provide a continuous or semi continuous moment joint. Section gauges are sometimes varied along the run of sections to match the applied loads and give economies

3.1.5**component I**

component (usually the trapezoidal sheeting) that is facing the head of the fastener (the swage head in the case of blind rivets)

3.1.6**component II**

second component of a connection (usually the supporting member)

3.1.7**diagonal ties**

component used between parallel structural elements used to transfer the wall dead load to the main supporting columns of the down slope component

3.1.8**envelope elements**

roofs and roof cladding, including canopies; external walls and wall cladding, including parapets; walls, including partitions and ceilings within the building envelope

3.1.9**edge stiffener**

supporting plate or profile at the longitudinal edge of a laying area to replace the missing neighbored sheeting and stiffen the free edge

3.1.10**flashings**

are non-load bearing elements, for example accessories and coverings in the areas of the skirting, eaves, gable end, ridge and corners

3.1.11**layout drawings**

showing the position of structural components and execution details

3.1.12**liner**

inner sheet of a double skin system only carrying self weight and insulation

3.1.13**restraints**

connecting member transverse between two parallel runs of purlin or rail to provide structural restraint to the members — dependent on the system that can be positional or rotational restraint to the sections

3.1.14**saddle washers**

oversized gaskets that are adapted to the respective profile shape. They are made of aluminium, steel or stainless steel with an elastomer or foamed rubber seal bonded to it. Their corrosion protection shall be adapted to that of the profiled sheeting. Saddle washers can be used when attaching profiled sheeting via its top flange.

3.1.15**structural cold formed components**

load-bearing element made from thin-gauge steel sheets

prEN 1090-5:2014 (E)**3.1.16****web folded cleat**

structural element especially a channel section with the flange ends notch away and the web folded at right angles to form a cleat from the web

3.1.17**structural elements**

parts of a structure e.g. profiled sheeting, such as trapezoidal, sinusoidal or cassette profiles or linear profile cross sections, e.g. with a Z, C, Ω or Π shape.

3.1.18**thin-gauge**

gauge in ranges up to 4 mm

3.2 Symbols and abbreviations

<i>C</i>	corrosivity category
<i>D</i>	edge waviness of the side lap
<i>E</i>	modulus of elasticity
<i>F</i>	force
<i>I</i>	second moment of area
<i>K</i>	shear force of the fastener
<i>L</i>	span, distance
<i>M</i>	bending moment
<i>R</i>	radius; end support reaction
<i>T</i>	shear flow
<i>V</i>	shear force of the structural component
<i>a</i>	distance between fastener and web of profiled sheet
<i>b</i>	width, width of spacing strip
<i>d</i>	hole diameter
<i>d</i>	nominal diameter of the fastener
<i>e</i>	distance of hole from edge, distance between fastener and centre line of flange of profiled sheet distance between fasteners
<i>h</i>	depth of profile
<i>l</i>	length of double layer
<i>p</i>	distances between holes
<i>q</i>	self-weight of the roof including the self-weight of the profile
<i>q₀</i>	α times roof load
<i>r</i>	radius
<i>t</i>	thickness of bare metal of the sheet, hole pitch
Δ	deviation, tolerance
δ	deviation from straightness
φ	inclination of the web of profile

Indices

- A centre-to-centre distance of the penetration from the end support or from the point of zero moment
- B internal support
- D Width of flange — theoretical requirement used for static calculations
- G web
- I component 1, profiled sheet
- II component 2, supporting member
- L longitudinal edge, left side
- N nominal sheet thickness
- Q shear load
- R rib edge, right side
- S tensile force from constraints due to shear reinforcement shear stiffness
- Z tensile force
- V thickness of the bare steel measured in the test
- a end support
- b intermediate support
- cl clear span
- i ideal distance between supports, equal spacing of points of zero moment
- k cantilever
- n nominal hole diameter
- r required, rib
- s stiffener at the web
- u bottom flange
- α ratio q_0/q

4 Specifications and documentation**4.1 Execution Specification****4.1.1 General**

The necessary information and technical requirements for execution of each part of the works shall be agreed and complete before commencement of execution of that part of the works. There shall be procedures for

prEN 1090-5:2014 (E)

making alterations to previously agreed execution specification. Execution specification consists of layout drawings and details, based on structural design and shall consider such of the following items as are relevant:

- a) additional information, as listed in Annex F if relevant;
- b) execution classes, see 4.1.2;
- c) technical requirements regarding the safety of the works, see 4.2.3 and 9.6.

4.1.2 Execution classes

As opposed to EN 1090-3 and in line with EN 1090-4 there is no differentiation in requirements between execution classes within this part.

4.1.3 Layout drawings

Layout drawings shall be part of the prepared execution specification and are based on structural design.

Layout drawings and assembly instructions shall include the following details and shall be prepared for the execution:

- Type and position of the structural elements
- Connection with the supporting member and arrangement of the fasteners
- Intended structural elements with profile designation and fabricator's name, constituent product, nominal sheet thickness and manufactured length
- Direction of lay and special installation sequences
- Statically effective overlapping (moment-resisting connections), if relevant
- Execution tolerances
- Intended fasteners with type designation, type of washer, arrangement and separation distances, special assembly instructions depending on the type of connection, e.g. hole diameters, axial spacings and edge distances
- Type and details of the supporting member for the structural elements, such as material, center to center distances and dimensions, the inclination
- Details of the side and end overlappings and edges of the installed area
- Openings in the installed areas, including the necessary framing, e.g. for skylights, smoke and heat extractors and roof drainage, if relevant
- Superstructures or suspensions, e.g. for piping, bunched cables or suspended ceilings, if relevant
- A label, stating that all structural elements shall be fixed immediately after laying
- Details about any special installation measures, if relevant
- Any specific hazards related to construction should be identified
- Details about corrosion protection, e.g. contact surfaces between different metals or between metals and timber, concrete, masonry or plaster, if relevant