

---

**[Not translated]**

Energy performance of buildings - Method for calculation of system energy requirements and system efficiencies - Part 6-5: Explanation and justification of EN 15316-4-2, Module M3-8

Heizungsanlagen und Wasserbasierte Kühlanlagen in Gebäuden - Verfahren zur Berechnung der Energieanforderungen und Nutzungsgrade der Anlagen - Teil 6-9: Begleitende TR zur EN 15316-4-2 (Wärmeerzeugung für die Raumheizung, Wärmepumpensysteme; )

**Ta slovenski standard je istoveten z: FprCEN/TR 15316-6-5**

**ICS:**

91.120.10	Toplotna izolacija stavb	Thermal insulation of buildings
91.140.10	Sistemi centralnega ogrevanja	Central heating systems

**kSIST-TP FprCEN/TR 15316-6-5:2016**      **en,fr,de**



TECHNICAL REPORT  
RAPPORT TECHNIQUE  
TECHNISCHER BERICHT

**FINAL DRAFT**  
**FprCEN/TR 15316-6-5**

November 2016

ICS 91.140.10; 91.120.10

English Version

**Energy performance of buildings - Method for calculation  
of system energy requirements and system efficiencies -  
Part 6-5: Explanation and justification of EN 15316-4-2,  
Module M3-8**

This draft Technical Report is submitted to CEN members for Vote. It has been drawn up by the Technical Committee CEN/TC 228.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

Recipients of this draft are invited to submit, with their comments, notification of any relevant patent rights of which they are aware and to provide supporting documentation.

**Warning :** This document is not a Technical Report. It is distributed for review and comments. It is subject to change without notice and shall not be referred to as a Technical Report.

[SIST-TP CEN/TR 15316-6-5:2018](https://standards.iteh.ai/catalog/standards/sist/5dbccf28-db06-4543-b7f8-618ba4b4f670/sist-tp-cen-tr-15316-6-5-2018)

<https://standards.iteh.ai/catalog/standards/sist/5dbccf28-db06-4543-b7f8-618ba4b4f670/sist-tp-cen-tr-15316-6-5-2018>



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

**CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels**

## Contents

Page

European foreword.....	4
Introduction .....	5
1 Scope .....	7
2 Normative references .....	7
3 Terms and definitions .....	7
4 Symbols and abbreviations .....	8
4.1 Symbols.....	8
4.2 Subscripts.....	8
5 Information on the method .....	8
5.1 General.....	8
6 Method description .....	9
6.1 Rationale .....	9
6.2 Time steps.....	10
6.3 Assumptions.....	10
6.4 Data input .....	10
6.4.1 Energy required.....	10
6.4.2 COP and thermal capacity .....	10
6.4.3 Other parameters and coefficients .....	11
6.5 Calculation methods.....	11
6.5.1 Calculation of COP and thermal capacity based on EN 14511 — Path A .....	11
6.5.2 Calculation of COP and thermal capacity based on EN 14825 (path B) .....	13
6.5.3 Time of operation of the heat pump in part load operation.....	13
6.5.4 Monthly and annual method .....	13
6.5.5 Auxiliary .....	14
6.6 Calculation information.....	14
7 Worked out example.....	14
7.1 Description .....	14
7.2 Calculation details .....	14
7.2.1 Example 1 – Path A - Hourly method based on a single reference value for COP and thermal capacity.....	14
7.2.2 Example 2 – Path B – Hourly method based on results at part load .....	14
7.2.3 Example 3 – Annual / Monthly method .....	15
7.3 Remarks and comments .....	15
8 Application range.....	15
8.1 Energy performance.....	15
8.2 Energy certificate .....	15
8.3 Inspection .....	15
8.4 System complexity .....	15
9 Regulation use.....	15
10 Information on the accompanying spreadsheet.....	15
11 Results of the validation tests.....	15

<b>12</b>	<b>Quality issues .....</b>	<b>15</b>
<b>Annex A</b> (informative)	<b>Calculation flowchart – Path A.....</b>	<b>16</b>
<b>Annex B</b> (informative)	<b>Path A - Calculation example.....</b>	<b>17</b>
<b>Annex C</b> (informative)	<b>Path B - Hourly method .....</b>	<b>31</b>
<b>C.1</b>	<b>Input data .....</b>	<b>31</b>
<b>C.2</b>	<b>– Calculation procedure .....</b>	<b>33</b>
<b>Annex D</b> (informative)	<b>Path B – monthly/annual method .....</b>	<b>35</b>
<b>D.1</b>	<b>Additional input data to Annex C.....</b>	<b>35</b>
<b>D.2</b>	<b>Example of results .....</b>	<b>36</b>
<b>Bibliography</b> .....		<b>39</b>

iTeh Standards  
(<https://standards.iteh.ai>)  
Document Preview

[SIST-TP CEN/TR 15316-6-5:2018](https://standards.iteh.ai/catalog/standards/sist/5dbccf28-db06-4543-b7f8-618ba4b4f670/sist-tp-cen-tr-15316-6-5-2018)

<https://standards.iteh.ai/catalog/standards/sist/5dbccf28-db06-4543-b7f8-618ba4b4f670/sist-tp-cen-tr-15316-6-5-2018>

**FprCEN/TR 15316-6-5:2016 (E)**

## **European foreword**

This document (FprCEN/TR 15316-6-5:2016) has been prepared by Technical Committee CEN/TC 228 “Heating systems and water based cooling systems in buildings”, the secretariat of which is held by DIN.

This document is currently submitted to the vote on TR.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association.

**iTeh Standards**  
**(<https://standards.iteh.ai>)**  
**Document Preview**

[SIST-TP CEN/TR 15316-6-5:2018](https://standards.iteh.ai/catalog/standards/sist/5dbccf28-db06-4543-b7f8-618ba4b4f670/sist-tp-cen-tr-15316-6-5-2018)

<https://standards.iteh.ai/catalog/standards/sist/5dbccf28-db06-4543-b7f8-618ba4b4f670/sist-tp-cen-tr-15316-6-5-2018>

## Introduction

### The set of EPB standards, technical reports and supporting tools

In order to facilitate the necessary overall consistency and coherence, in terminology, approach, input/output relations and formats, for the whole set of EPB-standards, the following documents and tools are available:

- a) a document with basic principles to be followed in drafting EPB-standards: CEN/TS 16628:2014, *Energy Performance of Buildings - Basic Principles for the set of EPB standards* [2];
- b) a document with detailed technical rules to be followed in drafting EPB-standards: CEN/TS 16629:2014, *Energy Performance of Buildings - Detailed Technical Rules for the set of EPB-standards* [3];
- c) the detailed technical rules are the basis for the following tools:
  - 1) a common template for each EPB-standard, including specific drafting instructions for the relevant clauses;
  - 2) a common template for each technical report that accompanies an EPB standard or a cluster of EPB standards, including specific drafting instructions for the relevant clauses;
  - 3) a common template for the spreadsheet that accompanies each EPB standard, to demonstrate the correctness of the EPB calculation procedures.

Each EPB-standards follows the basic principles and the detailed technical rules and relates to the overarching EPB-standard, prEN ISO 52000-1:2015 [4].

One of the main purposes of the revision of the EPB-standards is to enable that laws and regulations directly refer to the EPB-standards and make compliance with them compulsory. This requires that the set of EPB-standards consists of a systematic, clear, comprehensive and unambiguous set of energy performance procedures. The number of options provided is kept as low as possible, taking into account national and regional differences in climate, culture and building tradition, policy and legal frameworks (subsidiarity principle). For each option, an informative default option is provided (Annex B).

### Rationale behind the EPB technical reports

There is a risk that the purpose and limitations of the EPB standards will be misunderstood, unless the background and context to their contents – and the thinking behind them – is explained in some detail to readers of the standards. Consequently, various types of informative contents are recorded and made available for users to properly understand, apply and nationally or regionally implement the EPB standards.

If this explanation would have been attempted in the standards themselves, the result is likely to be confusing and cumbersome, especially if the standards are implemented or referenced in national or regional building codes.

Therefore each EPB standard is accompanied by an informative technical report, like this one, where all informative content is collected, to ensure a clear separation between normative and informative contents (see CEN/TS 16629 [3]):

- to avoid flooding and confusing the actual normative part with informative content,

**FprCEN/TR 15316-6-5:2016 (E)**

- to reduce the page count of the actual standard, and
- to facilitate understanding of the set of EPB standards.

This was also one of the main recommendations from the European CENSE project [5] that laid the foundation for the preparation of the set of EPB standards.

**iTeh Standards**  
**(<https://standards.iteh.ai>)**  
**Document Preview**

[SIST-TP CEN/TR 15316-6-5:2018](https://standards.iteh.ai/catalog/standards/sist/5dbccf28-db06-4543-b7f8-618ba4b4f670/sist-tp-cen-tr-15316-6-5-2018)

<https://standards.iteh.ai/catalog/standards/sist/5dbccf28-db06-4543-b7f8-618ba4b4f670/sist-tp-cen-tr-15316-6-5-2018>



## 1 Scope

This Technical Report refers to prEN 15316-4-2:2014, covering module M3-8.

It contains information to support the correct understanding, use and national adaptation of prEN 15316-4-2:2014.

This Technical Report does not contain any normative provision.

## 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

prEN 15316-4-2:2014, *Energy performance of buildings — Method for calculation of system energy requirements and system efficiencies — Part 4-2: Space heating generation systems, heat pump systems, Module M3-8-2, M8-8-2*

EN 15603, *Energy performance of buildings — Overall energy use and definition of energy ratings*

EN ISO 7345, *Thermal insulation — Physical quantities and definitions (ISO 7345)*

## 3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN ISO 7345, EN 15603, prEN 15316-4-2:2014 and the following apply.

### 3.1

#### bivalent temperature

$\vartheta_{biv,ref}$

outdoor temperature **declared** by the supplier for heating at which the declared capacity for heating equals the part load for heating and below which the declared capacity for heating requires supplementary capacity for heating to meet the part load for heating, expressed in degrees Celsius

Note 1 to entry: This definition corresponds to the terms of EN 14825.

Note 2 to entry: In the context of prEN 15316-4-2:2014, the bivalent temperature  $\vartheta_{biv}$  is adapted to the thermal load of the building and is different from the EN 14825 conditions which means:

- 1) Input data consider temperatures, thermal capacities and COP based on the test conditions identified from EN 14825,
- 2) This EN 14825 bivalent temperature  $\vartheta_{biv,ref}$ , COP<sub>ref</sub> and thermal capacity data is used as part of the EN 14825 dataset to interpolate COP and capacity for each time step (operating condition) (using Path B)
- 3) prEN 15316-4-2:2014 determines a specific bivalent temperature for each time step (operating condition), which is different to the Manufacturer declared value (from EN 14825 data), to determine back-up requirement
- 4) Practically the bivalent temperature is a fixed value declared in the input data  $\vartheta_{biv}$  and use for control of the additional heating system when thermal capacity does not fulfill the thermal capacity required.

**FprCEN/TR 15316-6-5:2016 (E)****4 Symbols and abbreviations****4.1 Symbols**

For the purposes of this document, the symbols given in EN 15603 and in prEN 15316-4-2:2014 apply.

**4.2 Subscripts**

For the purposes of this document, subscripts given in EN 15603 and in prEN 15316-4-2:2014 apply.

**5 Information on the method****5.1 General**

The method calculates the thermal energy provided by heat pump systems for heating of domestic hot water use.

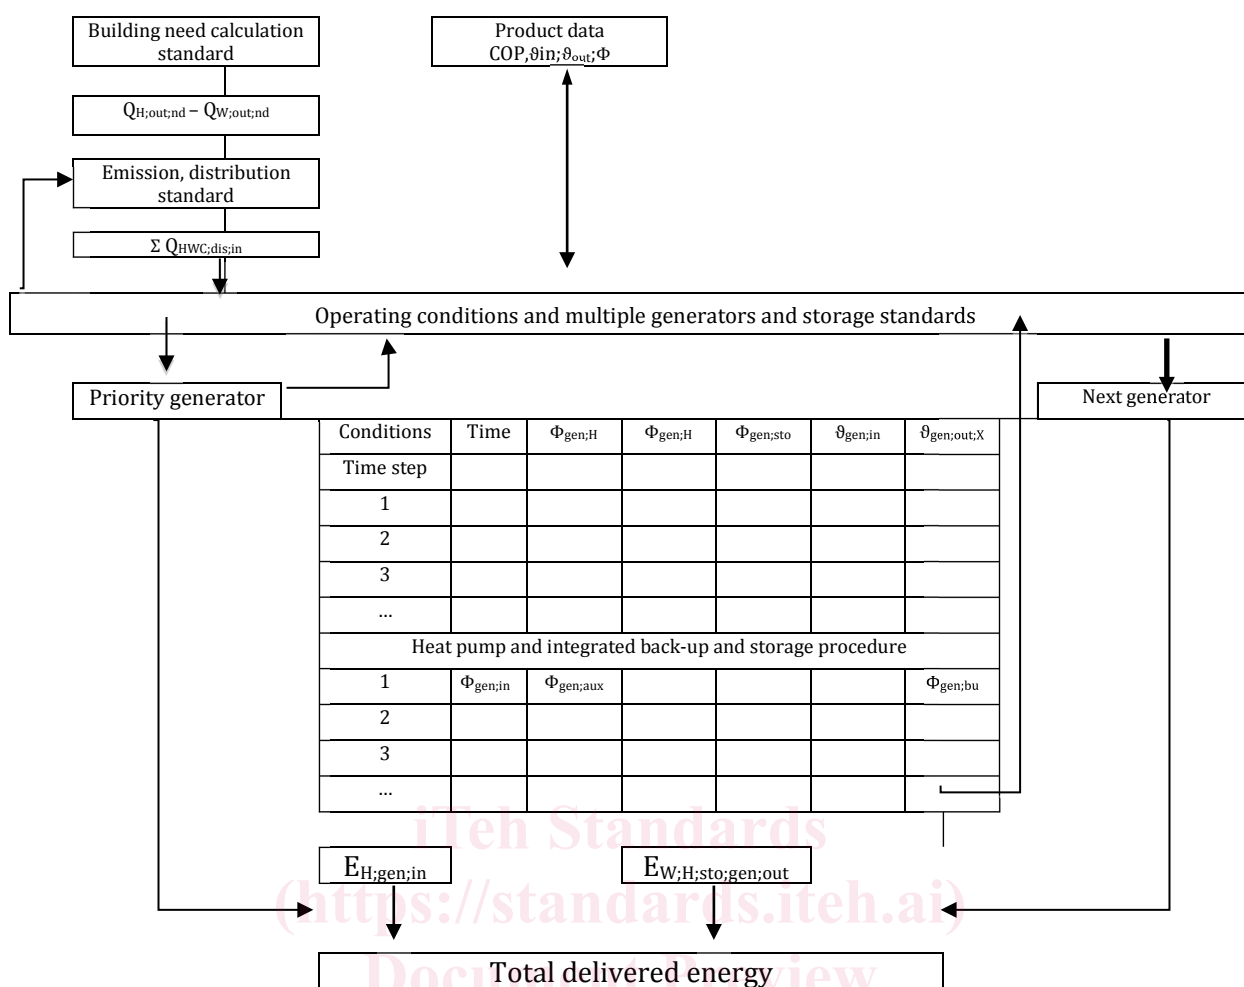
Table 1 explains how the information and output of the calculation are used in such multiple systems.

In this case, the heat pump, including its integrated back-up system (if any) is considered as the priority generator.

**iTeh Standards**  
**(<https://standards.iteh.ai>)**  
**Document Preview**

[SIST-TP CEN/TR 15316-6-5:2018](https://standards.iteh.ai/catalog/standards/sist/5dbccf28-db06-4543-b7f8-618ba4b4f670/sist-tp-cen-tr-15316-6-5-2018)

<https://standards.iteh.ai/catalog/standards/sist/5dbccf28-db06-4543-b7f8-618ba4b4f670/sist-tp-cen-tr-15316-6-5-2018>

**Table 1 — Heat pump systems and interaction with other generators**

## 6 Method description SIST-TP CEN/TR 15316-6-5:2018

<https://standards.iteh.ai/catalog/standards/sist/5dbccf28-db06-4543-b7f8-618ba4b4f670/sist-tp-cen-tr-15316-6-5-2018>

### 6.1 Rationale

Depending of the input data provided 2 paths can be used for the calculation of the energy performance of the heat pump generation system

Path A is based on a single reference value.

Path B is based on performances of the heat pump according to EN 14825.

Depending on the thermal power and temperature determined form the operating conditions and from the distribution systems, the following values are calculated:

- energy delivered to the heat pump systems;
- COP (coefficient of performance);
- energy for auxiliaries;
- recoverable thermal losses.

The calculation is processed in 2 stages:

**FprCEN/TR 15316-6-5:2016 (E)**

- determination of energy used from and delivered to at full load for the non nominal operating conditions;
- determination of energy used from and delivered to the heat pump systems at part load.

A flowchart is given in Annex A.

**6.2 Time steps**

Time step is typically:

- hourly;
- bin;
- monthly (or annual) based on bin approach.

**6.3 Assumptions**

The matrix for COP and power of the heat pump at the nominal condition is calculated at the beginning of the calculation. It is assumed that the COP and power vary linearly within the narrowest values of the matrix.

Energy is delivered to the distribution system at the beginning of the step time.

The energy for auxiliaries is considered as proportion of the operative time of the heat pump.

Dynamic effects due to transient thermal conditions are transformed into a time delay depending on the type of emitters and of the temperature to be achieved at the output of the heat pump system.

Heat pump is considered operating at full load for DWH energy use.

**6.4 Data input****6.4.1 Energy required**

The energy and temperature requirements are issued from prEN 15316-3:2014, including thermal gains and impact of the control system on the energy demand.

For annual and monthly method, the default energy demand for heating is based on the design temperature of the building. The impacts of control system (reduced temperature during the night or occupancy) and thermal gains (activity, type of building, solar gains) are introduced as weighting factors. These weighting factors can be superseded based on national methods, as internal gains are assumed not to be in proportion of the external temperature and impact of the reduced temperature increase with the external temperature.

**6.4.2 COP and thermal capacity**

Thermal capacity and COP are the declared values by the manufacturer.

Path A is based on a reference value for COP and thermal capacity at full load. Default values are proposed to calculate COP and thermal capacity for any conditions at full load. If available, the user of the method can adapt the default multiplying factors to the performance of the heat pump as for example more than one value are available (e.g. air-to-water heat pump with a lot of values according to EN 14511: —7/35, 2/35, 7/35, -7/55, 7/55).

User should mind that the test values of EN 14511 have not to be and are not at 100 % capacity of inverter-controlled heat pump. That means, mostly the values at -7 °C or -15 °C are at 100 % capacity, but the values at 2 °C, 7 °C or higher may be given at a lower capacity (e.g. 60 %). That means, the usage