

SLOVENSKI STANDARD
oSIST prEN 12098-3:2016
01-januar-2016

Regulacijske naprave za sisteme ogrevanja - 3. del: Naprave za regulacijo električnih sistemov ogrevanja - Moduli M3-5, 6, 7, 8

Controls for heating systems - Part 3: Control equipment for electrical heating systems - Modules M3-5,6,7,8

Mess-, Steuer- und Regeleinrichtungen für Heizungen - Teil 3: Regeleinrichtungen für Elektroheizungen - Module M3-5, 6, 7, 8

Régulation pour les systèmes de chauffage - Partie 3 : Équipement de régulation pour les systèmes de chauffage électrique - Modules M3-5, 6, 7, 8

Ta slovenski standard je istoveten z: prEN 12098-3

ICS:

91.140.10	Sistemi centralnega ogrevanja	Central heating systems
97.120	Avtomatske krmilne naprave za dom	Automatic controls for household use

oSIST prEN 12098-3:2016

en,fr,de

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

DRAFT
prEN 12098-3

December 2015

ICS 97.100.10; 97.120

Will supersede EN 12098-3:2013

English Version

**Controls for heating systems - Part 3: Control equipment
for electrical heating systems - Modules M3-5,6,7,8**

Régulation pour les systèmes de chauffage - Partie 3 :
Équipement de régulation pour les systèmes de
chauffage électrique - Modules M3-5, 6, 7, 8

Mess-, Steuer- und Regeleinrichtungen für Heizungen -
Teil 3: Regeleinrichtungen für Elektroheizungen -
Module M3-5, 6, 7, 8

This draft European Standard is submitted to CEN members for enquiry. It has been drawn up by the Technical Committee CEN/TC 247.

If this draft becomes a European Standard, CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

This draft European Standard was established by CEN in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

Recipients of this draft are invited to submit, with their comments, notification of any relevant patent rights of which they are aware and to provide supporting documentation.

Warning : This document is not a European Standard. It is distributed for review and comments. It is subject to change without notice and shall not be referred to as a European Standard.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

Page

European foreword.....	4
Introduction	5
1 Scope	8
2 Normative references	8
3 Terms and definitions	8
4 Symbols and abbreviations	16
4.1 Symbols.....	16
4.2 Subscripts.....	16
5 Functionality.....	16
5.1 Functional objective.....	16
5.2 Control equipment functionality.....	17
6 Requirements	18
6.1 Data protection	18
6.2 Characteristic heating curve	18
6.3 Input signal – Sensors	18
6.4 Controller operation modes	19
6.4.1 General.....	19
6.4.2 Comfort operation mode	19
6.4.3 Economy operation mode	19
6.4.4 Building protection operation mode	19
6.4.5 Automatic operation mode	19
6.5 Frost protection	19
6.6 Additional functions.....	19
6.6.1 General.....	19
6.6.2 Summer/winter switch function	20
6.6.3 Set back function	20
6.6.4 Optimum start function	20
6.6.5 Optimum stop function	20
6.7 Switching times.....	20
6.8 Override mode	21
6.9 Parameter settings	21
6.10 Factory settings / default values	21
6.10.1 Characteristic heating curve	21
6.10.2 Switching times / operating condition	21
6.11 Switching relays.....	21
6.12 Electrical requirements.....	21
6.12.1 Electrical connections	21
6.12.2 Supply voltage	21
6.12.3 Electrical safety.....	21
6.12.4 Electromagnetic compatibility	22
6.13 Degree of protection	22
6.14 Environmentally induced stress due to temperature.....	22
6.15 Materials.....	22
7 Test methods	22

7.1	Data Protection.....	22
7.2	Controller operation modes	22
7.3	Controller characteristic heating curve	22
7.4	Frost protection.....	25
7.5	Switching times	25
7.6	Manual override mode.....	25
7.7	Optimum start-stop function.....	25
7.7.1	General	25
7.7.2	Test conditions	27
7.7.3	Test run	27
7.7.4	Test results start optimization	27
7.7.5	Test results stop optimization	29
7.8	Set back	29
7.9	Parameter settings.....	29
7.10	Factory settings.....	29
7.11	Switching relays	30
7.12	Electrical test.....	30
7.13	Degrees of protection.....	30
7.14	Environmental individual stress due to temperature.....	30
8	Marking	30
9	Documentation	30
9.1	Technical documents.....	30
9.2	Technical Specifications.....	30
9.2.1	Controller	30
9.2.2	Output signals	31
9.2.3	Input signals (sensors)	31
9.3	Instruction installation.....	31
9.4	User guideline	31
	Bibliography	32

prEN 12098-3:2015 (E)

European foreword

This document (prEN 12098-3:2015) has been prepared by Technical Committee CEN/TC 247 “Building Automation, Controls and Building Management”, the secretariat of which is held by SNV.

This document is currently submitted to the CEN Enquiry.

This document will supersede EN 12098-3:2013.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 12098-3:2018

<https://standards.iteh.ai/catalog/standards/sist/163ae542-9485-46bc-a74e-a675deb146de/sist-en-12098-3-2018>

Introduction

This standard is part of a series of standards aiming at international harmonization of the methodology for the assessment of the energy performance of buildings, called “EPB set of standards”.

As part of the “EPB set of standards” it complies with the requirements for the set of basic EPB documents (prEN ISO 52000-1:2015 (see Normative references), CEN/TS 16628 and CEN/TS 16629 (see bibliography [2] and [3]) developed under a mandate given to CEN by the European Commission and the European Free Trade Association (Mandate M/480), and supports essential requirements of EU Directive 2010/31/EC on the energy performance of buildings (EPBD).

The standards issued by TC 247 for M/480 belong to the EPB set of standards and are in line with the over-arching standard (prEN ISO 52000-1) and drafted in accordance with the basic principles and detailed technical rules developed in the Phase I of the mandate.

Also these standards are clearly identified in the modular structure developed to ensure a transparent and coherent EPB standard set. BAC (Building Automation and Control) is identified in the modular structure as Technical Building System M10. However, the standards of TC 247 deal with control accuracy, control functions and control strategies using standards communications protocol (these last standards don't belong to the EPB standards set).

To avoid a duplication of calculation due to the BAC (avoid double impact), no calculation are done in BAC EPB standard set, but in each underlying standard of EPB set of standards (from M1 to M9 in the Modular Structure), an IDENTIFIER developed and present in the M10 covered by EN 15232 is used where appropriate. These way of interaction is described in detailed in the Technical Report (prCEN ISO/TR 52000-2) accompanying the over-arching standard. As consequence, the Annex A and Annex B concept as EXCEL sheet with the calculation formulas used in the EPB standards are not applicable for the standards issued by TC 247 for M/480.

SIST EN 12098-3:2018

<https://standards.iteh.ai/catalog/standards/sist/163ae542-9485-46be-a74e-a675deb146de/sist-en-12098-3-2018>

Table 1 shows the relative position of this standard within the EN EPB set of standards.

Table 1 — Position of this standard within the EPBD set of standards

	Over-arching	Building (as such)	Technical Building System									
Submodule	Descriptions	Descriptions	Descriptions	Heating	Cooling	Ventilation	Humidification	Dehumidification	Domestic Hot waters	Lighting	Building automation and control	PV, wind, ..
sub1	M1	M2		M3	M4	M5	M6	M7	M8	M9	M10	M11
1	General	General	General									
2	Common terms and definitions; symbols, units and subscripts	Building Energy Needs	Needs									
3	Application	(Free) Indoor Conditions without Systems	Maximum Load and Power									
4	Ways to Express Energy Performance	Ways to Express Energy Performance	Ways to Express Energy Performance									
5	Building Functions and Building Boundaries	Heat Transfer by Transmission	Emission and control	x								
6	Building Occupancy and Operating Conditions	Heat Transfer by Infiltration and Ventilation	Distribution and control	x								
7	Aggregation of Energy Services and Energy Carriers	Internal Heat Gains	Storage and control	x								
8	Building Partitioning	Solar Heat Gains	Generation and control	x								
9	Calculated Energy Performance	Building Dynamics (thermal mass)	Load dispatching and operating conditions									
10	Measured Energy Performance	Measured Energy Performance	Measured Energy Performance									
11	Inspection	Inspection	Inspection									

12	Ways to Express Indoor Comfort		BMS									
13	External Environment Conditions											
14	Economic Calculation											

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 12098-3:2018

<https://standards.iteh.ai/catalog/standards/sist/163ae542-9485-46bc-a74e-a675deb146de/sist-en-12098-3-2018>

1 Scope

This European Standard applies to electronic control equipment for heating systems with direct electrical emission, which do not have an integrated outdoor compensated function and or optimum start/stop function.

This control equipment controls and regulates the distribution and/or the generation of heat in relation to the outside temperature and time and other reference variables.

This European Standard also covers controllers that contain an integrated optimum start or an optimum start-stop control function. The controller modulates heating or control modes of electronic individual zone or emitter control equipment.

Safety requirements on heating systems remain unaffected by this standard. The dynamic behaviour of the local thermostats, sensors, or actuators is not covered in this standard.

A multi-distribution and/or multi-generation system needs a coordinated solution to prevent undesired interaction and is not part of this standard.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 60038, *CENELEC standard voltages (IEC 60038)*

EN 60529, *Degrees of protection provided by enclosures (IP Code) (IEC 60529)*

EN 60730-1, *Automatic electrical controls for household and similar use — Part 1: General requirements (IEC 60730-1)*

prEN ISO 52000-1:2015, *Energy performance of buildings — Overarching EPB assessment – Part 1: General framework and procedures*

EN ISO 7345:1995, *Thermal insulation - Physical quantities and definitions (ISO 7345:1987)*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN ISO 7345:1995, prEN ISO 52000-1:2015 and the following apply.

3.1

outside temperature compensated controller

OTC controller

controller optimising and/or regulating the generation of heat in relation to the outside temperature, time and optionally other reference variables (e.g. room temperature)


Note 1 to entry: The outside temperature compensated function calculates the heating power in relation to the outside temperature, based on the heating curve.

Note 2 to entry: The outside temperature optimum start-stop function calculates the pre-heat time and/or stop time to reach the comfort temperature level in relation with the outside temperature, switch time and several parameters (e.g. room temperature, tariff).

3.2

control equipment

equipment, consisting of OTC controller sensor input signals and output signals but not including the sensors and actuating equipment (see Figure 1)

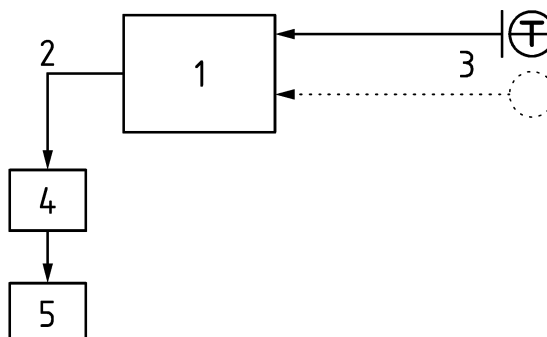

Key

- 1 OTC controller
- 2 output signals
- 3 input signals: reference variables
- 4 actuating equipment
- 5 heat generation and distribution

Figure 1 — Control equipment for electrical heating systems

3.3

actuating equipment

equipment by which the controller affects the controlled variable

3.4

controlled variable

heating emitted power

3.5

output signals

signals generated by the OTC controller for operating the local thermostat or the actuating equipment

3.6

reference variable

outside temperature with or without other influences or variables (e.g. room temperature) used to determine the set point of the controlled variable

Note 1 to entry: The reference variable is an input signal.

3.7

outside temperature

reference variable that is measured with a sensor fitted outside the building, mainly intended to measure the ambient temperature

prEN 12098-3:2015 (E)

3.8**room temperature**

resulting temperature in the building arising in comfort, economy or building protection operation mode of the OTC controller

Note 1 to entry: Room temperature can be different for individual rooms.

3.9**characteristic heating curve**

relation between the set point value of the controlled variable (heating) and the reference variables (outside temperature) defined by two or more parameters and depending on operation mode and additional variables

Note 1 to entry: The heating is calculated as a function of the heating curve, based on the outside temperature and the present room temperature set point.

3.10**comfort operation mode**

mode of operation between the switch-on time and the switch-off time, maintaining comfort room temperature

Note 1 to entry: Mode of operation for normally occupied rooms.

3.11**economy operation mode**

mode of operation between the switch-off time and the switch-on time, maintaining a reduced room temperature compared to the comfort room temperature

Note 1 to entry: The economy operation mode is a reduced mode.

3.12**building protection operation mode**

mode of operation between the switch-off time and the switch-on time, maintaining a room temperature required for building protection

3.13**automatic operation mode**

mode of operation of equipment when significant control functions are not overridden by the user

Note 1 to entry: During automatic operation mode, operation mode is selected automatically according to the scheduler, actual date and time.

3.14**summer/winter switch function**

seasonal switch on/off of the heating depending on a function of the outside temperature

3.15**set back function**

function, starting when the operation mode changes from comfort to economy or building protection mode

Note 1 to entry: During set back period, the heating is switched off until the calculated or measured room temperature drops below the economy or building protection set point; the operation mode switches back to comfort mode or the calculated switch-on time of the optimization start function is reached.