

---

**Priporočila za sisteme malih obnovljivih virov energije in hibridne sisteme za elektrifikacijo podeželja - 9-1. del: Mikro napajalni sistemi**

Recommendations for small renewable energy and hybrid systems for rural electrification  
- Part 9-1: Micropower systems

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

**Ta slovenski standard je istoveten z: IEC/TS 62257-9-1**  
SIST-TS IEC/TS 62257-9-1:2009  
<https://standards.iteh.ai/catalog/standards/sist/d1a4b95c-29f3-46cf-92a4-67959cf78c4d/sist-ts-iec-ts-62257-9-1-2009>

---

**ICS:**

27.190

Biološki viri in drugi  
alternativni viri energije

Biological sources and  
alternative sources of energy

**SIST-TS IEC/TS 62257-9-1:2009**

**en**

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

[SIST-TS IEC/TS 62257-9-1:2009](https://standards.iteh.ai/catalog/standards/sist/d1a4f93c-29f3-46cf-92a4-67959cf78c4d/sist-ts-iec-ts-62257-9-1-2009)

<https://standards.iteh.ai/catalog/standards/sist/d1a4f93c-29f3-46cf-92a4-67959cf78c4d/sist-ts-iec-ts-62257-9-1-2009>



IEC/TS 62257-9-1

Edition 1.0 2008-09

# TECHNICAL SPECIFICATION

**Recommendations for small renewable energy and hybrid systems for rural electrification –  
Part 9-1: Micropower systems**

[SIST-TS IEC/TS 62257-9-1:2009  
https://standards.iteh.ai/catalog/standards/sist/d1a4f93c-29f3-46cf-92a4-67959cf78c4d/sist-ts-iec-ts-62257-9-1-2009](https://standards.iteh.ai/catalog/standards/sist/d1a4f93c-29f3-46cf-92a4-67959cf78c4d/sist-ts-iec-ts-62257-9-1-2009)

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

PRICE CODE

**XA**

ICS 27.160; 27.180

ISBN 2-8318-9996-6

## CONTENTS

FOREWORD.....	5
INTRODUCTION.....	7
1 Scope.....	8
2 Normative references .....	9
3 Terms and definitions .....	9
4 General .....	11
4.1 Boundary of a micropower plant .....	11
4.2 Composition of a micropower plant.....	12
4.3 General functional layout of a micropower plant .....	12
5 Design.....	13
5.1 Design criteria .....	13
5.2 Power generation mix.....	14
5.2.1 General .....	14
5.2.2 Internal combustion generator sets .....	15
5.3 Electrical design.....	15
5.3.1 System voltage selection .....	15
5.3.2 Interconnection of generators .....	15
5.4 Mechanical and civil works .....	16
5.4.1 Civil works.....	16
5.4.2 Technical room.....	16
5.4.3 Battery room.....	17
5.4.4 Specific requirements .....	17
6 Safety issues.....	17
6.1 Electrical issues .....	17
6.1.1 General .....	17
6.1.2 Specific requirements .....	17
6.2 Mechanical issues .....	21
6.3 Thermal and fire issues .....	22
6.4 Noise issues.....	22
6.5 Access security .....	22
7 Erection of equipment.....	22
7.1 Siting.....	22
7.1.1 Photovoltaic array.....	22
7.1.2 Wind turbine .....	23
7.1.3 Micro-hydro turbine .....	23
7.1.4 Generator set .....	23
7.1.5 Technical room.....	23
7.2 Equipment installation .....	24
7.2.1 Mechanical .....	24
7.2.2 Electrical .....	24
8 Acceptance process .....	26
8.1 General.....	26
8.2 Phase 1: Preparation.....	27
8.3 Phase 2: Documentation .....	27
8.4 Phase 3: Commissioning .....	27

8.4.1	Step 1: Evaluation of the conformity of the installed system with the accepted design .....	27
8.4.2	Step 2: Evaluation of qualification of the installation .....	27
8.4.3	Step 3: Preliminary tests.....	27
8.4.4	Step 4: Performance testing .....	28
8.5	Phase 4: Agreement.....	28
8.6	Commissioning records .....	28
9	Operation, maintenance and replacement.....	28
10	Marking and documentation.....	29
10.1	Marking .....	29
10.1.1	Information for emergency services .....	29
10.1.2	Information for maintenance .....	29
10.1.3	Information for batteries .....	29
10.1.4	Information for sockets .....	29
10.1.5	Signs .....	29
10.2	Documentation .....	30
Annex A (informative)	Selectivity of protection .....	31
Annex B (informative)	Risk assessment of lightning stroke.....	32
Annex C (normative)	Voltage domains .....	35
Annex D (informative)	Battery room .....	36
Annex E (informative)	Energy fraction calculations .....	39
Annex F (informative)	Noise control .....	41
Annex G (informative)	Commissioning record sheet (examples).....	43
Bibliography.....	<a href="https://standards.iteh.ai/catalog/standards/sist/d1a493c-29b-46cf-92a4-67959cf78c4d/sist-ts-iec-ts-62257-9-1-2009">https://standards.iteh.ai/catalog/standards/sist/d1a493c-29b-46cf-92a4-67959cf78c4d/sist-ts-iec-ts-62257-9-1-2009</a>	53
Figure 1	– Micropower system limits .....	11
Figure 2	– Example of functional layout for a micropower plant supplying a.c. energy.....	13
Figure 3	– Interconnection configuration with d.c. bus and a.c. bus.....	16
Figure 4	– Interconnection configuration with a.c. bus only .....	16
Figure 5	– Example of protection against effects of lightning and over-voltage for generators with two live conductors output (d.c. or a.c.) TNS P+N .....	18
Figure 6	– Example of protection against effects of lightning over-voltage for three phase generators with four live a.c. conductors (TNS P+N scheme) – Generator side.....	19
Figure 7	– Example of a simplified lightning protection including a crow's foot earth termination.....	20
Figure 8	– Protection of a photovoltaic array.....	21
Figure 9	– Wiring arrangement for equipotential link .....	21
Figure A.1	– Example of the selectivity of protection .....	31
Table 1	– Minimum dimensions for lightning protection wires .....	20
Table 2	– Cross-section of 230 V a.c. power cables .....	24
Table 3	– Fuse ratings for protection from short-circuiting in 230 V/400 V a.c. circuits .....	25
Table 4	– Fuse ratings for protection from short-circuiting in 120 V/208 V a.c. circuits .....	26
Table 5	– Circuit-breaker ratings for protection from short-circuiting .....	26
Table B.1	– Stake index values.....	32
Table B.2	– Construction index values .....	33

Table B.3 – Height index values.....	33
Table B.4 – Situation index values .....	33
Table B.5 – Lightning prevalence index values .....	33
Table B.6 – Assessment of risk and need for protection.....	34
Table C.1 – Voltage domains .....	35

## **iTeh STANDARD PREVIEW** **(standards.iteh.ai)**

[SIST-TS IEC/TS 62257-9-1:2009](https://standards.iteh.ai/catalog/standards/sist/d1a4f93c-29f3-46cf-92a4-67959cf78c4d/sist-ts-iec-ts-62257-9-1-2009)

<https://standards.iteh.ai/catalog/standards/sist/d1a4f93c-29f3-46cf-92a4-67959cf78c4d/sist-ts-iec-ts-62257-9-1-2009>

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**RECOMMENDATIONS FOR SMALL RENEWABLE ENERGY AND  
HYBRID SYSTEMS FOR RURAL ELECTRIFICATION –****Part 9-1: Micropower systems**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. In exceptional circumstances, a technical committee may propose the publication of a technical specification when

- the required support cannot be obtained for the publication of an International Standard, despite repeated efforts, or
- the subject is still under technical development or where, for any other reason, there is the future but no immediate possibility of an agreement on an International Standard.

Technical specifications are subject to review within three years of publication to decide whether they can be transformed into International Standards.

IEC 62257-9-1, which is a technical specification, has been prepared by IEC technical committee 82: Solar photovoltaic energy systems.

This technical specification is based on IEC/PAS 62111 (1999); it cancels and replaces the relevant parts of IEC/PAS 62111.

This technical specification is to be used in conjunction with the IEC 62257 series and with future parts of this series as and when they are published.

The text of this technical specification is based on the following documents:

Enquiry draft	Report on voting
82/501/DTS	82/526/RVC

Full information on the voting for the approval of this technical specification can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all the parts of the IEC 62257 series, under the general title *Recommendations for small renewable energy and hybrid systems for rural electrification*, can be found on the IEC web site.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under "http://webstore.iec.ch" in the data related to the specific publication. At this date, the publication will be

- transformed into an international standard;
- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

A bilingual version of this publication may be issued at a later date.

**iTeh STANDARD PREVIEW**  
(standards.iteh.ai)  
SIST-TS IEC/TS 62257-9-1:2009  
<https://standards.iteh.ai/catalog/standards/sist/d1a4b93c-2913-46cf-92a4-67959cf78c4d/sist-ts-iec-ts-62257-9-1-2009>



## INTRODUCTION

The IEC 62257 series of documents intends to provide to the different players involved in rural electrification projects (such as project implementers, project contractors, project supervisors, installers, etc.) documents for the setting-up of renewable energy and hybrid systems with a.c. nominal voltage below 500 V, d.c. nominal voltage below 750 V and nominal power below 100 kVA.

These documents are recommendations:

- to choose the right system for the right place;
- to design the system;
- to operate and maintain the system.

These documents are focused only on rural electrification concentrating on, but not specific to, developing countries. They must not be considered as all-inclusive to rural electrification. The documents try to promote the use of renewable energies in rural electrification; they do not deal with clean mechanisms developments at this time (CO<sub>2</sub> emission, carbon credit, etc.). Further developments in this field could be introduced in future steps.

This consistent set of documents is best considered as a whole with different parts corresponding to items for safety, sustainability of systems and at the lowest life-cycle cost as possible. One of the main objectives is to provide the minimum sufficient requirements, relevant to the field of application, that is, small renewable energy and hybrid off-grid systems.

iteh STANDARD PREVIEW  
(standards.iteh.ai)

SIST-TS IEC/TS 62257-9-1:2009

<https://standards.iteh.ai/catalog/standards/sist/d1a4f93c-29f3-46cf-92a4-67959cf78c4d/sist-ts-iec-ts-62257-9-1-2009>

## RECOMMENDATIONS FOR SMALL RENEWABLE ENERGY AND HYBRID SYSTEMS FOR RURAL ELECTRIFICATION –

### Part 9-1: Micropower systems

#### 1 Scope

Decentralized Rural Electrification Systems (DRES) are designed to supply electric power for sites which are not connected to a large interconnected system, or a national grid, in order to meet basic needs.

The majority of these sites are

- isolated dwellings;
- village houses;
- community services (public lighting, pumping, health centres, places of worship or cultural activities, administrative buildings, etc.);
- economic activities (workshops, micro-industry, etc.).

The DRES fall into the following three categories:

- process electrification systems (for example, for pumping);
- individual electrification systems (IES) for single users;
- collective electrification systems (CES) for multiple users.

Process or individual electrification systems exclusively consist of two subsystems:

- an electric energy generation subsystem;
- the user's electrical installation.

Collective electrification systems, however, consist of three subsystems:

- an electric energy generation subsystem;
- a distribution subsystem, also called microgrid;
- user's electrical installations including interface equipment between the installations and the microgrid.

This technical specification applies to a micropower plant which is the electric energy generation subsystem associated with a decentralized rural electrification system.

It provides general requirements for the design, erection and operation of micropower plants and general requirements to ensure the safety of persons and property.

The micropower plants covered by this specification are low-voltage a.c., three-phase or single-phase, with rated capacity less than, or equal to, 100 kVA. They do not include voltage transformation.

The low-voltage levels covered under this specification are

- the 230 V 1-Ø/400 V 3-Ø, the 220 V 1-Ø/380 V 3-Ø, and the 120 V 1-Ø/208 V 3-Ø systems at 60 Hz or 50 Hz;
- the ELV d.c. systems.

The requirements cover “centralized” micropower plants for application in

- process electrification;
- individual electrification systems and collective electrification systems.

It does not apply to distributed generation on microgrids.

## 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60364 (all parts), *Low-voltage electrical installations*

IEC 60364-5-53:2001, *Electrical installations of buildings – Part 5-53: Selection and erection of electrical equipment – Isolation, switching and control*

IEC 60529 (all parts), *Degrees of protection provided by enclosures (IP Code)*

IEC/TS 62257-2:2004, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 2: From requirements to a range of electrification systems*

IEC/TS 62257-4:2005, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 4: System selection and design*

IEC/TS 62257-5:2005, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 5: Protection against electrical hazards*

IEC/TS 62257-6:2005, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 6: Acceptance, operation, maintenance and replacement*

IEC/TS 62257-7-1:2006, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 7-1: Generators – Photovoltaic arrays*

IEC/TS 62257-7-3:2008, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 7-3: Generator set – Selection of generator sets for rural electrification systems*

IEC/TS 62257-9-2:2006, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 9-2: Microgrids*

IEC/TS 62257-9-4:2006, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 9-4: Integrated system – User installation*

## 3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

### 3.1

#### **generator set**

equipment producing electricity from a fossil fuel; it consists basically of an internal combustion engine producing mechanical energy and a generator which converts the mechanical energy into electrical energy and mechanical transmission, support and assembly components

**3.2****reference earth****reference ground (US)**

conductive part of the earth, considered as conductive, the electric potential of which is conventionally taken as zero, being outside the zone of influence of any earthing arrangement

[IEV 826-13-01]

**3.3****skilled person**

person with relevant education or experience to enable him/her

- to perceive risks and to avoid hazards which electrical, chemical or mechanical equipment may create;
- to perform or supervise correctly the required task.

**3.4****instructed person**

person adequately advised or supervised by skilled persons to enable him/her

- to perceive risks and to avoid hazards which electrical, chemical or mechanical equipment may create;
- to perform correctly the required task.

**3.5****ordinary person**

person who is neither a skilled person nor an instructed person

**3.6****licenced person**

person who is authorized to perform electrical work under the appropriate state or territory statutes and regulations (only skilled or instructed persons can be licenced)

**3.7****microgrid**

subsystem of a DRES intended for power distribution of which the capacity does not exceed 100 kVA, the prefix “micro” being intended to express the low level of transmitting capacity

**3.8****micropower plant**

subsystem of a DRES for power generation up to 100 kVA, the prefix “micro” being intended to express the low power level generated (from a few kVA to a few tens of kVA)

**3.9****protective conductor (identification: PE)**

conductor provided for purposes of safety, for example protection against electric shock

[IEV 826-13-22]

**3.10****PEN conductor**

conductor combining the functions of both a protective earthing conductor and a neutral conductor

[IEV 826-13-25]

**3.11****power line**

overhead or underground line installed to convey electrical energy for any purpose other than communication

**3.12****renewable energy****RE**

energy generated from natural resources such as sunlight, wind, rain, waves, tides, geothermal heat (list not exhaustive), which are renewable (naturally replenished). Renewable energy technologies include solar power, wind power, hydroelectricity, micro hydro, biomass, biofuels (list not exhaustive)

**3.13****selectivity of protection**

ability of a protection to identify the faulty section and/or phase(s) of a power system

[IEV 448-11-06]

**3.14****lightning arrester****surge diverter****surge arrester**

device intended to protect the electrical apparatus from high transient overvoltages and to limit the duration and frequently the amplitude of the follow-on current


[IEV 811-31-09]

**3.15****technical room/cabinet**

room or cabinet in which are located devices and apparatus dedicated to inter-connection of the different generators, protection of the different circuits, monitoring and control of the micropower plant and interfacing with the application

**4 General****4.1 Boundary of a micropower plant**

The micropower plant is defined as illustrated in Figure 1.

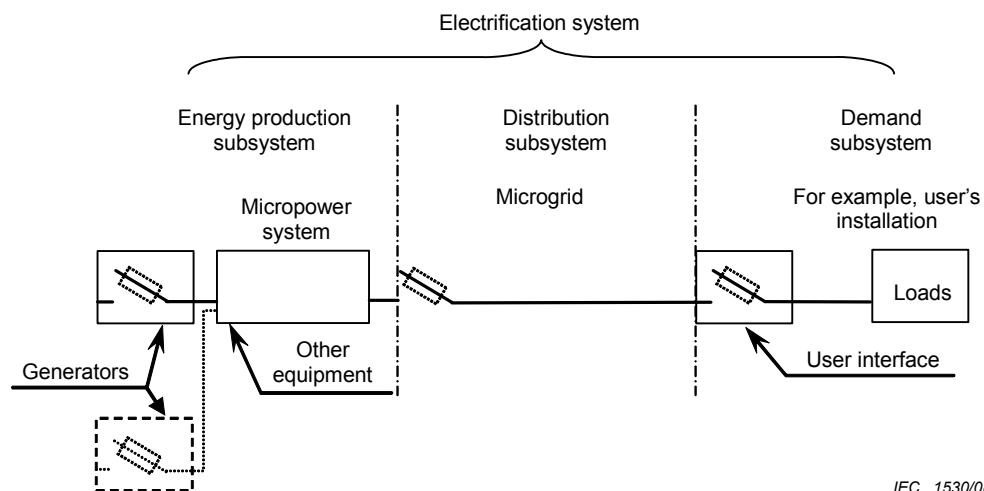

IEC 1530/08

**Figure 1 – Micropower system limits**

The physical limits of the micropower plant are the upstream terminals of the main switch between the micropower plant and the microgrid.

## 4.2 Composition of a micropower plant

A micropower plant includes:

- one or several generators;
- storage devices (if needed) and associated charge controller;
- other equipment, such as
  - energy management device;
  - energy converter;
  - telecommunication equipment (if any);
  - main board;
  - interfaces:
    - between generators;
    - between the micropower plant and the microgrid or the application;
    - between the micropower plant and the operator;
  - switches;
  - protection devices;
- equipotential bonding;
- earthing system;
- civil works.


iteh STANDARD PREVIEW  
(standards.iteh.ai)

[SIST-TS IEC/TS 62257-9-1:2009](https://standards.iteh.ai/catalog/standards/sist-ts-iec-ts-62257-9-1-2009)

## 4.3 General functional layout of a micropower plant

<https://standards.iteh.ai/catalog/standards/sist-ts-iec-ts-62257-9-1-2009>

Figure 2 illustrates an example of the general functional layout of a micropower plant combining the different equipment listed in 4.2.

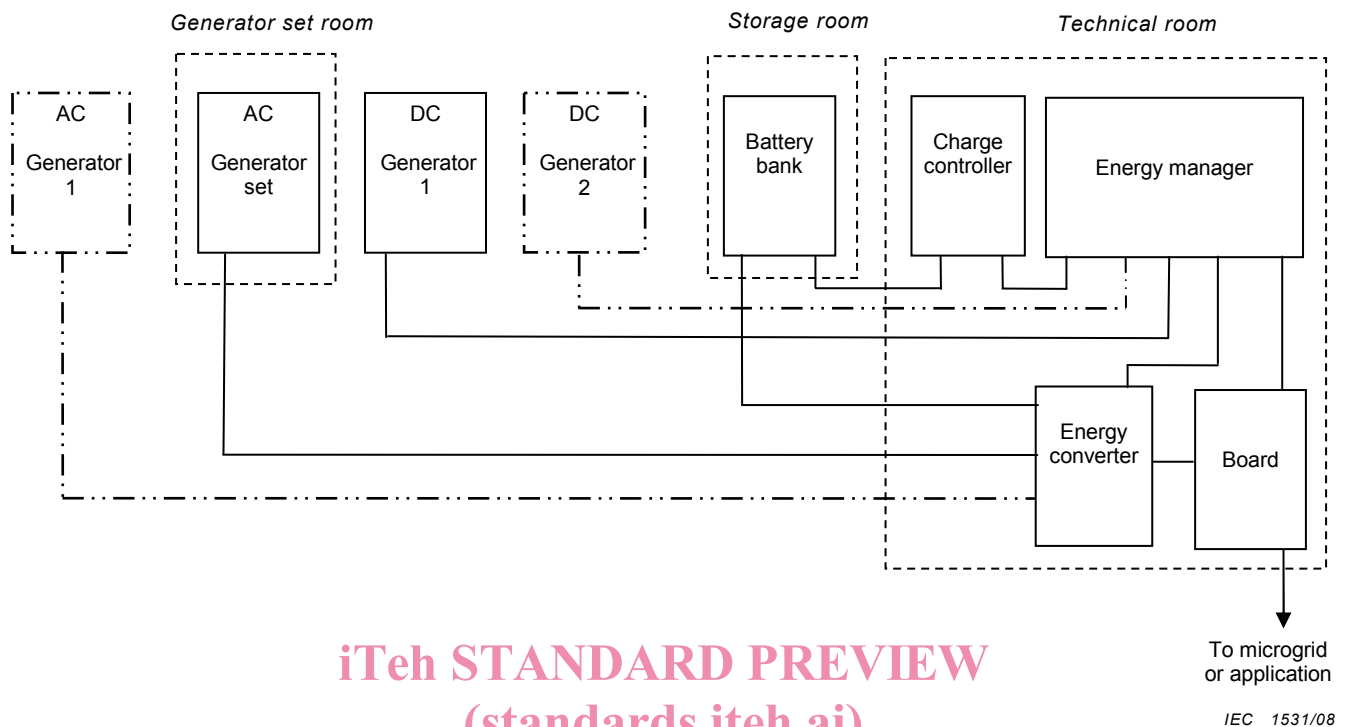

SIST-TS IEC/TS 62257-9-1:2009  
Figure 2 – Example of functional layout for a micropower plant supplying a.c. energy  
<https://standards.iteh.ai/catalog/standards/sist/62257-9-1-2009/67959cf78c4d/sist-ts-iec-ts-62257-9-1-2009>

## 5 Design

### 5.1 Design criteria

The design of any system should be guided by a number of criteria, determined by the project implementer (for example, user's affordable needs, lowest economic life-cycle cost, lowest environmental impact, site constraints). Some of the major areas to be considered are:

- average daily design d.c. load energy and average daily design a.c. load energy;
- maximum and surge power demand;
- system *bus bar* voltage and *service (output)* voltage;
- energy resources (sun, wind, hydro, fuel, biomass, etc.);
- budget constraints;
- power quality (for example, waveform quality or continuity of supply);
- environmental impact (for example, trimming or removal of trees for a PV system, civil works and diversion of water in a hydro system);
- use of existing equipment;
- acceptable extent of generator set running versus renewable energy contribution;
- acceptable noise levels;
- availability of spare parts and maintenance service;
- site accessibility;
- acceptable level of reliability and maintenance;