



SLOVENSKI STANDARD SIST-TP ISO/TR 4191:2018

01-september-2018

Nadomešča:
SIST ISO/TR 4191:1995

Cevni sistemi iz polimernih materialov za oskrbo z vodo - Nemehčan polivinilklorid (PVC-U) in orientiran PVC-U (PVC-O) - Navodila za vgradnjo

Plastics piping systems for water supply -- Unplasticized poly(vinyl chloride)(PVC-U) and oriented PVC-U (PVC-O) -- Guidance for installation

iTeh STANDARD PREVIEW
(standards.iteh.ai)

Systèmes de canalisations en plastique pour l'alimentation en eau -- Polychlorure de vinyle non plastifié (PVC-U) et orienté PVC-U (PVC-O) -- Pratique recommandée pour la pose

<https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ff64f8ebec7/sist-tp-iso-tr-4191-2018>

Ta slovenski standard je istoveten z: ISO/TR 4191:2014

ICS:

23.040.20	Cevi iz polimernih materialov	Plastics pipes
91.140.60	Sistemi za oskrbo z vodo	Water supply systems

SIST-TP ISO/TR 4191:2018 en

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST-TP ISO/TR 4191:2018](https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ff64f8ebec7/sist-tp-iso-tr-4191-2018)

<https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ff64f8ebec7/sist-tp-iso-tr-4191-2018>

TECHNICAL
REPORT

ISO/TR
4191

Second edition
2014-01-15

**Plastics piping systems for water
supply — Unplasticized poly(vinyl
chloride)(PVC-U) and oriented PVC-U
(PVC-O) — Guidance for installation**

*Systèmes de canalisations en plastique pour l'alimentation en eau —
Polychlorure de vinyle non plastifié (PVC-U) et orienté PVC-U (PVC-O)
— Pratique recommandée pour la pose*

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST-TP ISO/TR 4191:2018](https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ff64f8ebec7/sist-tp-iso-tr-4191-2018)

<https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ff64f8ebec7/sist-tp-iso-tr-4191-2018>



Reference number
ISO/TR 4191:2014(E)

© ISO 2014

iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST-TP ISO/TR 4191:2018](https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ffe4f8ebec7/sist-tp-iso-tr-4191-2018)

<https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ffe4f8ebec7/sist-tp-iso-tr-4191-2018>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2014

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword	iv
Introduction	v
1 Scope	1
2 Normative references	1
3 Terms and definitions, symbols, and abbreviations	2
3.1 Terms and definitions.....	2
3.2 Symbols.....	4
3.3 Abbreviations.....	4
4 Parameters influencing design	5
4.1 Allowable operating pressure.....	5
4.2 Ring stiffness of pipes.....	5
5 Hydraulic properties	7
5.1 Loss of head.....	7
6 Assembly methods	9
6.1 General.....	9
6.2 Integral rubber ring joints.....	13
6.3 Solvent cement joints.....	14
6.4 Mechanical joints.....	15
7 Storage, handling, and transport of pipes	15
7.1 Handling.....	15
7.2 Transport.....	16
7.3 Storage.....	16
7.4 Cold bending on site.....	17
7.5 Anchoring and thrust blocks.....	19
8 Storage, handling, and transport of fittings, valves, and ancillaries	21
8.1 PVC-U fittings, valves, and ancillaries are light and easy to handle.....	21
9 Installation	22
9.1 Installation below ground.....	22
9.2 Pipe deflection.....	25
9.3 Installation above ground.....	27
9.4 Installation in ducts.....	31
10 Commissioning by site pressure testing	31
10.1 General.....	31
10.2 Preparation for test.....	31
10.3 Test pressures.....	35
10.4 Applying the test.....	35
10.5 Interpretation of results.....	36
11 Contaminated soil	36
12 Corrosion protection of metal parts	36
13 Pressure surge	37
14 Usage at lower temperature	37
15 Fatigue	37
16 Repairs	38
17 Pipeline detection	39
Annex A (informative) Classification of soils	40
Bibliography	44

ISO/TR 4191:2014(E)

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the WTO principles in the Technical Barriers to Trade (TBT) see the following URL: Foreword - Supplementary information

The committee responsible for this document is ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*, Subcommittee SC 2, *Plastics pipes and fittings for water supplies*.

This second edition cancels and replaces the first edition (ISO/TR 4191:1989), which has been technically revised.

Introduction

This Technical Report is a guidance document and gives a recommended practice for the installation of unplasticized poly(vinyl chloride) (PVC-U) and oriented unplasticized poly(vinyl chloride) (PVC-O) piping systems conveying water under pressure for buried and above-ground drainage and sewerage systems.

Molecular orientation of PVC-U results in the improvement of physical and mechanical properties.

Unless specifically mentioned, the recommendations are valid for both PVC-U and PVC-O and expressed as PVC.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[SIST-TP ISO/TR 4191:2018](https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ffe4f8ebec7/sist-tp-iso-tr-4191-2018)

<https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ffe4f8ebec7/sist-tp-iso-tr-4191-2018>

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST-TP ISO/TR 4191:2018](https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ffe4f8ebec7/sist-tp-iso-tr-4191-2018)

<https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ffe4f8ebec7/sist-tp-iso-tr-4191-2018>

Plastics piping systems for water supply — Unplasticized poly(vinyl chloride)(PVC-U) and oriented PVC-U (PVC-O) — Guidance for installation

1 Scope

This ISO Technical Report gives recommended practices for installation of unplasticized poly(vinyl chloride) (PVC-U) and oriented unplasticized poly(vinyl chloride) (PVC-O) pipes, fittings, valves, and ancillaries when used in piping systems conveying water under pressure.

The recommendations are intended to give practical guidance of design and installation of piping systems incorporating pipes, fittings, valves, and ancillary equipment made from PVC materials and used for the following purposes:

- water mains and services buried in ground;
- waste water under pressure;
- conveyance of water above ground for both outside and inside buildings,

for the supply of water under pressure at approximately 20 °C (cold water) intended for human consumption and for general purposes.

This Technical report is also applicable to components for the conveyance of water up to and including 45 °C. For temperatures between 25 °C and 45 °C, Figure 1 of ISO 1452-2:2009 applies.

In addition, recommendations are given for the connection to fittings, valves, and ancillary equipment made from materials other than PVC.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 3, *Preferred numbers — Series of preferred numbers*

ISO 161-1, *Thermoplastics pipes for the conveyance of fluids — Nominal outside diameters and nominal pressures — Part 1: Metric series*

ISO 1452-1:2009, *Plastics piping systems for water supply and for buried and above-ground drainage and sewerage under pressure — Unplasticized poly(vinyl chloride) (PVC-U) — Part 1: General*

ISO 1452-2:2009, *Plastics piping systems for water supply and for buried and above-ground drainage and sewerage under pressure — Unplasticized poly(vinyl chloride) (PVC-U) — Part 2: Pipes*

ISO 1452-3, *Plastics piping systems for water supply and for buried and above-ground drainage and sewerage under pressure — Unplasticized poly(vinyl chloride) (PVC-U) — Part 3: Fittings*

ISO 1452-4, *Plastics piping systems for water supply and for buried and above-ground drainage and sewerage under pressure — Unplasticized poly(vinyl chloride) (PVC-U) — Part 4: Valves*

ISO 1452-5, *Plastics piping systems for water supply and for buried and above-ground drainage and sewerage under pressure — Unplasticized poly(vinyl chloride) (PVC-U) — Part 5: Fitness for purpose of the system*

ISO 4065, *Thermoplastics pipes — Universal wall thickness table*

ISO/TR 4191:2014(E)

ISO 4633, *Rubber seals — Joint rings for water supply, drainage and sewerage pipelines — Specification for materials*

ISO 7387-1, *Adhesives with solvents for assembly of PVC-U pipe elements — Characterization — Part 1: Basic test methods*

ISO 9080, *Plastics piping and ducting systems — Determination of the long-term hydrostatic strength of thermoplastics materials in pipe form by extrapolation*

ISO 9311-1, *Adhesives for thermoplastic piping systems — Part 1: Determination of film properties*

ISO 9969, *Thermoplastics pipes — Determination of ring stiffness*

ISO/DIS 16422:2013, *Pipes and joints made of oriented unplasticized poly(vinyl chloride) (PVC-O) for the conveyance of water under pressure — Specifications*

3 Terms and definitions, symbols, and abbreviations**3.1 Terms and definitions**

For the purposes of this document, the terms and definitions in ISO 1452-1:2009 and the following apply.

3.1.1**nominal outside diameter** d_n

numerical designation of size which is common to all components in a thermoplastics piping system other than flanges and components designated by thread size

Note 1 to entry: It is a convenient round number for reference purposes.

Note 2 to entry: For pipe conforming to ISO 161-1, the nominal outside diameter, expressed in millimetres, is the minimum mean outside diameter $d_{em, min}$.

3.1.2**nominal wall thickness** e_n

specified wall thickness, in millimetres

Note 1 to entry: It is identical to the specified minimum wall thickness at any point $e_{y, min}$.

3.1.3**nominal pressure (PN)**

alphanumeric designation related to the mechanical characteristics of the components of a piping system and used for reference purposes

3.1.4**hydrostatic pressure** p

internal pressure applied to a piping system

3.1.5**working pressure (PFA)**

maximum pressure which a piping system can sustain in continuous use under given service conditions without pressure surge

Note 1 to entry: For thermoplastics piping systems, the value of the nominal pressure is equal to the working pressure at a temperature of 20 °C expressed in bars.

3.1.6 hydrostatic stress

σ

stress induced in the wall of a pipe when it is subjected to internal water pressure

Note 1 to entry: The stress in megapascals is related to the internal pressure, p , in bars, the nominal wall thickness, e_n , in millimetres, and the nominal outside diameter of the pipe, d_n , in millimetres by the following formula:

$$\sigma = \frac{p \times (d_n - e_n)}{20e_n}$$

Note 2 to entry: If σ and p are given in the same units, the denominator becomes $2e_n$.

3.1.7 long-term hydrostatic strength at 20 °C

σ_{lhts}

quantity with the unit of stress, i.e. MPa, which can be considered to be a property of the material under consideration and which represents the 97,5 % lower confidence limit for the long-term hydrostatic strength and equals the predicted average strength at a temperature of 20 °C and a time of 50 years with internal water pressure

Note 1 to entry: ISO 9080 gives the possibility to extrapolate to 100 year lifetime.

3.1.8 lower confidence limit of the predicted hydrostatic strength

σ_{LPL}

quantity with the dimension of stress, which represents the 97,5 % lower confidence limit of the predicted hydrostatic strength for a single value at a temperature T and a time t

Note 1 to entry: It is denoted as $\sigma_{LPL} = \sigma_{(T,t,0,975)}$.
<https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ff418beba7/sist-tp-iso-tr-4191-2018>

Note 2 to entry: The value of this quantity is determined by the method given in ISO 9080.

3.1.9 minimum required strength

MRS

value of σ_{LPL} rounded to the next lower value of the R 10 series from ISO 3 when σ_{LPL} is below 10 MPa or to the next lower value of the R 20 series when σ_{LPL} is higher than 10 MPa

3.1.10 design coefficient

C

overall coefficient with a value greater than one, which takes into consideration service conditions, as well as properties of the components of a piping system other than those represented in σ_{LPL}

3.1.11 pipe series S

dimensionless number for pipe designation (see ISO 4065)

3.1.12 standard dimension ratio

SDR

numerical designation of a pipe series which is a convenient round number approximately equal to the dimension ratio of the nominal outside diameter, d_n , and the nominal wall thickness, e_n

Note 1 to entry: According to ISO 4065, the standard dimension ratio, SDR, and the pipe series S are related as follows:

$$[SDR] = 2[S] + 1$$

ISO/TR 4191:2014(E)

3.2 Symbols

C	design coefficient
d_e	outside diameter (at any point)
d_{em}	mean outside diameter
d_i	inside diameter (at any point)
d_{im}	mean inside diameter of socket
d_n	nominal (outside or inside) diameter
DN	nominal size
E	wall thickness (at any point)
e_m	mean wall thickness
e_n	nominal wall thickness
f_A	derating (or uprating) factor for application
f_T	derating factor for temperatures
Δ	material density
Σ	hydrostatic stress
P	internal hydrostatic pressure
p_T	test pressure
σ_s	design stress
σ_{LPL}	stress at lower predicted confidence limit

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST-TP ISO/TR 4191:2018](https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ff64f8ebec7/sist-tp-iso-tr-4191-2018)

<https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ff64f8ebec7/sist-tp-iso-tr-4191-2018>

3.3 Abbreviations

LPL	lower predicted confidence limit
MRS	minimum required strength
MOP	maximum operating pressure
PFA	allowable operating pressure
PEA	allowable site test pressure
PN	nominal pressure
DN	nominal diameter
PVC-U	unplasticized poly(vinyl chloride)
SDR	standard dimension ratio
PVC-O	oriented poly(vinyl chloride)

4 Parameters influencing design

4.1 Allowable operating pressure

4.1.1 Where pipe material temperatures do not exceed 25 °C, and where no extra safety considerations are applicable, nominal pressures are given in Table A.1 of ISO 1452-2:2009 and in Table 2 of ISO/DIS 16422:2013. These nominal pressures have been calculated on the basis of well-established data, taking into account a service life of at least 50 years of continuous operation. For common water supply systems up to 25 °C, the allowable operating pressure PFA in bars (1 bar = 105 N/m² = 0,1 MPa) is equal to the nominal pressure, PN.

4.1.2 Design coefficient, *C*, should comply with those specified in ISO 1452, for PVC-U, and ISO 16422, for PVC-O.

4.1.3 Where the water service temperature is between 25 °C and 45 °C, it is required that the maximum allowable pressure is reduced by applying a derating factor, *f_T*, as shown in Figure A.1 of ISO 1452-2:2009 and Annex C of ISO/DIS 16422:2013.

Figure A.1 of ISO 1452-2:2009 shows that for temperatures up to and including 25 °C, the derating factor to be applied is 1,0 and for temperatures above 25 °C, the derating factor reduces from 1,0 to 0,63 at 45 °C. The same is valid for PVC-O pipes.

Where water service temperatures are expected to exceed 45 °C, the manufacturer's advice should be obtained.

ITeH STANDARD PREVIEW

4.2 Ring stiffness of pipes (standards.iteh.ai)

Where a calculation of the initial pipe deflection is applied, the initial ring stiffness of the pipe should be taken from [Table 1](https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ff64f8ebec7/sist-tp-iso-tr-4191-2018).

Table 1 — Initial ring stiffness of pipes

	Pipe series							
	S 20 (SDR 41)	S 16,7 (SDR 34,4)	S 16 (SDR 33)	S 12,5 (SDR 26)	S 10 (SDR 21)	S 8 (SDR 17)	S 6,3 (SDR 13,6)	S 5 (SDR 11)
Nominal pressure for $d_n \leq 90$ for $d_n > 90$	– PN 6	PN 6 PN 7,5	PN 6 PN 8	PN 8 PN 10	PN 10 PN 12,5	PN 12,5 PN 16	PN 16 PN 20	PN 20 PN 25
Calculated ring stiffness in kN/m ² (<i>S_{calc}</i>)	3,9	6,7	7,6	16	31,3	61	125	250
Nominal ring stiff- ness <i>SN</i>	4	8	–	16	32	–	–	–

ISO/TR 4191:2014(E)

The initial ring stiffness S_{calc} in [Table 1](#) has been calculated using the following formula:

$$S_{\text{calc}} = \frac{E \times I}{(d_e - e_n)^3} = \frac{E}{96 [S]^3} \quad (1)$$

where

S_{calc} is the calculated initial ring stiffness in kilonewtons per square metre;

E is the modulus of elasticity in flexure, having the value of $3,2 \times 10^6$ kN/m² for PVC-U and having the value of 4×10^6 kN/m² for PVC-O;

I is the moment of inertia in cubic millimetres with $\frac{1 \times e_n^3}{12}$ for 1 m pipe length;


d_e is the nominal outside diameter in millimetres;

e_n is the nominal wall thickness in millimetres;


S is the pipe series.

The initial ring stiffness of PVC-O pipes with the different MRS values are given in the graphs of [Figure 1](#).

E: PVC-O: 4×10^6 kN/m² (4 000 Mpa) E: PVC-U: $3,2 \times 10^6$ kN/m² (3 200 Mpa).

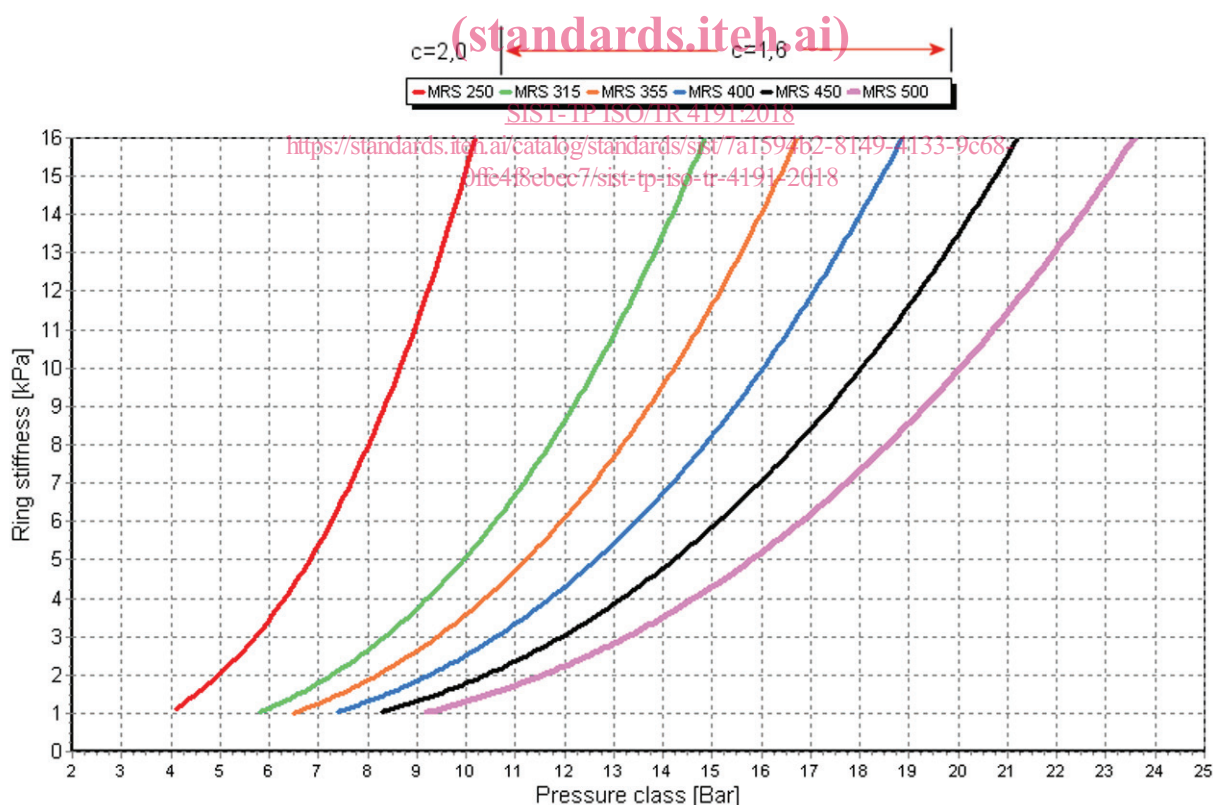

NOTE The following C factor has been used: MRS 250 (PVC-U): C = 2,0; PVC-O: C = 1,6.

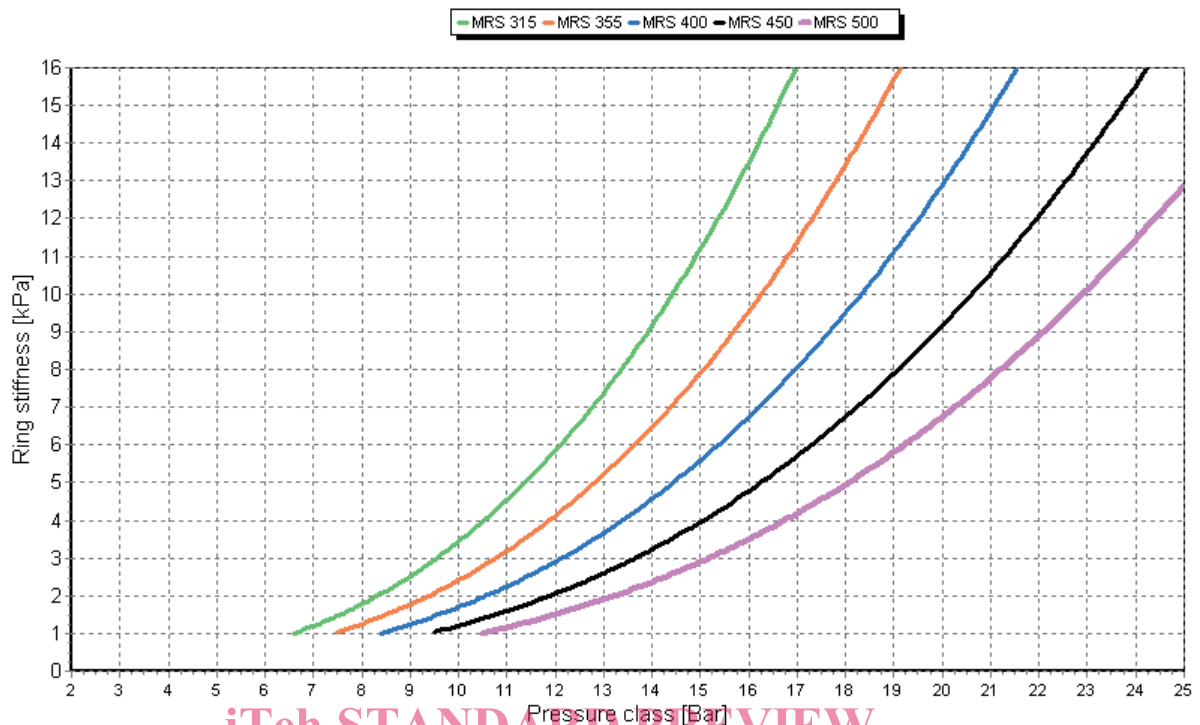

NOTE The following C factor has been used: PVC-O: C = 1,4.

Figure 1 — Initial ring stiffness of pipes of PVC-O
 SIST-TP ISO/TR 4191:2018
<https://standards.iteh.ai/catalog/standards/sist/7a1594b2-8149-4133-9c68-0ff64f8ebec7/sist-tp-iso-tr-4191-2018>

In case the actual modulus measured or stated by the manufacturer or designer is known, then use the following correction formulae:

For PVC-U: $SN = SN1 \times E/3\ 200$

For PVC-O: $SN = SN1 \times E/4\ 000$

(SN1 = taken from the graph)

5 Hydraulic properties

5.1 Loss of head

For head losses through fittings, the manufacturer's advice should be obtained.

PVC pressure pipes are specified by nominal diameters, d_n . Internal diameters vary according to pipe series (see Table 2 of ISO 1452-2:2009 and ISO/DIS 16422:2013). This shall be taken into account when calculating the flow characteristics of pipes.