
**Resilient and textile floor-coverings —
Determination of side length, edge
straightness and squareness of tiles**

*Revêtements de sol résilients ou textiles — Détermination de la
longueur des bords, de la rectitude des arêtes et de l'équerrage des
dalles*

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[ISO 24342:2007](#)

[https://standards.iteh.ai/catalog/standards/sist/97c8886d-1f69-4f78-a144-
dcf7ed6fedba/iso-24342-2007](https://standards.iteh.ai/catalog/standards/sist/97c8886d-1f69-4f78-a144-dcf7ed6fedba/iso-24342-2007)



PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 24342:2007

<https://standards.iteh.ai/catalog/standards/sist/97c8886d-1f69-4f78-a144-dcf7ed6fedba/iso-24342-2007>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2007

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword.....	iv
1 Scope	1
2 Terms and definitions.....	1
3 Principle	2
4 Apparatus	2
5 Sampling and selection of specimens.....	6
6 Atmosphere for conditioning and testing	7
7 Procedure	7
7.1 General.....	7
7.2 Side length.....	7
7.2.1 Gauge method.....	7
7.2.2 Movable dial gauge method.....	7
7.2.3 Sliding calliper method	7
7.3 Squareness.....	7
7.3.1 Thickness gauge method.....	7
7.3.2 Movable dial gauge method.....	8
7.4 Straightness	8
7.4.1 Thickness gauge method.....	8
7.4.2 Movable dial gauge method.....	8
8 Calculation and expression of the results	8
8.1 For thickness gauge apparatus.....	8
8.1.1 Side length.....	8
8.1.2 Squareness.....	8
8.1.3 Straightness	8
8.2 For movable dial gauge apparatus	8
8.3 For the sliding calliper apparatus	8
9 Precision statement.....	8
10 Test report	9
Bibliography	10

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 24342 was prepared by Technical Committee ISO/TC 219, *Floor coverings*.

This second edition cancels and replaces the first edition (ISO 24342:2006), of which it constitutes a minor revision, with a view to include textile floor coverings in the scope. It also cancels and replaces ISO 13747:1999.

ISO 24342:2007
<https://standards.iteh.ai/catalog/standards/sist/97c8886d-1f69-4f78-a144-dcf7ed6fedba/iso-24342-2007>

Resilient and textile floor-coverings — Determination of side length, edge straightness and squareness of tiles

1 Scope

This International Standard describes methods for determining side lengths, straightness of edges and squareness of resilient or textile floor tiles.

The side lengths, straightness and squareness of resilient or textile floor tiles are important considerations because installed flooring will have an objectionable appearance if these performance criteria are not followed. This may cause the installed tiles to line up unevenly, producing unsightly seams and corners that do not match.

2 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

2.1 squareness

measurement of the amount each corner of the tile deviates from 90°

See Figure 1.

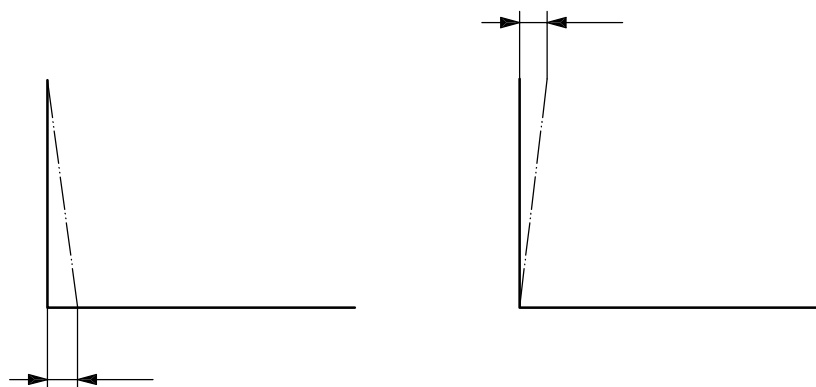


Figure 1 — Definition of squareness

2.2 straightness

property of an edge to be straight, unbent

See Figure 2.

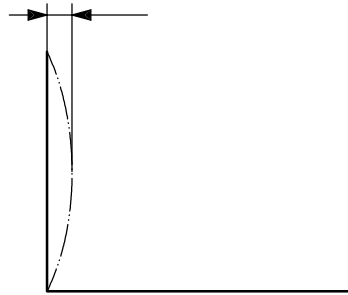


Figure 2 — Definition of straightness

2.3 tile

type of resilient or textile flooring of predetermined shape intended to be used in a modular mode

NOTE Tiles are usually square, but can also be rectangular, e.g. “plank”, “panel”.

3 Principle

The surface dimensions of a tile are measured by a contact method at defined positions in each direction. To assess the squareness, each corner of a right-angled tile is fitted into the dihedral angle of a precision square and the maximum gap between the arm of the square and the ends of the tile is measured. The maximum opening between the arm and the edge is measured at defined points along the edge to assess the straightness.


4 Apparatus

<https://standards.iteh.ai/catalog/standards/sist/97c8886d-1f69-4f78-a144-dcf7ed6fedba/iso-24342-2007>

4.1 **Reference plate** (calibration plate), made to the target dimensions of the manufactured tile.

The length and width dimensions shall be within 0,02 mm of the specified dimensions of the resilient or textile tiles. The reference plate shall contain at least two sides that are perpendicular to $\pm 0,000\ 05$ rad ($0,003^\circ$) to one or another and are used to set squareness gauge to zero (see Figure 3).

Dimensions in millimetres

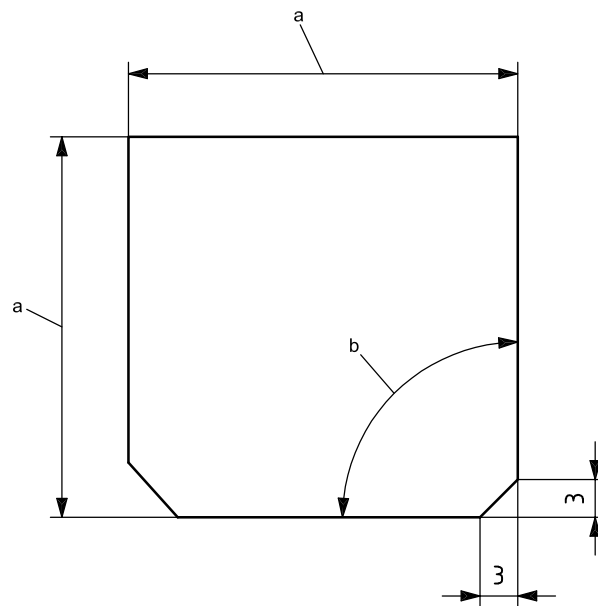

- a Tile target dimension $\pm 0,02$ mm.
 b $1,570\ 80$ rad $\pm 0,000\ 05$ rad.

Figure 3 — Reference plate
 iTeh STANDARD PREVIEW
 (standards.iteh.ai)


4.2 Rigid metal or glass plate, squared and finished, with dimensions 5 mm to 10 mm less than those of the tile, for the thickness gauge method.

ISO 24342:2007

The mass per unit area of the plate shall be approximately 20 kg/m^2 .
<https://standards.iteh.ai/catalog/standards/cis/97-8886d-2-f69-4f78-a144-dcf7ed6fedba/iso-24342-2007>

4.3 Flat bedplate apparatus, for measuring squareness and straightness of floor tiles.

This apparatus shall be an “L” shaped steel device having an angle of $1,570\ 80$ rad (90°) with a tolerance of $\pm 0,000\ 05$ rad ($0,003^\circ$), as shown in Figures 4 and 5 with the length of both reference strips larger than the largest dimension of the tile. For measuring side length, a dial gauge is also placed on the flat bedplate according to Figure 6.

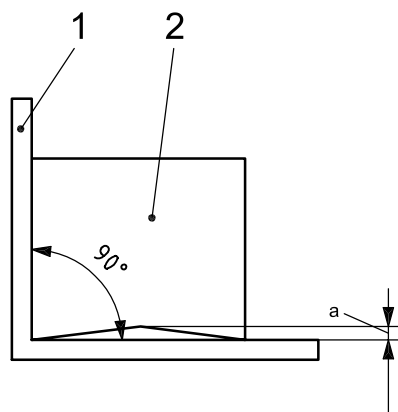


Key

1 measuring tool

2 tile

a Maximum length of gap.

Figure 4 — Apparatus and position of tile for measuring straightness

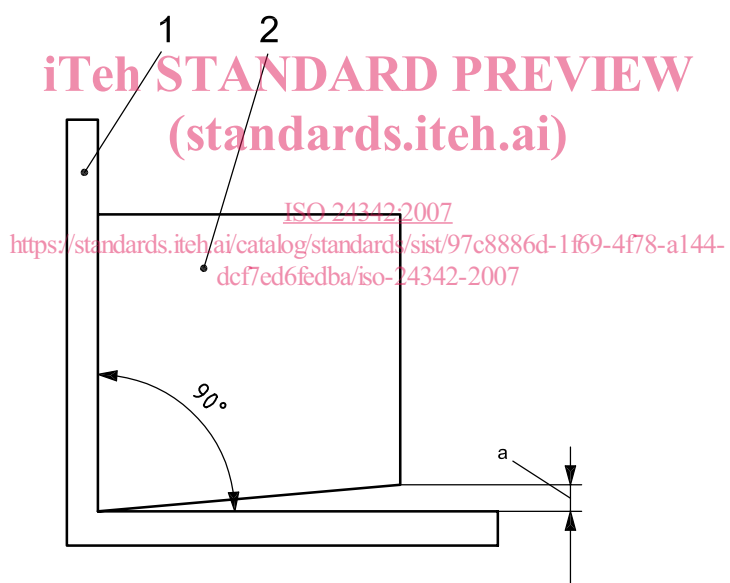

Key

1 measuring tool

2 tile

a Out-of-squareness.

Figure 5 — Apparatus and position of tile for measuring squareness

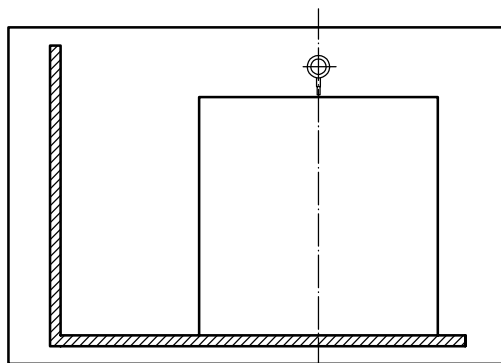


Figure 6 — Apparatus for measuring side length

4.4 Gauge and/or calliper, for the measurement of the length of the tiles up to 610 mm.

A dial gauge, a sliding calliper gauge or equivalent device with an accuracy of 0,05 mm or a set of thickness gauges in steps of 0,05 mm that can be easily inserted at any point between the “L” shaped steel device and the edge of the tile.

4.5 Movable dial gauges apparatus, containing two fixed index strips according to Figure 7.

A horizontal index strip shall be mounted parallel to and just inside the lower edge of the bedplate. It shall be $38 \text{ mm} \pm 3 \text{ mm}$ greater in length and a minimum of twice the thickness of the largest resilient or textile tile to be tested. A second index strip shall be mounted $1,570,80 \pm 0,000,05 \text{ rad}$ ($90 \pm 0,003^\circ$) to the horizontal index strip. The lower end of this index strip shall be $3,1 \text{ mm} \pm 0,25 \text{ mm}$ above the right end of the horizontal index strip and is used to locate one corner of the sample tile. The length of the second index strip shall be maximum 10 mm.

ISO 24342:2007

[https://standards.iteh.ai/catalog/standards/sist/97c8886d-1f69-4f78-a144-](https://standards.iteh.ai/catalog/standards/sist/97c8886d-1f69-4f78-a144-101010101010/iso-24342-2007)

The four dial gauges are mounted allowing for measurement of various tiles side lengths while remaining within 10 % of the corner of the tile edge (for the two corner gauges and one squareness gauge) or within the central 10 % of the tile edge (for the centre gauge only). Dial gauges may report measurements using electrical or mechanical means, but they shall be graduated to read 0,02 mm and have a stem travel greater than 6 mm. The contact foot of the dial gauge stem shall be flat, 12,7 mm to 19,1 mm in diameter and exert a total force of not more than 1,0 N. Dial gauges shall be securely positioned so that when the reference plate is in place, the contact foot is extended approximately 50 % of its full travel.