



Designation: G57 – 06

Standard Test Method for Field Measurement of Soil Resistivity Using the Wenner Four-Electrode Method¹

This standard is issued under the fixed designation G57; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This test method covers the equipment and procedures for the field measurement of soil resistivity, both in situ and for samples removed from the ground, for use in the control of corrosion of buried structures.

1.2 To convert cm (metric unit) to metre (SI unit), divide by 100.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Terminology

2.1 Definition:

2.1.1 *resistivity*—the electrical resistance between opposite faces of a unit cube of material; the reciprocal of conductivity. Resistivity is used in preference to conductivity as an expression of the electrical character of soils (and waters) since it is expressed in whole numbers.

2.1.2 Resistivity measurements indicate the relative ability of a medium to carry electrical currents. When a metallic structure is immersed in a conductive medium, the ability of the medium to carry current will influence the magnitude of galvanic currents and cathodic protection currents. The degree of electrode polarization will also affect the size of such currents.

3. Summary of Test Method

3.1 The Wenner four-electrode method requires that four metal electrodes be placed with equal separation in a straight line in the surface of the soil to a depth not exceeding 5 % of the minimum separation of the electrodes. The electrode

¹ This test method is under the jurisdiction of ASTM Committee G01 on Corrosion of Metals and is the direct responsibility of Subcommittee G01.10 on Corrosion in Soils.

Current edition approved Nov. 1, 2006. Published December 2006. Originally approved in 1978. Last previous edition approved in 2001 as G57 – 95a (2001). DOI: 10.1520/G0057-06.

separation should be selected with consideration of the soil strata of interest. The resulting resistivity measurement represents the average resistivity of a hemisphere of soil of a radius equal to the electrode separation.

3.2 A voltage is impressed between the outer electrodes, causing current to flow, and the voltage drop between the inner electrodes is measured using a sensitive voltmeter. Alternatively, the resistance can be measured directly. The resistivity, ρ , is then:

$$\begin{aligned}\rho, \Omega \cdot \text{cm} &= 2\pi aR \quad (a \text{ in cm}) \\ &= 191.5 aR \quad (a \text{ in ft})\end{aligned}$$

where:

a = electrode separation, and
 R = resistance, Ω .

Using dimensional analysis, the correct unit for resistivity is ohm-centimetre.

3.3 If the current-carrying (outside) electrodes are not spaced at the same interval as the potential-measuring (inside) electrodes, the resistivity, ρ is:

$$\rho, \Omega \cdot \text{cm} = 95.76 b R / \left(1 - \frac{b}{b+a} \right)$$

where:

b = outer electrode spacing, ft,
 a = inner electrode spacing, ft, and
 R = resistance, Ω .

or:

$$\rho, \Omega \cdot \text{cm} = \pi b R / \left(1 - \frac{b}{b+a} \right)$$

where:

b = outer electrode spacing, cm,
 a = inner electrode spacing, cm, and
 R = resistance, Ω .

3.4 For soil contained in a soil box similar to the one shown in Fig. 1, the resistivity, ρ , is:

$$\rho, \Omega \cdot \text{cm} = R A / a$$

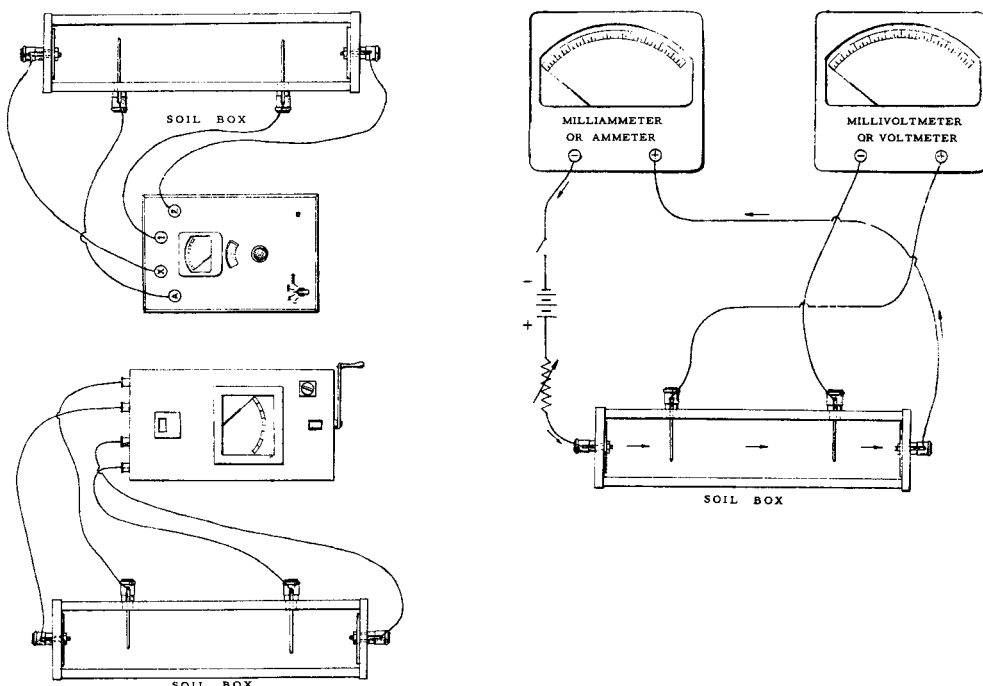


FIG. 1 Typical Connections for Use of Soil Box with Various Types of Instruments

where:

R = resistance, Ω ,

A = cross sectional area of the container perpendicular to the current flow, cm^2 , and

a = inner electrode spacing, cm.

NOTE 1—The spacing between the inner electrodes should be measured from the inner edges of the electrode pins, and not from the center of the electrodes.

4. Significance and Use

4.1 Measurement of soil resistivity is used for the control of corrosion of buried structures. Soil resistivity is used both for the estimation of expected corrosion rates and for the design of

cathodic protection systems. As an essential design parameter for cathodic protection systems, it is important to take as many measurements as necessary so as to get a sufficiently representative characterization of the soil environment that the entire buried structure will experience.

5. Apparatus

5.1 At-Grade Measurements in situ:

5.1.1 The equipment required for field resistivity measurements to be taken at grade consists of a current source, a suitable voltmeter, ammeter, or galvanometer, four metal electrodes, and the necessary wiring to make the connections shown in Fig. 2.

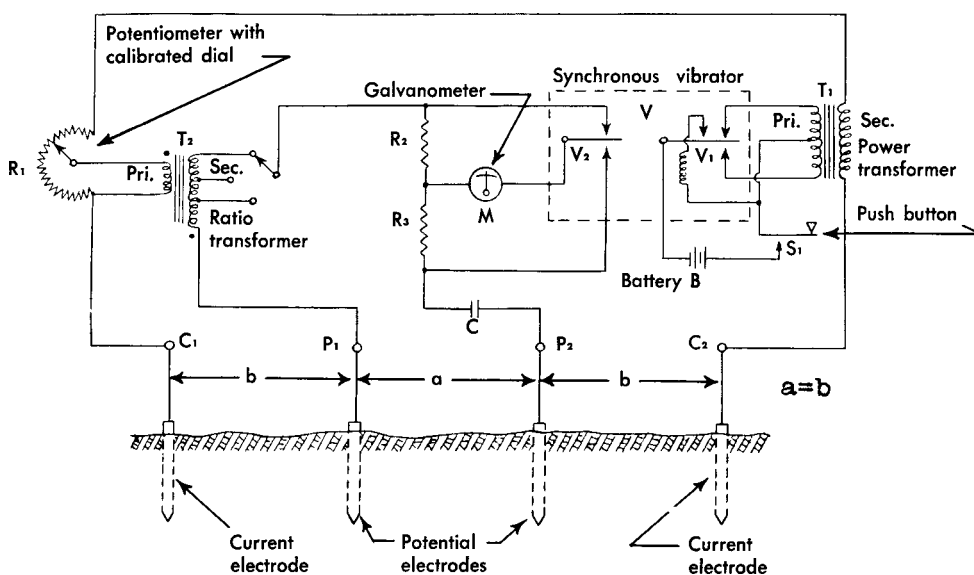


FIG. 2 Wiring Diagram for Typical dc Vibrator-Current Source