



# DRAFT INTERNATIONAL STANDARD ISO/DIS 13910

ISO/TC 165

Secretariat: CFI

Voting begins on  
2013-02-11

Voting terminates on  
2013-05-11

INTERNATIONAL ORGANIZATION FOR STANDARDIZATION • МЕЖДУНАРОДНАЯ ОРГАНИЗАЦИЯ ПО СТАНДАРТИЗАЦИИ • ORGANISATION INTERNATIONALE DE NORMALISATION

## Timber structures — Strength graded timber — Test methods for structural properties

*Structure en bois — Bois classé selon la résistance — Méthodes d'essai des propriétés structurelles*

[Revision of first edition (ISO 13910:2005)]

ICS 91.080.20

To expedite distribution, this document is circulated as received from the committee secretariat. ISO Central Secretariat work of editing and text composition will be undertaken at publication stage.

Pour accélérer la distribution, le présent document est distribué tel qu'il est parvenu du secrétariat du comité. Le travail de rédaction et de composition de texte sera effectué au Secrétariat central de l'ISO au stade de publication.

THIS DOCUMENT IS A DRAFT CIRCULATED FOR COMMENT AND APPROVAL. IT IS THEREFORE SUBJECT TO CHANGE AND MAY NOT BE REFERRED TO AS AN INTERNATIONAL STANDARD UNTIL PUBLISHED AS SUCH.

IN ADDITION TO THEIR EVALUATION AS BEING ACCEPTABLE FOR INDUSTRIAL, TECHNOLOGICAL, COMMERCIAL AND USER PURPOSES, DRAFT INTERNATIONAL STANDARDS MAY ON OCCASION HAVE TO BE CONSIDERED IN THE LIGHT OF THEIR POTENTIAL TO BECOME STANDARDS TO WHICH REFERENCE MAY BE MADE IN NATIONAL REGULATIONS.

RECIPIENTS OF THIS DRAFT ARE INVITED TO SUBMIT, WITH THEIR COMMENTS, NOTIFICATION OF ANY RELEVANT PATENT RIGHTS OF WHICH THEY ARE AWARE AND TO PROVIDE SUPPORTING DOCUMENTATION.

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

Full standard:  
<https://standards.iteh.ai/catalog/standards/sist/1a148b7a-bb09-4ab8-b626-b59486e05cea/iso-13910-2014>

### Copyright notice

This ISO document is a Draft International Standard and is copyright-protected by ISO. Except as permitted under the applicable laws of the user's country, neither this ISO draft nor any extract from it may be reproduced, stored in a retrieval system or transmitted in any form or by any means, electronic, photocopying, recording or otherwise, without prior written permission being secured.

Requests for permission to reproduce should be addressed to either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
Case postale 56 • CH-1211 Geneva 20  
Tel. + 41 22 749 01 11  
Fax + 41 22 749 09 47  
E-mail [copyright@iso.org](mailto:copyright@iso.org)  
Web [www.iso.org](http://www.iso.org)

Reproduction may be subject to royalty payments or a licensing agreement.

Violators may be prosecuted.

# Contents

Page

Foreword .....	iv
Introduction .....	v
1 Scope .....	1
2 Normative references .....	1
3 Terms and definitions .....	1
4 Symbols and abbreviated terms .....	1
4.1 General notation .....	1
4.2 Subscripts .....	2
5 Test specimens .....	2
6 Test conditions .....	2
7 Test configurations .....	2
7.1 Density .....	2
7.2 Bending strength and stiffness .....	3
7.3 Tension strength parallel to the grain .....	5
7.4 Compression strength parallel to the grain .....	5
7.5 Shear strength parallel to the grain .....	6
7.6 Tension strength perpendicular to the grain .....	8
7.7 Compression strength and stiffness perpendicular to the grain .....	11
7.8 Torsional shear modulus .....	13
8 Adjustment for non-standard test conditions .....	14
9 Test report .....	15
Bibliography .....	16

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.


International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO/DIS 13910 was prepared by Technical Committee ISO/TC 165 *Timber Structures*

This second edition cancels and replaces the first edition (ISO 13910 2005)

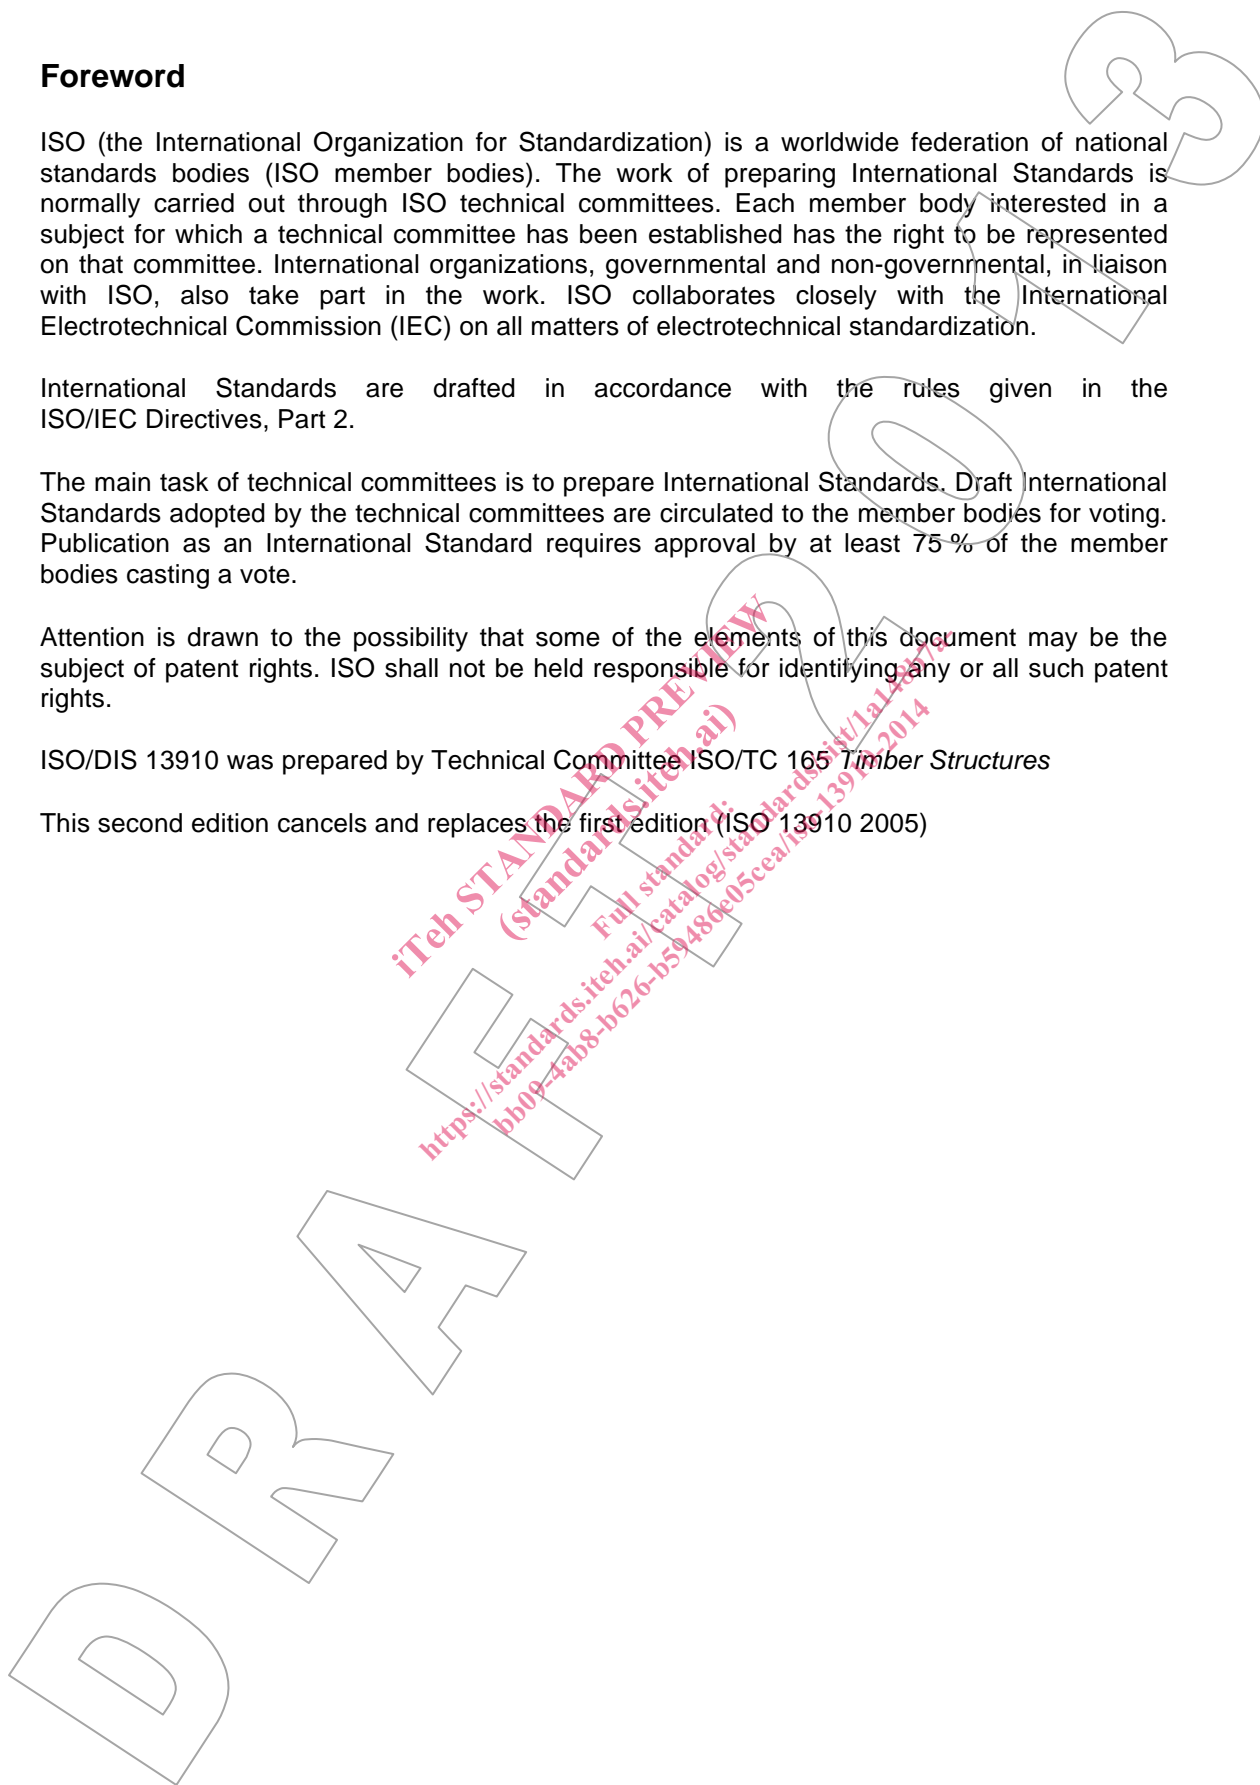

## Introduction

This International Standard provides requirements for testing of structural properties for a specific grade and size of sawn timber. In accordance with the requirements of performance-based International Standards, it is concerned with the measurement of properties similar to those that occur under service conditions and are intended for deriving engineering properties in structural design codes. Hence, terms such as “bending strength”, “shear strength”, “bearing strength”, etc. relate to the loading configuration used and to the targeted mode of failure.

It is not the intent to imply that every property of every grade and size of timber used in building construction needs to be assessed according to this International Standard. The requirements for any assessment typically are specified in building regulations, quality manuals or other material standards and specifications.

This document is an internationally-agreed reference standard for measurement of structural properties of strength-graded timber. Other standards related to the measurement of structural properties may be deemed to comply with this International Standard, provided that the adjustments necessary to establish equivalency between this and other standards are applied appropriately

**DRAFT**

**ISO**

**DR**

**STANDARD PREVIEW**  
(standards.iteh.ai)  
Full standard:  
<https://standards.iteh.ai/catalog/standards/sist/1a148b7a-bb09-4ab8-b626-b59486e05cea/iso-13910-2014>

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

Full standard:  
<https://standards.iteh.ai/catalog/standards/sist/1a148b7a-bb09-4ab8-b626-b59486e05cea/iso-13910-2014>

# Timber structures – Strength graded timber – Test methods for structural properties

## 1 Scope

This International Standard specifies test procedures for full-size sawn timber that has been strength-graded, for the derivation of design properties in codes dealing with structural engineering design. It is applicable to sawn timber of rectangular cross-section subjected to a short-duration load.

## 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ASTM D198	Standard test methods of static tests of lumber in structural sizes
AS/NZS 4063	Timber - Stress-graded - In-grade strength and stiffness evaluation
EN 408	Timber structures. Structural timber and glued laminated timber. Determination of some physical and mechanical properties

## 3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

Grade	population of timber with defined design properties in a design standard
Piece of timber	timber of rectangular cross-section manufactured for construction purposes of a specific grade
Test specimen	length of timber, cut from a piece, for purposes of testing to evaluate a timber property

## 4 Symbols and abbreviated terms

### 4.1 General notation

a	distance between a load point and nearest support in a bending test set-up, expressed in millimetres
b	thickness (smaller dimension of a cross section) of a rectangular piece or specimen of timber, expressed in millimetres
E	modulus of elasticity parallel to direction of grain, expressed in Newtons per square millimetre
F	applied load, expressed in Newtons
f	strength, expressed in Newtons per square millimetre
G	shear modulus of rigidity, expressed in Newtons per square millimetre
h	width (larger dimension of a cross section) of a rectangular piece or specimen of timber, expressed in millimetres
K	stiffness, expressed in Newtons per square millimetre per millimetre deformation
L	length along a piece or specimen of timber, expressed in millimetres
L <sub>T</sub>	length test specimen subjected to torsion forces, expressed in millimetres
l <sub>h</sub>	length cut from a specimen, expressed in millimetres

$l_t$  lever arm of applied torsion load, expressed in millimetres  
 $e$  displacement of beam, expressed in millimetres  
 $m$  mass of specimen, expressed in kilograms  
 $SH_v$  volumetric shrinkage of wood from green fibre saturation point (FSP) to oven-dry condition  
 $w$  ratio of mass of water to mass of oven-dry wood, equivalent to moisture content  
 $W_{FSP}$  moisture content at fibre saturation point  
 $x_i$  data value  
 $\theta$  rotational deformation in a torsion test, in radians  
 $\rho$  density, expressed in kilograms per cubic metre,  
 $\rho_{12}$  density, expressed in kilograms per cubic metre, at 12% moisture content  
 $\rho_{test}$  density, expressed in kilograms per cubic metre, at time of test

## 4.2 Subscripts

0.1h value at deformation of 0.1h  
 0 property in a direction 0° to the grain  
 90 property in a direction of 90° to the grain  
 c compression  
 m bending  
 t tension  
 ult value at failure  
 v shear

## 5 Test specimens

All test specimens are of full-size cross section. The length required for a test specimen shall be related to the specific test (see Clause 7).

Unless otherwise stated, test specimens shall be selected from random locations within a piece of timber. Specimens cut from pre-defined locations (centre of a piece of timber, a randomly selected end within a piece or clear sections, etc.) may be deemed to comply with this requirement provided this does not produce any bias in the measured properties.

Each test specimen for a given size, grade or property shall be cut from a different piece of timber and more than one type of test specimen may be cut from each piece.

## 6 Test conditions

Unless otherwise specified in the description of the reference population, the reference moisture content at the time of testing shall be consistent with conditioning at a temperature of 20°C (±2°C) and 65 % (±5%) relative humidity. Other test procedures and conditioning criteria may be used provided they are more conservative; otherwise, an equivalency in performance for these alternative procedures and conditions shall be established. The rate of loading shall be selected that targets average time-to-failure in 1 to 5 minutes. (Note: The intent here is not to reject data for weak pieces that fail in a short time.)

At the time of testing, the moisture content of the timber, the temperature of the timber, and the time to failure shall be recorded.

## 7 Test configurations

### 7.1 Density

The specimens for the measurement of density shall be free of knots and comprise the full cross-section of



the piece of timber. The length of the test specimen shall be not less than  $h$ . The mass,  $m$ , and moisture content,  $w$ , are measured for each test specimen. The density at the time of test,  $\rho_{\text{test}}$ , shall be calculated from

$$\rho_{\text{test}} = \frac{m \times 10^9}{Lbh} \quad (1)$$

The density at 12% moisture content,  $\rho_{12}$ , shall be calculated from

$$\rho_{12} = \rho_{\text{test}} \left( \frac{1.12}{1+w} \right) \quad (2)$$

where  $w$  is the moisture content at the time of test as determined by the oven-dry method.


Alternatively, it may be sufficiently accurate to measure moisture content by means of a moisture meter, provided that the meter is calibrated against moisture content measurements determined by the oven dry method. Where such moisture meter measurements are made, they shall be made at several locations along each specimen.

NOTE: If specific gravity (e.g. based on oven-dry mass and oven-dry volume,  $SG_{OD}$ ) is desired, it can be estimated from wood density at test ( $\rho_{\text{test}}$ ), moisture content ( $w$ ), fibre saturation point  $w_{FSP}$ , and wood volumetric shrinkage ( $SH_v$ ) as follows:

$$SG_{OD} = \frac{(1 + w SH_v / w_{FSP}) \rho_{\text{test}}}{1000 (1 + w)}$$

## 7.2 Bending strength and stiffness

The bending strength and stiffness test configuration shall be as shown in Figure 1. The beam specimen shall be loaded at two points, equally spaced between the end supports, with each load equal to  $F/2$ . The distance between load points shall be  $6h$  and the distance between a load point and the nearest support,  $a$ , shall be  $4.5h$  to  $7h$ . The tension edge of the beam shall be chosen randomly. If the beam has a slenderness where there could be a tendency for the compression edge to buckle during loading, lateral restraints may be provided to the compression edge. Such restraints shall not resist any movement in the direction of the loading. Bearing blocks at loading and support points (Fig. 1), shall be of sufficient thickness and extend entirely across the beam thickness to eliminate high-stress concentrations at places of contact between beam and bearing blocks. Load shall be applied to the blocks in such a manner that the blocks may rotate about an axis perpendicular to the span. The slider bearing plate in Figure 1 shall allow rotation and horizontal movement whereas the bearing plate shall allow only rotation.

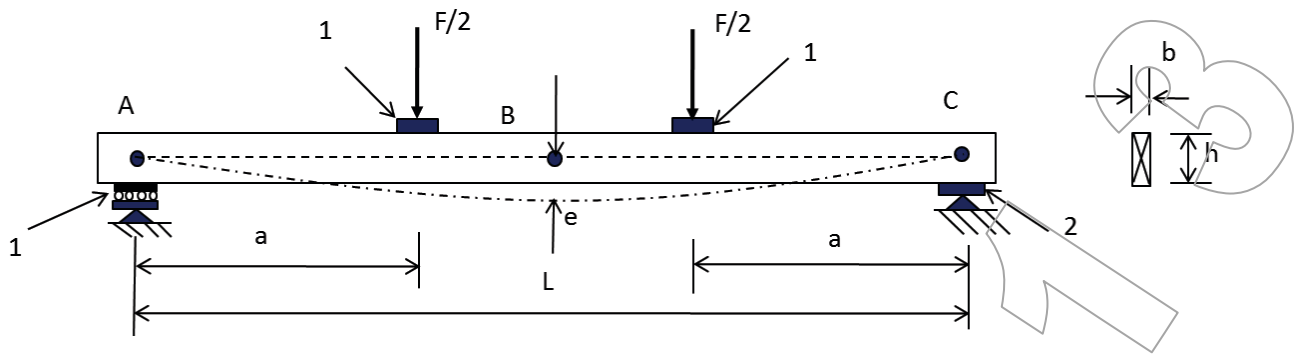

Key

- 1. Slider bearing plate
- 2. Bearing plate (rocker)

Figure 1 - Test set-up for measuring bending strength and stiffness

Modulus of elasticity,  $E$ , shall be calculated from measurement of  $e$ , the centre-point deflection of the centre-line of the beam relative to the position of the centre-line at the ends of the beam, i.e. the deflection of point B relative to points A and C as shown in Figure 1.

The applied load,  $F$ , shall be increased until the maximum load is reached.

To evaluate the modulus of elasticity in bending,  $E_m$ , the incremental deflection  $\Delta e$  for an incremental load  $\Delta F$  shall be selected from the linear elastic part of the load-deformation graph.  $E_m$  is calculated from

$$E_m = \frac{a}{4bh^3} \left( \frac{\Delta F}{\Delta e} \right) (3L^2 - 4a^2) \quad (3)$$

The range of 10 % to 40 % of the maximum load shall be used to determine  $\Delta F/\Delta e$ . The deflection  $e$  may be evaluated by the measurement of the movement of points other than those described above, provided that an acceptable equivalency for these procedures is established, or it can be shown that the alternative procedures produce conservative results.

NOTE : The test set-up will lead to the determination of apparent modulus of elasticity. Shear-corrected modulus of elasticity can be estimated by adjusting the measured deflection,  $\Delta s$ , using the following formula assuming shear modulus is known (For structural timber,  $G$  can be assumed to be  $E/16$ .), and substituting  $\Delta e$  into equation (3):

$$\Delta e = \Delta s \left( 1 - \frac{3 \Delta F a}{5 bh G \Delta s} \right)$$

The bending strength  $f_m$  shall be calculated from

$$f_m = \frac{3F_{ult} a}{bh^2} \quad (4)$$

where  $F_{ult}$  is the value of the applied load at failure.