

ISO/TC 205

Secretariat: **ANSI**

Voting begins on:
2011-01-04

Voting terminates on:
2011-03-04

Interconnection of information technology equipment — Control Network Protocol —

Part 3: Power line channel specification

iTeh STANDARD PREVIEW
*Interconnexion des équipements des technologies de l'information —
Protocole de réseau de contrôle —
(standards.iteh.ai)
Partie 3: Spécification de canal de courants porteurs*

[ISO/FDIS 14908-3](#)

<https://standards.iteh.ai/catalog/standards/sist/d17a6d2e-9e29-408c-818a-444a5d001ab3/iso-fdis-14908-3>

Please see the administrative notes on page iii

RECIPIENTS OF THIS DRAFT ARE INVITED TO SUBMIT, WITH THEIR COMMENTS, NOTIFICATION OF ANY RELEVANT PATENT RIGHTS OF WHICH THEY ARE AWARE AND TO PROVIDE SUPPORTING DOCUMENTATION.

IN ADDITION TO THEIR EVALUATION AS BEING ACCEPTABLE FOR INDUSTRIAL, TECHNOLOGICAL, COMMERCIAL AND USER PURPOSES, DRAFT INTERNATIONAL STANDARDS MAY ON OCCASION HAVE TO BE CONSIDERED IN THE LIGHT OF THEIR POTENTIAL TO BECOME STANDARDS TO WHICH REFERENCE MAY BE MADE IN NATIONAL REGULATIONS.



Reference number
ISO/FDIS 14908-3:2011(E)

PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

**iTeh STANDARD PREVIEW
(standards.iteh.ai)**

[ISO/FDIS 14908-3](https://standards.iteh.ai/catalog/standards/sist/d17a6d2e-9e29-408c-818a-444a5d001ab3/iso-fdis-14908-3)

<https://standards.iteh.ai/catalog/standards/sist/d17a6d2e-9e29-408c-818a-444a5d001ab3/iso-fdis-14908-3>

Copyright notice

This ISO document is a Draft International Standard and is copyright-protected by ISO. Except as permitted under the applicable laws of the user's country, neither this ISO draft nor any extract from it may be reproduced, stored in a retrieval system or transmitted in any form or by any means, electronic, photocopying, recording or otherwise, without prior written permission being secured.

Requests for permission to reproduce should be addressed to either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Reproduction may be subject to royalty payments or a licensing agreement.

Violators may be prosecuted.

In accordance with the provisions of Council Resolution 15/1993, this document is **circulated in the English language only**.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[ISO/FDIS 14908-3](https://standards.iteh.ai/catalog/standards/sist/d17a6d2e-9e29-408c-818a-444a5d001ab3/iso-fdis-14908-3)

<https://standards.iteh.ai/catalog/standards/sist/d17a6d2e-9e29-408c-818a-444a5d001ab3/iso-fdis-14908-3>

Contents

Page

Foreword.....	v
Introduction	vi
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 General description	2
4.1 Electrical safety.....	2
4.2 Functional partitioning of PL specification.....	2
5 Power Line Medium specifications	3
5.1 Power	3
5.2 Data channel.....	3
5.3 Physical and electrical specifications	3
5.4 Connectors and coupling	3
5.5 Signal coupling between phases	3
5.6 Surge protection and related devices.....	4
6 PL Node specifications	4
6.1 Compliance.....	4
6.2 Interface to MAC sub-layer	4
6.3 Word encoding.....	4
6.4 PL packet timing	4
6.5 Transmitter characteristics	5
6.6 Receiver characteristics	7
Bibliography.....	13

iTech STANDARD PREVIEW
(standards.itech.ai)

ISO/FDIS 14908-3
<http://standards.itech.ai/catalog/standards/sist/d17a6d2e-9e29-408c-818a-444a5d001ab3/iso-fdis-14908-3>

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 14908-3 was prepared by CEN/TC 247, was adopted, under the fast track procedure, by joint Technical Committee ISO/IEC JTC 1, *Information technology*, and was assigned to SC 25, *Interconnection of information technology equipment*. It was then transferred to ISO/TC 205, *Building environment design*.

ISO 14908 consists of the following parts, under the general title *Interconnection of information technology equipment — Control Network Protocol*:

- *Part 1: Protocol Stack* [ISO/FDIS 14908-3](https://standards.iteh.ai/catalog/standards/sist/d17a6d2e-9e29-408c-818a-444a5d001ab3/iso-fdis-14908-3)
- *Part 2: Twisted-pair communication*
- *Part 3: Power line channel specification*
- *Part 4: IP communication*

Introduction

This part of ISO 14908 specifies the Control Network Power Line (PL) Channel and serves as a companion document to ISO 14908-1. Its purpose is to present the information necessary for the development of a PL physical network and nodes to communicate and share information over that network. This is one of a series of documents covering the various media that comprise the CNP standard.

This part of ISO 14908 covers the complete physical layer (OSI layer 1), including the interface to the Medium Access Control (MAC) sub-layer and the interface to the medium. It includes parameters specific to the PL channel type, even though the parameters may be controlled at an OSI layer other than layer 1. This part of ISO 14908 also provides a set of physical and electrical specifications to serve as guidelines for the power line environment as an aid in developing products for that environment.

This part of ISO 14908 has been prepared to provide mechanisms through which various vendors of local area control networks may exchange information in a standardized way. It defines communication capabilities.

This part of ISO 14908 is used by anyone involved in design, manufacture, engineering, installation and commissioning activities and has been prepared in response to the essential requirements of the Constructive Products Directive.

The CNP specification model is based on the OSI 7-layer model Reference Model. There are also important extensions to the OSI Reference Model. Figure 1 illustrates the scope of this specification in reference to the entire CNP model. In this part of ISO 14908, only the parts of the model relevant to power line communication are specified. Anything outside this boundary is covered in other parts of ISO 14908. Similar specifications exist for other CNP media.

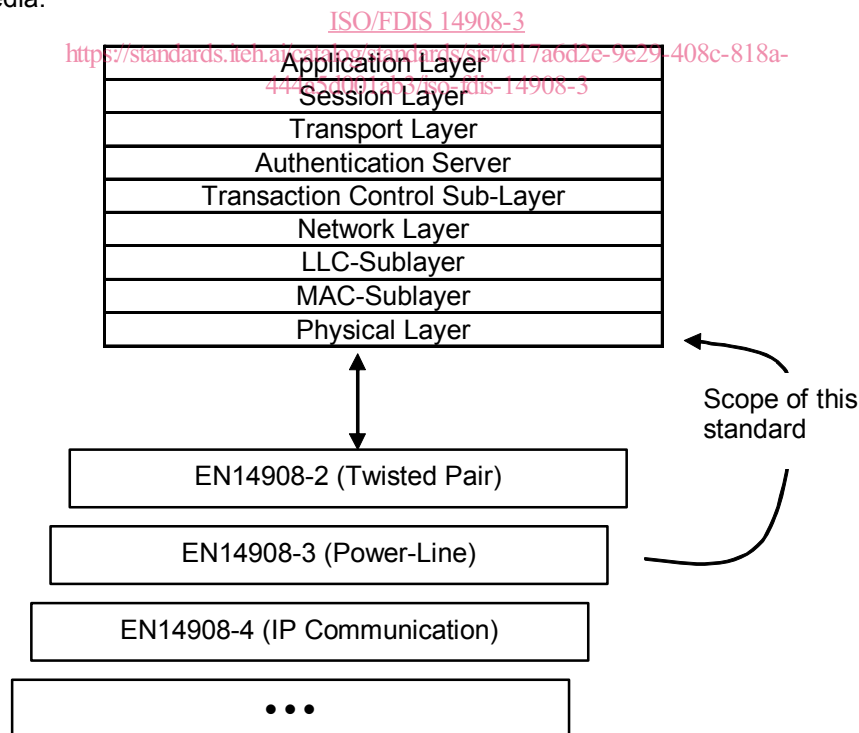


Figure 1 — Relationship of CNP 3 specification to CNP 1 specification

The International Organization for Standardization (ISO) and the International Electrotechnical Commission (IEC) draw attention to the fact that it is claimed that compliance with this International Standard may involve the use of patents held by Echelon Corporation.

ISO and the IEC take no position concerning the evidence, validity and scope of this patent right.

The holder of this patent right has assured ISO and the IEC that they are willing to negotiate licences under reasonable and non-discriminatory terms and conditions with applicants throughout the world. In this respect, the statement of the holder of the patent rights is registered with ISO and the IEC. Information may be obtained from:

Echelon Corporation, 4015 Meridian Avenue, San Jose, CA 94304, USA, phone +1-408-938-5234, fax: +1-408-790-3800, <http://www.echelon.com>.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[ISO/FDIS 14908-3](https://standards.iteh.ai/catalog/standards/sist/d17a6d2e-9e29-408c-818a-444a5d001ab3/iso-fdis-14908-3)

<https://standards.iteh.ai/catalog/standards/sist/d17a6d2e-9e29-408c-818a-444a5d001ab3/iso-fdis-14908-3>

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO/FDIS 14908-3

<https://standards.iteh.ai/catalog/standards/sist/d17a6d2e-9e29-408c-818a-444a5d001ab3/iso-fdis-14908-3>

Interconnection of information technology equipment — Control Network Protocol —

Part 3: Power line channel specification

1 Scope

This part of ISO 14908 specifies all the information necessary to facilitate the exchange of data and control information over the power line medium for networked control systems used in conjunction with ISO 14908-1.

This part of ISO 14908 establishes a minimal set of rules for compliance. It does not rule out extended services to be provided, given that the rules are adhered to within the system. It is the intention of this part of ISO 14908 to permit extended services (defined by users) to coexist.

Certain aspects of this part of ISO 14908 are defined in other documents. These documents are referenced where relevant. In the case where a referenced standard conflicts with this part of ISO 14908, the latter will prevail.

2 Normative references

[ISO/FDIS 14908-3](https://standards.iteh.ai/catalog/standards/sist/d17a6d2e-9e29-408c-818a-444a5d001ab3/iso-fdis-14908-3)

<https://standards.iteh.ai/catalog/standards/sist/d17a6d2e-9e29-408c-818a-444a5d001ab3/iso-fdis-14908-3>

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 14908-1, *Interconnection of information technology equipment — Control Network Protocol — Part 1: Protocol Stack*

EN 50065-1, *Signalling on low-voltage electrical installations in the frequency range 3 kHz to 148,5 kHz — Part 1: General requirements, frequency bands and electromagnetic disturbances*

EN 50065-2-1, *Signalling on low-voltage electrical installations in the frequency range 3 kHz to 148,5 kHz — Part 2-1: Immunity requirements for mains communications equipment and systems operating in the range of frequencies 95 kHz to 148,5 kHz and intended for use in residential, commercial and light industrial environments*

EN 50065-2-2, *Signalling on low-voltage electrical installations in the frequency range 3 kHz to 148,5 kHz — Part 2-2: Immunity requirements for mains communications equipment and systems operating in the range of frequencies 95 kHz to 148,5 kHz and intended for use in industrial environments*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 14908-1 and the following, with regard to the power line medium and physical layer shown in Figure 1, apply.

3.1
PL node
user node attached to the power line medium at a tap that meets the requirements of this International Standard

3.2
line cord
cable not part of the power line network that allows a node located away from the power line network to be connected to the network

3.3
power line network
communication network based on power distribution lines ("power lines"), from the final distribution transformer to all homes served by that transformer, including all wiring in those homes

3.4
non-network-powered node
compatible node that attaches to the power line network but does not draw any power from the network

4 General description

4.1 Electrical safety

This clause gives several recommendations related to safety concerns with respect to this International Standard.

This discussion is not complete, nor does it address all possible safety issues. The designer is urged to consult, among other things, the relevant local and national electrical codes for the country of intended use. Local codes may supplement national electrical codes and impose additional safety related requirements.

Products conforming to this International Standard shall be designed, constructed, assembled, tested and installed following recognised safety provisions appropriate to products covered by the standard.

Power line network cables are subject to at least five direct electrical safety hazards during their use:

- high-energy transients coupled into the power line network from external environmental sources;
- possible differences between safety grounds to which network components are connected;
- possible high voltages on neutral or ground wiring;
- possible open safety grounds;
- high short-circuit current levels available at interface.

These electrical safety hazards should be alleviated for the network to perform properly. In addition to provisions for properly handling these faults in an operational system, special measures should be taken to maintain the intended safety features during changes of an existing network.

All wire and wiring to which nodes connect should conform to wiring standards of the appropriate national code for the country of intended use and should have been inspected to comply with that code.

4.2 Functional partitioning of PL specification

This specification divides the complete power line environment into two basic parts: the powerline medium and the node physical access specification.

The medium specification concerns the capabilities and properties of the physical medium. This encompasses such items as its bandwidth, frequency allocation, electrical and physical specifications, connectors etc.

The node physical access specification deals with the physical properties of that part of the node that makes contact with the medium. Also described is the interface between the physical layer and the symbol-encoding sub-layer.

5 Power Line Medium specifications

5.1 Power

The nodes should not rely on the line frequency for timing or synchronisation to perform communications. AC power may be used to power the interface and application needs of a node.

5.2 Data channel

The channel occupies bandwidth from 125 kHz to 140 kHz frequency band, as defined in EN 50065-1, as a Binary Phase Shift Keyed (BPSK) modulated carrier. This channel is used to send protocol messages containing control, status, configuration and diagnostic information. The rules established in the CNP Medium Access Control (MAC) Layers and above shall be followed. The signalling characteristics of the channel are described in Clause 6.

5.3 Physical and electrical specifications

Physical and electrical specifications for the PL medium are not formally given in this International Standard since: 1) the PL medium is assumed to already exist in any environment using power line communications and; 2) this specification lacks control over the installation of the power line medium, its physical properties, topology, or other devices connected to the medium.

<https://standards.iteh.ai/catalog/standards/sist/d17a6d2e-9e29-408c-818a-444a5d001ab3/iso-fdis-14908-3>

5.4 Connectors and coupling

If a connector is used to attach a CNP node to the power line network (as opposed to a direct connection), then the connector shall meet the following requirements:

- the connector shall impose a negligible signal loss (less than 0,1 dB) from the power line network and the attached node;
- the connector shall not impose any signal or voltage loss (greater than 0,1 dB) to the power line network (with or without a node connected to the connector).

Single-phase power line node connectors are assumed to fit standard electrical outlets appropriate for the country of use and may or may not include a connection to the protective conductor of such outlets if present. Signalling shall only be between phase and neutral conductors and no functional connection shall be made to the protective conductor.

Multi-phase powerline nodes may use any of the connection schemes given in EN 50065-1 permitting signalling between all phases simultaneously and the neutral conductor or between any of the phase conductors individually and the neutral conductor. No functional connection shall be made to the protective conductor.

5.5 Signal coupling between phases

Signal coupling between phases in multi-phase installations may be achieved by using phase couplers according to EN 50065-4-1.